

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P924343

Luminaire Tested: DFN2DIP-HX3F0-030D030US950-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P924343
REPORT IS A COMBINATION OF REPORTS P900721 AND P897645
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-030D030US950-FLLONL
Description: 3 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5666.8 lumens
Efficiency: N/A
Efficacy: 121.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 46.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.983
Total Harmonic Distortion (THDi): 0.073
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P924343

CATALOG NUMBER: DFN2DIP-HX3F0-030D030US950-FLLONL

Luminous Intensity Polar Plot

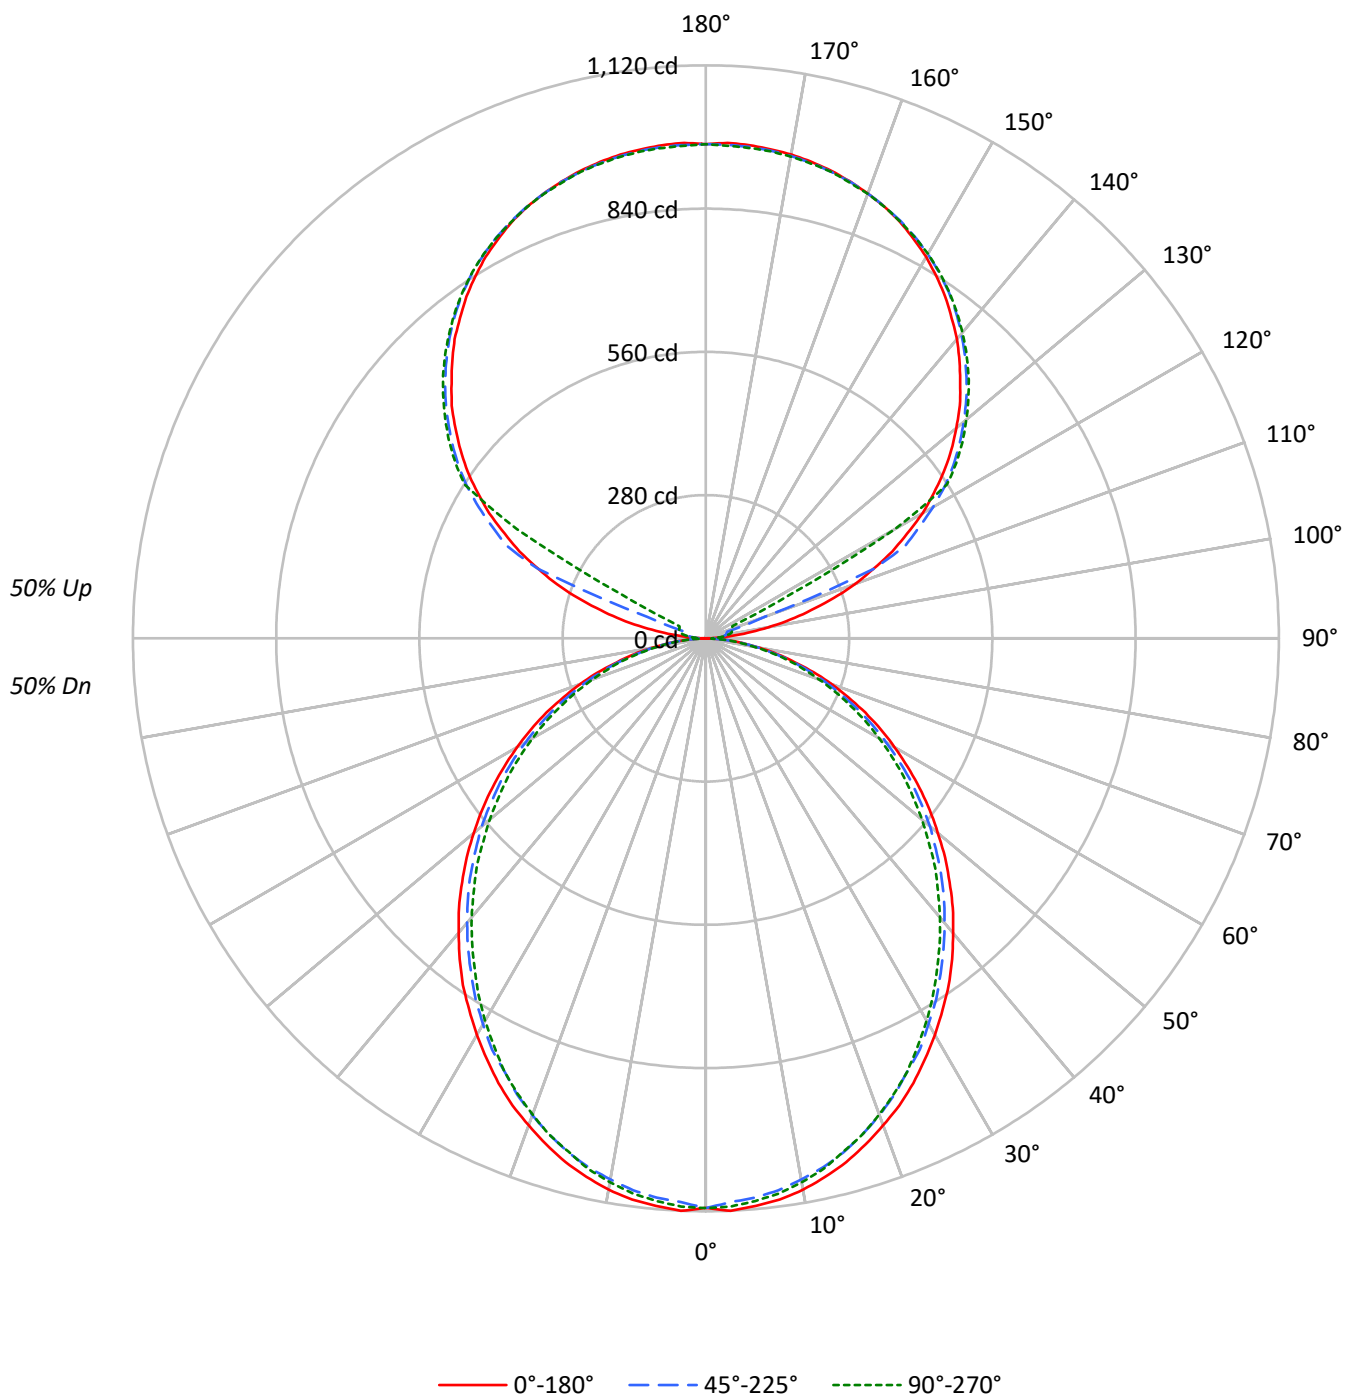

TEST NUMBER: P924343

CATALOG NUMBER: DFN2DIP-HX3F0-030D030US950-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1290	1290	1290
5°	1291	1271	1280
10°	1280	1253	1262
15°	1261	1232	1234
20°	1235	1202	1206
25°	1209	1167	1173
30°	1177	1134	1131
35°	1146	1095	1088
40°	1108	1057	1046
45°	1071	1017	1003
50°	1030	976	954
55°	987	929	908
60°	938	873	856
65°	884	814	794
70°	816	743	727
75°	722	657	665
80°	609	548	548
85°	433	363	355

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1071 cd/sqm

TEST NUMBER: P924343

CATALOG NUMBER: DFN2DIP-HX3F0-030D030US950-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	104.8	1.8
10°-20°	294.9	5.2
20°-30°	433.4	7.6
30°-40°	503.4	8.9
40°-50°	502.7	8.9
50°-60°	438.4	7.7
60°-70°	324.1	5.7
70°-80°	183.3	3.2
80°-90°	50.1	0.9
90°-100°	31.9	0.6
100°-110°	118.7	2.1
110°-120°	314.9	5.6
120°-130°	522.3	9.2
130°-140°	554.8	9.8
140°-150°	515.6	9.1
150°-160°	414.5	7.3
160°-170°	267.1	4.7
170°-180°	91.9	1.6
0°-30°	833.1	14.7
0°-40°	1336.5	23.6
0°-60°	2277.6	40.2
0°-90°	2835.1	50.0
90°-120°	465.5	8.2
90°-150°	2058.1	36.3
90°-180°	2832.0	50.0
0°-180°	5666.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1114	1114	1114	1114	1114	
5°	1114	1109	1098	1106	1104	106
15°	1060	1054	1040	1044	1039	299
25°	959	951	933	935	933	441
35°	828	817	800	793	788	517
45°	674	666	650	638	634	520
55°	510	503	490	478	472	456
65°	344	337	327	317	312	340
75°	180	178	172	166	168	192
85°	44	43	42	38	38	49
90°	1	8	14	18	19	5
95°	45	22	27	31	30	54
105°	212	233	43	50	53	227
115°	402	414	431	108	57	396
125°	568	577	591	596	598	507
135°	703	714	721	728	726	543
145°	816	815	827	832	828	510
155°	898	892	900	904	899	414
165°	946	942	944	949	944	267
175°	968	963	964	969	962	92
180°	966	966	966	966	966	

TEST NUMBER: P924343

CATALOG NUMBER: DFN2DIP-HX3F0-030D030US950-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1113.6	1113.6	1113.6	1113.6	1113.6
2.5°	1120.1	1114.7	1102.9	1113.6	1111.6
5°	1113.6	1109.4	1097.6	1106.2	1104.1
7.5°	1106.2	1099.8	1087.9	1096.6	1094.4
10°	1094.4	1086.9	1074.1	1082.6	1079.5
12.5°	1078.3	1071.9	1059.1	1064.4	1062.3
15°	1060.1	1053.8	1039.8	1044.1	1038.7
17.5°	1037.6	1031.3	1017.3	1022.6	1017.3
20°	1013.0	1006.6	991.6	994.7	990.5
22.5°	988.4	978.8	964.8	964.8	962.6
25°	959.4	950.9	932.7	934.8	932.7
27.5°	927.3	919.8	905.9	902.8	897.4
30°	895.2	886.6	870.6	867.4	863.1
32.5°	861.0	854.6	837.4	830.9	826.6
35°	827.8	817.1	799.9	793.4	788.1
37.5°	790.3	780.7	763.5	755.9	750.6
40°	751.8	743.2	726.0	716.5	712.2
42.5°	714.3	705.7	688.6	677.8	671.4
45°	673.6	666.1	650.0	638.2	633.9
47.5°	633.9	626.5	609.3	597.5	591.1
50°	592.1	586.8	571.8	556.8	551.5
52.5°	551.5	544.0	530.1	518.3	510.8
55°	509.8	503.3	490.5	477.7	472.3
57.5°	467.9	462.6	448.7	435.8	431.5
60°	426.2	422.0	407.0	395.1	392.0
62.5°	385.5	378.0	367.3	356.6	352.3
65°	343.8	337.3	326.6	317.0	311.7
67.5°	301.0	295.5	285.9	278.5	274.2
70°	261.3	257.0	247.4	239.8	235.6
72.5°	220.7	216.3	210.9	203.5	200.3
75°	179.8	177.8	172.4	166.0	168.2
77.5°	143.5	139.2	137.0	133.8	130.7
80°	107.1	106.0	103.8	100.6	98.5
82.5°	72.8	72.8	71.8	67.4	67.4
85°	43.9	42.8	41.8	38.5	37.5
87.5°	19.3	17.2	15.0	11.8	10.7
90°	0.7	8.4	13.9	17.6	18.8
92.5°	17.6	14.7	16.8	18.2	18.8
95°	45.4	22.3	27.2	30.8	30.1
97.5°	81.8	24.5	35.6	37.8	38.4
100°	123.7	28.0	39.9	45.4	46.8
102.5°	169.8	168.5	41.2	48.8	51.0
105°	212.5	233.4	42.6	50.3	53.1
107.5°	262.1	279.5	44.1	51.7	54.6
110°	309.7	324.3	122.3	52.5	55.2



TEST NUMBER: P924343

CATALOG NUMBER: DFN2DIP-HX3F0-030D030US950-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	354.4	366.9	355.1	53.8	55.9
115°	401.8	413.7	431.2	107.6	57.3
117.5°	443.1	457.1	469.0	369.0	185.9
120°	489.2	499.7	512.3	520.7	426.3
122.5°	528.3	539.6	553.6	557.7	558.5
125°	568.2	577.3	590.6	595.5	597.6
127.5°	604.5	614.3	624.9	631.8	632.5
130°	638.8	650.1	657.7	665.3	664.7
132.5°	673.7	682.9	690.5	696.8	696.1
135°	703.1	714.4	720.6	727.6	726.2
137.5°	733.8	742.2	749.3	756.2	754.1
140°	763.9	769.5	777.1	783.4	780.0
142.5°	789.1	794.0	803.1	808.6	805.2
145°	815.7	814.9	826.8	831.7	828.2
147.5°	838.7	836.6	848.5	851.9	849.2
150°	861.1	856.2	867.4	871.5	868.0
152.5°	879.9	874.3	884.8	889.0	884.2
155°	898.1	891.9	900.2	904.4	898.9
157.5°	912.8	907.3	913.6	918.4	912.8
160°	925.4	921.2	925.4	929.6	924.6
162.5°	936.5	932.3	935.9	940.7	934.4
165°	946.3	942.2	944.3	949.1	944.3
167.5°	954.0	949.8	951.9	956.9	950.6
170°	960.3	956.1	957.5	962.4	956.1
172.5°	964.5	960.3	961.7	966.6	960.3
175°	967.9	963.1	964.5	969.4	962.4
177.5°	969.4	964.5	965.3	970.1	963.8
180°	965.9	965.9	965.9	965.9	965.9

TEST NUMBER: P924343

CATALOG NUMBER: DFN2DIP-HX3F0-030D030US950-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.12	8.98	9.07	9.95	11.22	7.69	8.55	8.64	9.52	10.79
	3H	9.77	10.54	10.74	11.52	12.82	9.30	10.07	10.27	11.05	12.35
	4H	10.35	11.08	11.33	12.07	13.37	9.88	10.61	10.86	11.60	12.90
	6H	10.74	11.42	11.74	12.41	13.72	10.27	10.95	11.27	11.94	13.25
	8H	10.85	11.49	11.85	12.50	13.81	10.38	11.02	11.38	12.03	13.34
	12H	10.89	11.50	11.90	12.50	13.84	10.42	11.03	11.42	12.03	13.36
4H	2H	8.57	9.31	9.56	10.29	11.59	8.23	8.96	9.22	9.95	11.25
	3H	10.43	11.04	11.43	12.06	13.37	10.04	10.65	11.04	11.67	12.98
	4H	11.14	11.70	12.15	12.71	14.04	10.74	11.30	11.74	12.30	13.64
	6H	11.65	12.13	12.66	13.16	14.50	11.24	11.72	12.26	12.75	14.09
	8H	11.79	12.24	12.81	13.27	14.62	11.39	11.84	12.40	12.86	14.21
	12H	11.86	12.27	12.90	13.31	14.66	11.45	11.85	12.48	12.89	14.25
8H	4H	11.33	11.78	12.35	12.81	14.16	10.98	11.43	11.99	12.45	13.80
	6H	11.96	12.33	13.00	13.39	14.74	11.60	11.97	12.64	13.03	14.38
	8H	12.17	12.50	13.22	13.55	14.92	11.81	12.13	12.86	13.18	14.55
	12H	12.30	12.59	13.35	13.63	15.04	11.92	12.21	12.97	13.25	14.66
12H	4H	11.32	11.72	12.35	12.76	14.12	10.97	11.37	12.01	12.41	13.77
	6H	11.98	12.31	13.03	13.36	14.73	11.64	11.96	12.69	13.01	14.38
	8H	12.22	12.51	13.27	13.55	14.96	11.87	12.15	12.92	13.20	14.61

END OF REPORT