

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P924405

Luminaire Tested: DFN2DIP-HX3F0-050D060US950-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P924405
REPORT IS A COMBINATION OF REPORTS P900768 AND P897645
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-050D060US950-RLLONL
Description: 3 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9721.3 lumens
Efficiency: N/A
Efficacy: 107.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 90.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P924405

CATALOG NUMBER: DFN2DIP-HX3F0-050D060US950-RLLONL

Luminous Intensity Polar Plot

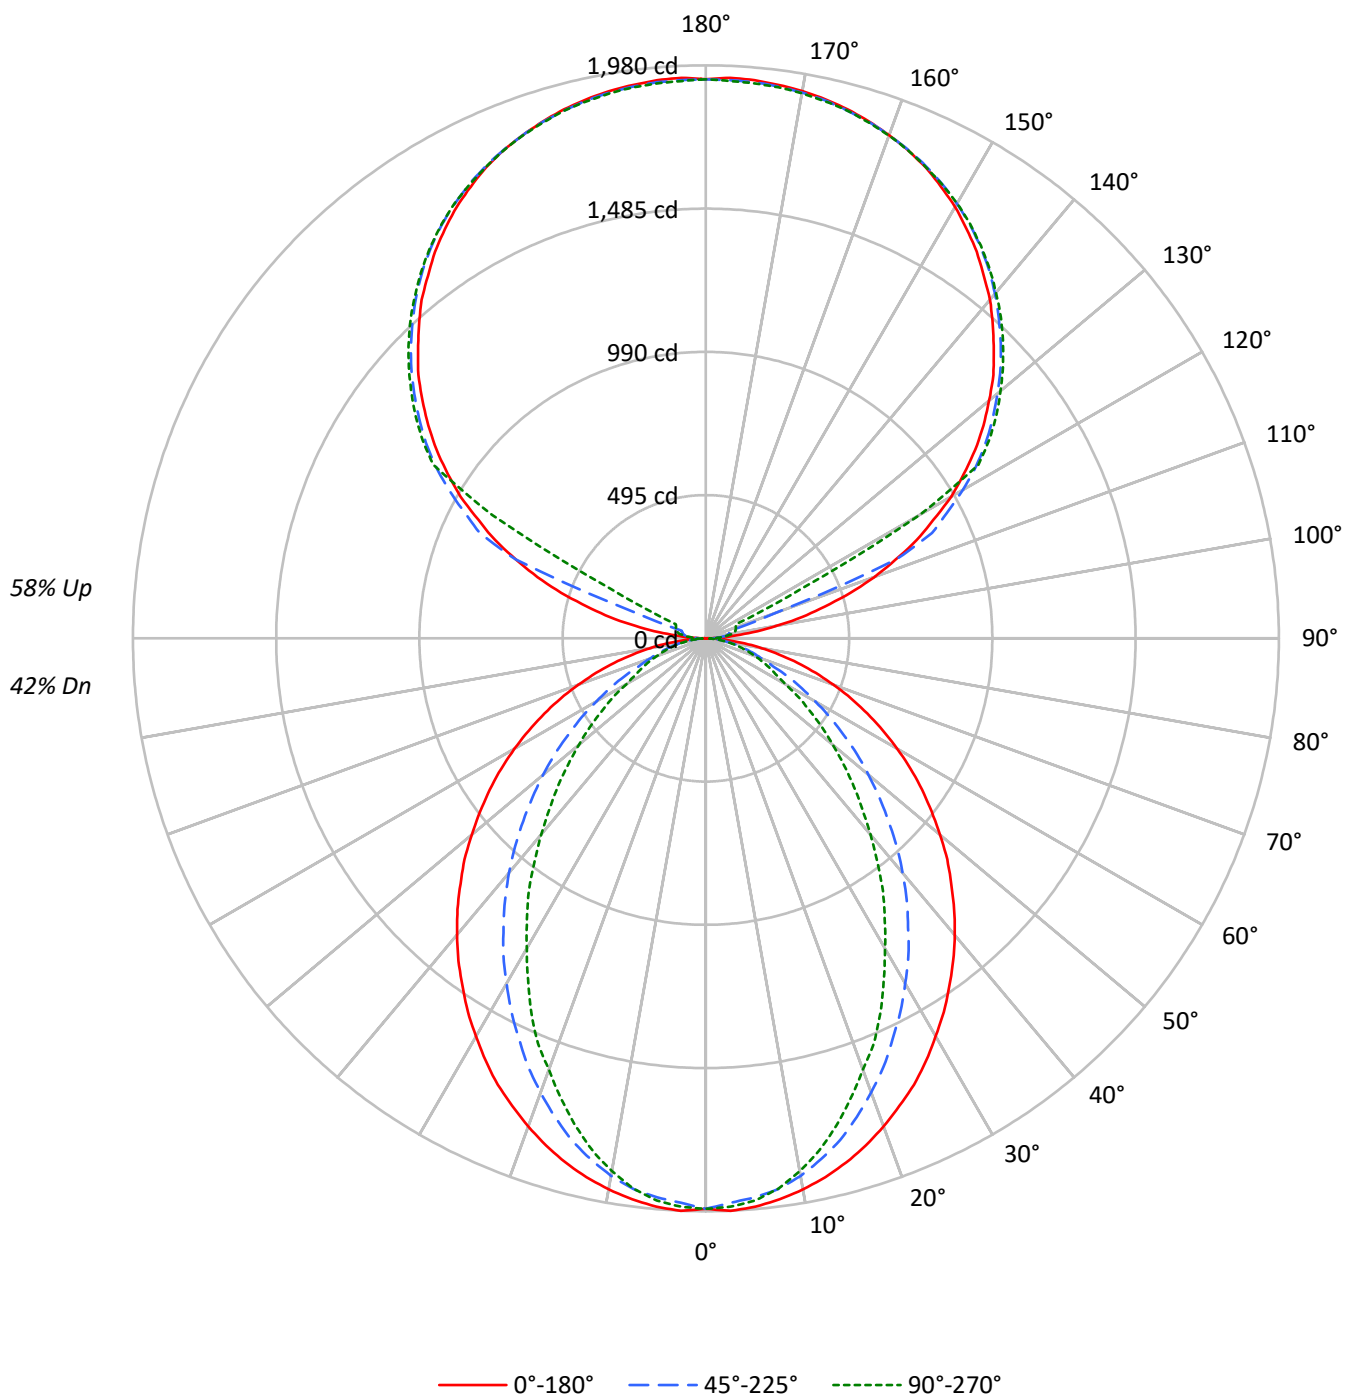

TEST NUMBER: P924405

CATALOG NUMBER: DFN2DIP-HX3F0-050D060US950-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	63	63	63	49	49	49
1	96	92	89	85	88	84	81	78	70	67	65	56	55	53	43	43	42
2	88	81	75	70	80	74	69	65	61	58	55	50	47	45	39	37	36
3	81	72	65	59	73	66	60	55	55	50	46	44	41	39	35	33	31
4	74	64	56	50	67	58	52	47	49	44	40	40	36	33	31	29	27
5	68	57	49	43	62	52	45	40	44	39	35	36	32	29	28	26	24
6	63	51	43	38	57	47	40	35	39	34	30	32	29	26	26	23	21
7	58	46	38	33	53	43	36	31	36	31	27	30	26	23	24	21	19
8	54	42	34	29	49	39	32	27	33	28	24	27	23	20	22	19	17
9	50	38	31	26	46	35	29	25	30	25	22	25	21	18	20	17	15
10	47	35	28	23	43	33	26	22	28	23	19	23	19	17	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2284	2284	2284
5°	2286	2246	2261
10°	2263	2200	2186
15°	2230	2126	2071
20°	2188	2024	1930
25°	2145	1910	1795
30°	2087	1794	1623
35°	2030	1669	1472
40°	1973	1540	1300
45°	1906	1396	1143
50°	1837	1252	991
55°	1764	1098	844
60°	1680	937	693
65°	1583	774	623
70°	1466	621	562
75°	1319	544	508
80°	1105	452	436
85°	756	294	321

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1906 cd/sqm

TEST NUMBER: P924405

CATALOG NUMBER: DFN2DIP-HX3F0-050D060US950-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	184.8	1.9
10°-20°	507.2	5.2
20°-30°	712.1	7.3
30°-40°	776.3	8.0
40°-50°	713.5	7.3
50°-60°	560.3	5.8
60°-70°	364.7	3.8
70°-80°	187.7	1.9
80°-90°	51.3	0.5
90°-100°	63.7	0.7
100°-110°	237.5	2.4
110°-120°	629.8	6.5
120°-130°	1044.5	10.7
130°-140°	1109.5	11.4
140°-150°	1031.2	10.6
150°-160°	829.1	8.5
160°-170°	534.2	5.5
170°-180°	183.9	1.9
0°-30°	1404.1	14.4
0°-40°	2180.4	22.4
0°-60°	3454.1	35.5
0°-90°	4057.9	41.7
90°-120°	930.9	9.6
90°-150°	4116.2	42.3
90°-180°	5663.0	58.3
0°-180°	9721.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1971	1971	1971	1971	1971	
5°	1971	1963	1939	1955	1950	187
15°	1875	1855	1795	1761	1743	528
25°	1702	1645	1527	1454	1427	783
35°	1467	1376	1219	1106	1067	918
45°	1199	1079	892	765	722	926
55°	912	772	580	473	439	815
65°	616	471	310	250	244	610
75°	328	203	143	130	128	347
85°	77	39	34	34	34	88
90°	1	17	28	35	38	9
95°	91	45	54	62	60	108
105°	425	467	85	101	106	454
115°	804	828	862	215	115	791
125°	1136	1155	1181	1191	1195	1014
135°	1406	1429	1441	1455	1452	1086
145°	1631	1630	1654	1663	1656	1020
155°	1796	1784	1800	1809	1798	828
165°	1893	1884	1888	1898	1888	535
175°	1936	1926	1929	1939	1925	184
180°	1932	1932	1932	1932	1932	

TEST NUMBER: P924405

CATALOG NUMBER: DFN2DIP-HX3F0-050D060US950-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1971.4	1971.4	1971.4	1971.4	1971.4
2.5°	1980.3	1971.4	1951.8	1969.7	1966.1
5°	1971.4	1962.6	1939.3	1955.3	1950.1
7.5°	1955.3	1944.7	1919.7	1926.8	1917.8
10°	1933.9	1921.5	1885.9	1880.4	1869.7
12.5°	1907.2	1891.2	1842.9	1832.3	1812.6
15°	1875.1	1855.4	1794.9	1761.0	1743.1
17.5°	1837.6	1809.1	1734.1	1694.9	1666.3
20°	1794.9	1759.1	1669.9	1625.4	1586.0
22.5°	1748.5	1707.4	1603.9	1543.3	1516.6
25°	1702.0	1644.9	1527.2	1454.1	1427.2
27.5°	1646.8	1586.0	1455.8	1371.9	1330.9
30°	1587.9	1520.0	1377.3	1286.4	1238.1
32.5°	1530.8	1448.6	1302.5	1195.4	1150.7
35°	1466.6	1375.6	1218.6	1106.2	1066.9
37.5°	1404.1	1305.9	1140.1	1016.9	972.4
40°	1338.1	1231.1	1057.9	931.3	884.9
42.5°	1270.3	1156.2	975.9	843.8	799.4
45°	1199.0	1079.4	892.1	765.3	722.5
47.5°	1131.2	1004.6	811.9	685.1	645.9
50°	1056.3	929.6	733.3	610.1	572.8
52.5°	983.0	849.2	658.4	540.6	506.8
55°	911.6	772.5	579.7	472.8	438.9
57.5°	838.6	695.8	510.3	410.4	381.8
60°	763.6	620.9	437.0	346.2	317.6
62.5°	690.5	547.8	374.6	289.1	274.8
65°	615.5	471.0	310.4	249.9	244.4
67.5°	544.2	399.6	249.9	219.4	214.1
70°	469.3	330.1	206.9	189.1	181.9
72.5°	397.9	265.8	173.1	158.8	155.2
75°	328.3	203.3	142.7	130.2	128.5
77.5°	258.7	144.4	112.5	105.2	101.6
80°	194.4	103.5	85.6	78.5	78.5
82.5°	135.6	69.6	58.9	55.2	55.2
85°	76.7	39.2	33.9	33.9	33.9
87.5°	28.6	14.2	14.2	12.5	12.5
90°	1.3	16.8	27.9	35.0	37.7
92.5°	35.0	29.4	33.5	36.3	37.7
95°	90.8	44.6	54.5	61.6	60.1
97.5°	163.5	48.9	71.2	75.6	76.9
100°	247.5	55.9	79.7	90.8	93.6
102.5°	339.6	337.0	82.5	97.8	102.1
105°	424.9	466.9	85.3	100.6	106.3
107.5°	524.2	559.0	88.1	103.4	109.0
110°	619.3	648.5	244.7	104.9	110.4

TEST NUMBER: P924405

CATALOG NUMBER: DFN2DIP-HX3F0-050D060US950-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	708.7	733.8	710.1	107.5	111.9
115°	803.7	827.5	862.5	215.3	114.7
117.5°	886.2	914.1	938.0	738.0	371.8
120°	978.5	999.4	1024.7	1041.4	852.7
122.5°	1056.7	1079.1	1107.1	1115.4	1116.9
125°	1136.4	1154.6	1181.1	1191.0	1195.1
127.5°	1209.1	1228.7	1249.7	1263.7	1265.0
130°	1277.6	1300.0	1315.3	1330.7	1329.4
132.5°	1347.5	1365.7	1381.0	1393.6	1392.3
135°	1406.3	1428.7	1441.1	1455.2	1452.4
137.5°	1467.6	1484.4	1498.5	1512.5	1508.4
140°	1527.7	1539.1	1554.4	1566.9	1560.0
142.5°	1578.2	1588.0	1606.2	1617.2	1610.3
145°	1631.3	1629.8	1653.6	1663.4	1656.4
147.5°	1677.3	1673.1	1696.9	1703.8	1698.4
150°	1722.2	1712.3	1734.8	1743.1	1736.1
152.5°	1759.8	1748.7	1769.6	1778.1	1768.2
155°	1796.2	1783.7	1800.5	1808.8	1797.6
157.5°	1825.6	1814.4	1827.0	1836.8	1825.6
160°	1850.8	1842.3	1850.8	1859.1	1849.3
162.5°	1873.0	1864.7	1871.7	1881.5	1868.9
165°	1892.6	1884.3	1888.4	1898.3	1888.4
167.5°	1908.0	1899.6	1903.9	1913.7	1901.0
170°	1920.7	1912.2	1915.1	1924.8	1912.2
172.5°	1929.0	1920.7	1923.5	1933.3	1920.7
175°	1936.0	1926.1	1929.0	1938.7	1924.8
177.5°	1938.7	1929.0	1930.4	1940.2	1927.7
180°	1931.8	1931.8	1931.8	1931.8	1931.8

TEST NUMBER: P924405

CATALOG NUMBER: DFN2DIP-HX3F0-050D060US950-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.15	9.92	10.18	10.95	12.34	5.13	5.89	6.16	6.93	8.31
	3H	10.81	11.50	11.86	12.54	13.95	6.31	6.99	7.35	8.03	9.44
	4H	11.42	12.06	12.47	13.11	14.52	6.75	7.40	7.80	8.44	9.86
	6H	11.83	12.42	12.89	13.47	14.90	7.06	7.66	8.13	8.71	10.14
	8H	11.95	12.52	13.02	13.58	15.00	7.15	7.72	8.22	8.78	10.20
	12H	12.00	12.54	13.08	13.60	15.05	7.19	7.73	8.26	8.79	10.23
4H	2H	9.16	9.81	10.22	10.85	12.27	5.71	6.36	6.77	7.40	8.82
	3H	10.97	11.51	12.04	12.59	14.01	7.05	7.59	8.12	8.66	10.09
	4H	11.66	12.15	12.73	13.22	14.66	7.59	8.08	8.66	9.15	10.60
	6H	12.16	12.59	13.24	13.67	15.12	8.00	8.42	9.08	9.51	10.95
	8H	12.33	12.73	13.41	13.81	15.26	8.13	8.52	9.21	9.60	11.06
	12H	12.42	12.78	13.52	13.87	15.33	8.18	8.54	9.28	9.64	11.10
8H	4H	11.62	12.02	12.70	13.10	14.55	7.86	8.26	8.94	9.34	10.79
	6H	12.18	12.50	13.28	13.62	15.08	8.37	8.70	9.47	9.82	11.27
	8H	12.39	12.67	13.50	13.78	15.25	8.56	8.84	9.67	9.95	11.42
	12H	12.52	12.77	13.63	13.87	15.38	8.67	8.92	9.78	10.02	11.53
12H	4H	11.57	11.93	12.67	13.02	14.48	7.86	8.22	8.96	9.31	10.78
	6H	12.15	12.44	13.26	13.54	15.02	8.42	8.70	9.53	9.81	11.28
	8H	12.36	12.61	13.48	13.71	15.23	8.62	8.87	9.73	9.97	11.49