

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P924459

Luminaire Tested: DFN2DIP-HX3F0-070D080US950-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P924459
REPORT IS A COMBINATION OF REPORTS P899280 AND P896089
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-070D080US950-RLLFLL
Description: 3 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12430.6 lumens
Efficiency: N/A
Efficacy: 95.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 130.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P924459

CATALOG NUMBER: DFN2DIP-HX3F0-070D080US950-RLLFLL

Luminous Intensity Polar Plot

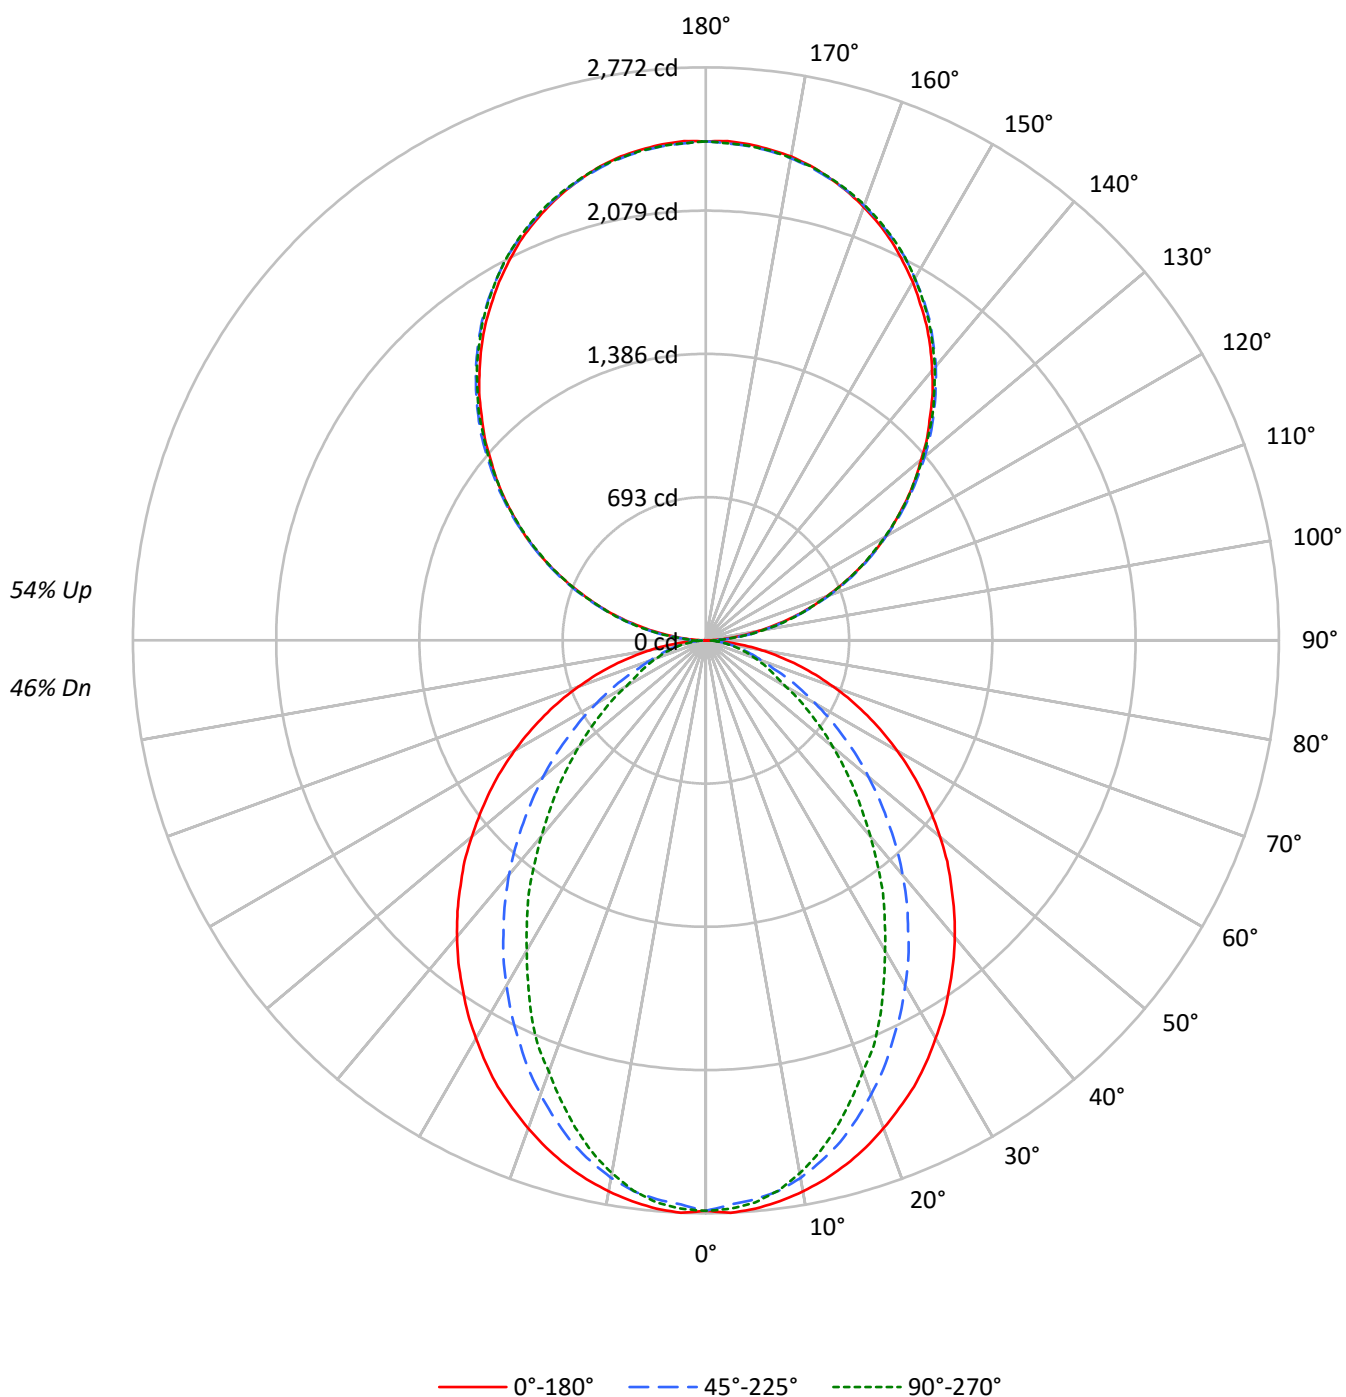

TEST NUMBER: P924459

CATALOG NUMBER: DFN2DIP-HX3F0-070D080US950-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	81	81	81	66	66	66	52	52	52
1	97	93	89	86	89	86	82	80	72	69	67	59	57	56	47	46	45
2	89	82	76	71	81	75	70	66	63	60	56	52	49	47	42	40	38
3	81	72	65	60	74	67	61	56	56	52	48	46	43	40	37	35	33
4	75	64	57	51	68	59	53	48	50	45	41	42	38	35	34	31	29
5	69	57	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26
6	63	52	44	38	58	48	41	36	41	35	31	34	30	27	28	25	23
7	59	47	39	34	54	43	37	32	37	32	28	31	27	24	26	23	20
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	18
9	51	39	32	27	47	36	30	25	31	26	22	26	22	20	22	19	17
10	47	36	29	24	44	33	27	23	29	24	20	24	20	18	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3197	3197	3197
5°	3201	3144	3165
10°	3168	3080	3060
15°	3123	2976	2899
20°	3063	2834	2702
25°	3003	2675	2513
30°	2922	2511	2272
35°	2843	2336	2061
40°	2762	2155	1820
45°	2668	1955	1601
50°	2571	1753	1387
55°	2470	1537	1182
60°	2352	1312	971
65°	2217	1083	872
70°	2053	870	786
75°	1846	762	712
80°	1548	632	612
85°	1057	411	449

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2668 cd/sqm

TEST NUMBER: P924459

CATALOG NUMBER: DFN2DIP-HX3F0-070D080US950-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	258.7	2.1
10°-20°	710.1	5.7
20°-30°	997.0	8.0
30°-40°	1086.8	8.7
40°-50°	998.8	8.0
50°-60°	784.4	6.3
60°-70°	510.6	4.1
70°-80°	262.8	2.1
80°-90°	74.0	0.6
90°-100°	149.4	1.2
100°-110°	474.6	3.8
110°-120°	812.1	6.5
120°-130°	1068.1	8.6
130°-140°	1198.9	9.6
140°-150°	1175.6	9.5
150°-160°	986.2	7.9
160°-170°	654.0	5.3
170°-180°	228.6	1.8
0°-30°	1965.7	15.8
0°-40°	3052.5	24.6
0°-60°	4835.8	38.9
0°-90°	5683.1	45.7
90°-120°	1436.1	11.6
90°-150°	4878.6	39.2
90°-180°	6747.0	54.3
0°-180°	12430.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2760	2760	2760	2760	2760	
5°	2760	2748	2715	2738	2730	262
15°	2625	2598	2513	2465	2440	740
25°	2383	2303	2138	2036	1998	1096
35°	2053	1926	1706	1549	1494	1285
45°	1679	1511	1249	1071	1012	1296
55°	1276	1082	812	662	615	1140
65°	862	659	435	350	342	854
75°	460	285	200	182	180	486
85°	107	55	47	47	47	123
90°	2	26	71	67	69	12
95°	106	127	130	130	127	118
105°	438	444	448	452	452	462
115°	815	827	823	821	815	806
125°	1185	1204	1198	1191	1189	1059
135°	1533	1556	1560	1558	1552	1185
145°	1861	1876	1888	1890	1882	1163
155°	2128	2134	2141	2151	2144	980
165°	2316	2313	2313	2328	2318	653
175°	2409	2404	2399	2414	2401	229
180°	2414	2414	2414	2414	2414	

TEST NUMBER: P924459

CATALOG NUMBER: DFN2DIP-HX3F0-070D080US950-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2760.0	2760.0	2760.0	2760.0	2760.0
2.5°	2772.4	2760.0	2732.4	2757.6	2752.6
5°	2760.0	2747.5	2715.0	2737.5	2730.1
7.5°	2737.5	2722.6	2687.7	2697.4	2685.0
10°	2707.5	2690.1	2640.2	2632.6	2617.7
12.5°	2670.2	2647.6	2580.1	2565.2	2537.6
15°	2625.1	2597.6	2512.7	2465.3	2440.4
17.5°	2572.7	2532.7	2427.7	2372.8	2332.8
20°	2512.7	2462.7	2337.9	2275.6	2220.4
22.5°	2447.9	2390.3	2245.3	2160.5	2123.2
25°	2382.9	2302.9	2138.0	2035.7	1998.2
27.5°	2305.5	2220.4	2038.1	1920.8	1863.3
30°	2223.1	2128.0	1928.1	1801.0	1733.4
32.5°	2143.1	2028.1	1823.5	1673.5	1610.9
35°	2053.2	1925.7	1706.1	1548.7	1493.6
37.5°	1965.8	1828.2	1596.1	1423.6	1361.4
40°	1873.3	1723.6	1481.1	1303.8	1238.9
42.5°	1778.4	1618.7	1366.3	1181.3	1119.1
45°	1678.6	1511.0	1249.0	1071.4	1011.5
47.5°	1583.6	1406.4	1136.6	959.1	904.2
50°	1478.7	1301.4	1026.6	854.1	801.9
52.5°	1376.1	1188.8	921.7	756.8	709.4
55°	1276.3	1081.5	811.7	662.0	614.6
57.5°	1174.0	974.1	714.5	574.5	534.5
60°	1069.1	869.2	611.9	484.7	444.7
62.5°	966.7	766.9	524.4	404.7	384.7
65°	861.7	659.3	434.6	349.8	342.1
67.5°	761.9	559.4	349.8	307.1	299.7
70°	656.9	462.1	289.6	264.7	254.6
72.5°	557.0	372.1	242.2	222.4	217.3
75°	459.5	284.6	199.8	182.3	179.9
77.5°	362.2	202.2	157.4	147.3	142.3
80°	272.2	144.9	119.8	110.0	110.0
82.5°	189.8	97.5	82.4	77.4	77.4
85°	107.3	54.9	47.4	47.4	47.4
87.5°	40.0	19.8	19.8	17.5	17.5
90°	2.2	26.2	71.4	67.0	69.2
92.5°	45.1	61.2	63.3	65.4	65.4
95°	106.3	126.6	130.2	130.2	126.6
97.5°	176.9	195.8	203.8	203.8	203.8
100°	258.3	275.0	280.9	280.9	278.7
102.5°	344.2	356.6	364.5	366.7	364.5
105°	438.1	443.9	448.3	451.9	451.9
107.5°	531.2	540.0	540.0	541.4	531.2
110°	621.4	633.1	633.1	633.1	627.3

TEST NUMBER: P924459

CATALOG NUMBER: DFN2DIP-HX3F0-070D080US950-RLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	718.9	731.3	729.1	723.3	718.9
115°	815.0	826.6	823.0	820.8	815.0
117.5°	910.3	926.3	916.1	910.3	904.5
120°	1006.4	1022.4	1006.4	1006.4	999.8
122.5°	1093.7	1114.1	1103.9	1098.1	1093.7
125°	1185.3	1203.6	1197.7	1191.2	1189.1
127.5°	1274.9	1297.4	1289.4	1280.7	1274.9
130°	1358.6	1384.7	1381.1	1376.8	1368.8
132.5°	1452.5	1472.8	1474.3	1464.1	1458.3
135°	1533.2	1555.8	1560.2	1558.0	1552.2
137.5°	1623.4	1641.6	1645.3	1643.8	1635.1
140°	1702.8	1720.9	1731.1	1731.1	1723.1
142.5°	1784.3	1802.5	1808.3	1810.5	1802.5
145°	1861.4	1875.9	1887.6	1889.8	1881.8
147.5°	1930.5	1948.7	1957.4	1961.1	1953.1
150°	2001.9	2014.2	2022.2	2028.8	2022.2
152.5°	2065.1	2077.5	2087.7	2095.7	2087.7
155°	2128.5	2134.3	2140.9	2151.0	2144.5
157.5°	2183.0	2187.4	2191.1	2205.6	2195.4
160°	2231.8	2236.2	2238.4	2250.7	2242.0
162.5°	2276.9	2276.9	2279.1	2292.9	2282.7
165°	2315.5	2313.3	2313.3	2327.9	2317.6
167.5°	2350.4	2343.9	2343.9	2358.4	2348.2
170°	2376.6	2370.8	2368.6	2383.2	2370.8
172.5°	2394.8	2389.0	2386.8	2401.3	2389.0
175°	2409.3	2403.5	2399.1	2413.7	2401.3
177.5°	2417.3	2411.5	2407.1	2419.5	2407.1
180°	2413.7	2413.7	2413.7	2413.7	2413.7

TEST NUMBER: P924459

CATALOG NUMBER: DFN2DIP-HX3F0-070D080US950-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.73	11.52	11.73	12.53	13.86	6.70	7.50	7.70	8.50	9.84
	3H	12.39	13.11	13.40	14.12	15.47	7.88	8.60	8.89	9.61	10.97
	4H	12.99	13.67	14.02	14.69	16.05	8.33	9.00	9.35	10.02	11.38
	6H	13.41	14.03	14.44	15.05	16.43	8.64	9.26	9.68	10.29	11.66
	8H	13.53	14.12	14.57	15.16	16.53	8.73	9.32	9.77	10.36	11.73
	12H	13.59	14.15	14.63	15.18	16.57	8.77	9.33	9.82	10.37	11.76
4H	2H	10.74	11.41	11.77	12.43	13.79	7.29	7.96	8.32	8.98	10.34
	3H	12.56	13.12	13.59	14.16	15.54	8.63	9.19	9.67	10.24	11.61
	4H	13.24	13.75	14.28	14.79	16.19	9.17	9.69	10.22	10.72	12.12
	6H	13.75	14.19	14.80	15.25	16.64	9.59	10.03	10.64	11.09	12.48
	8H	13.92	14.33	14.97	15.38	16.79	9.71	10.12	10.77	11.18	12.59
	12H	14.01	14.38	15.08	15.45	16.86	9.77	10.14	10.84	11.21	12.63
8H	4H	13.21	13.62	14.26	14.67	16.08	9.45	9.86	10.50	10.91	12.32
	6H	13.76	14.10	14.84	15.20	16.60	9.96	10.30	11.03	11.39	12.80
	8H	13.97	14.27	15.06	15.35	16.78	10.14	10.44	11.23	11.52	12.95
	12H	14.10	14.37	15.19	15.44	16.91	10.26	10.52	11.35	11.60	13.06
12H	4H	13.16	13.53	14.23	14.59	16.01	9.45	9.82	10.52	10.89	12.30
	6H	13.74	14.03	14.82	15.11	16.54	10.00	10.30	11.09	11.38	12.81
	8H	13.95	14.21	15.04	15.29	16.75	10.21	10.47	11.30	11.55	13.01

END OF REPORT