

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P924482

Luminaire Tested: DFN2DIP-HX3F0-080D080US950-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P924482
REPORT IS A COMBINATION OF REPORTS P899281 AND P896089
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-080D080US950-FLLFLL
Description: 3 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14310.0 lumens
Efficiency: N/A
Efficacy: 101.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 141.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P924482

CATALOG NUMBER: DFN2DIP-HX3F0-080D080US950-FLLFLL

Luminous Intensity Polar Plot

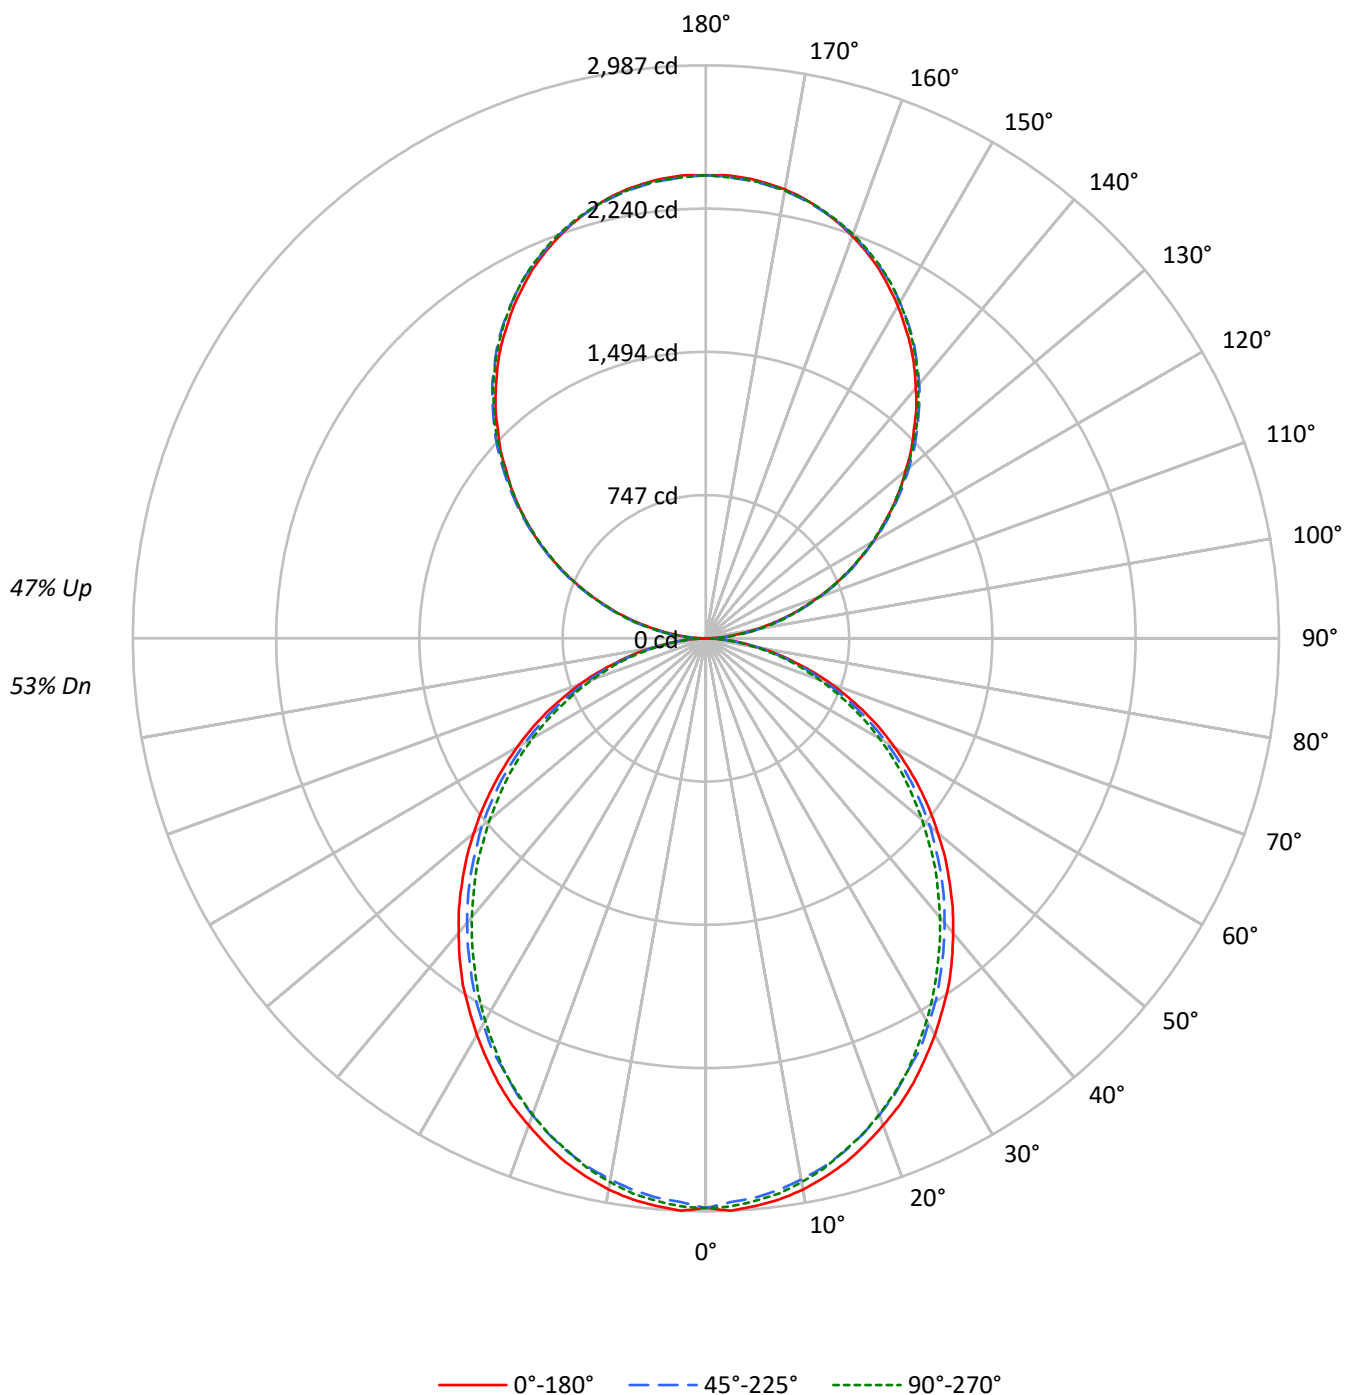

TEST NUMBER: P924482

CATALOG NUMBER: DFN2DIP-HX3F0-080D080US950-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	59	59	59
1	98	94	90	87	91	87	84	81	74	72	70	63	61	59	52	51	50
2	90	82	76	71	83	76	71	66	65	61	58	55	52	50	46	44	42
3	82	72	65	59	75	67	61	55	58	53	49	49	45	42	41	38	36
4	75	64	56	50	69	60	52	47	51	46	41	43	39	36	36	33	31
5	69	57	49	43	63	53	46	40	46	40	36	39	35	31	33	29	27
6	63	51	43	37	58	48	40	35	41	36	31	35	31	27	30	26	24
7	59	46	38	33	54	43	36	31	37	32	28	32	28	24	27	24	21
8	54	42	34	29	50	39	32	27	34	29	24	29	25	22	25	21	19
9	51	38	31	26	47	36	29	24	31	26	22	27	23	19	23	20	17
10	47	35	28	23	44	33	26	22	29	23	20	25	21	18	21	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3440	3440	3440
5°	3444	3390	3413
10°	3414	3342	3365
15°	3363	3284	3291
20°	3293	3205	3215
25°	3224	3112	3128
30°	3138	3024	3017
35°	3056	2921	2900
40°	2956	2817	2789
45°	2855	2713	2675
50°	2746	2603	2543
55°	2631	2477	2421
60°	2500	2327	2282
65°	2358	2171	2118
70°	2177	1981	1940
75°	1927	1753	1773
80°	1625	1462	1460
85°	1153	968	947

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2855 cd/sqm

TEST NUMBER: P924482

CATALOG NUMBER: DFN2DIP-HX3F0-080D080US950-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	279.5	2.0
10°-20°	786.4	5.5
20°-30°	1155.7	8.1
30°-40°	1342.3	9.4
40°-50°	1340.6	9.4
50°-60°	1169.0	8.2
60°-70°	864.1	6.0
70°-80°	488.9	3.4
80°-90°	135.9	0.9
90°-100°	149.4	1.0
100°-110°	474.6	3.3
110°-120°	812.1	5.7
120°-130°	1068.1	7.5
130°-140°	1198.9	8.4
140°-150°	1175.6	8.2
150°-160°	986.2	6.9
160°-170°	654.0	4.6
170°-180°	228.6	1.6
0°-30°	2221.6	15.5
0°-40°	3563.9	24.9
0°-60°	6073.6	42.4
0°-90°	7562.5	52.8
90°-120°	1436.1	10.0
90°-150°	4878.6	34.1
90°-180°	6747.0	47.1
0°-180°	14310.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2970	2970	2970	2970	2970	
5°	2970	2958	2927	2950	2944	282
15°	2827	2810	2773	2784	2770	796
25°	2558	2536	2487	2493	2487	1177
35°	2207	2179	2133	2116	2102	1378
45°	1796	1776	1733	1702	1691	1386
55°	1359	1342	1308	1274	1259	1215
65°	917	900	871	845	831	906
75°	480	474	460	443	448	512
85°	117	114	112	103	100	130
90°	2	26	71	67	69	14
95°	106	127	130	130	127	118
105°	438	444	448	452	452	462
115°	815	827	823	821	815	806
125°	1185	1204	1198	1191	1189	1059
135°	1533	1556	1560	1558	1552	1185
145°	1861	1876	1888	1890	1882	1163
155°	2128	2134	2141	2151	2144	980
165°	2316	2313	2313	2328	2318	653
175°	2409	2404	2399	2414	2401	229
180°	2414	2414	2414	2414	2414	

TEST NUMBER: P924482

CATALOG NUMBER: DFN2DIP-HX3F0-080D080US950-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2969.6	2969.6	2969.6	2969.6	2969.6
2.5°	2986.9	2972.7	2941.2	2969.6	2964.2
5°	2969.6	2958.4	2927.0	2949.7	2944.2
7.5°	2949.7	2932.7	2901.2	2924.2	2918.5
10°	2918.5	2898.4	2864.2	2886.9	2878.5
12.5°	2875.5	2858.5	2824.2	2838.4	2832.7
15°	2827.0	2810.0	2772.7	2784.2	2770.0
17.5°	2767.0	2750.0	2712.7	2727.0	2712.7
20°	2701.3	2684.3	2644.3	2652.8	2641.5
22.5°	2635.8	2610.0	2572.7	2572.7	2567.0
25°	2558.5	2535.8	2487.4	2492.8	2487.4
27.5°	2472.8	2452.8	2415.8	2407.3	2393.1
30°	2387.4	2364.3	2321.7	2313.2	2301.6
32.5°	2295.9	2278.9	2233.1	2215.9	2204.4
35°	2207.4	2178.9	2133.1	2115.9	2101.7
37.5°	2107.4	2081.6	2035.9	2015.9	2001.7
40°	2004.7	1981.6	1936.0	1910.5	1898.9
42.5°	1904.8	1881.7	1836.3	1807.4	1790.6
45°	1796.3	1776.3	1733.2	1702.0	1690.6
47.5°	1690.6	1670.5	1624.8	1593.3	1576.3
50°	1579.1	1564.8	1524.8	1484.8	1470.6
52.5°	1470.6	1450.6	1413.6	1382.2	1362.1
55°	1359.4	1342.1	1307.9	1273.7	1259.4
57.5°	1247.9	1233.7	1196.4	1162.2	1150.6
60°	1136.4	1125.2	1085.2	1053.7	1045.2
62.5°	1027.9	1008.0	979.5	951.0	939.5
65°	916.8	899.5	871.0	845.2	831.0
67.5°	802.5	788.0	762.5	742.6	731.1
70°	696.8	685.3	659.6	639.6	628.3
72.5°	588.3	576.9	562.6	542.6	534.1
75°	479.6	474.1	459.6	442.7	448.4
77.5°	382.6	371.1	365.4	356.9	348.4
80°	285.7	282.7	276.9	268.5	262.6
82.5°	194.2	194.2	191.5	179.9	179.9
85°	117.0	114.2	111.5	102.7	100.0
87.5°	51.5	45.8	40.0	31.5	28.5
90°	2.2	26.2	71.4	67.0	69.2
92.5°	45.1	61.2	63.3	65.4	65.4
95°	106.3	126.6	130.2	130.2	126.6
97.5°	176.9	195.8	203.8	203.8	203.8
100°	258.3	275.0	280.9	280.9	278.7
102.5°	344.2	356.6	364.5	366.7	364.5
105°	438.1	443.9	448.3	451.9	451.9
107.5°	531.2	540.0	540.0	541.4	531.2
110°	621.4	633.1	633.1	633.1	627.3

TEST NUMBER: P924482

CATALOG NUMBER: DFN2DIP-HX3F0-080D080US950-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	718.9	731.3	729.1	723.3	718.9
115°	815.0	826.6	823.0	820.8	815.0
117.5°	910.3	926.3	916.1	910.3	904.5
120°	1006.4	1022.4	1006.4	1006.4	999.8
122.5°	1093.7	1114.1	1103.9	1098.1	1093.7
125°	1185.3	1203.6	1197.7	1191.2	1189.1
127.5°	1274.9	1297.4	1289.4	1280.7	1274.9
130°	1358.6	1384.7	1381.1	1376.8	1368.8
132.5°	1452.5	1472.8	1474.3	1464.1	1458.3
135°	1533.2	1555.8	1560.2	1558.0	1552.2
137.5°	1623.4	1641.6	1645.3	1643.8	1635.1
140°	1702.8	1720.9	1731.1	1731.1	1723.1
142.5°	1784.3	1802.5	1808.3	1810.5	1802.5
145°	1861.4	1875.9	1887.6	1889.8	1881.8
147.5°	1930.5	1948.7	1957.4	1961.1	1953.1
150°	2001.9	2014.2	2022.2	2028.8	2022.2
152.5°	2065.1	2077.5	2087.7	2095.7	2087.7
155°	2128.5	2134.3	2140.9	2151.0	2144.5
157.5°	2183.0	2187.4	2191.1	2205.6	2195.4
160°	2231.8	2236.2	2238.4	2250.7	2242.0
162.5°	2276.9	2276.9	2279.1	2292.9	2282.7
165°	2315.5	2313.3	2313.3	2327.9	2317.6
167.5°	2350.4	2343.9	2343.9	2358.4	2348.2
170°	2376.6	2370.8	2368.6	2383.2	2370.8
172.5°	2394.8	2389.0	2386.8	2401.3	2389.0
175°	2409.3	2403.5	2399.1	2413.7	2401.3
177.5°	2417.3	2411.5	2407.1	2419.5	2407.1
180°	2413.7	2413.7	2413.7	2413.7	2413.7

TEST NUMBER: P924482

CATALOG NUMBER: DFN2DIP-HX3F0-080D080US950-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.78	12.67	12.71	13.62	14.85	11.35	12.24	12.28	13.19	14.42
	3H	13.43	14.23	14.38	15.19	16.44	12.96	13.76	13.91	14.72	15.97
	4H	14.02	14.77	14.98	15.73	17.00	13.55	14.30	14.51	15.27	16.53
	6H	14.41	15.11	15.38	16.08	17.35	13.94	14.64	14.91	15.61	16.88
	8H	14.51	15.18	15.49	16.16	17.43	14.05	14.71	15.02	15.69	16.97
	12H	14.56	15.19	15.54	16.17	17.47	14.09	14.72	15.07	15.70	16.99
4H	2H	12.24	12.99	13.20	13.96	15.22	11.90	12.65	12.86	13.62	14.88
	3H	14.10	14.73	15.07	15.72	17.00	13.71	14.34	14.68	15.33	16.61
	4H	14.81	15.38	15.79	16.37	17.67	14.41	14.98	15.39	15.97	17.27
	6H	15.32	15.81	16.31	16.82	18.12	14.91	15.41	15.91	16.42	17.72
	8H	15.47	15.93	16.46	16.93	18.24	15.06	15.52	16.05	16.52	17.84
	12H	15.54	15.95	16.55	16.97	18.29	15.12	15.54	16.13	16.56	17.88
8H	4H	15.01	15.47	16.00	16.47	17.78	14.65	15.11	15.64	16.11	17.43
	6H	15.63	16.01	16.65	17.06	18.37	15.27	15.65	16.29	16.70	18.01
	8H	15.84	16.18	16.87	17.21	18.54	15.48	15.82	16.51	16.85	18.18
	12H	15.97	16.27	17.00	17.30	18.67	15.59	15.89	16.63	16.92	18.29
12H	4H	14.99	15.41	16.01	16.43	17.75	14.64	15.06	15.66	16.08	17.40
	6H	15.66	16.00	16.69	17.03	18.36	15.31	15.65	16.34	16.68	18.01
	8H	15.89	16.19	16.93	17.22	18.59	15.54	15.84	16.57	16.86	18.24