

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P926912

Luminaire Tested: DFN2DIP-HX4F0-050D050US830-FLLONL

Issue Date: 12/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P926912
REPORT IS A COMBINATION OF REPORTS P900839 AND P896187
Test Lab: INNOVATION CENTER
Issue Date: 12/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-050D050US830-FLLONL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9330.8 lumens
Efficiency: N/A
Efficacy: 114.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 81.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P926912

CATALOG NUMBER: DFN2DIP-HX4F0-050D050US830-FLLONL

Luminous Intensity Polar Plot

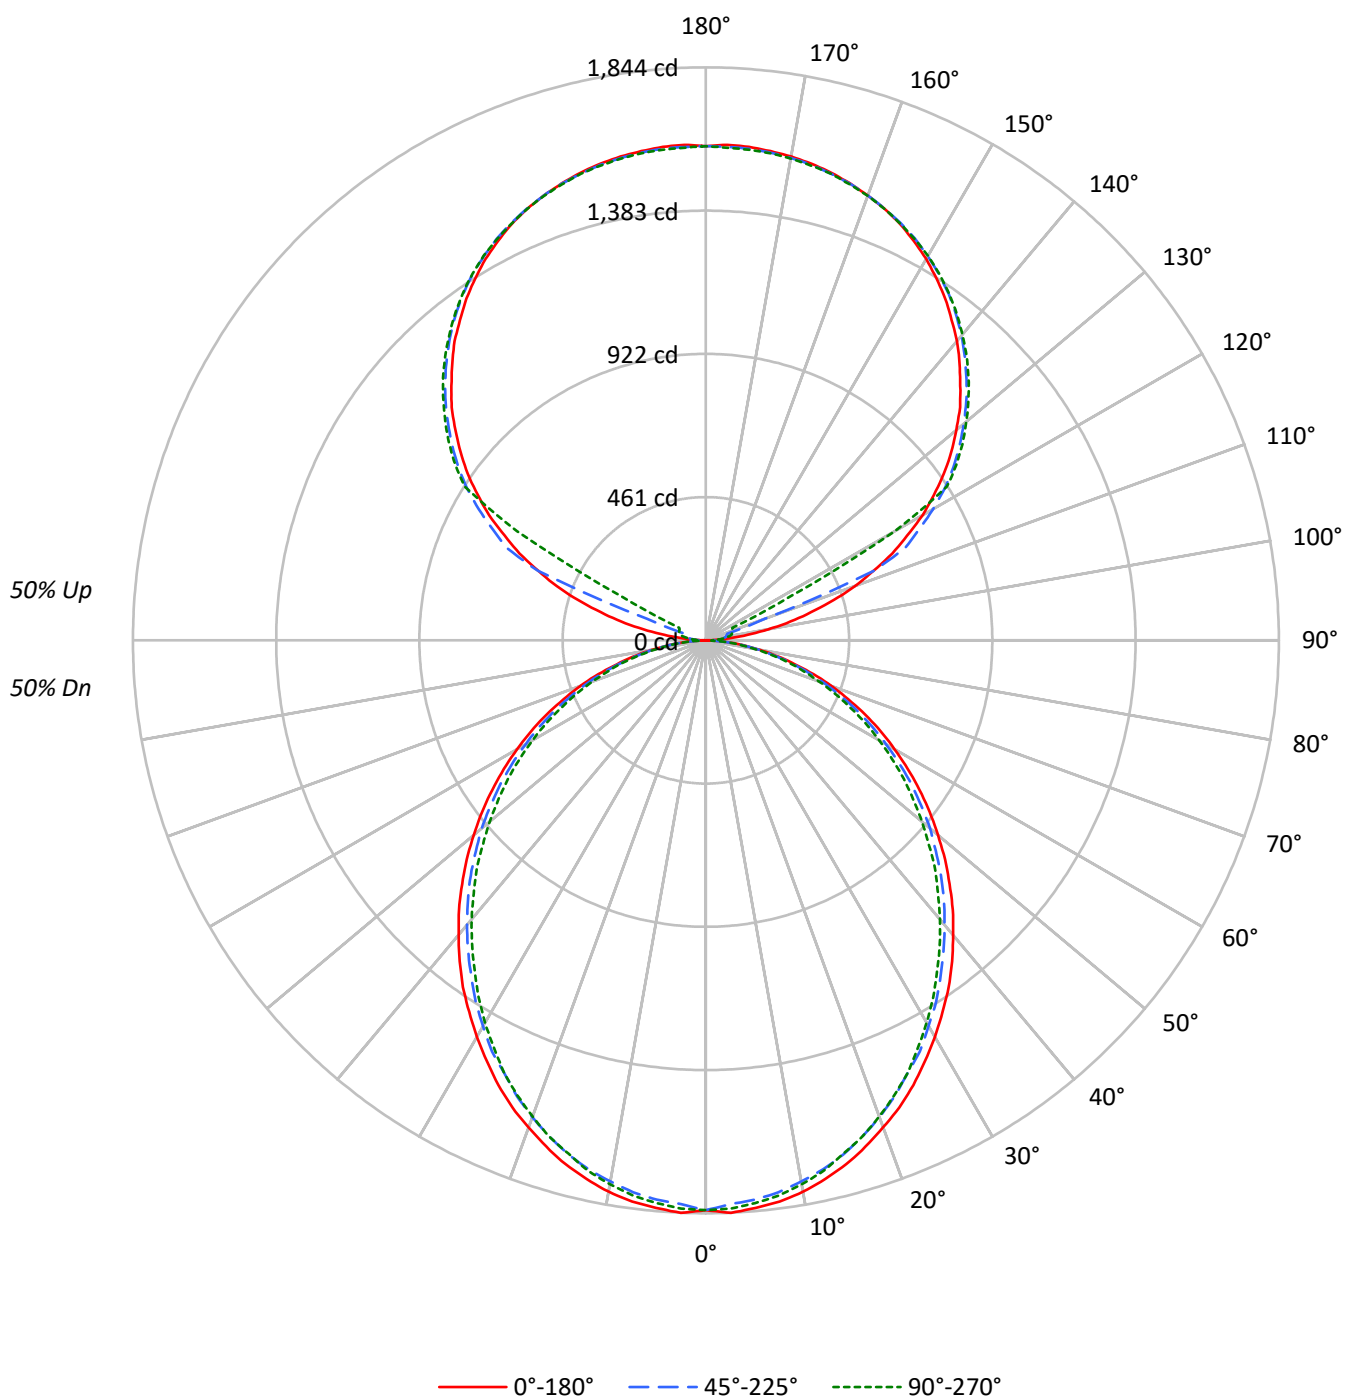

TEST NUMBER: P926912

CATALOG NUMBER: DFN2DIP-HX4F0-050D050US830-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1363	1363	1363
5°	1366	1345	1354
10°	1355	1327	1335
15°	1335	1305	1307
20°	1308	1275	1278
25°	1282	1238	1244
30°	1248	1205	1201
35°	1216	1165	1155
40°	1177	1125	1112
45°	1138	1085	1067
50°	1096	1043	1016
55°	1051	994	969
60°	1001	936	915
65°	946	876	851
70°	877	803	783
75°	780	716	720
80°	663	604	599
85°	481	412	398

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1138 cd/sqm

TEST NUMBER: P926912

CATALOG NUMBER: DFN2DIP-HX4F0-050D050US830-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	172.6	1.8
10°-20°	485.6	5.2
20°-30°	713.6	7.6
30°-40°	828.8	8.9
40°-50°	827.8	8.9
50°-60°	721.8	7.7
60°-70°	533.6	5.7
70°-80°	301.9	3.2
80°-90°	82.5	0.9
90°-100°	52.5	0.6
100°-110°	195.5	2.1
110°-120°	518.5	5.6
120°-130°	860.0	9.2
130°-140°	913.5	9.8
140°-150°	849.0	9.1
150°-160°	682.6	7.3
160°-170°	439.8	4.7
170°-180°	151.4	1.6
0°-30°	1371.8	14.7
0°-40°	2200.6	23.6
0°-60°	3750.2	40.2
0°-90°	4668.2	50.0
90°-120°	766.4	8.2
90°-150°	3388.8	36.3
90°-180°	4663.0	50.0
0°-180°	9330.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1834	1834	1834	1834	1834	
5°	1834	1827	1807	1821	1818	174
15°	1746	1735	1712	1719	1710	492
25°	1580	1566	1536	1539	1536	727
35°	1363	1345	1317	1306	1298	851
45°	1109	1097	1070	1051	1044	856
55°	839	829	808	786	778	750
65°	566	555	538	522	513	560
75°	296	293	284	273	277	316
85°	72	70	69	63	62	81
90°	1	14	23	29	31	9
95°	75	37	45	51	50	89
105°	350	384	70	83	88	374
115°	662	681	710	177	94	651
125°	936	951	972	980	984	834
135°	1158	1176	1186	1198	1196	894
145°	1343	1342	1361	1370	1364	840
155°	1479	1468	1482	1489	1480	681
165°	1558	1551	1555	1563	1555	440
175°	1594	1586	1588	1596	1585	152
180°	1590	1590	1590	1590	1590	

TEST NUMBER: P926912

CATALOG NUMBER: DFN2DIP-HX4F0-050D050US830-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1833.6	1833.6	1833.6	1833.6	1833.6
2.5°	1844.3	1835.5	1816.1	1833.6	1830.3
5°	1833.6	1826.8	1807.2	1821.3	1818.0
7.5°	1821.3	1810.8	1791.4	1805.6	1802.1
10°	1802.1	1789.7	1768.6	1782.6	1777.4
12.5°	1775.5	1765.0	1743.9	1752.7	1749.1
15°	1745.5	1735.0	1712.1	1719.2	1710.4
17.5°	1708.5	1698.0	1675.0	1683.8	1675.0
20°	1667.9	1657.5	1632.8	1638.0	1631.1
22.5°	1627.5	1611.6	1588.6	1588.6	1585.0
25°	1579.8	1565.8	1535.8	1539.2	1535.8
27.5°	1526.8	1514.5	1491.7	1486.4	1477.7
30°	1474.1	1459.9	1433.5	1428.3	1421.2
32.5°	1417.6	1407.2	1378.9	1368.2	1361.2
35°	1362.9	1345.4	1317.1	1306.5	1297.7
37.5°	1301.2	1285.4	1257.1	1244.8	1236.0
40°	1237.9	1223.6	1195.4	1179.6	1172.6
42.5°	1176.1	1161.9	1133.8	1116.0	1105.6
45°	1109.1	1096.8	1070.2	1051.0	1043.8
47.5°	1043.8	1031.5	1003.3	983.8	973.3
50°	975.0	966.3	941.6	916.9	908.0
52.5°	908.0	895.7	872.8	853.4	841.1
55°	839.4	828.7	807.5	786.4	777.7
57.5°	770.5	761.7	738.7	717.6	710.5
60°	701.7	694.8	670.1	650.6	645.4
62.5°	634.8	622.4	604.8	587.2	580.1
65°	566.1	555.4	537.8	522.0	513.1
67.5°	495.6	486.6	470.9	458.5	451.4
70°	430.3	423.2	407.3	394.9	388.0
72.5°	363.3	356.2	347.4	335.1	329.8
75°	296.1	292.7	283.8	273.3	276.9
77.5°	236.3	229.1	225.6	220.4	215.2
80°	176.4	174.6	171.0	165.8	162.2
82.5°	119.9	119.9	118.2	111.1	111.1
85°	72.2	70.5	68.8	63.4	61.7
87.5°	31.8	28.3	24.7	19.4	17.6
90°	1.1	13.8	23.0	28.8	31.0
92.5°	28.8	24.2	27.6	30.0	31.0
95°	74.7	36.8	44.9	50.7	49.5
97.5°	134.6	40.3	58.6	62.2	63.2
100°	203.8	46.1	65.6	74.7	77.1
102.5°	279.6	277.4	68.0	80.5	84.1
105°	349.9	384.4	70.2	82.8	87.5
107.5°	431.6	460.2	72.6	85.1	89.8
110°	509.9	533.9	201.4	86.3	90.9



TEST NUMBER: P926912

CATALOG NUMBER: DFN2DIP-HX4F0-050D050US830-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	583.5	604.1	584.6	88.6	92.1
115°	661.7	681.2	710.1	177.3	94.4
117.5°	729.6	752.6	772.3	607.5	306.1
120°	805.6	822.8	843.5	857.4	702.0
122.5°	869.9	888.4	911.5	918.4	919.6
125°	935.5	950.6	972.5	980.5	984.0
127.5°	995.4	1011.5	1028.9	1040.3	1041.5
130°	1051.8	1070.3	1082.8	1095.6	1094.5
132.5°	1109.4	1124.4	1136.9	1147.4	1146.3
135°	1157.8	1176.2	1186.4	1198.1	1195.7
137.5°	1208.3	1222.1	1233.7	1245.2	1241.8
140°	1257.8	1267.1	1279.6	1290.0	1284.3
142.5°	1299.3	1307.4	1322.3	1331.5	1325.7
145°	1343.1	1341.8	1361.3	1369.5	1363.7
147.5°	1381.0	1377.5	1397.1	1402.8	1398.3
150°	1417.8	1409.8	1428.2	1435.1	1429.3
152.5°	1448.8	1439.7	1456.9	1463.9	1455.8
155°	1478.8	1468.5	1482.3	1489.2	1480.0
157.5°	1502.9	1493.8	1504.1	1512.2	1502.9
160°	1523.7	1516.8	1523.7	1530.5	1522.5
162.5°	1542.0	1535.2	1540.9	1549.0	1538.6
165°	1558.1	1551.4	1554.7	1562.8	1554.7
167.5°	1570.9	1563.9	1567.5	1575.5	1565.1
170°	1581.2	1574.3	1576.6	1584.6	1574.3
172.5°	1588.1	1581.2	1583.6	1591.6	1581.2
175°	1593.9	1585.8	1588.1	1596.1	1584.6
177.5°	1596.1	1588.1	1589.3	1597.3	1587.0
180°	1590.4	1590.4	1590.4	1590.4	1590.4

TEST NUMBER: P926912

CATALOG NUMBER: DFN2DIP-HX4F0-050D050US830-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.35	9.21	9.31	10.19	11.46	7.92	8.78	8.88	9.75	11.03
	3H	10.01	10.79	10.98	11.77	13.06	9.54	10.31	10.51	11.30	12.59
	4H	10.60	11.33	11.58	12.32	13.62	10.13	10.86	11.11	11.85	13.15
	6H	11.00	11.68	12.00	12.67	13.98	10.53	11.20	11.52	12.19	13.51
	8H	11.11	11.75	12.11	12.76	14.07	10.63	11.27	11.63	12.28	13.59
	12H	11.16	11.77	12.16	12.77	14.10	10.68	11.29	11.68	12.29	13.62
4H	2H	8.81	9.55	9.80	10.53	11.83	8.47	9.20	9.46	10.19	11.49
	3H	10.68	11.29	11.68	12.31	13.62	10.29	10.90	11.29	11.91	13.23
	4H	11.40	11.96	12.40	12.96	14.30	10.99	11.55	12.00	12.56	13.90
	6H	11.91	12.39	12.93	13.43	14.76	11.50	11.98	12.52	13.02	14.35
	8H	12.06	12.51	13.08	13.54	14.89	11.65	12.10	12.67	13.12	14.48
	12H	12.14	12.54	13.17	13.58	14.94	11.72	12.12	12.75	13.16	14.52
8H	4H	11.59	12.04	12.61	13.07	14.42	11.23	11.68	12.25	12.71	14.06
	6H	12.23	12.60	13.27	13.66	15.01	11.86	12.24	12.91	13.30	14.65
	8H	12.45	12.78	13.50	13.83	15.19	12.08	12.41	13.13	13.46	14.83
	12H	12.58	12.87	13.64	13.91	15.33	12.20	12.48	13.25	13.53	14.94
12H	4H	11.58	11.99	12.62	13.03	14.38	11.23	11.63	12.26	12.67	14.03
	6H	12.26	12.59	13.31	13.64	15.00	11.91	12.23	12.96	13.28	14.65
	8H	12.50	12.79	13.55	13.83	15.24	12.14	12.43	13.20	13.48	14.89

END OF REPORT