

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P926934

Luminaire Tested: DFN2DIP-HX4F0-050D100US830-RLLONL

Issue Date: 12/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P926934
REPORT IS A COMBINATION OF REPORTS P900930 AND P896187
Test Lab: INNOVATION CENTER
Issue Date: 12/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-050D100US830-RLLONL
Description: 4 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13336.4 lumens
Efficiency: N/A
Efficacy: 111.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 119.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P926934

CATALOG NUMBER: DFN2DIP-HX4F0-050D100US830-RLLONL

Luminous Intensity Polar Plot

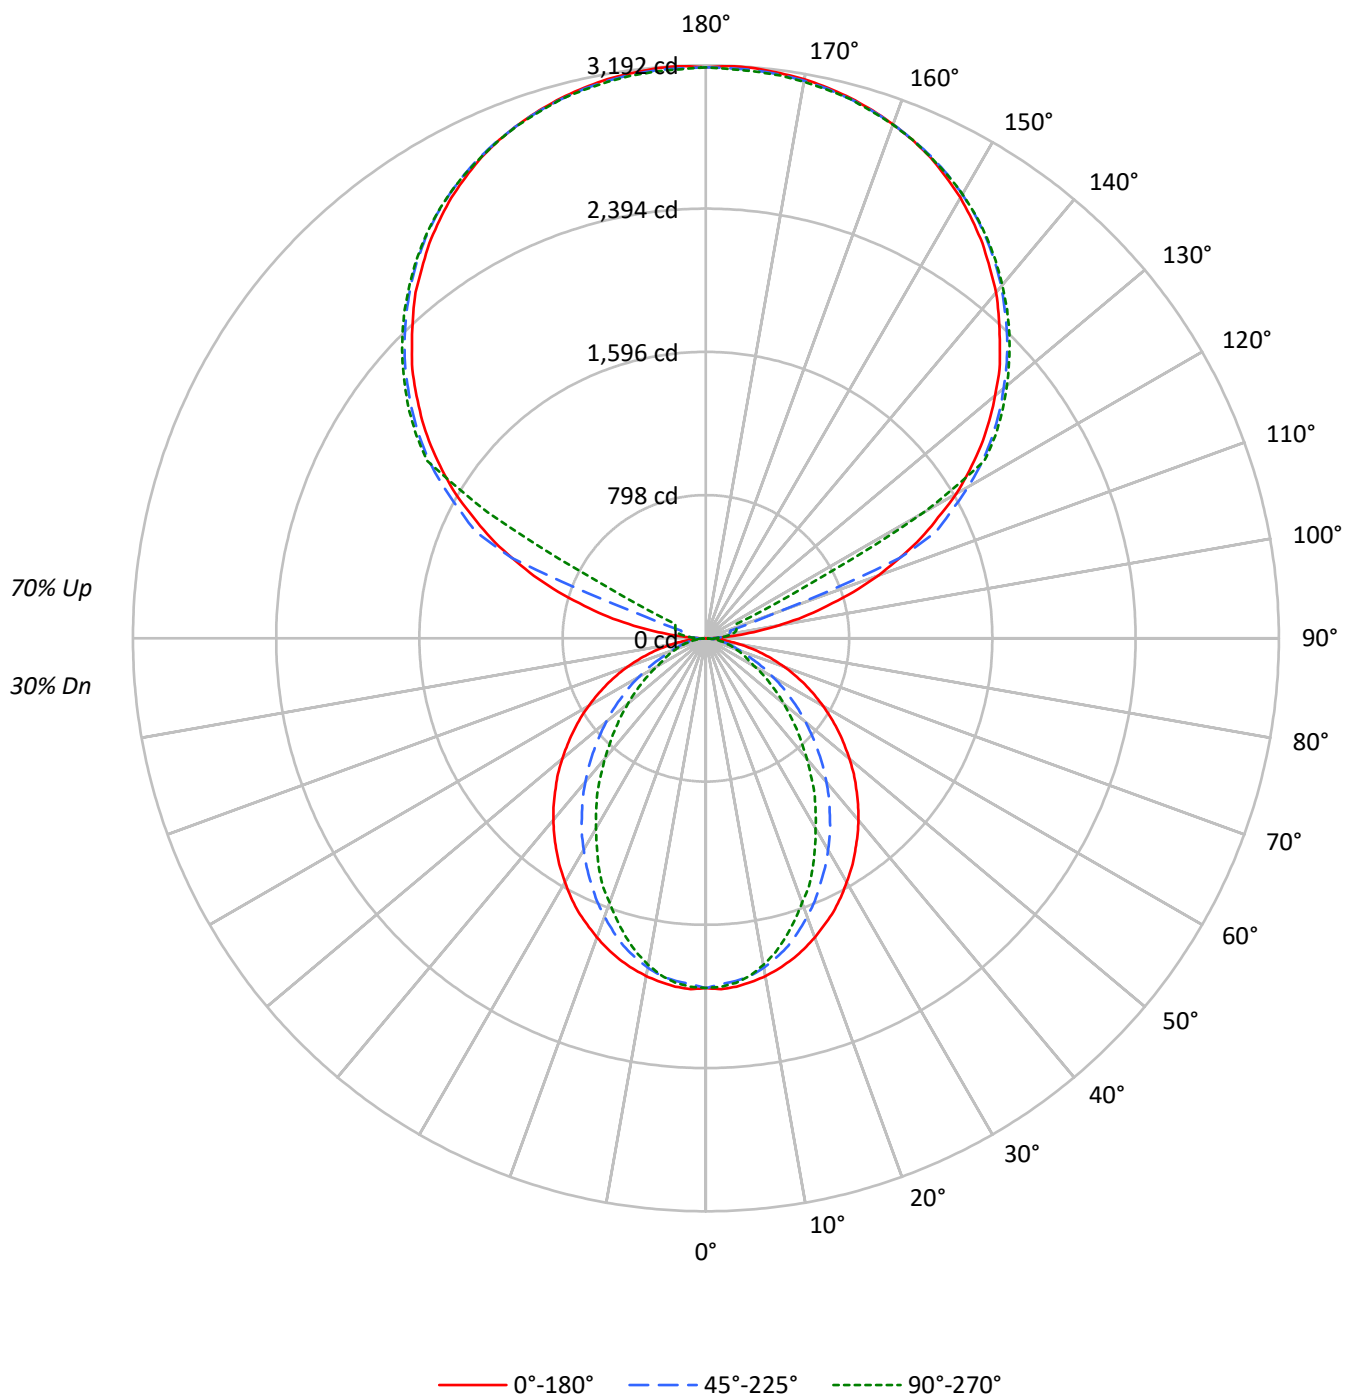

TEST NUMBER: P926934

CATALOG NUMBER: DFN2DIP-HX4F0-050D100US830-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	102	102	102	102	92	92	92	92	72	72	72	54	54	54	38	38	38
1	94	90	86	83	84	81	77	75	64	62	60	48	47	46	34	33	32
2	85	78	73	68	76	71	66	62	56	53	50	43	40	39	30	29	28
3	78	69	62	57	70	62	57	52	50	46	42	38	35	33	27	25	24
4	71	61	54	48	64	55	49	44	44	40	36	34	31	28	24	22	21
5	66	55	47	41	59	49	43	38	40	35	31	30	27	25	22	20	18
6	60	49	41	36	54	44	38	33	36	31	27	28	24	22	20	18	16
7	56	44	37	31	50	40	34	29	32	28	24	25	22	19	18	16	15
8	52	40	33	28	46	36	30	25	29	25	21	23	20	17	17	15	13
9	48	37	29	25	43	33	27	23	27	22	19	21	18	15	16	13	12
10	45	33	27	22	40	30	24	20	25	20	17	20	16	14	14	12	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1448	1448	1448
5°	1451	1425	1434
10°	1436	1398	1388
15°	1417	1352	1316
20°	1391	1288	1227
25°	1364	1217	1142
30°	1328	1144	1033
35°	1293	1065	938
40°	1257	984	829
45°	1216	893	730
50°	1173	802	633
55°	1128	705	540
60°	1076	603	445
65°	1017	500	401
70°	944	403	363
75°	854	356	330
80°	722	299	286
85°	505	200	216

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1632 cd/sqm

TEST NUMBER: P926934

CATALOG NUMBER: DFN2DIP-HX4F0-050D100US830-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	182.5	1.4
10°-20°	501.1	3.8
20°-30°	703.5	5.3
30°-40°	766.9	5.8
40°-50°	704.9	5.3
50°-60°	553.6	4.2
60°-70°	360.3	2.7
70°-80°	185.5	1.4
80°-90°	52.9	0.4
90°-100°	104.9	0.8
100°-110°	391.0	2.9
110°-120°	1037.0	7.8
120°-130°	1719.9	12.9
130°-140°	1827.0	13.7
140°-150°	1697.9	12.7
150°-160°	1365.1	10.2
160°-170°	879.6	6.6
170°-180°	302.8	2.3
0°-30°	1387.2	10.4
0°-40°	2154.1	16.2
0°-60°	3412.5	25.6
0°-90°	4011.3	30.1
90°-120°	1532.9	11.5
90°-150°	6777.7	50.8
90°-180°	9325.0	69.9
0°-180°	13336.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1948	1948	1948	1948	1948	
5°	1948	1939	1916	1932	1927	185
15°	1852	1833	1773	1740	1722	522
25°	1682	1625	1509	1437	1410	773
35°	1449	1359	1204	1093	1054	907
45°	1184	1066	881	756	714	915
55°	901	763	573	467	434	805
65°	608	465	307	247	242	603
75°	324	201	141	129	127	343
85°	76	39	34	34	34	87
90°	2	28	46	58	62	12
95°	150	74	90	101	99	177
105°	700	769	140	166	175	748
115°	1323	1362	1420	354	189	1303
125°	1871	1901	1945	1961	1968	1669
135°	2316	2352	2373	2396	2392	1789
145°	2686	2684	2723	2739	2727	1680
155°	2958	2937	2965	2978	2960	1363
165°	3116	3103	3110	3126	3110	880
175°	3188	3172	3176	3192	3169	303
180°	3181	3181	3181	3181	3181	

TEST NUMBER: P926934

CATALOG NUMBER: DFN2DIP-HX4F0-050D100US830-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1947.7	1947.7	1947.7	1947.7	1947.7
2.5°	1956.4	1947.7	1928.3	1946.0	1942.4
5°	1947.7	1938.9	1915.9	1931.7	1926.6
7.5°	1931.7	1921.3	1896.6	1903.6	1894.7
10°	1910.6	1898.3	1863.1	1857.8	1847.2
12.5°	1884.2	1868.4	1820.7	1810.3	1790.8
15°	1852.5	1833.1	1773.2	1739.8	1722.1
17.5°	1815.4	1787.3	1713.2	1674.4	1646.2
20°	1773.2	1737.9	1649.8	1605.8	1566.9
22.5°	1727.4	1686.8	1584.5	1524.7	1498.3
25°	1681.5	1625.1	1508.8	1436.6	1410.0
27.5°	1626.9	1566.9	1438.3	1355.4	1314.9
30°	1568.8	1501.7	1360.7	1270.9	1223.2
32.5°	1512.3	1431.2	1286.8	1181.0	1136.8
35°	1448.9	1359.0	1203.9	1092.8	1054.0
37.5°	1387.2	1290.2	1126.4	1004.6	960.7
40°	1322.0	1216.3	1045.1	920.1	874.3
42.5°	1255.0	1142.2	964.2	833.6	789.7
45°	1184.5	1066.3	881.3	756.1	713.8
47.5°	1117.5	992.5	802.1	676.8	638.1
50°	1043.5	918.4	724.5	602.7	565.9
52.5°	971.2	838.9	650.4	534.1	500.7
55°	900.7	763.1	572.8	467.1	433.6
57.5°	828.5	687.5	504.1	405.5	377.2
60°	754.4	613.4	431.8	342.0	313.8
62.5°	682.2	541.2	370.1	285.6	271.5
65°	608.1	465.3	306.7	246.8	241.5
67.5°	537.6	394.8	246.8	216.8	211.5
70°	463.6	326.1	204.4	186.8	179.7
72.5°	393.1	262.6	171.0	156.9	153.3
75°	324.3	200.8	141.0	128.7	127.0
77.5°	255.6	142.7	111.1	104.0	100.4
80°	192.1	102.3	84.5	77.6	77.6
82.5°	133.9	68.8	58.2	54.6	54.6
85°	75.8	38.7	33.5	33.5	33.5
87.5°	28.3	14.0	14.0	12.3	12.3
90°	2.2	27.6	45.9	57.7	62.0
92.5°	57.7	48.4	55.2	59.8	62.0
95°	149.5	73.5	89.6	101.4	99.0
97.5°	269.2	80.6	117.2	124.3	126.6
100°	407.5	92.1	131.2	149.5	154.2
102.5°	559.2	554.8	135.8	161.0	168.0
105°	699.7	768.8	140.5	165.6	174.9
107.5°	863.1	920.5	145.1	170.3	179.5
110°	1019.7	1067.9	402.8	172.8	181.7



TEST NUMBER: P926934

CATALOG NUMBER: DFN2DIP-HX4F0-050D100US830-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1167.0	1208.3	1169.3	177.1	184.3
115°	1323.4	1362.5	1420.2	354.5	188.9
117.5°	1459.2	1505.2	1544.5	1215.2	612.2
120°	1611.2	1645.6	1687.2	1714.8	1404.0
122.5°	1739.9	1776.8	1823.0	1836.6	1839.1
125°	1871.1	1901.2	1944.9	1961.1	1967.8
127.5°	1990.8	2023.1	2057.8	2080.8	2082.9
130°	2103.7	2140.6	2165.8	2191.1	2189.0
132.5°	2218.7	2248.8	2274.0	2294.7	2292.5
135°	2315.5	2352.4	2372.9	2396.1	2391.5
137.5°	2416.7	2444.3	2467.5	2490.5	2483.6
140°	2515.5	2534.2	2559.3	2580.1	2568.6
142.5°	2598.7	2614.8	2644.6	2662.8	2651.4
145°	2686.1	2683.7	2722.8	2738.9	2727.4
147.5°	2761.8	2755.0	2794.0	2805.5	2796.6
150°	2835.6	2819.5	2856.4	2870.1	2858.6
152.5°	2897.6	2879.3	2913.8	2927.7	2911.6
155°	2957.6	2937.0	2964.6	2978.3	2960.0
157.5°	3005.9	2987.6	3008.4	3024.5	3005.9
160°	3047.5	3033.5	3047.5	3061.1	3045.0
162.5°	3084.0	3070.4	3081.9	3098.0	3077.3
165°	3116.3	3102.6	3109.5	3125.6	3109.5
167.5°	3141.7	3127.8	3134.9	3151.1	3130.2
170°	3162.5	3148.6	3153.2	3169.3	3148.6
172.5°	3176.1	3162.5	3167.2	3183.3	3162.5
175°	3187.6	3171.5	3176.1	3192.3	3169.3
177.5°	3192.3	3176.1	3178.7	3194.8	3174.0
180°	3180.8	3180.8	3180.8	3180.8	3180.8

TEST NUMBER: P926934

CATALOG NUMBER: DFN2DIP-HX4F0-050D100US830-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.21	6.90	7.33	8.01	9.54	2.19	2.88	3.30	3.98	5.52
	3H	7.88	8.50	9.01	9.61	11.16	3.37	3.98	4.49	5.10	6.65
	4H	8.48	9.07	9.62	10.19	11.74	3.81	4.40	4.95	5.51	7.07
	6H	8.90	9.44	10.04	10.56	12.12	4.13	4.67	5.27	5.78	7.35
	8H	9.02	9.53	10.17	10.67	12.23	4.21	4.73	5.36	5.86	7.42
	12H	9.08	9.57	10.23	10.69	12.27	4.25	4.74	5.40	5.87	7.45
4H	2H	6.22	6.80	7.36	7.92	9.47	2.77	3.35	3.91	4.47	6.02
	3H	8.03	8.52	9.18	9.66	11.23	4.10	4.59	5.25	5.73	7.30
	4H	8.72	9.17	9.87	10.30	11.88	4.65	5.10	5.80	6.23	7.81
	6H	9.23	9.61	10.38	10.77	12.34	5.06	5.45	6.22	6.60	8.18
	8H	9.40	9.76	10.56	10.90	12.50	5.19	5.55	6.34	6.69	8.29
	12H	9.49	9.81	10.66	10.97	12.57	5.25	5.57	6.42	6.73	8.33
8H	4H	8.68	9.04	9.83	10.18	11.77	4.92	5.28	6.07	6.42	8.02
	6H	9.24	9.53	10.41	10.72	12.31	5.43	5.73	6.61	6.92	8.51
	8H	9.46	9.71	10.64	10.88	12.49	5.63	5.88	6.81	7.05	8.66
	12H	9.59	9.82	10.77	10.98	12.62	5.74	5.97	6.92	7.13	8.77
12H	4H	8.62	8.95	9.79	10.10	11.70	4.92	5.24	6.09	6.40	8.00
	6H	9.21	9.47	10.39	10.64	12.25	5.48	5.74	6.66	6.91	8.52
	8H	9.43	9.66	10.61	10.82	12.46	5.69	5.92	6.87	7.08	8.72

END OF REPORT