

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P926939

Luminaire Tested: DFN2DIP-HX4F0-050D120US830-FLLFLL

Issue Date: 12/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P926939
REPORT IS A COMBINATION OF REPORTS P899445 AND P896187
Test Lab: INNOVATION CENTER
Issue Date: 12/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-050D120US830-FLLFLL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14674.7 lumens
Efficiency: N/A
Efficacy: 105.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 139.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P926939

CATALOG NUMBER: DFN2DIP-HX4F0-050D120US830-FLLFLL

Luminous Intensity Polar Plot

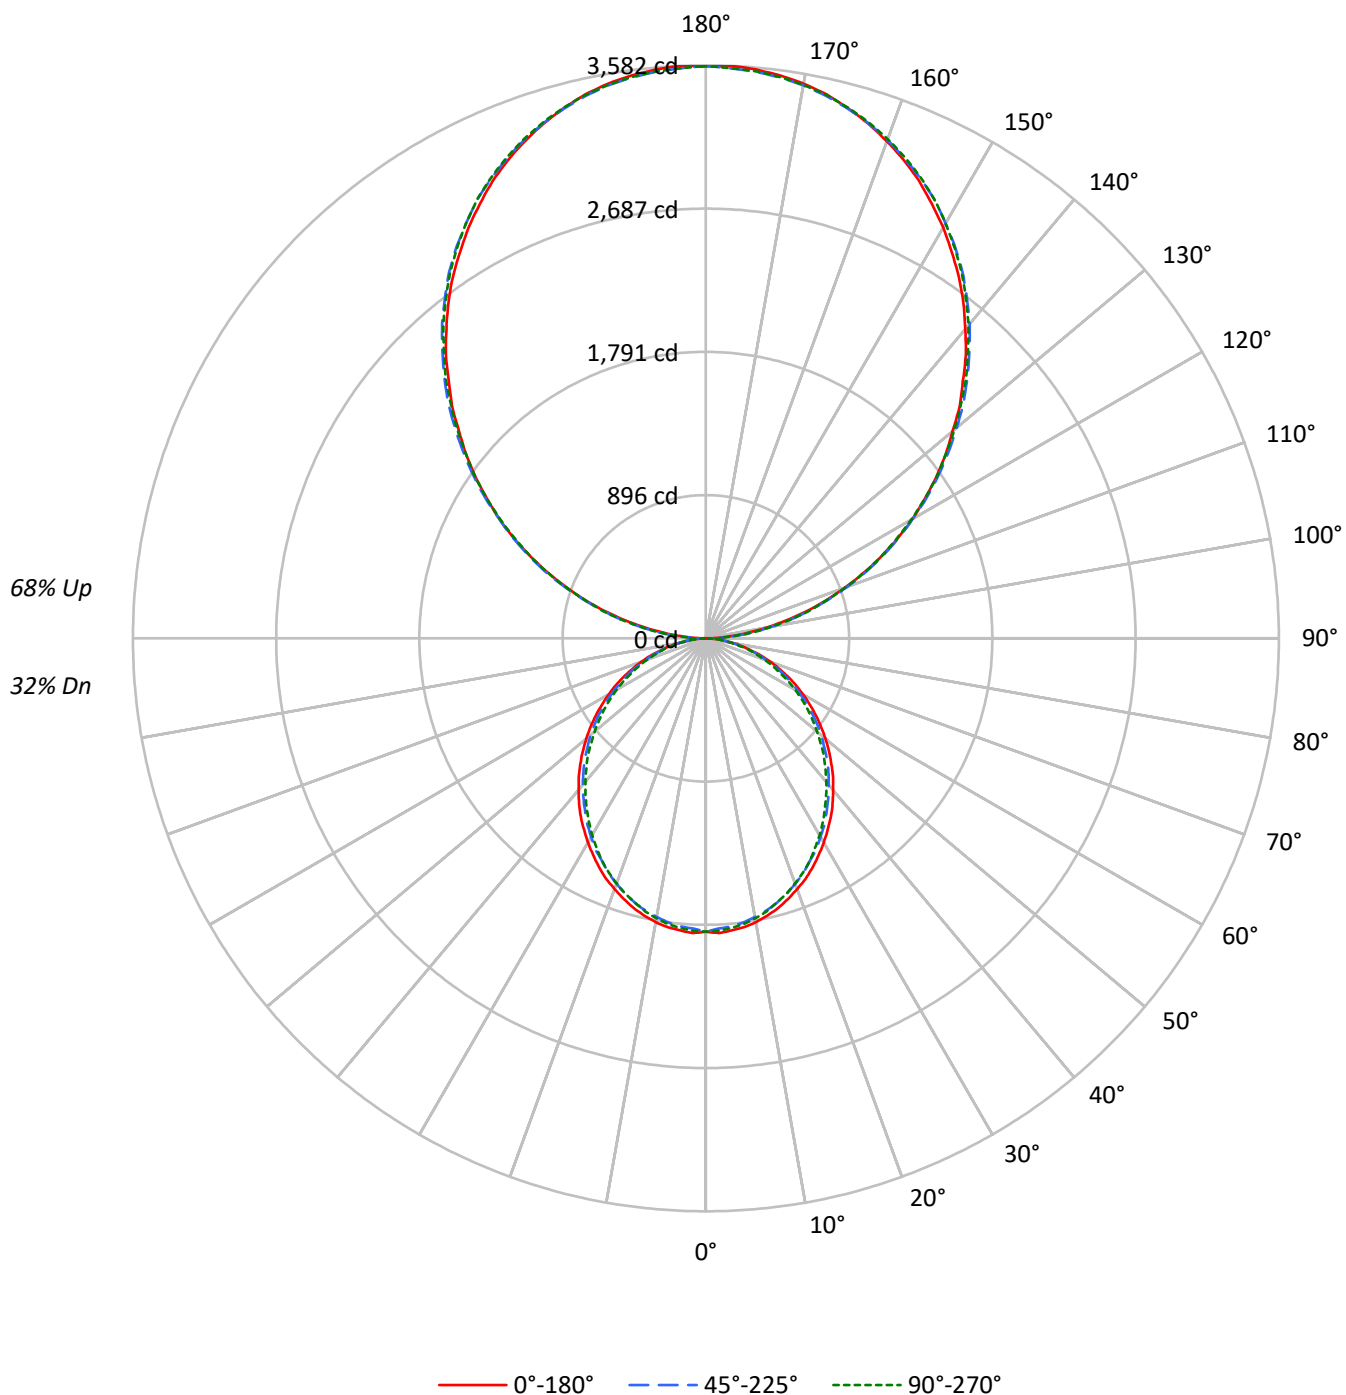

TEST NUMBER: P926939

CATALOG NUMBER: DFN2DIP-HX4F0-050D120US830-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	93	93	93	93	73	73	73	56	56	56	39	39	39
1	94	89	86	82	84	81	77	75	64	62	60	49	47	46	35	34	33
2	85	78	72	67	76	70	65	61	56	53	50	43	41	39	31	29	28
3	78	69	62	56	70	62	56	51	49	45	42	38	35	33	27	25	24
4	71	61	53	47	64	55	48	43	44	39	35	34	30	28	24	22	20
5	65	54	46	40	58	49	42	37	39	34	30	30	27	24	22	20	18
6	60	48	40	35	54	44	37	32	35	30	26	27	24	21	20	17	16
7	55	43	36	30	50	39	33	28	32	27	23	25	21	19	18	16	14
8	51	39	32	27	46	36	29	25	29	24	20	23	19	16	17	14	12
9	48	36	29	24	43	33	26	22	26	22	18	21	17	15	15	13	11
10	44	33	26	21	40	30	24	19	24	20	16	19	16	13	14	12	10

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1363	1363	1363
5°	1366	1345	1354
10°	1355	1327	1335
15°	1335	1305	1307
20°	1308	1275	1278
25°	1282	1238	1244
30°	1248	1205	1201
35°	1216	1165	1155
40°	1177	1125	1112
45°	1138	1085	1067
50°	1096	1043	1016
55°	1051	994	969
60°	1001	936	915
65°	946	876	851
70°	877	803	783
75°	780	716	720
80°	663	604	599
85°	481	412	398

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2696 cd/sqm

TEST NUMBER: P926939

CATALOG NUMBER: DFN2DIP-HX4F0-050D120US830-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	172.6	1.2
10°-20°	485.6	3.3
20°-30°	713.6	4.9
30°-40°	828.8	5.6
40°-50°	827.8	5.6
50°-60°	721.8	4.9
60°-70°	533.6	3.6
70°-80°	301.9	2.1
80°-90°	89.8	0.6
90°-100°	221.3	1.5
100°-110°	703.3	4.8
110°-120°	1203.5	8.2
120°-130°	1582.8	10.8
130°-140°	1776.6	12.1
140°-150°	1742.2	11.9
150°-160°	1461.5	10.0
160°-170°	969.2	6.6
170°-180°	338.8	2.3
0°-30°	1371.8	9.3
0°-40°	2200.6	15.0
0°-60°	3750.2	25.6
0°-90°	4675.5	31.9
90°-120°	2128.1	14.5
90°-150°	7229.8	49.3
90°-180°	9999.0	68.1
0°-180°	14674.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1834	1834	1834	1834	1834	
5°	1834	1827	1807	1821	1818	174
15°	1746	1735	1712	1719	1710	492
25°	1580	1566	1536	1539	1536	727
35°	1363	1345	1317	1306	1298	851
45°	1109	1097	1070	1051	1044	856
55°	839	829	808	786	778	750
65°	566	555	538	522	513	560
75°	296	293	284	273	277	316
85°	72	70	69	63	62	81
90°	3	39	106	99	102	14
95°	157	188	193	193	188	175
105°	649	658	664	670	670	685
115°	1208	1225	1220	1216	1208	1195
125°	1757	1784	1775	1765	1762	1570
135°	2272	2306	2312	2309	2300	1756
145°	2758	2780	2797	2800	2789	1724
155°	3154	3163	3172	3188	3178	1452
165°	3431	3428	3428	3450	3435	968
175°	3570	3562	3555	3577	3559	339
180°	3577	3577	3577	3577	3577	

TEST NUMBER: P926939

CATALOG NUMBER: DFN2DIP-HX4F0-050D120US830-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1833.6	1833.6	1833.6	1833.6	1833.6
2.5°	1844.3	1835.5	1816.1	1833.6	1830.3
5°	1833.6	1826.8	1807.2	1821.3	1818.0
7.5°	1821.3	1810.8	1791.4	1805.6	1802.1
10°	1802.1	1789.7	1768.6	1782.6	1777.4
12.5°	1775.5	1765.0	1743.9	1752.7	1749.1
15°	1745.5	1735.0	1712.1	1719.2	1710.4
17.5°	1708.5	1698.0	1675.0	1683.8	1675.0
20°	1667.9	1657.5	1632.8	1638.0	1631.1
22.5°	1627.5	1611.6	1588.6	1588.6	1585.0
25°	1579.8	1565.8	1535.8	1539.2	1535.8
27.5°	1526.8	1514.5	1491.7	1486.4	1477.7
30°	1474.1	1459.9	1433.5	1428.3	1421.2
32.5°	1417.6	1407.2	1378.9	1368.2	1361.2
35°	1362.9	1345.4	1317.1	1306.5	1297.7
37.5°	1301.2	1285.4	1257.1	1244.8	1236.0
40°	1237.9	1223.6	1195.4	1179.6	1172.6
42.5°	1176.1	1161.9	1133.8	1116.0	1105.6
45°	1109.1	1096.8	1070.2	1051.0	1043.8
47.5°	1043.8	1031.5	1003.3	983.8	973.3
50°	975.0	966.3	941.6	916.9	908.0
52.5°	908.0	895.7	872.8	853.4	841.1
55°	839.4	828.7	807.5	786.4	777.7
57.5°	770.5	761.7	738.7	717.6	710.5
60°	701.7	694.8	670.1	650.6	645.4
62.5°	634.8	622.4	604.8	587.2	580.1
65°	566.1	555.4	537.8	522.0	513.1
67.5°	495.6	486.6	470.9	458.5	451.4
70°	430.3	423.2	407.3	394.9	388.0
72.5°	363.3	356.2	347.4	335.1	329.8
75°	296.1	292.7	283.8	273.3	276.9
77.5°	236.3	229.1	225.6	220.4	215.2
80°	176.4	174.6	171.0	165.8	162.2
82.5°	119.9	119.9	118.2	111.1	111.1
85°	72.2	70.5	68.8	63.4	61.7
87.5°	31.8	28.3	24.7	19.4	17.6
90°	3.2	38.8	105.7	99.2	102.4
92.5°	66.8	90.6	93.8	97.1	97.1
95°	157.4	187.7	193.0	193.0	187.7
97.5°	262.0	290.1	302.0	302.0	302.0
100°	382.8	407.6	416.2	416.2	413.0
102.5°	510.1	528.4	540.2	543.5	540.2
105°	649.2	657.8	664.3	669.6	669.6
107.5°	787.2	800.2	800.2	802.3	787.2
110°	920.9	938.2	938.2	938.2	929.6

TEST NUMBER: P926939

CATALOG NUMBER: DFN2DIP-HX4F0-050D120US830-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1065.4	1083.8	1080.5	1071.9	1065.4
115°	1207.7	1225.1	1219.6	1216.4	1207.7
117.5°	1349.0	1372.8	1357.7	1349.0	1340.4
120°	1491.4	1515.1	1491.4	1491.4	1481.7
122.5°	1620.8	1651.0	1635.9	1627.2	1620.8
125°	1756.6	1783.6	1775.0	1765.3	1762.0
127.5°	1889.3	1922.7	1910.8	1897.9	1889.3
130°	2013.3	2052.1	2046.7	2040.2	2028.4
132.5°	2152.4	2182.6	2184.7	2169.6	2161.1
135°	2272.1	2305.5	2312.0	2308.7	2300.2
137.5°	2405.8	2432.8	2438.2	2436.0	2423.1
140°	2523.4	2550.3	2565.4	2565.4	2553.5
142.5°	2644.2	2671.1	2679.7	2682.9	2671.1
145°	2758.4	2780.0	2797.2	2800.5	2788.7
147.5°	2860.9	2887.8	2900.8	2906.2	2894.3
150°	2966.6	2984.9	2996.8	3006.5	2996.8
152.5°	3060.4	3078.7	3093.9	3105.7	3093.9
155°	3154.2	3162.8	3172.5	3187.6	3177.9
157.5°	3235.1	3241.5	3246.9	3268.5	3253.4
160°	3307.3	3313.8	3317.0	3335.4	3322.4
162.5°	3374.2	3374.2	3377.4	3397.9	3382.8
165°	3431.4	3428.2	3428.2	3449.6	3434.6
167.5°	3483.1	3473.4	3473.4	3495.0	3479.9
170°	3521.9	3513.3	3510.1	3531.6	3513.3
172.5°	3548.9	3540.2	3537.0	3558.6	3540.2
175°	3570.5	3561.8	3555.4	3576.9	3558.6
177.5°	3582.3	3573.7	3567.2	3585.6	3567.2
180°	3576.9	3576.9	3576.9	3576.9	3576.9

TEST NUMBER: P926939

CATALOG NUMBER: DFN2DIP-HX4F0-050D120US830-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.38	7.10	7.48	8.20	9.70	5.95	6.67	7.05	7.76	9.27
	3H	8.03	8.68	9.14	9.78	11.31	7.56	8.20	8.67	9.31	10.83
	4H	8.61	9.22	9.73	10.33	11.86	8.14	8.75	9.26	9.86	11.39
	6H	9.01	9.57	10.13	10.68	12.22	8.53	9.09	9.66	10.20	11.74
	8H	9.11	9.64	10.24	10.77	12.30	8.63	9.17	9.76	10.29	11.83
	12H	9.15	9.66	10.28	10.78	12.34	8.67	9.18	9.80	10.30	11.85
4H	2H	6.83	7.44	7.95	8.54	10.07	6.48	7.09	7.61	8.20	9.73
	3H	8.68	9.19	9.81	10.32	11.87	8.29	8.80	9.42	9.93	11.47
	4H	9.39	9.86	10.52	10.98	12.54	8.98	9.45	10.12	10.57	12.14
	6H	9.90	10.30	11.04	11.44	13.00	9.49	9.89	10.63	11.03	12.59
	8H	10.04	10.42	11.18	11.55	13.13	9.63	10.01	10.77	11.14	12.71
	12H	10.11	10.45	11.27	11.60	13.17	9.69	10.03	10.85	11.18	12.75
8H	4H	9.57	9.95	10.71	11.09	12.66	9.21	9.59	10.35	10.72	12.30
	6H	10.20	10.51	11.36	11.69	13.26	9.84	10.15	11.00	11.33	12.89
	8H	10.42	10.69	11.59	11.85	13.44	10.05	10.32	11.22	11.48	13.07
	12H	10.55	10.78	11.72	11.94	13.56	10.16	10.40	11.33	11.55	13.18
12H	4H	9.55	9.89	10.71	11.04	12.62	9.20	9.54	10.36	10.69	12.27
	6H	10.23	10.50	11.40	11.66	13.25	9.88	10.15	11.05	11.31	12.89
	8H	10.47	10.70	11.64	11.86	13.48	10.11	10.35	11.28	11.50	13.12

END OF REPORT