

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P926960

Luminaire Tested: DFN2DIP-HX4F0-060D080US830-FLLONL

Issue Date: 12/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P926960
REPORT IS A COMBINATION OF REPORTS P900895 AND P896187
Test Lab: INNOVATION CENTER
Issue Date: 12/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-060D080US830-FLLONL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13063.1 lumens
Efficiency: N/A
Efficacy: 116.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 112.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.099
Total Harmonic Distortion (THDi): 0.979
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P926960

CATALOG NUMBER: DFN2DIP-HX4F0-060D080US830-FLLONL

Luminous Intensity Polar Plot

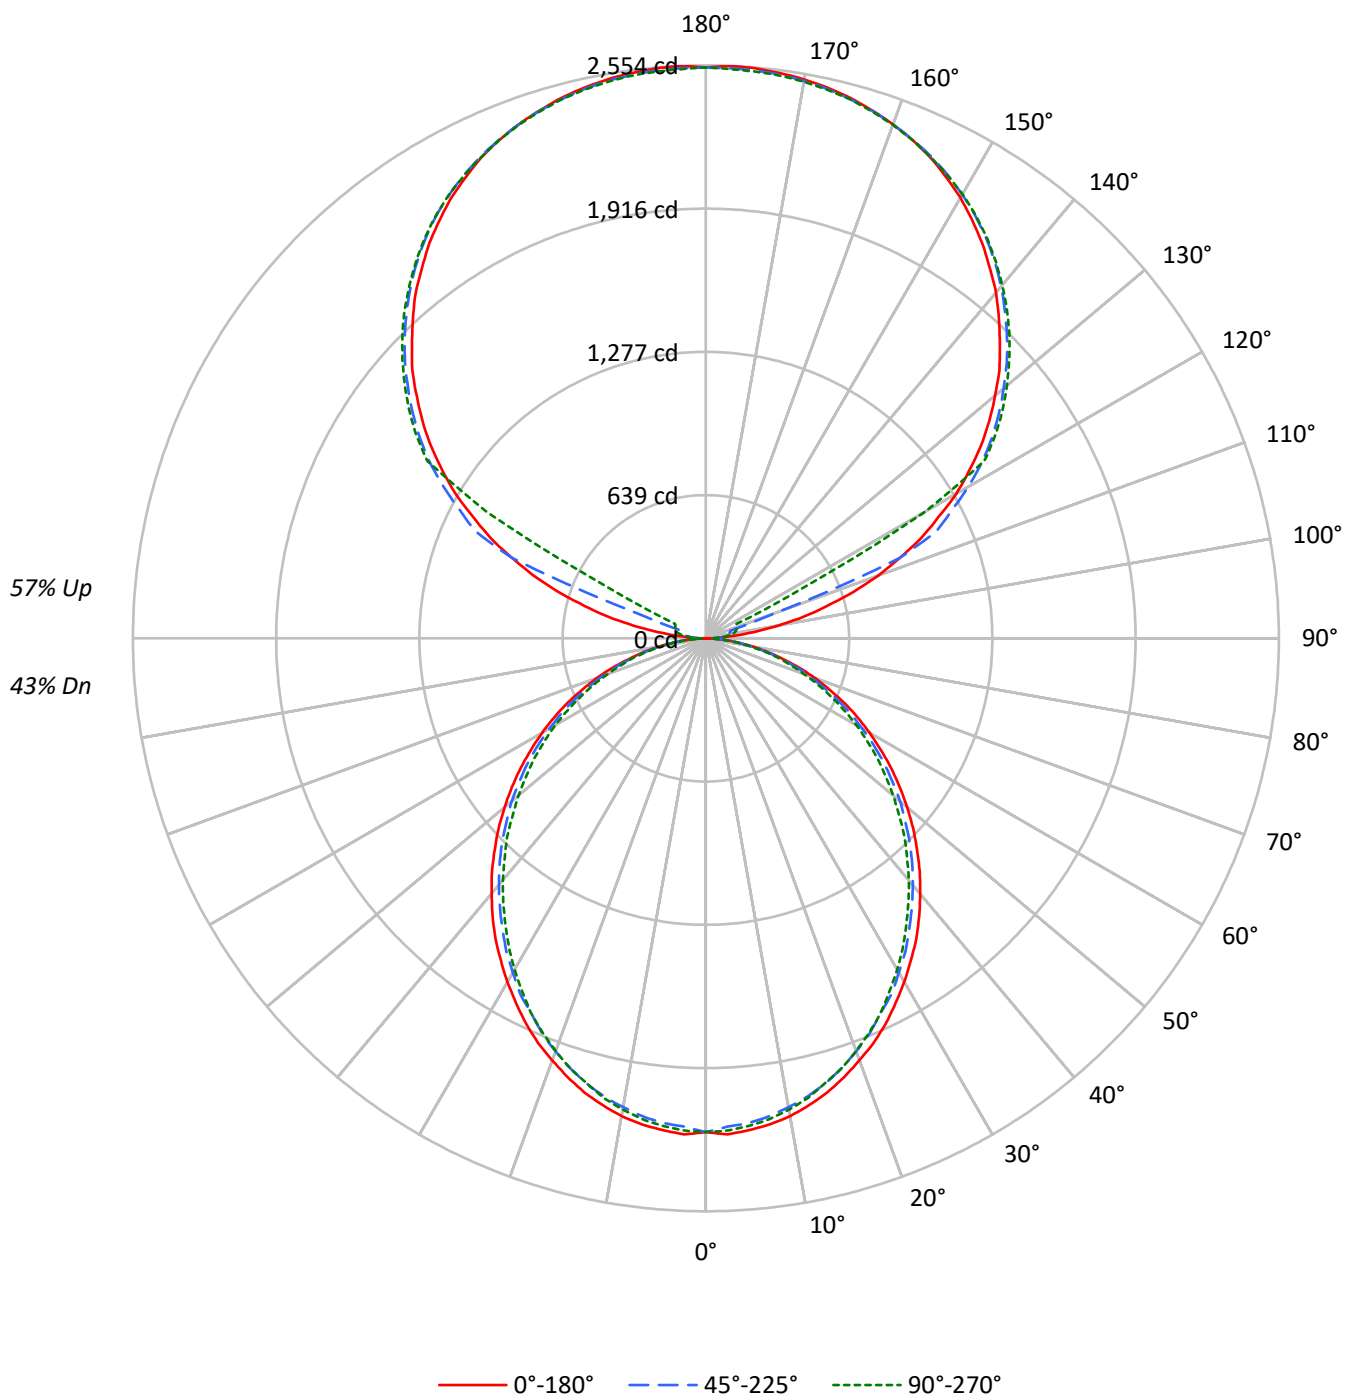

TEST NUMBER: P926960

CATALOG NUMBER: DFN2DIP-HX4F0-060D080US830-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	64	64	64	50	50	50
1	96	92	88	85	88	84	81	78	70	67	65	56	55	53	44	43	42
2	88	80	74	69	80	74	68	64	61	57	54	49	47	44	39	37	35
3	80	71	63	58	73	65	58	53	54	49	45	44	40	38	34	32	30
4	73	62	55	49	66	57	50	45	48	43	39	39	35	32	31	28	26
5	67	56	48	42	61	51	44	39	43	37	33	35	31	28	28	25	23
6	62	50	42	36	56	46	39	34	38	33	29	31	27	24	25	22	20
7	57	45	37	32	52	41	34	29	35	29	25	29	25	22	23	20	18
8	53	41	33	28	48	38	31	26	32	26	23	26	22	19	21	18	16
9	49	37	30	25	45	34	28	23	29	24	20	24	20	17	19	16	14
10	46	34	27	22	42	31	25	21	27	22	18	22	18	16	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1636	1636	1636
5°	1639	1613	1624
10°	1626	1592	1602
15°	1602	1566	1568
20°	1570	1530	1533
25°	1538	1486	1492
30°	1498	1446	1441
35°	1460	1398	1386
40°	1413	1350	1334
45°	1366	1302	1281
50°	1315	1251	1219
55°	1262	1193	1163
60°	1201	1123	1098
65°	1136	1051	1021
70°	1052	964	939
75°	935	859	863
80°	796	725	718
85°	577	494	478

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1366 cd/sqm

TEST NUMBER: P926960

CATALOG NUMBER: DFN2DIP-HX4F0-060D080US830-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	207.1	1.6
10°-20°	582.7	4.5
20°-30°	856.3	6.6
30°-40°	994.6	7.6
40°-50°	993.4	7.6
50°-60°	866.2	6.6
60°-70°	640.3	4.9
70°-80°	362.3	2.8
80°-90°	100.1	0.8
90°-100°	83.9	0.6
100°-110°	312.8	2.4
110°-120°	829.6	6.4
120°-130°	1375.9	10.5
130°-140°	1461.6	11.2
140°-150°	1358.3	10.4
150°-160°	1092.1	8.4
160°-170°	703.7	5.4
170°-180°	242.2	1.9
0°-30°	1646.2	12.6
0°-40°	2640.7	20.2
0°-60°	4500.3	34.5
0°-90°	5602.9	42.9
90°-120°	1226.3	9.4
90°-150°	5422.1	41.5
90°-180°	7460.0	57.1
0°-180°	13063.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2200	2200	2200	2200	2200	
5°	2200	2192	2169	2186	2182	209
15°	2095	2082	2054	2063	2052	590
25°	1896	1879	1843	1847	1843	872
35°	1636	1614	1581	1568	1557	1021
45°	1331	1316	1284	1261	1253	1027
55°	1007	994	969	944	933	901
65°	679	666	645	626	616	672
75°	355	351	340	328	332	379
85°	87	85	83	76	74	97
90°	2	22	37	46	50	12
95°	120	59	72	81	79	142
105°	560	615	112	132	140	598
115°	1059	1090	1136	284	151	1042
125°	1497	1521	1556	1569	1574	1335
135°	1852	1882	1898	1917	1913	1431
145°	2149	2147	2178	2191	2182	1344
155°	2366	2350	2372	2383	2368	1090
165°	2493	2482	2488	2500	2488	704
175°	2550	2537	2541	2554	2536	243
180°	2545	2545	2545	2545	2545	

TEST NUMBER: P926960

CATALOG NUMBER: DFN2DIP-HX4F0-060D080US830-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2200.4	2200.4	2200.4	2200.4	2200.4
2.5°	2213.2	2202.6	2179.2	2200.4	2196.3
5°	2200.4	2192.1	2168.7	2185.6	2181.5
7.5°	2185.6	2173.0	2149.7	2166.7	2162.5
10°	2162.5	2147.7	2122.2	2139.1	2132.8
12.5°	2130.6	2118.0	2092.6	2103.2	2098.9
15°	2094.6	2082.1	2054.5	2063.0	2052.5
17.5°	2050.2	2037.7	2010.1	2020.5	2010.1
20°	2001.5	1989.0	1959.3	1965.6	1957.3
22.5°	1953.0	1933.9	1906.3	1906.3	1902.1
25°	1895.7	1879.0	1843.0	1847.0	1843.0
27.5°	1832.2	1817.4	1790.0	1783.8	1773.2
30°	1769.0	1751.8	1720.3	1713.9	1705.4
32.5°	1701.1	1688.6	1654.7	1641.8	1633.4
35°	1635.6	1614.5	1580.6	1567.8	1557.2
37.5°	1561.5	1542.4	1508.6	1493.7	1483.1
40°	1485.4	1468.3	1434.5	1415.6	1407.1
42.5°	1411.3	1394.2	1360.6	1339.3	1326.7
45°	1331.0	1316.1	1284.3	1261.2	1252.6
47.5°	1252.6	1237.8	1203.9	1180.6	1167.9
50°	1170.0	1159.5	1129.9	1100.2	1089.6
52.5°	1089.6	1074.8	1047.4	1024.1	1009.3
55°	1007.2	994.4	969.1	943.7	933.2
57.5°	924.7	914.1	886.5	861.2	852.6
60°	842.0	833.7	804.1	780.8	774.5
62.5°	761.6	746.8	725.7	704.6	696.1
65°	679.3	666.5	645.4	626.3	615.7
67.5°	594.6	583.9	565.0	550.2	541.7
70°	516.3	507.8	488.7	473.9	465.6
72.5°	435.9	427.4	416.9	402.1	395.8
75°	355.3	351.4	340.5	328.0	332.2
77.5°	283.5	275.0	270.7	264.5	258.2
80°	211.7	209.4	205.2	198.9	194.6
82.5°	143.9	143.9	141.8	133.4	133.4
85°	86.6	84.6	82.6	76.1	74.1
87.5°	38.2	33.9	29.6	23.4	21.1
90°	1.8	22.1	36.8	46.1	49.7
92.5°	46.1	38.7	44.2	47.9	49.7
95°	119.6	58.8	71.7	81.1	79.2
97.5°	215.4	64.5	93.8	99.5	101.2
100°	326.0	73.7	105.0	119.6	123.3
102.5°	447.4	443.8	108.7	128.7	134.5
105°	559.8	615.1	112.3	132.5	140.0
107.5°	690.5	736.4	116.1	136.2	143.6
110°	815.8	854.3	322.3	138.2	145.4

TEST NUMBER: P926960

CATALOG NUMBER: DFN2DIP-HX4F0-060D080US830-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	933.6	966.6	935.4	141.7	147.4
115°	1058.7	1090.0	1136.1	283.6	151.1
117.5°	1167.4	1204.1	1235.6	972.1	489.8
120°	1289.0	1316.5	1349.8	1371.8	1123.2
122.5°	1391.9	1421.5	1458.4	1469.4	1471.3
125°	1496.9	1520.9	1555.9	1568.8	1574.3
127.5°	1592.6	1618.5	1646.3	1664.5	1666.3
130°	1682.9	1712.4	1732.6	1753.0	1751.2
132.5°	1775.0	1799.0	1819.2	1835.8	1834.0
135°	1852.4	1881.9	1898.3	1917.0	1913.2
137.5°	1933.4	1955.4	1974.0	1992.4	1986.9
140°	2012.4	2027.3	2047.5	2064.1	2054.8
142.5°	2079.0	2091.8	2115.6	2130.3	2121.1
145°	2148.9	2146.9	2178.2	2191.1	2181.9
147.5°	2209.5	2204.0	2235.2	2244.5	2237.2
150°	2268.5	2255.6	2285.1	2296.0	2286.9
152.5°	2318.2	2303.5	2331.0	2342.2	2329.3
155°	2366.1	2349.7	2371.7	2382.6	2368.0
157.5°	2404.7	2390.1	2406.7	2419.6	2404.7
160°	2438.0	2426.8	2438.0	2448.9	2436.0
162.5°	2467.3	2456.3	2465.5	2478.4	2461.8
165°	2493.1	2482.2	2487.6	2500.5	2487.6
167.5°	2513.4	2502.2	2507.9	2520.8	2504.2
170°	2530.0	2518.8	2522.6	2535.5	2518.8
172.5°	2541.0	2530.0	2533.7	2546.6	2530.0
175°	2550.1	2537.2	2541.0	2553.8	2535.5
177.5°	2553.8	2541.0	2542.9	2555.8	2539.2
180°	2544.7	2544.7	2544.7	2544.7	2544.7

TEST NUMBER: P926960

CATALOG NUMBER: DFN2DIP-HX4F0-060D080US830-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.29	9.09	9.30	10.11	11.48	7.86	8.66	8.87	9.68	11.05
	3H	9.95	10.66	10.97	11.70	13.09	9.47	10.19	10.50	11.22	12.61
	4H	10.53	11.21	11.57	12.25	13.64	10.06	10.74	11.10	11.77	13.17
	6H	10.93	11.55	11.98	12.60	14.00	10.45	11.08	11.50	12.12	13.53
	8H	11.03	11.63	12.09	12.68	14.09	10.56	11.15	11.61	12.21	13.61
	12H	11.08	11.64	12.14	12.70	14.12	10.60	11.16	11.66	12.21	13.64
4H	2H	8.74	9.42	9.79	10.46	11.86	8.40	9.08	9.44	10.12	11.51
	3H	10.61	11.17	11.66	12.24	13.65	10.21	10.78	11.27	11.84	13.25
	4H	11.32	11.84	12.38	12.89	14.33	10.91	11.43	11.97	12.49	13.92
	6H	11.83	12.28	12.90	13.36	14.78	11.42	11.87	12.49	12.95	14.37
	8H	11.98	12.40	13.05	13.47	14.91	11.57	11.98	12.64	13.06	14.50
	12H	12.05	12.43	13.14	13.51	14.96	11.63	12.01	12.72	13.09	14.54
8H	4H	11.51	11.93	12.58	13.00	14.44	11.15	11.57	12.22	12.64	14.08
	6H	12.14	12.49	13.23	13.60	15.04	11.78	12.12	12.87	13.24	14.68
	8H	12.36	12.66	13.46	13.76	15.22	11.99	12.30	13.09	13.39	14.85
	12H	12.49	12.76	13.59	13.85	15.35	12.11	12.37	13.21	13.46	14.96
12H	4H	11.49	11.87	12.58	12.96	14.40	11.14	11.52	12.23	12.60	14.05
	6H	12.17	12.47	13.27	13.57	15.03	11.82	12.12	12.92	13.22	14.68
	8H	12.41	12.68	13.51	13.77	15.27	12.05	12.32	13.16	13.41	14.91

END OF REPORT