

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P927058

Luminaire Tested: DFN2DIP-HX4F0-090D050US830-RLLONL

Issue Date: 12/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P927058
REPORT IS A COMBINATION OF REPORTS P900848 AND P896187
Test Lab: INNOVATION CENTER
Issue Date: 12/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-090D050US830-RLLONL
Description: 4 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11875.5 lumens
Efficiency: N/A
Efficacy: 94.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 126.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9821
Total Harmonic Distortion (THDi): 0.08
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P927058

CATALOG NUMBER: DFN2DIP-HX4F0-090D050US830-RLLONL

Luminous Intensity Polar Plot

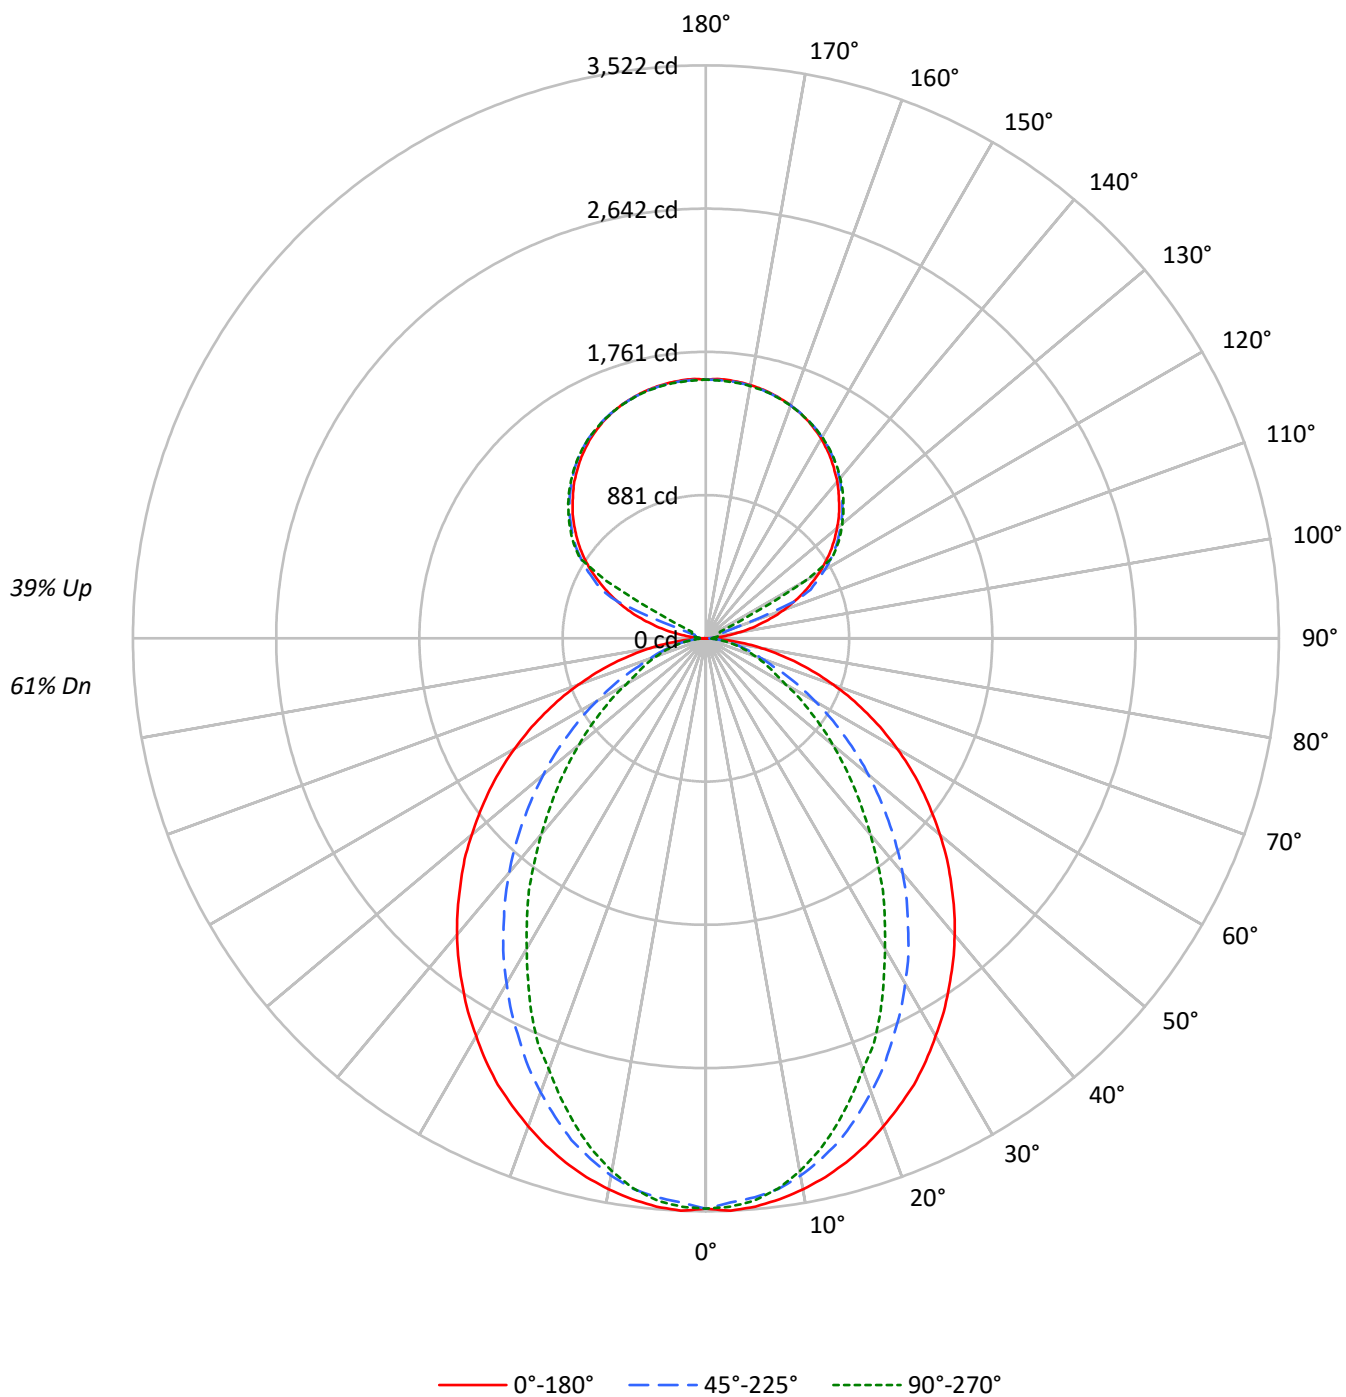

TEST NUMBER: P927058

CATALOG NUMBER: DFN2DIP-HX4F0-090D050US830-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	89	89	89	77	77	77	66	66	66
1	101	97	93	90	94	91	87	84	79	77	75	69	67	65	59	58	57
2	92	85	79	74	86	80	75	70	70	66	63	61	58	56	53	51	49
3	85	75	68	62	79	71	65	59	62	58	53	55	51	48	47	45	42
4	78	67	59	53	73	63	56	51	56	50	46	49	45	41	43	40	37
5	72	60	52	46	67	57	50	44	50	45	40	44	40	36	39	35	33
6	66	54	46	41	62	51	44	39	46	40	35	40	36	32	35	32	29
7	61	49	41	36	57	47	39	34	42	36	32	37	32	29	33	29	26
8	57	45	37	32	53	43	36	31	38	32	28	34	29	26	30	26	23
9	53	41	34	29	50	39	32	28	35	30	26	31	27	23	28	24	21
10	50	38	31	26	47	36	30	25	33	27	23	29	25	21	26	22	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2607	2607	2607
5°	2611	2566	2582
10°	2586	2516	2498
15°	2550	2433	2368
20°	2503	2318	2209
25°	2455	2190	2055
30°	2391	2059	1860
35°	2328	1917	1689
40°	2263	1771	1492
45°	2188	1608	1314
50°	2111	1444	1140
55°	2031	1269	973
60°	1937	1086	801
65°	1830	899	721
70°	1700	726	653
75°	1537	640	594
80°	1300	538	516
85°	909	360	388

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2188 cd/sqm

TEST NUMBER: P927058

CATALOG NUMBER: DFN2DIP-HX4F0-090D050US830-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	328.6	2.8
10°-20°	902.0	7.6
20°-30°	1266.4	10.7
30°-40°	1380.4	11.6
40°-50°	1268.7	10.7
50°-60°	996.4	8.4
60°-70°	648.6	5.5
70°-80°	333.9	2.8
80°-90°	88.0	0.7
90°-100°	52.5	0.4
100°-110°	195.5	1.6
110°-120°	518.5	4.4
120°-130°	860.0	7.2
130°-140°	913.5	7.7
140°-150°	849.0	7.1
150°-160°	682.6	5.7
160°-170°	439.8	3.7
170°-180°	151.4	1.3
0°-30°	2496.9	21.0
0°-40°	3877.3	32.6
0°-60°	6142.5	51.7
0°-90°	7212.9	60.7
90°-120°	766.4	6.5
90°-150°	3388.8	28.5
90°-180°	4663.0	39.3
0°-180°	11875.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3506	3506	3506	3506	3506	
5°	3506	3490	3449	3477	3468	332
15°	3334	3300	3192	3132	3100	940
25°	3027	2925	2716	2586	2538	1392
35°	2608	2446	2167	1967	1897	1632
45°	2132	1919	1586	1361	1285	1647
55°	1621	1374	1031	841	781	1449
65°	1095	838	552	444	435	1085
75°	584	362	254	232	229	617
85°	136	70	60	60	60	156
90°	1	14	23	29	31	11
95°	75	37	45	51	50	89
105°	350	384	70	83	88	374
115°	662	681	710	177	94	651
125°	936	951	972	980	984	834
135°	1158	1176	1186	1198	1196	894
145°	1343	1342	1361	1370	1364	840
155°	1479	1468	1482	1489	1480	681
165°	1558	1551	1555	1563	1555	440
175°	1594	1586	1588	1596	1585	152
180°	1590	1590	1590	1590	1590	

TEST NUMBER: P927058

CATALOG NUMBER: DFN2DIP-HX4F0-090D050US830-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3505.8	3505.8	3505.8	3505.8	3505.8
2.5°	3521.7	3505.8	3470.8	3502.8	3496.4
5°	3505.8	3490.0	3448.6	3477.2	3467.7
7.5°	3477.2	3458.3	3413.9	3426.4	3410.5
10°	3439.2	3416.9	3353.7	3343.9	3325.0
12.5°	3391.7	3363.1	3277.3	3258.4	3223.4
15°	3334.5	3299.5	3191.8	3131.5	3099.9
17.5°	3267.8	3217.0	3083.7	3014.0	2963.2
20°	3191.8	3128.2	2969.5	2890.5	2820.4
22.5°	3109.3	3036.3	2852.1	2744.4	2697.0
25°	3026.8	2925.1	2715.8	2585.8	2538.1
27.5°	2928.5	2820.4	2588.9	2439.8	2366.7
30°	2823.8	2703.0	2449.2	2287.6	2201.8
32.5°	2722.1	2576.0	2316.2	2125.7	2046.3
35°	2608.1	2446.2	2167.1	1967.2	1897.2
37.5°	2497.0	2322.3	2027.4	1808.3	1729.2
40°	2379.5	2189.3	1881.3	1656.2	1573.7
42.5°	2259.0	2056.1	1735.5	1500.6	1421.5
45°	2132.1	1919.4	1586.4	1360.9	1284.8
47.5°	2011.6	1786.4	1443.7	1218.2	1148.5
50°	1878.3	1653.1	1304.0	1084.9	1018.6
52.5°	1748.1	1510.1	1170.8	961.4	901.1
55°	1621.1	1373.7	1031.0	840.9	780.6
57.5°	1491.2	1237.4	907.5	729.8	679.0
60°	1357.9	1104.0	777.3	615.6	564.8
62.5°	1228.0	974.2	666.2	514.0	488.8
65°	1094.6	837.5	552.0	444.3	434.6
67.5°	967.8	710.6	444.3	390.1	380.7
70°	834.5	587.1	368.0	336.3	323.5
72.5°	707.5	472.6	307.6	282.4	276.1
75°	583.7	361.5	253.8	231.6	228.6
77.5°	460.1	256.8	199.9	187.2	180.8
80°	345.7	184.2	152.1	139.7	139.7
82.5°	241.0	123.8	104.7	98.3	98.3
85°	136.3	69.7	60.2	60.2	60.2
87.5°	50.8	25.3	25.3	22.2	22.2
90°	1.1	13.8	23.0	28.8	31.0
92.5°	28.8	24.2	27.6	30.0	31.0
95°	74.7	36.8	44.9	50.7	49.5
97.5°	134.6	40.3	58.6	62.2	63.2
100°	203.8	46.1	65.6	74.7	77.1
102.5°	279.6	277.4	68.0	80.5	84.1
105°	349.9	384.4	70.2	82.8	87.5
107.5°	431.6	460.2	72.6	85.1	89.8
110°	509.9	533.9	201.4	86.3	90.9



TEST NUMBER: P927058

CATALOG NUMBER: DFN2DIP-HX4F0-090D050US830-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	583.5	604.1	584.6	88.6	92.1
115°	661.7	681.2	710.1	177.3	94.4
117.5°	729.6	752.6	772.3	607.5	306.1
120°	805.6	822.8	843.5	857.4	702.0
122.5°	869.9	888.4	911.5	918.4	919.6
125°	935.5	950.6	972.5	980.5	984.0
127.5°	995.4	1011.5	1028.9	1040.3	1041.5
130°	1051.8	1070.3	1082.8	1095.6	1094.5
132.5°	1109.4	1124.4	1136.9	1147.4	1146.3
135°	1157.8	1176.2	1186.4	1198.1	1195.7
137.5°	1208.3	1222.1	1233.7	1245.2	1241.8
140°	1257.8	1267.1	1279.6	1290.0	1284.3
142.5°	1299.3	1307.4	1322.3	1331.5	1325.7
145°	1343.1	1341.8	1361.3	1369.5	1363.7
147.5°	1381.0	1377.5	1397.1	1402.8	1398.3
150°	1417.8	1409.8	1428.2	1435.1	1429.3
152.5°	1448.8	1439.7	1456.9	1463.9	1455.8
155°	1478.8	1468.5	1482.3	1489.2	1480.0
157.5°	1502.9	1493.8	1504.1	1512.2	1502.9
160°	1523.7	1516.8	1523.7	1530.5	1522.5
162.5°	1542.0	1535.2	1540.9	1549.0	1538.6
165°	1558.1	1551.4	1554.7	1562.8	1554.7
167.5°	1570.9	1563.9	1567.5	1575.5	1565.1
170°	1581.2	1574.3	1576.6	1584.6	1574.3
172.5°	1588.1	1581.2	1583.6	1591.6	1581.2
175°	1593.9	1585.8	1588.1	1596.1	1584.6
177.5°	1596.1	1588.1	1589.3	1597.3	1587.0
180°	1590.4	1590.4	1590.4	1590.4	1590.4

TEST NUMBER: P927058

CATALOG NUMBER: DFN2DIP-HX4F0-090D050US830-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.42	12.35	12.29	13.23	14.35	7.40	8.32	8.26	9.21	10.32
	3H	13.11	13.94	13.99	14.83	15.97	8.60	9.42	9.47	10.32	11.45
	4H	13.72	14.51	14.62	15.40	16.55	9.05	9.83	9.95	10.73	11.88
	6H	14.15	14.87	15.06	15.78	16.94	9.38	10.10	10.29	11.00	12.17
	8H	14.28	14.97	15.19	15.89	17.05	9.47	10.16	10.39	11.08	12.24
	12H	14.35	15.00	15.27	15.91	17.10	9.52	10.17	10.44	11.09	12.27
4H	2H	11.45	12.24	12.35	13.13	14.28	8.01	8.79	8.91	9.69	10.83
	3H	13.29	13.94	14.20	14.87	16.04	9.37	10.02	10.28	10.95	12.11
	4H	13.99	14.58	14.91	15.51	16.70	9.92	10.51	10.84	11.44	12.63
	6H	14.51	15.02	15.45	15.97	17.16	10.35	10.85	11.28	11.80	12.99
	8H	14.69	15.16	15.63	16.11	17.31	10.48	10.95	11.42	11.90	13.10
	12H	14.79	15.22	15.75	16.18	17.39	10.55	10.98	11.50	11.94	13.15
8H	4H	13.97	14.44	14.90	15.38	16.59	10.21	10.68	11.14	11.63	12.83
	6H	14.54	14.93	15.50	15.91	17.12	10.73	11.12	11.69	12.11	13.31
	8H	14.75	15.10	15.73	16.08	17.30	10.92	11.27	11.90	12.25	13.47
	12H	14.90	15.20	15.87	16.17	17.44	11.05	11.35	12.02	12.32	13.59
12H	4H	13.92	14.35	14.88	15.31	16.52	10.22	10.64	11.17	11.61	12.81
	6H	14.51	14.86	15.48	15.83	17.05	10.78	11.13	11.75	12.10	13.32
	8H	14.74	15.04	15.71	16.01	17.28	11.00	11.30	11.97	12.27	13.54

END OF REPORT