

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P927071

Luminaire Tested: DFN2DIP-HX4F0-090D090US830-FLLFLL

Issue Date: 12/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P927071
REPORT IS A COMBINATION OF REPORTS P899399 AND P896187
Test Lab: INNOVATION CENTER
Issue Date: 12/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-090D090US830-FLLFLL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15904.7 lumens
Efficiency: N/A
Efficacy: 101.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 156.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9821
Total Harmonic Distortion (THDi): 0.08
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P927071

CATALOG NUMBER: DFN2DIP-HX4F0-090D090US830-FLLFLL

Luminous Intensity Polar Plot

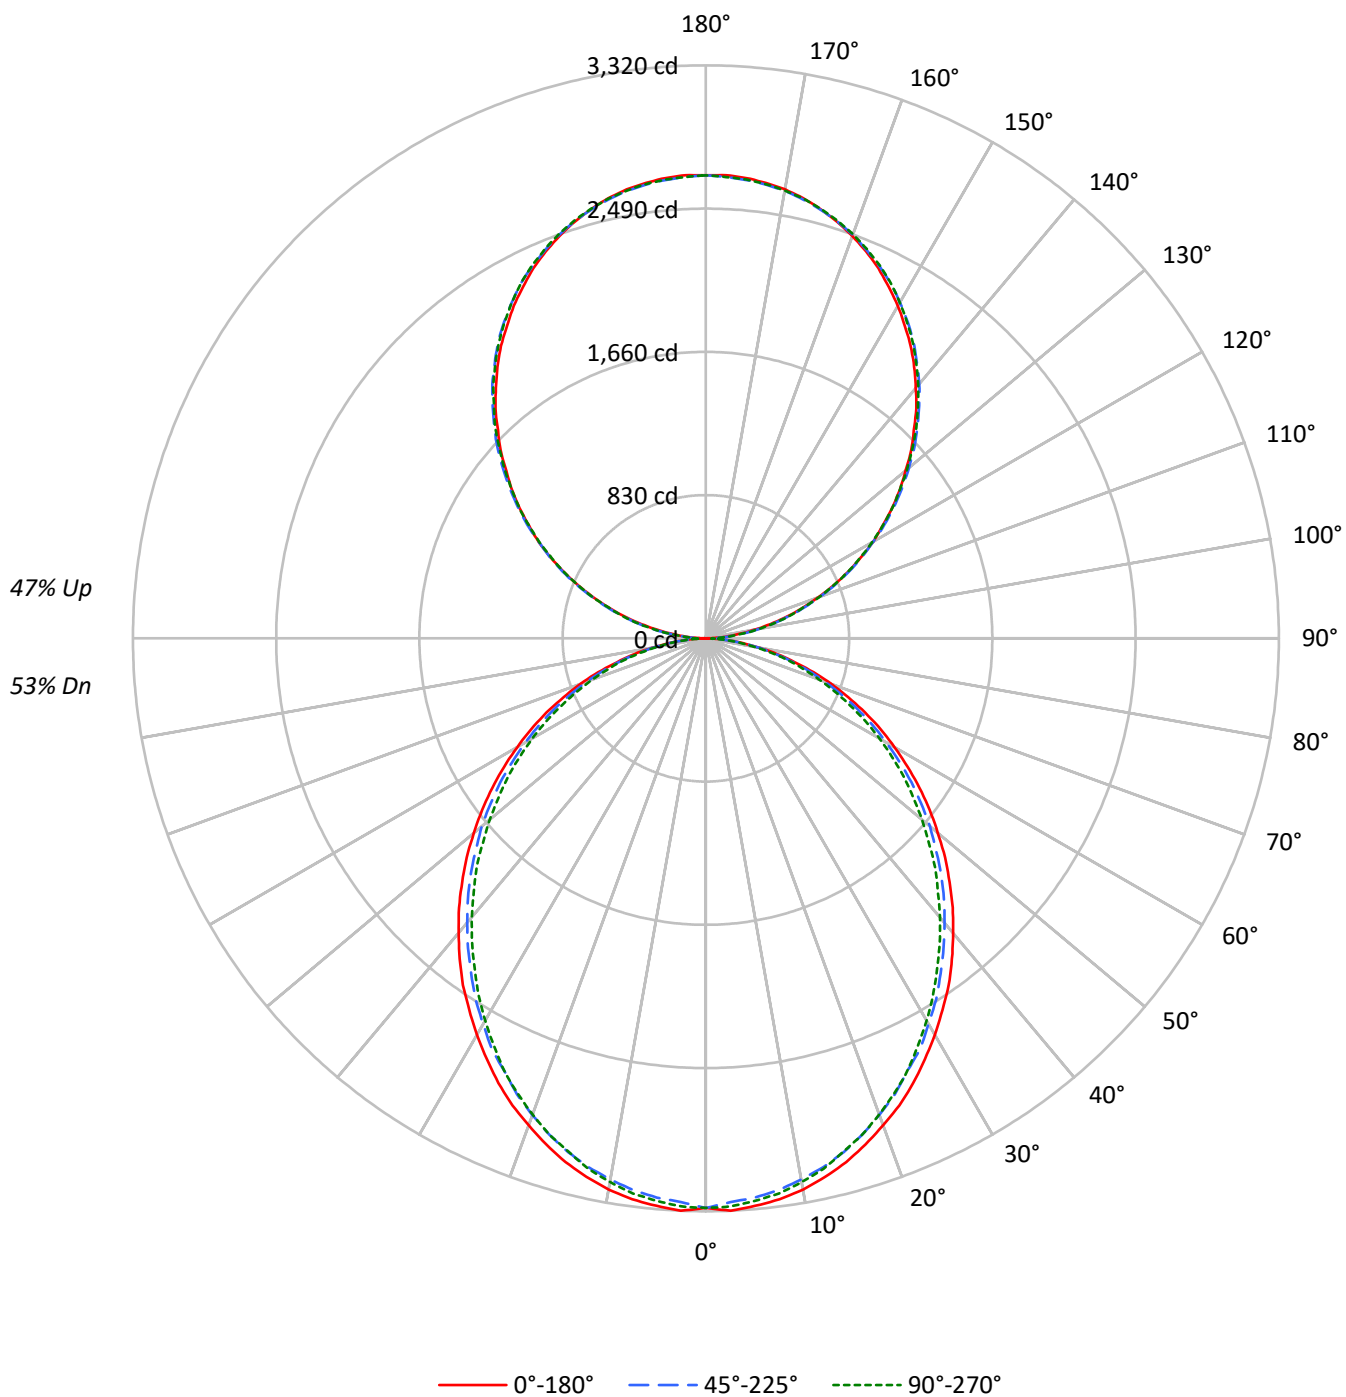

TEST NUMBER: P927071

CATALOG NUMBER: DFN2DIP-HX4F0-090D090US830-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	59	59	59
1	98	94	90	87	91	87	84	81	74	72	70	63	61	59	52	51	50
2	90	82	76	71	83	76	71	66	65	61	58	55	52	50	46	44	42
3	82	72	65	59	75	67	61	55	58	53	49	49	45	42	41	38	36
4	75	64	56	50	69	60	52	47	51	46	41	43	39	36	36	33	31
5	69	57	49	43	63	53	46	40	46	40	36	39	35	31	33	29	27
6	63	51	43	37	58	48	40	35	41	36	31	35	31	27	30	26	24
7	59	46	38	33	54	43	36	31	37	32	28	32	28	24	27	24	21
8	54	42	34	29	50	39	32	27	34	29	24	29	25	22	25	21	19
9	51	38	31	26	47	36	29	24	31	26	22	27	23	19	23	20	17
10	47	35	28	23	44	33	26	22	29	23	20	25	21	18	21	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2454	2454	2454
5°	2458	2420	2436
10°	2439	2388	2404
15°	2403	2349	2352
20°	2355	2294	2299
25°	2307	2229	2239
30°	2246	2169	2161
35°	2190	2097	2079
40°	2119	2025	2001
45°	2049	1953	1922
50°	1973	1877	1829
55°	1893	1789	1744
60°	1802	1685	1647
65°	1703	1577	1532
70°	1578	1446	1409
75°	1403	1288	1295
80°	1194	1088	1078
85°	867	741	717

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2049 cd/sqm

TEST NUMBER: P927071

CATALOG NUMBER: DFN2DIP-HX4F0-090D090US830-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	310.7	2.0
10°-20°	874.1	5.5
20°-30°	1284.5	8.1
30°-40°	1491.9	9.4
40°-50°	1490.0	9.4
50°-60°	1299.3	8.2
60°-70°	960.4	6.0
70°-80°	543.4	3.4
80°-90°	151.0	0.9
90°-100°	166.0	1.0
100°-110°	527.5	3.3
110°-120°	902.7	5.7
120°-130°	1187.1	7.5
130°-140°	1332.5	8.4
140°-150°	1306.6	8.2
150°-160°	1096.1	6.9
160°-170°	726.9	4.6
170°-180°	254.1	1.6
0°-30°	2469.2	15.5
0°-40°	3961.1	24.9
0°-60°	6750.4	42.4
0°-90°	8405.3	52.8
90°-120°	1596.1	10.0
90°-150°	5422.3	34.1
90°-180°	7499.0	47.1
0°-180°	15904.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3300	3300	3300	3300	3300	
5°	3300	3288	3253	3278	3272	313
15°	3142	3123	3082	3094	3079	885
25°	2844	2818	2764	2771	2764	1308
35°	2453	2422	2371	2352	2336	1532
45°	1996	1974	1926	1892	1879	1541
55°	1511	1492	1454	1416	1400	1351
65°	1019	1000	968	940	924	1007
75°	533	527	511	492	498	569
85°	130	127	124	114	111	145
90°	2	29	79	74	77	15
95°	118	141	145	145	141	131
105°	487	493	498	502	502	514
115°	906	919	915	912	906	896
125°	1318	1338	1331	1324	1322	1177
135°	1704	1729	1734	1732	1725	1317
145°	2069	2085	2098	2100	2092	1293
155°	2366	2372	2379	2391	2384	1089
165°	2574	2571	2571	2587	2576	726
175°	2678	2671	2666	2683	2669	254
180°	2683	2683	2683	2683	2683	

TEST NUMBER: P927071

CATALOG NUMBER: DFN2DIP-HX4F0-090D090US830-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3300.5	3300.5	3300.5	3300.5	3300.5
2.5°	3319.8	3303.9	3269.0	3300.5	3294.5
5°	3300.5	3288.1	3253.1	3278.4	3272.3
7.5°	3278.4	3259.5	3224.5	3250.1	3243.7
10°	3243.7	3221.5	3183.4	3208.6	3199.2
12.5°	3195.8	3177.0	3139.0	3154.7	3148.4
15°	3142.0	3123.2	3081.7	3094.5	3078.7
17.5°	3075.3	3056.4	3015.1	3030.9	3015.1
20°	3002.2	2983.4	2938.9	2948.3	2935.9
22.5°	2929.5	2900.9	2859.5	2859.5	2853.0
25°	2843.6	2818.4	2764.5	2770.6	2764.5
27.5°	2748.3	2726.1	2685.1	2675.7	2659.8
30°	2653.4	2627.8	2580.3	2570.9	2558.1
32.5°	2551.7	2532.9	2482.0	2462.8	2450.0
35°	2453.4	2421.8	2370.9	2351.7	2335.9
37.5°	2342.3	2313.6	2262.8	2240.6	2224.8
40°	2228.1	2202.5	2151.6	2123.4	2110.6
42.5°	2116.9	2091.4	2040.9	2008.9	1990.1
45°	1996.4	1974.3	1926.4	1891.7	1879.0
47.5°	1879.0	1856.7	1805.8	1770.9	1752.0
50°	1755.0	1739.2	1694.7	1650.3	1634.5
52.5°	1634.5	1612.2	1571.1	1536.2	1513.9
55°	1510.9	1491.7	1453.6	1415.6	1399.8
57.5°	1387.0	1371.1	1329.8	1291.7	1278.9
60°	1263.0	1250.6	1206.1	1171.2	1161.7
62.5°	1142.5	1120.3	1088.6	1057.0	1044.2
65°	1018.9	999.7	968.0	939.5	923.6
67.5°	892.0	875.9	847.5	825.3	812.5
70°	774.5	761.6	733.1	710.8	698.4
72.5°	653.9	641.1	625.3	603.1	593.7
75°	533.1	527.0	510.8	492.0	498.4
77.5°	425.3	412.5	406.1	396.7	387.3
80°	317.5	314.1	307.7	298.3	292.0
82.5°	215.8	215.8	212.8	200.0	200.0
85°	130.0	127.0	123.9	114.1	111.1
87.5°	57.2	50.8	44.5	35.1	31.7
90°	2.5	29.1	79.3	74.4	76.8
92.5°	50.1	68.0	70.4	72.8	72.8
95°	118.1	140.7	144.8	144.8	140.7
97.5°	196.5	217.5	226.5	226.5	226.5
100°	287.1	305.7	312.2	312.2	309.8
102.5°	382.6	396.3	405.2	407.6	405.2
105°	486.9	493.3	498.2	502.3	502.3
107.5°	590.4	600.1	600.1	601.7	590.4
110°	690.7	703.7	703.7	703.7	697.2



TEST NUMBER: P927071

CATALOG NUMBER: DFN2DIP-HX4F0-090D090US830-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	799.1	812.8	810.4	804.0	799.1
115°	905.8	918.7	914.7	912.3	905.8
117.5°	1011.8	1029.6	1018.3	1011.8	1005.3
120°	1118.6	1136.3	1118.6	1118.6	1111.2
122.5°	1215.5	1238.3	1226.9	1220.4	1215.5
125°	1317.5	1337.7	1331.3	1323.9	1321.6
127.5°	1417.0	1442.0	1433.2	1423.5	1417.0
130°	1510.0	1539.1	1535.0	1530.1	1521.3
132.5°	1614.3	1636.9	1638.5	1627.2	1620.8
135°	1704.0	1729.1	1734.0	1731.6	1725.2
137.5°	1804.3	1824.6	1828.6	1827.0	1817.3
140°	1892.5	1912.7	1924.0	1924.0	1915.2
142.5°	1983.1	2003.3	2009.8	2012.2	2003.3
145°	2068.9	2085.0	2097.9	2100.4	2091.5
147.5°	2145.7	2165.9	2175.6	2179.6	2170.8
150°	2225.0	2238.7	2247.6	2254.8	2247.6
152.5°	2295.3	2309.0	2320.3	2329.3	2320.3
155°	2365.7	2372.1	2379.4	2390.7	2383.5
157.5°	2426.3	2431.2	2435.2	2451.3	2440.0
160°	2480.5	2485.4	2487.8	2501.5	2491.8
162.5°	2530.6	2530.6	2533.1	2548.4	2537.1
165°	2573.5	2571.0	2571.0	2587.3	2575.9
167.5°	2612.3	2605.1	2605.1	2621.2	2609.9
170°	2641.5	2634.9	2632.6	2648.7	2634.9
172.5°	2661.6	2655.2	2652.8	2669.0	2655.2
175°	2677.8	2671.3	2666.5	2682.7	2669.0
177.5°	2686.7	2680.3	2675.4	2689.1	2675.4
180°	2682.7	2682.7	2682.7	2682.7	2682.7

TEST NUMBER: P927071

CATALOG NUMBER: DFN2DIP-HX4F0-090D090US830-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.65	11.54	11.58	12.49	13.72	10.22	11.11	11.15	12.06	13.29
	3H	12.31	13.11	13.26	14.07	15.32	11.84	12.64	12.78	13.60	14.85
	4H	12.90	13.66	13.86	14.62	15.88	12.43	13.18	13.39	14.15	15.41
	6H	13.30	14.00	14.27	14.97	16.24	12.83	13.52	13.80	14.49	15.77
	8H	13.41	14.07	14.39	15.06	16.33	12.94	13.60	13.91	14.58	15.86
	12H	13.46	14.09	14.44	15.07	16.37	12.98	13.61	13.96	14.59	15.89
4H	2H	11.12	11.87	12.08	12.83	14.09	10.77	11.52	11.73	12.49	13.75
	3H	12.99	13.61	13.96	14.61	15.88	12.59	13.22	13.57	14.21	15.49
	4H	13.70	14.28	14.68	15.26	16.56	13.30	13.87	14.28	14.86	16.16
	6H	14.22	14.71	15.21	15.72	17.02	13.81	14.30	14.80	15.32	16.61
	8H	14.37	14.83	15.37	15.84	17.15	13.96	14.42	14.95	15.42	16.74
	12H	14.44	14.86	15.46	15.88	17.20	14.02	14.44	15.04	15.46	16.78
8H	4H	13.90	14.36	14.90	15.37	16.68	13.54	14.00	14.54	15.01	16.32
	6H	14.53	14.92	15.56	15.96	17.27	14.17	14.55	15.19	15.60	16.91
	8H	14.76	15.09	15.79	16.13	17.46	14.39	14.72	15.42	15.76	17.09
	12H	14.89	15.19	15.92	16.21	17.59	14.51	14.80	15.54	15.83	17.20
12H	4H	13.89	14.31	14.90	15.33	16.64	13.54	13.95	14.55	14.97	16.29
	6H	14.56	14.90	15.59	15.93	17.26	14.21	14.55	15.24	15.58	16.91
	8H	14.81	15.11	15.84	16.13	17.51	14.45	14.75	15.48	15.77	17.15

END OF REPORT