

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P927288

Luminaire Tested: DFN2DIP-HX4F0-060D090US835-FLLONL

Issue Date: 12/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P927288
REPORT IS A COMBINATION OF REPORTS P900913 AND P896187
Test Lab: INNOVATION CENTER
Issue Date: 12/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-060D090US835-FLLONL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14850.0 lumens
Efficiency: N/A
Efficacy: 121.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 122.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.099
Total Harmonic Distortion (THDi): 0.979
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P927288

CATALOG NUMBER: DFN2DIP-HX4F0-060D090US835-FLLONL

Luminous Intensity Polar Plot

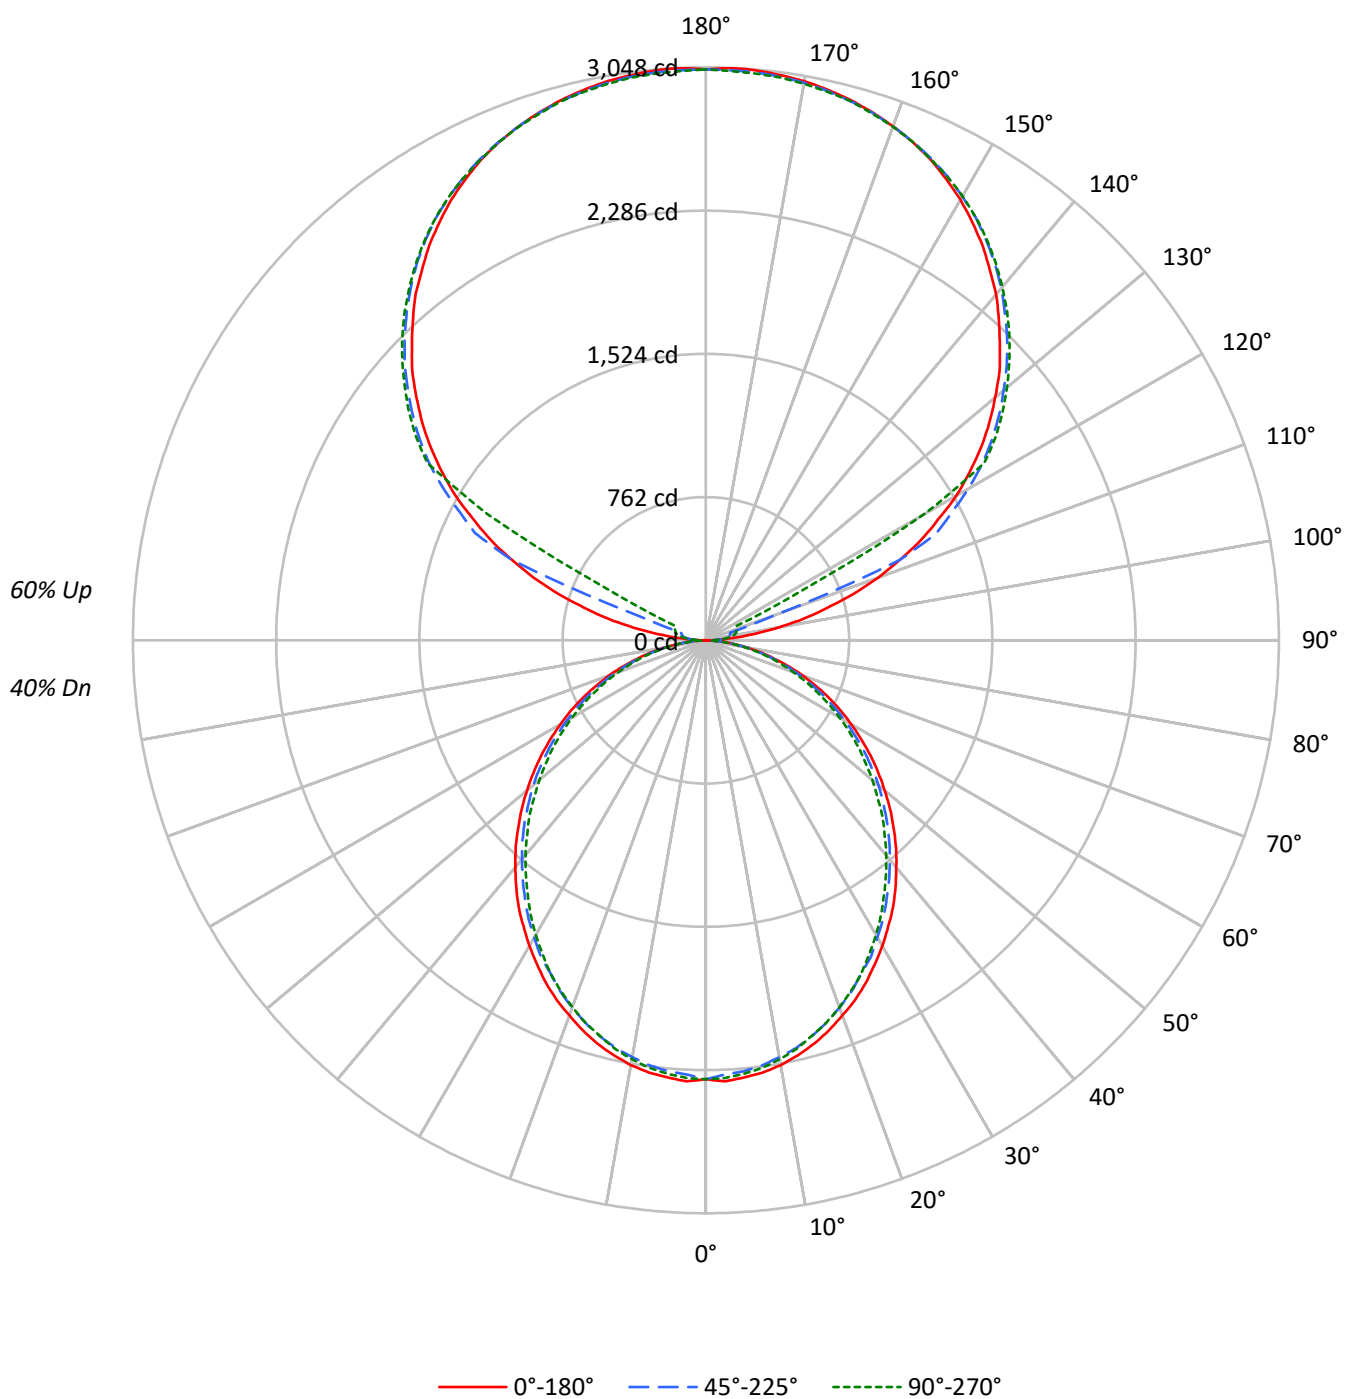

TEST NUMBER: P927288

CATALOG NUMBER: DFN2DIP-HX4F0-060D090US835-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	95	95	95	95	78	78	78	62	62	62	47	47	47
1	96	91	87	84	87	83	80	77	68	66	64	54	53	51	41	41	40
2	87	80	74	69	79	73	68	63	60	56	53	48	45	43	37	35	33
3	79	70	63	57	72	64	58	53	53	48	44	42	39	36	32	30	28
4	73	62	54	48	66	57	50	45	47	42	38	37	34	31	29	26	24
5	67	55	47	41	60	50	44	38	42	37	33	34	30	27	26	23	21
6	61	49	41	36	56	45	38	33	38	32	28	30	26	23	24	21	19
7	57	45	37	31	51	41	34	29	34	29	25	28	24	21	22	19	17
8	52	40	33	27	48	37	30	26	31	26	22	25	21	18	20	17	15
9	49	37	29	24	44	34	27	23	28	23	20	23	19	17	18	15	13
10	46	34	27	22	41	31	25	20	26	21	18	21	18	15	17	14	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1736	1736	1736
5°	1739	1712	1723
10°	1725	1689	1700
15°	1700	1661	1664
20°	1666	1623	1627
25°	1632	1577	1583
30°	1589	1534	1529
35°	1549	1484	1471
40°	1499	1433	1416
45°	1450	1381	1359
50°	1395	1328	1294
55°	1339	1266	1234
60°	1275	1192	1165
65°	1205	1116	1084
70°	1116	1023	997
75°	992	911	916
80°	845	770	762
85°	613	524	507

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1559 cd/sqm

TEST NUMBER: P927288

CATALOG NUMBER: DFN2DIP-HX4F0-060D090US835-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	219.7	1.5
10°-20°	618.3	4.2
20°-30°	908.6	6.1
30°-40°	1055.3	7.1
40°-50°	1054.0	7.1
50°-60°	919.0	6.2
60°-70°	679.4	4.6
70°-80°	384.4	2.6
80°-90°	106.8	0.7
90°-100°	100.2	0.7
100°-110°	373.4	2.5
110°-120°	990.2	6.7
120°-130°	1642.4	11.1
130°-140°	1744.6	11.7
140°-150°	1621.4	10.9
150°-160°	1303.5	8.8
160°-170°	840.0	5.7
170°-180°	289.1	1.9
0°-30°	1746.6	11.8
0°-40°	2801.8	18.9
0°-60°	4774.8	32.2
0°-90°	5945.3	40.0
90°-120°	1463.7	9.9
90°-150°	6472.0	43.6
90°-180°	8905.0	60.0
0°-180°	14850.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2335	2335	2335	2335	2335	
5°	2335	2326	2301	2319	2315	222
15°	2222	2209	2180	2189	2178	626
25°	2011	1994	1955	1960	1955	926
35°	1735	1713	1677	1663	1652	1084
45°	1412	1396	1363	1338	1329	1090
55°	1069	1055	1028	1001	990	955
65°	721	707	685	664	653	713
75°	377	373	361	348	352	402
85°	92	90	88	81	79	103
90°	2	26	44	55	59	14
95°	143	70	86	97	94	169
105°	668	734	134	158	167	714
115°	1264	1301	1356	338	180	1244
125°	1787	1815	1857	1873	1879	1594
135°	2211	2246	2266	2288	2284	1708
145°	2565	2563	2600	2615	2604	1604
155°	2824	2805	2831	2844	2826	1301
165°	2976	2963	2969	2985	2969	841
175°	3044	3028	3033	3048	3026	290
180°	3037	3037	3037	3037	3037	

TEST NUMBER: P927288

CATALOG NUMBER: DFN2DIP-HX4F0-060D090US835-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2334.6	2334.6	2334.6	2334.6	2334.6
2.5°	2348.2	2337.0	2312.2	2334.6	2330.3
5°	2334.6	2325.8	2301.0	2318.9	2314.6
7.5°	2318.9	2305.6	2280.8	2298.9	2294.4
10°	2294.4	2278.7	2251.7	2269.6	2262.9
12.5°	2260.6	2247.2	2220.3	2231.5	2227.0
15°	2222.4	2209.1	2179.8	2188.9	2177.7
17.5°	2175.3	2162.0	2132.7	2143.8	2132.7
20°	2123.6	2110.3	2078.8	2085.5	2076.7
22.5°	2072.2	2051.9	2022.6	2022.6	2018.1
25°	2011.4	1993.6	1955.4	1959.7	1955.4
27.5°	1944.0	1928.3	1899.2	1892.6	1881.4
30°	1876.9	1858.7	1825.2	1818.5	1809.4
32.5°	1804.9	1791.6	1755.6	1742.0	1733.0
35°	1735.4	1713.0	1677.0	1663.4	1652.2
37.5°	1656.8	1636.5	1600.6	1584.8	1573.6
40°	1576.0	1557.9	1522.0	1502.0	1492.9
42.5°	1497.4	1479.3	1443.6	1421.0	1407.6
45°	1412.2	1396.4	1362.6	1338.1	1329.0
47.5°	1329.0	1313.3	1277.4	1252.6	1239.2
50°	1241.4	1230.2	1198.8	1167.3	1156.1
52.5°	1156.1	1140.4	1111.3	1086.6	1070.9
55°	1068.7	1055.1	1028.2	1001.3	990.1
57.5°	981.1	969.9	940.6	913.7	904.6
60°	893.4	884.6	853.2	828.4	821.7
62.5°	808.1	792.4	770.0	747.6	738.6
65°	720.7	707.2	684.8	664.5	653.3
67.5°	630.9	619.5	599.5	583.8	574.7
70°	547.8	538.8	518.5	502.8	494.0
72.5°	462.5	453.5	442.3	426.6	419.9
75°	377.0	372.8	361.3	348.0	352.5
77.5°	300.8	291.8	287.2	280.6	273.9
80°	224.6	222.2	217.7	211.0	206.5
82.5°	152.7	152.7	150.5	141.5	141.5
85°	91.9	89.8	87.6	80.7	78.6
87.5°	40.5	36.0	31.4	24.8	22.4
90°	2.1	26.4	43.8	55.1	59.2
92.5°	55.1	46.2	52.7	57.2	59.2
95°	142.8	70.2	85.6	96.8	94.5
97.5°	257.1	77.0	112.0	118.7	120.8
100°	389.1	88.0	125.3	142.8	147.2
102.5°	534.0	529.8	129.7	153.7	160.5
105°	668.1	734.2	134.1	158.2	167.0
107.5°	824.2	879.0	138.6	162.6	171.5
110°	973.7	1019.7	384.7	164.9	173.6

TEST NUMBER: P927288

CATALOG NUMBER: DFN2DIP-HX4F0-060D090US835-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1114.4	1153.8	1116.5	169.1	175.9
115°	1263.7	1301.0	1356.1	338.5	180.3
117.5°	1393.4	1437.3	1474.8	1160.4	584.6
120°	1538.5	1571.4	1611.1	1637.4	1340.7
122.5°	1661.5	1696.7	1740.8	1753.8	1756.2
125°	1786.7	1815.4	1857.2	1872.6	1879.1
127.5°	1901.0	1931.8	1965.0	1986.9	1989.0
130°	2008.8	2044.1	2068.1	2092.3	2090.3
132.5°	2118.7	2147.4	2171.4	2191.3	2189.2
135°	2211.1	2246.3	2265.9	2288.1	2283.7
137.5°	2307.7	2334.0	2356.2	2378.1	2371.6
140°	2402.1	2419.9	2443.9	2463.7	2452.8
142.5°	2481.5	2496.9	2525.3	2542.8	2531.9
145°	2565.0	2562.6	2600.0	2615.4	2604.4
147.5°	2637.3	2630.8	2668.1	2679.1	2670.4
150°	2707.8	2692.4	2727.6	2740.6	2729.7
152.5°	2767.0	2749.5	2782.4	2795.7	2780.3
155°	2824.2	2804.6	2830.9	2844.0	2826.5
157.5°	2870.4	2852.9	2872.7	2888.1	2870.4
160°	2910.0	2896.7	2910.0	2923.1	2907.7
162.5°	2945.0	2931.9	2942.9	2958.3	2938.5
165°	2975.8	2962.7	2969.3	2984.7	2969.3
167.5°	3000.1	2986.8	2993.5	3008.9	2989.1
170°	3019.9	3006.6	3011.0	3026.4	3006.6
172.5°	3033.0	3019.9	3024.3	3039.7	3019.9
175°	3043.9	3028.5	3033.0	3048.3	3026.4
177.5°	3048.3	3033.0	3035.3	3050.7	3030.9
180°	3037.4	3037.4	3037.4	3037.4	3037.4

TEST NUMBER: P927288

CATALOG NUMBER: DFN2DIP-HX4F0-060D090US835-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.19	8.97	9.23	10.01	11.42	7.76	8.54	8.80	9.58	10.99
	3H	9.85	10.54	10.90	11.60	13.02	9.37	10.07	10.42	11.12	12.55
	4H	10.43	11.09	11.49	12.15	13.58	9.96	10.62	11.02	11.67	13.11
	6H	10.83	11.44	11.90	12.50	13.94	10.35	10.96	11.42	12.02	13.46
	8H	10.93	11.51	12.00	12.59	14.02	10.46	11.03	11.53	12.11	13.55
	12H	10.98	11.53	12.06	12.60	14.06	10.49	11.05	11.57	12.11	13.58
4H	2H	8.64	9.31	9.71	10.36	11.79	8.30	8.96	9.37	10.02	11.45
	3H	10.50	11.06	11.58	12.14	13.58	10.11	10.66	11.18	11.75	13.19
	4H	11.22	11.72	12.30	12.80	14.26	10.81	11.32	11.89	12.39	13.86
	6H	11.73	12.16	12.82	13.26	14.72	11.32	11.75	12.41	12.85	14.31
	8H	11.88	12.28	12.96	13.37	14.85	11.46	11.87	12.55	12.96	14.43
	12H	11.94	12.31	13.05	13.41	14.90	11.52	11.89	12.63	12.99	14.47
8H	4H	11.41	11.81	12.49	12.90	14.38	11.05	11.45	12.13	12.54	14.02
	6H	12.04	12.37	13.15	13.50	14.98	11.67	12.01	12.78	13.14	14.61
	8H	12.26	12.55	13.37	13.66	15.16	11.89	12.18	13.00	13.29	14.79
	12H	12.38	12.64	13.51	13.75	15.28	12.00	12.26	13.12	13.37	14.90
12H	4H	11.39	11.76	12.49	12.86	14.34	11.04	11.40	12.14	12.51	13.99
	6H	12.06	12.36	13.18	13.47	14.97	11.71	12.01	12.83	13.12	14.61
	8H	12.30	12.56	13.43	13.67	15.20	11.95	12.20	13.07	13.31	14.85

END OF REPORT