

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P905494

Luminaire Tested: DFN2DIP-HX4F0-080D080US835-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P905494
REPORT IS A COMBINATION OF REPORTS P899379 AND P896188
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-080D080US835-FLLFLL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15000.0 lumens
Efficiency: N/A
Efficacy: 123.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 122
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9613
Total Harmonic Distortion (THDi): 0.083
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P905494

CATALOG NUMBER: DFN2DIP-HX4F0-080D080US835-FLLFLL

Luminous Intensity Polar Plot

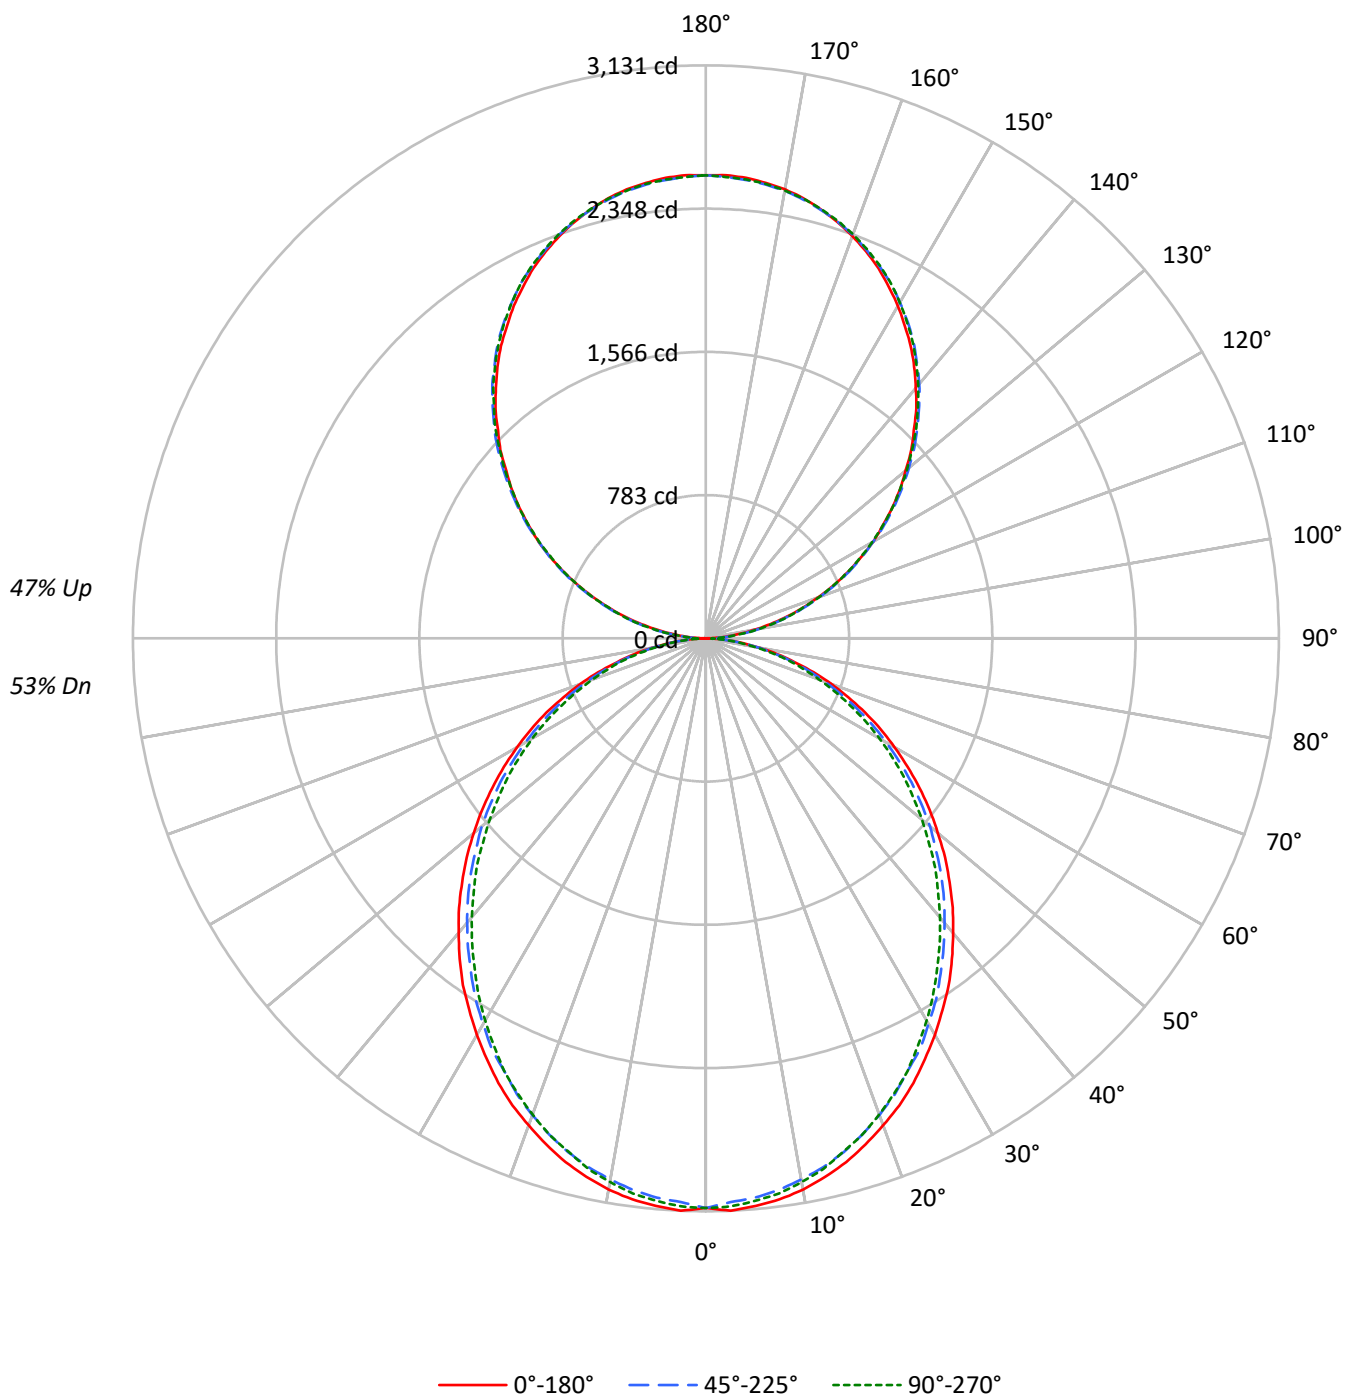

TEST NUMBER: P905494

CATALOG NUMBER: DFN2DIP-HX4F0-080D080US835-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	59	59	59
1	98	94	90	87	91	87	84	81	74	72	70	63	61	59	52	51	50
2	90	82	76	71	83	76	71	66	65	61	58	55	52	50	46	44	42
3	82	72	65	59	75	67	61	55	58	53	49	49	45	42	41	38	36
4	75	64	56	50	69	60	52	47	51	46	41	43	39	36	36	33	31
5	69	57	49	43	63	53	46	40	46	40	36	39	35	31	33	29	27
6	63	51	43	37	58	48	40	35	41	36	31	35	31	27	30	26	24
7	59	46	38	33	54	43	36	31	37	32	28	32	28	24	27	24	21
8	54	42	34	29	50	39	32	27	34	29	24	29	25	22	25	21	19
9	51	38	31	26	47	36	29	24	31	26	22	27	23	19	23	20	17
10	47	35	28	23	44	33	26	22	29	23	20	25	21	18	21	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2315	2315	2315
5°	2318	2283	2298
10°	2300	2252	2267
15°	2266	2215	2218
20°	2221	2164	2169
25°	2176	2103	2111
30°	2119	2045	2038
35°	2065	1978	1961
40°	1999	1910	1887
45°	1933	1842	1812
50°	1860	1770	1725
55°	1785	1688	1645
60°	1699	1589	1553
65°	1607	1487	1445
70°	1488	1364	1329
75°	1323	1215	1222
80°	1126	1026	1016
85°	817	699	676

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1933 cd/sqm

TEST NUMBER: P905494

CATALOG NUMBER: DFN2DIP-HX4F0-080D080US835-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	293.0	2.0
10°-20°	824.3	5.5
20°-30°	1211.5	8.1
30°-40°	1407.0	9.4
40°-50°	1405.3	9.4
50°-60°	1225.4	8.2
60°-70°	905.8	6.0
70°-80°	512.5	3.4
80°-90°	142.5	0.9
90°-100°	156.6	1.0
100°-110°	497.5	3.3
110°-120°	851.3	5.7
120°-130°	1119.6	7.5
130°-140°	1256.7	8.4
140°-150°	1232.3	8.2
150°-160°	1033.7	6.9
160°-170°	685.6	4.6
170°-180°	239.6	1.6
0°-30°	2328.8	15.5
0°-40°	3735.8	24.9
0°-60°	6366.4	42.4
0°-90°	7927.2	52.8
90°-120°	1505.3	10.0
90°-150°	5113.9	34.1
90°-180°	7073.0	47.2
0°-180°	15000.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3113	3113	3113	3113	3113	
5°	3113	3101	3068	3092	3086	295
15°	2963	2946	2906	2918	2904	835
25°	2682	2658	2607	2613	2607	1234
35°	2314	2284	2236	2218	2203	1445
45°	1883	1862	1817	1784	1772	1453
55°	1425	1407	1371	1335	1320	1274
65°	961	943	913	886	871	950
75°	503	497	482	464	470	537
85°	123	120	117	108	105	137
90°	2	28	75	70	72	15
95°	111	133	136	136	133	124
105°	459	465	470	474	474	485
115°	854	866	863	860	854	845
125°	1242	1262	1256	1249	1246	1110
135°	1607	1631	1635	1633	1627	1242
145°	1951	1966	1979	1981	1972	1219
155°	2231	2237	2244	2255	2248	1027
165°	2427	2425	2425	2440	2429	685
175°	2526	2519	2515	2530	2517	240
180°	2530	2530	2530	2530	2530	

TEST NUMBER: P905494

CATALOG NUMBER: DFN2DIP-HX4F0-080D080US835-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3112.8	3112.8	3112.8	3112.8	3112.8
2.5°	3130.9	3116.0	3083.0	3112.8	3107.1
5°	3112.8	3101.1	3068.1	3091.9	3086.2
7.5°	3091.9	3074.1	3041.1	3065.2	3059.2
10°	3059.2	3038.2	3002.3	3026.1	3017.3
12.5°	3014.1	2996.3	2960.4	2975.3	2969.3
15°	2963.3	2945.5	2906.4	2918.5	2903.6
17.5°	2900.4	2882.6	2843.5	2858.5	2843.5
20°	2831.5	2813.7	2771.8	2780.7	2768.9
22.5°	2762.9	2735.9	2696.8	2696.8	2690.8
25°	2681.9	2658.1	2607.3	2613.0	2607.3
27.5°	2592.0	2571.1	2532.3	2523.4	2508.5
30°	2502.5	2478.3	2433.6	2424.7	2412.6
32.5°	2406.6	2388.8	2340.8	2322.7	2310.7
35°	2313.8	2284.0	2236.0	2217.9	2203.0
37.5°	2209.0	2182.0	2134.1	2113.1	2098.2
40°	2101.4	2077.2	2029.3	2002.6	1990.5
42.5°	1996.6	1972.4	1924.8	1894.6	1876.9
45°	1882.9	1861.9	1816.8	1784.1	1772.1
47.5°	1772.1	1751.1	1703.1	1670.1	1652.3
50°	1655.2	1640.3	1598.3	1556.4	1541.5
52.5°	1541.5	1520.5	1481.8	1448.8	1427.8
55°	1424.9	1406.8	1371.0	1335.1	1320.1
57.5°	1308.1	1293.2	1254.1	1218.2	1206.1
60°	1191.2	1179.5	1137.5	1104.5	1095.6
62.5°	1077.5	1056.6	1026.7	996.9	984.8
65°	961.0	942.9	913.0	886.0	871.1
67.5°	841.2	826.0	799.3	778.4	766.3
70°	730.4	718.3	691.4	670.4	658.6
72.5°	616.7	604.7	589.7	568.8	559.9
75°	502.7	497.0	481.8	464.0	470.0
77.5°	401.1	389.0	383.0	374.1	365.2
80°	299.5	296.3	290.3	281.4	275.3
82.5°	203.6	203.6	200.7	188.6	188.6
85°	122.6	119.7	116.9	107.7	104.8
87.5°	54.0	48.0	41.9	33.0	29.9
90°	2.3	27.5	74.8	70.2	72.5
92.5°	47.3	64.1	66.4	68.6	68.6
95°	111.4	132.7	136.5	136.5	132.7
97.5°	185.4	205.2	213.6	213.6	213.6
100°	270.8	288.3	294.4	294.4	292.1
102.5°	360.8	373.8	382.1	384.4	382.1
105°	459.2	465.3	469.9	473.7	473.7
107.5°	556.8	566.0	566.0	567.5	556.8
110°	651.4	663.6	663.6	663.6	657.5

TEST NUMBER: P905494

CATALOG NUMBER: DFN2DIP-HX4F0-080D080US835-FLLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	753.6	766.6	764.3	758.2	753.6
115°	854.3	866.5	862.7	860.4	854.3
117.5°	954.2	971.0	960.3	954.2	948.1
120°	1054.9	1071.7	1054.9	1054.9	1048.0
122.5°	1146.4	1167.8	1157.1	1151.0	1146.4
125°	1242.5	1261.6	1255.5	1248.6	1246.4
127.5°	1336.4	1360.0	1351.6	1342.5	1336.4
130°	1424.1	1451.5	1447.7	1443.2	1434.8
132.5°	1522.5	1543.8	1545.4	1534.7	1528.6
135°	1607.1	1630.8	1635.4	1633.1	1627.0
137.5°	1701.7	1720.8	1724.6	1723.1	1713.9
140°	1784.9	1803.9	1814.6	1814.6	1806.2
142.5°	1870.3	1889.4	1895.5	1897.8	1889.4
145°	1951.2	1966.4	1978.6	1980.9	1972.5
147.5°	2023.6	2042.7	2051.8	2055.7	2047.3
150°	2098.4	2111.3	2119.7	2126.6	2119.7
152.5°	2164.7	2177.7	2188.4	2196.8	2188.4
155°	2231.1	2237.2	2244.1	2254.7	2247.9
157.5°	2288.3	2292.9	2296.7	2311.9	2301.3
160°	2339.4	2344.0	2346.3	2359.2	2350.1
162.5°	2386.7	2386.7	2389.0	2403.5	2392.8
165°	2427.1	2424.8	2424.8	2440.1	2429.4
167.5°	2463.7	2456.9	2456.9	2472.1	2461.4
170°	2491.2	2485.1	2482.8	2498.1	2485.1
172.5°	2510.3	2504.2	2501.9	2517.1	2504.2
175°	2525.5	2519.4	2514.8	2530.1	2517.1
177.5°	2533.9	2527.8	2523.2	2536.2	2523.2
180°	2530.1	2530.1	2530.1	2530.1	2530.1

TEST NUMBER: P905494

CATALOG NUMBER: DFN2DIP-HX4F0-080D080US835-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.45	11.33	11.38	12.28	13.51	10.01	10.90	10.95	11.85	13.08
	3H	12.11	12.91	13.05	13.87	15.12	11.64	12.43	12.58	13.39	14.65
	4H	12.70	13.45	13.66	14.42	15.68	12.23	12.98	13.18	13.94	15.20
	6H	13.10	13.80	14.07	14.76	16.04	12.63	13.32	13.59	14.29	15.56
	8H	13.21	13.87	14.18	14.85	16.13	12.73	13.39	13.71	14.38	15.65
	12H	13.26	13.89	14.24	14.87	16.16	12.78	13.40	13.76	14.38	15.68
4H	2H	10.91	11.67	11.88	12.63	13.89	10.57	11.32	11.53	12.28	13.55
	3H	12.78	13.41	13.76	14.40	15.68	12.39	13.02	13.36	14.01	15.29
	4H	13.50	14.07	14.48	15.06	16.36	13.09	13.67	14.07	14.65	15.95
	6H	14.02	14.51	15.01	15.52	16.82	13.61	14.10	14.60	15.11	16.41
	8H	14.17	14.63	15.16	15.63	16.95	13.75	14.22	14.75	15.22	16.53
	12H	14.24	14.66	15.26	15.68	17.00	13.82	14.24	14.83	15.26	16.57
8H	4H	13.70	14.16	14.69	15.16	16.48	13.34	13.80	14.33	14.80	16.12
	6H	14.33	14.71	15.35	15.76	17.07	13.97	14.35	14.99	15.40	16.71
	8H	14.55	14.89	15.58	15.92	17.25	14.18	14.52	15.21	15.55	16.88
	12H	14.69	14.98	15.72	16.01	17.38	14.30	14.60	15.33	15.62	17.00
12H	4H	13.68	14.10	14.70	15.12	16.44	13.33	13.75	14.35	14.77	16.09
	6H	14.36	14.70	15.39	15.73	17.06	14.01	14.35	15.04	15.38	16.71
	8H	14.61	14.90	15.64	15.93	17.30	14.25	14.55	15.28	15.57	16.95

END OF REPORT