

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P908150

Luminaire Tested: DFN2DIP-HX4F0-040D080US840-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P908150
REPORT IS A COMBINATION OF REPORTS P899371 AND P896188
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-040D080US840-FLLFLL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11148.9 lumens
Efficiency: N/A
Efficacy: 141.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 78.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P908150

CATALOG NUMBER: DFN2DIP-HX4F0-040D080US840-FLLFLL

Luminous Intensity Polar Plot

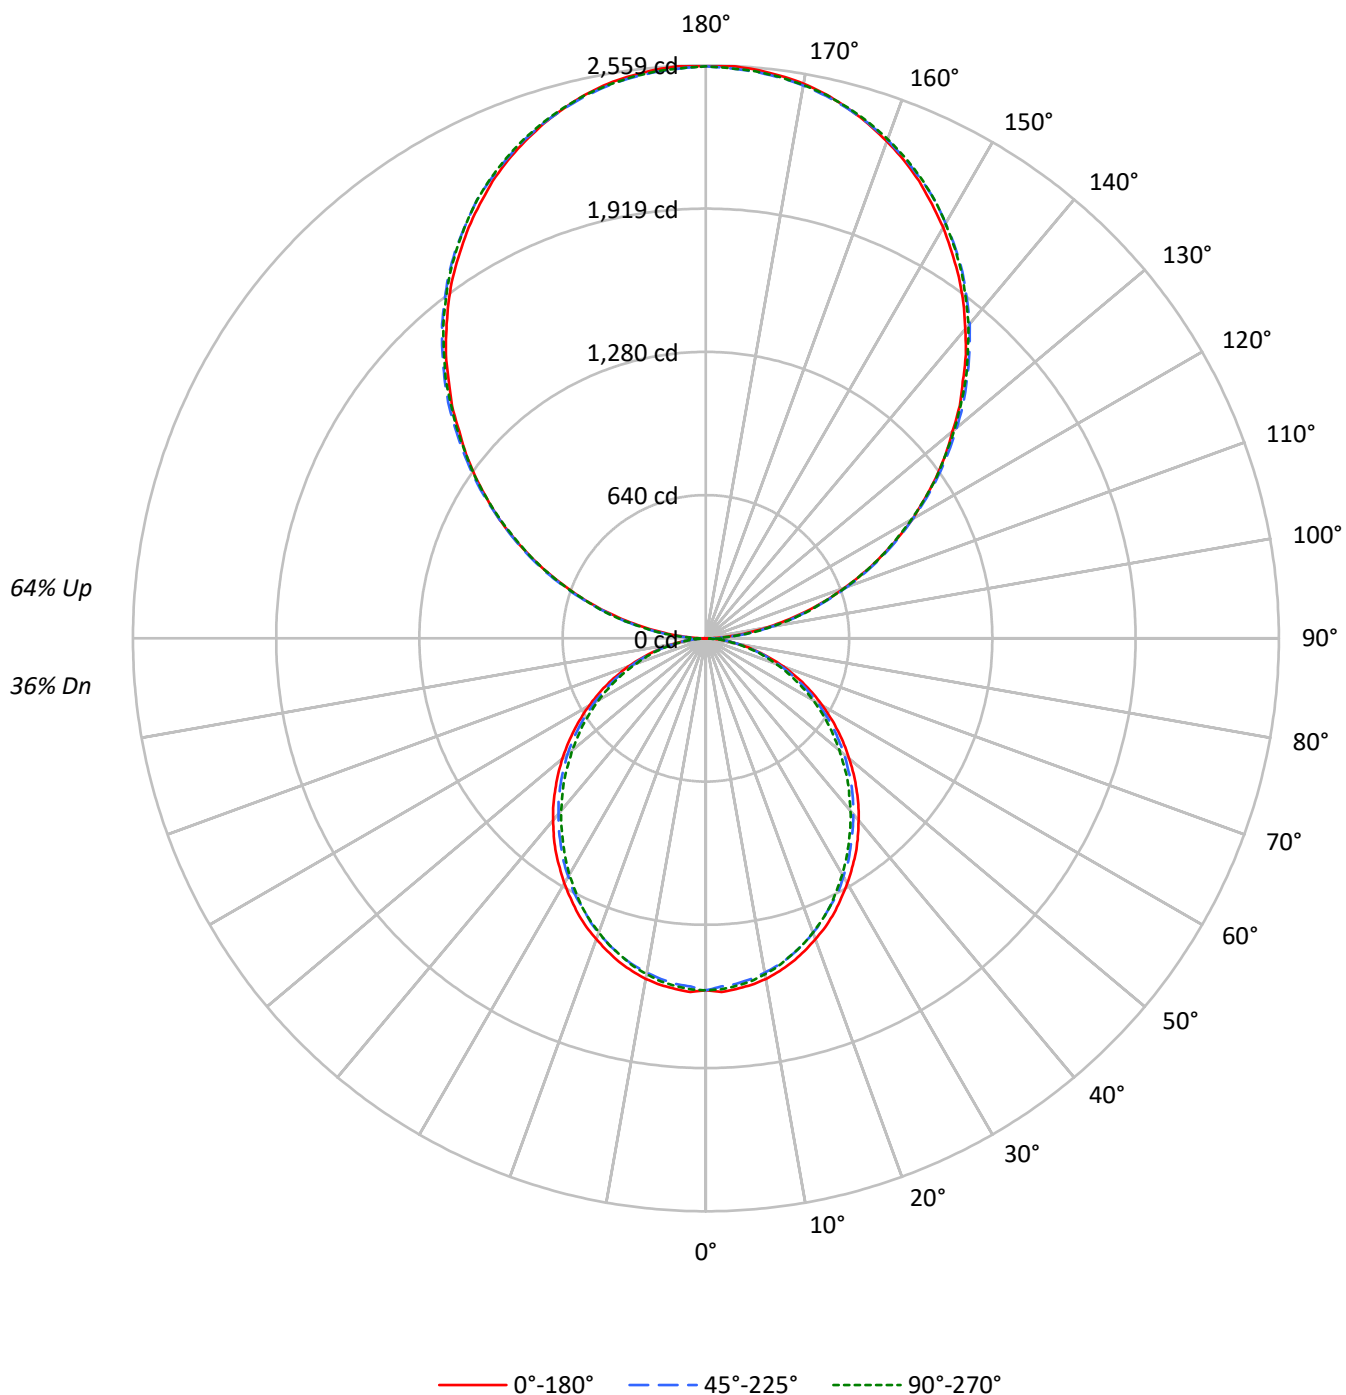

TEST NUMBER: P908150

CATALOG NUMBER: DFN2DIP-HX4F0-040D080US840-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	76	76	76	59	59	59	43	43	43
1	95	90	87	83	85	82	79	76	66	64	62	52	50	49	38	37	36
2	86	79	73	68	78	72	66	62	58	54	51	45	43	41	34	32	31
3	79	69	62	56	71	63	57	52	51	47	43	40	37	34	30	28	26
4	72	61	54	48	65	56	49	44	45	40	37	36	32	29	27	24	22
5	66	54	47	41	59	50	43	38	40	35	31	32	28	25	24	22	20
6	61	49	41	35	55	45	38	33	36	31	27	29	25	22	22	19	17
7	56	44	36	31	50	40	33	28	33	28	24	26	22	20	20	17	15
8	52	40	32	27	47	36	30	25	30	25	21	24	20	17	18	16	14
9	48	36	29	24	44	33	27	22	27	22	19	22	18	16	17	14	12
10	45	33	26	21	41	30	24	20	25	20	17	20	17	14	16	13	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1169	1169	1169
5°	1171	1152	1160
10°	1161	1137	1145
15°	1144	1119	1120
20°	1121	1093	1095
25°	1098	1062	1066
30°	1070	1033	1029
35°	1043	999	990
40°	1009	964	953
45°	976	930	915
50°	939	894	871
55°	901	852	831
60°	858	802	784
65°	811	751	730
70°	751	688	671
75°	668	614	617
80°	569	518	513
85°	413	353	341

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1927 cd/sqm

TEST NUMBER: P908150

CATALOG NUMBER: DFN2DIP-HX4F0-040D080US840-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	147.9	1.3
10°-20°	416.2	3.7
20°-30°	611.7	5.5
30°-40°	710.5	6.4
40°-50°	709.6	6.4
50°-60°	618.7	5.5
60°-70°	457.4	4.1
70°-80°	258.8	2.3
80°-90°	75.6	0.7
90°-100°	158.1	1.4
100°-110°	502.4	4.5
110°-120°	859.7	7.7
120°-130°	1130.6	10.1
130°-140°	1269.1	11.4
140°-150°	1244.5	11.2
150°-160°	1043.9	9.4
160°-170°	692.3	6.2
170°-180°	242.0	2.2
0°-30°	1175.9	10.5
0°-40°	1886.3	16.9
0°-60°	3214.6	28.8
0°-90°	4006.3	35.9
90°-120°	1520.1	13.6
90°-150°	5164.3	46.3
90°-180°	7143.0	64.1
0°-180°	11148.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1572	1572	1572	1572	1572	
5°	1572	1566	1549	1561	1558	149
15°	1496	1487	1468	1474	1466	421
25°	1354	1342	1316	1319	1316	623
35°	1168	1153	1129	1120	1112	730
45°	951	940	917	901	895	734
55°	720	710	692	674	667	643
65°	485	476	461	447	440	480
75°	254	251	243	234	237	271
85°	62	60	59	54	53	69
90°	2	28	76	71	73	11
95°	112	134	138	138	134	125
105°	464	470	474	478	478	489
115°	863	875	871	869	863	853
125°	1255	1274	1268	1261	1259	1121
135°	1623	1647	1652	1649	1643	1254
145°	1970	1986	1998	2000	1992	1231
155°	2253	2259	2266	2277	2270	1037
165°	2451	2449	2449	2464	2453	691
175°	2550	2544	2540	2555	2542	242
180°	2555	2555	2555	2555	2555	

TEST NUMBER: P908150

CATALOG NUMBER: DFN2DIP-HX4F0-040D080US840-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1571.8	1571.8	1571.8	1571.8	1571.8
2.5°	1580.9	1573.4	1556.7	1571.8	1568.9
5°	1571.8	1565.8	1549.1	1561.2	1558.3
7.5°	1561.2	1552.2	1535.5	1547.7	1544.7
10°	1544.7	1534.1	1516.0	1528.0	1523.5
12.5°	1521.9	1512.9	1494.8	1502.4	1499.2
15°	1496.2	1487.2	1467.5	1473.6	1466.1
17.5°	1464.5	1455.5	1435.8	1443.3	1435.8
20°	1429.7	1420.7	1399.6	1404.0	1398.2
22.5°	1395.0	1381.4	1361.7	1361.7	1358.7
25°	1354.1	1342.1	1316.5	1319.4	1316.5
27.5°	1308.8	1298.2	1278.7	1274.1	1266.7
30°	1263.5	1251.4	1228.8	1224.3	1218.2
32.5°	1215.2	1206.2	1181.9	1172.9	1166.7
35°	1168.3	1153.3	1129.0	1119.9	1112.4
37.5°	1115.4	1101.8	1077.5	1067.0	1059.4
40°	1061.1	1048.8	1024.6	1011.2	1005.1
42.5°	1008.1	995.9	971.9	956.6	947.7
45°	950.7	940.2	917.4	900.9	894.7
47.5°	894.7	884.1	860.0	843.3	834.4
50°	835.8	828.2	807.1	785.9	778.3
52.5°	778.3	767.8	748.2	731.5	720.9
55°	719.5	710.3	692.3	674.1	666.6
57.5°	660.5	653.0	633.2	615.1	609.0
60°	601.5	595.5	574.4	557.7	553.2
62.5°	544.1	533.5	518.5	503.3	497.3
65°	485.2	476.1	461.0	447.4	439.9
67.5°	424.7	417.1	403.6	393.0	387.0
70°	368.8	362.7	349.1	338.5	332.5
72.5°	311.4	305.3	297.8	287.2	282.7
75°	253.9	251.0	243.3	234.3	237.3
77.5°	202.5	196.4	193.4	188.8	184.4
80°	151.2	149.6	146.5	142.1	139.1
82.5°	102.8	102.8	101.4	95.2	95.2
85°	61.9	60.5	59.0	54.3	52.9
87.5°	27.3	24.2	21.2	16.7	15.0
90°	2.3	27.8	75.5	70.9	73.2
92.5°	47.8	64.7	67.1	69.3	69.3
95°	112.5	134.0	137.8	137.8	134.0
97.5°	187.2	207.2	215.7	215.7	215.7
100°	273.5	291.1	297.3	297.3	295.0
102.5°	364.4	377.5	385.9	388.2	385.9
105°	463.7	469.9	474.5	478.4	478.4
107.5°	562.3	571.6	571.6	573.1	562.3
110°	657.8	670.1	670.1	670.1	664.0

TEST NUMBER: P908150

CATALOG NUMBER: DFN2DIP-HX4F0-040D080US840-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	761.0	774.2	771.8	765.7	761.0
115°	862.7	875.0	871.2	868.9	862.7
117.5°	963.6	980.6	969.8	963.6	957.5
120°	1065.3	1082.3	1065.3	1065.3	1058.3
122.5°	1157.7	1179.3	1168.5	1162.4	1157.7
125°	1254.8	1274.0	1267.9	1260.9	1258.7
127.5°	1349.6	1373.4	1364.9	1355.7	1349.6
130°	1438.1	1465.8	1462.0	1457.4	1449.0
132.5°	1537.5	1559.0	1560.6	1549.8	1543.7
135°	1623.0	1646.9	1651.5	1649.2	1643.1
137.5°	1718.5	1737.8	1741.6	1740.1	1730.8
140°	1802.5	1821.7	1832.5	1832.5	1824.0
142.5°	1888.8	1908.0	1914.2	1916.5	1908.0
145°	1970.4	1985.8	1998.1	2000.4	1992.0
147.5°	2043.6	2062.9	2072.0	2076.0	2067.5
150°	2119.1	2132.1	2140.6	2147.6	2140.6
152.5°	2186.1	2199.2	2210.0	2218.5	2210.0
155°	2253.1	2259.3	2266.2	2276.9	2270.1
157.5°	2310.9	2315.5	2319.4	2334.7	2324.0
160°	2362.5	2367.1	2369.4	2382.5	2373.3
162.5°	2410.2	2410.2	2412.6	2427.2	2416.4
165°	2451.0	2448.7	2448.7	2464.2	2453.4
167.5°	2488.0	2481.1	2481.1	2496.5	2485.7
170°	2515.8	2509.6	2507.3	2522.7	2509.6
172.5°	2535.1	2528.9	2526.6	2541.9	2528.9
175°	2550.4	2544.3	2539.6	2555.1	2541.9
177.5°	2558.9	2552.7	2548.1	2561.2	2548.1
180°	2555.1	2555.1	2555.1	2555.1	2555.1

TEST NUMBER: P908150

CATALOG NUMBER: DFN2DIP-HX4F0-040D080US840-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.35	7.10	7.42	8.17	9.63	5.92	6.67	6.99	7.74	9.20
	3H	8.00	8.67	9.08	9.75	11.23	7.53	8.20	8.61	9.28	10.76
	4H	8.59	9.22	9.68	10.30	11.79	8.11	8.75	9.20	9.83	11.31
	6H	8.98	9.57	10.08	10.65	12.15	8.50	9.09	9.60	10.17	11.67
	8H	9.08	9.64	10.18	10.74	12.23	8.61	9.16	9.71	10.26	11.75
	12H	9.13	9.66	10.23	10.75	12.26	8.65	9.17	9.75	10.27	11.78
4H	2H	6.80	7.43	7.90	8.52	10.00	6.45	7.09	7.55	8.17	9.65
	3H	8.66	9.19	9.76	10.29	11.79	8.26	8.79	9.37	9.90	11.40
	4H	9.37	9.85	10.47	10.95	12.47	8.96	9.45	10.07	10.54	12.06
	6H	9.88	10.29	10.99	11.41	12.92	9.47	9.88	10.58	11.00	12.51
	8H	10.02	10.41	11.14	11.53	13.05	9.61	10.00	10.73	11.11	12.64
	12H	10.09	10.44	11.22	11.57	13.10	9.67	10.02	10.80	11.15	12.68
8H	4H	9.55	9.94	10.67	11.06	12.58	9.19	9.58	10.31	10.70	12.22
	6H	10.18	10.50	11.32	11.66	13.18	9.82	10.14	10.96	11.30	12.82
	8H	10.40	10.68	11.54	11.82	13.36	10.03	10.31	11.18	11.45	12.99
	12H	10.53	10.78	11.68	11.91	13.49	10.14	10.39	11.29	11.52	13.10
12H	4H	9.53	9.89	10.67	11.01	12.54	9.18	9.54	10.31	10.66	12.19
	6H	10.21	10.49	11.35	11.63	13.17	9.86	10.14	11.00	11.28	12.82
	8H	10.45	10.70	11.60	11.83	13.41	10.09	10.34	11.24	11.47	13.05

END OF REPORT