

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P908174

Luminaire Tested: DFN2DIP-HX4F0-050D110US840-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P908174
REPORT IS A COMBINATION OF REPORTS P899427 AND P896188
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-050D110US840-FLLFLL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14829.9 lumens
Efficiency: N/A
Efficacy: 136.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 108.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P908174

CATALOG NUMBER: DFN2DIP-HX4F0-050D110US840-FLLFLL

Luminous Intensity Polar Plot

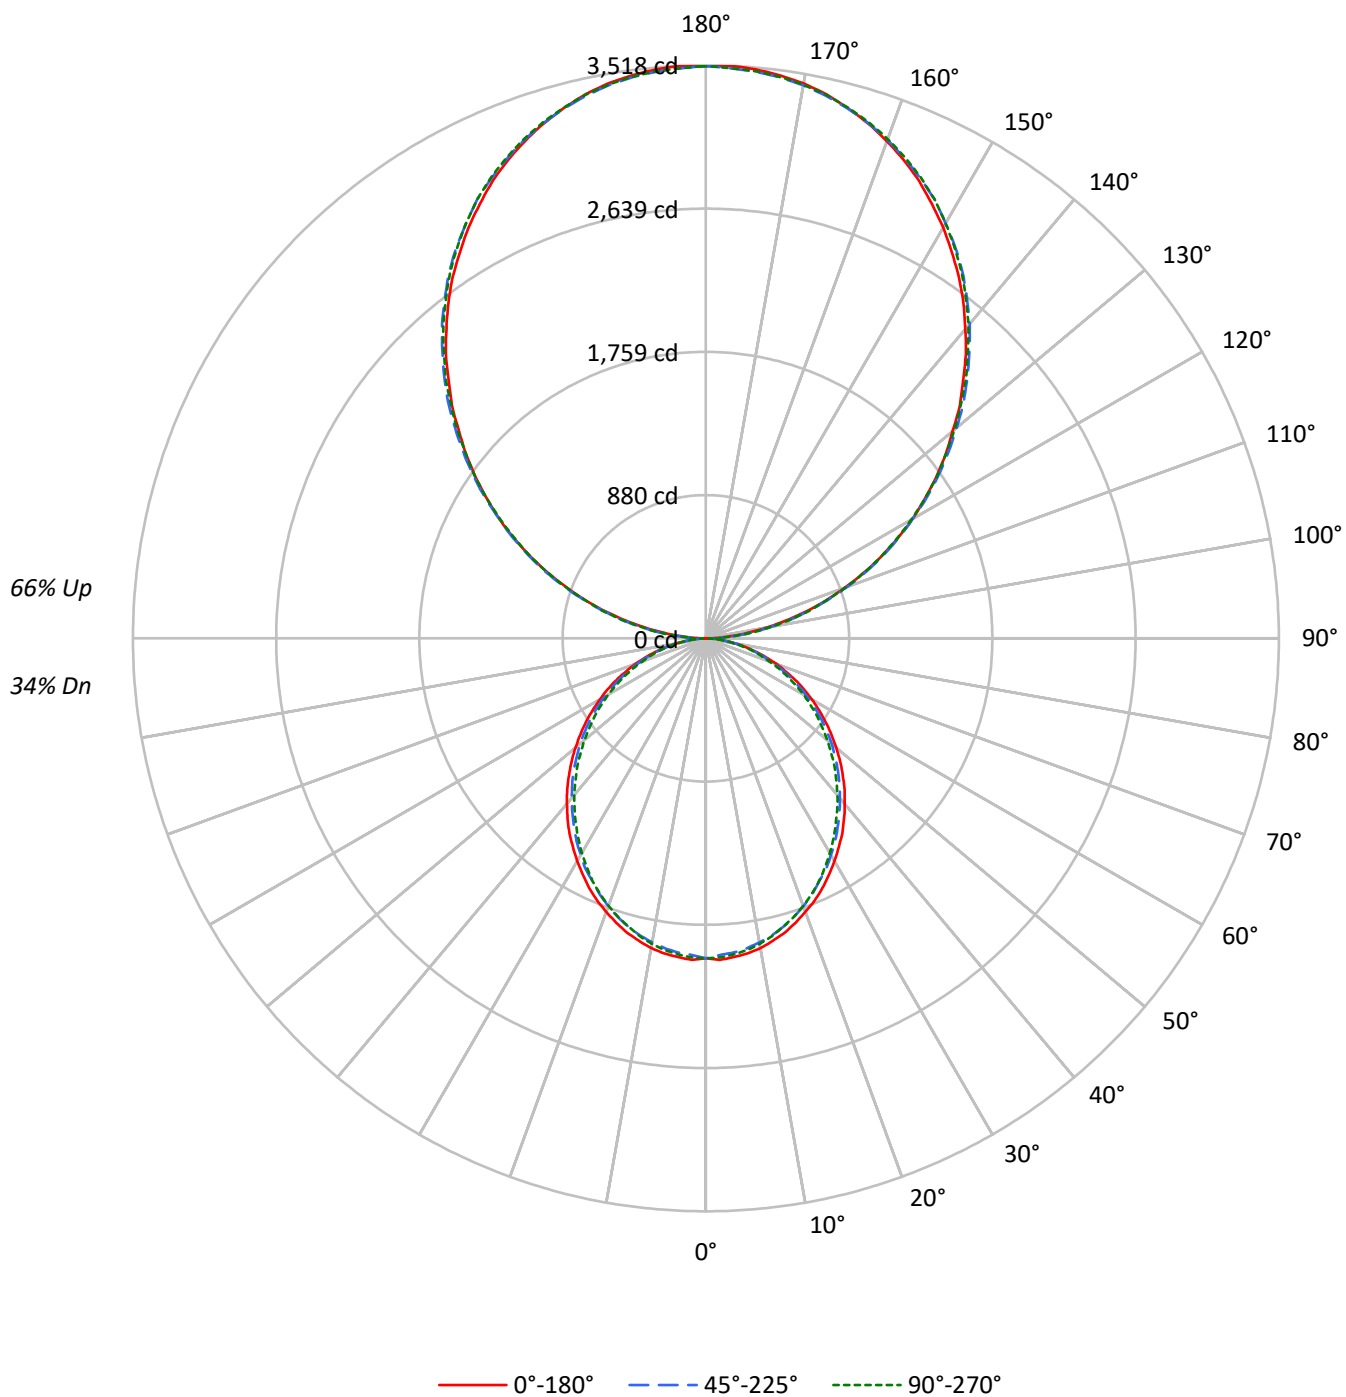

TEST NUMBER: P908174

CATALOG NUMBER: DFN2DIP-HX4F0-050D110US840-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	93	93	93	93	74	74	74	57	57	57	41	41	41
1	94	90	86	83	85	81	78	75	65	63	61	50	49	47	36	36	35
2	86	78	73	67	77	71	66	62	57	53	50	44	42	40	32	31	29
3	78	69	62	56	70	62	56	51	50	46	42	39	36	33	28	26	25
4	71	61	53	47	64	55	49	44	45	40	36	35	31	29	25	23	21
5	65	54	46	40	59	49	42	37	40	35	31	31	27	25	23	20	19
6	60	48	41	35	54	44	37	32	36	31	27	28	24	22	21	18	16
7	56	44	36	31	50	40	33	28	32	27	24	25	22	19	19	16	15
8	52	40	32	27	46	36	29	25	29	24	21	23	20	17	17	15	13
9	48	36	29	24	43	33	26	22	27	22	19	21	18	15	16	14	12
10	45	33	26	21	40	30	24	20	25	20	17	20	16	14	15	12	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1461	1461	1461
5°	1463	1441	1450
10°	1452	1421	1431
15°	1430	1398	1400
20°	1402	1366	1369
25°	1373	1327	1333
30°	1337	1291	1286
35°	1303	1248	1238
40°	1262	1206	1191
45°	1220	1163	1144
50°	1174	1117	1089
55°	1127	1065	1038
60°	1073	1003	981
65°	1014	939	912
70°	939	861	839
75°	835	767	771
80°	711	648	641
85°	516	441	426

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2649 cd/sqm

TEST NUMBER: P908174

CATALOG NUMBER: DFN2DIP-HX4F0-050D110US840-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	184.9	1.2
10°-20°	520.3	3.5
20°-30°	764.6	5.2
30°-40°	888.1	6.0
40°-50°	887.0	6.0
50°-60°	773.4	5.2
60°-70°	571.7	3.9
70°-80°	323.5	2.2
80°-90°	95.4	0.6
90°-100°	217.4	1.5
100°-110°	690.8	4.7
110°-120°	1182.1	8.0
120°-130°	1554.6	10.5
130°-140°	1745.0	11.8
140°-150°	1711.2	11.5
150°-160°	1435.4	9.7
160°-170°	951.9	6.4
170°-180°	332.7	2.2
0°-30°	1469.8	9.9
0°-40°	2357.9	15.9
0°-60°	4018.3	27.1
0°-90°	5008.8	33.8
90°-120°	2090.2	14.1
90°-150°	7101.0	47.9
90°-180°	9821.0	66.2
0°-180°	14829.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1965	1965	1965	1965	1965	
5°	1965	1957	1936	1952	1948	187
15°	1870	1859	1834	1842	1833	527
25°	1693	1678	1646	1649	1646	779
35°	1460	1442	1411	1400	1390	912
45°	1188	1175	1147	1126	1118	917
55°	899	888	865	843	833	804
65°	606	595	576	559	550	600
75°	317	314	304	293	297	339
85°	77	76	74	68	66	86
90°	3	38	104	98	101	14
95°	155	184	190	190	184	172
105°	638	646	652	658	658	673
115°	1186	1203	1198	1195	1186	1173
125°	1725	1752	1743	1734	1731	1542
135°	2232	2264	2271	2268	2259	1725
145°	2709	2730	2747	2751	2739	1693
155°	3098	3106	3116	3131	3121	1426
165°	3370	3367	3367	3388	3373	951
175°	3507	3498	3492	3513	3495	333
180°	3513	3513	3513	3513	3513	

TEST NUMBER: P908174

CATALOG NUMBER: DFN2DIP-HX4F0-050D110US840-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1964.7	1964.7	1964.7	1964.7	1964.7
2.5°	1976.1	1966.7	1945.9	1964.7	1961.2
5°	1964.7	1957.3	1936.4	1951.5	1947.9
7.5°	1951.5	1940.3	1919.5	1934.7	1930.9
10°	1930.9	1917.6	1895.0	1910.0	1904.4
12.5°	1902.4	1891.2	1868.6	1877.9	1874.1
15°	1870.3	1859.1	1834.4	1842.1	1832.6
17.5°	1830.6	1819.4	1794.7	1804.1	1794.7
20°	1787.2	1775.9	1749.5	1755.0	1747.7
22.5°	1743.8	1726.8	1702.1	1702.1	1698.3
25°	1692.7	1677.7	1645.6	1649.2	1645.6
27.5°	1636.0	1622.8	1598.3	1592.7	1583.3
30°	1579.4	1564.3	1536.0	1530.4	1522.8
32.5°	1518.9	1507.7	1477.4	1466.0	1458.4
35°	1460.4	1441.6	1411.3	1399.9	1390.5
37.5°	1394.2	1377.3	1347.0	1333.7	1324.3
40°	1326.4	1311.1	1280.8	1263.9	1256.4
42.5°	1260.2	1245.0	1214.9	1195.8	1184.6
45°	1188.4	1175.2	1146.7	1126.1	1118.4
47.5°	1118.4	1105.2	1075.0	1054.1	1042.9
50°	1044.7	1035.3	1008.9	982.4	972.9
52.5°	972.9	959.7	935.2	914.4	901.2
55°	899.4	888.0	865.3	842.6	833.2
57.5°	825.6	816.2	791.5	768.9	761.2
60°	751.8	744.5	718.0	697.1	691.6
62.5°	680.1	666.9	648.0	629.1	621.6
65°	606.5	595.1	576.2	559.3	549.8
67.5°	531.0	521.4	504.5	491.3	483.6
70°	461.0	453.4	436.4	423.1	415.8
72.5°	389.3	381.6	372.2	359.0	353.4
75°	317.3	313.7	304.1	292.9	296.7
77.5°	253.2	245.5	241.8	236.1	230.6
80°	189.0	187.0	183.2	177.6	173.8
82.5°	128.5	128.5	126.6	119.1	119.1
85°	77.4	75.5	73.7	68.0	66.1
87.5°	34.0	30.3	26.5	20.8	18.9
90°	3.1	38.2	103.8	97.5	100.6
92.5°	65.6	89.0	92.1	95.3	95.3
95°	154.6	184.3	189.6	189.6	184.3
97.5°	257.4	284.9	296.6	296.6	296.6
100°	376.0	400.3	408.8	408.8	405.7
102.5°	501.0	519.0	530.7	533.8	530.7
105°	637.6	646.1	652.5	657.7	657.7
107.5°	773.2	785.9	785.9	788.0	773.2
110°	904.5	921.5	921.5	921.5	913.0

TEST NUMBER: P908174

CATALOG NUMBER: DFN2DIP-HX4F0-050D110US840-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1046.4	1064.4	1061.3	1052.8	1046.4
115°	1186.3	1203.2	1197.9	1194.8	1186.3
117.5°	1325.0	1348.3	1333.4	1325.0	1316.6
120°	1464.8	1488.1	1464.8	1464.8	1455.3
122.5°	1592.0	1621.5	1606.7	1598.2	1592.0
125°	1725.4	1751.8	1743.3	1733.8	1730.6
127.5°	1855.6	1888.4	1876.8	1864.1	1855.6
130°	1977.4	2015.6	2010.2	2003.9	1992.3
132.5°	2114.1	2143.7	2145.9	2131.0	2122.5
135°	2231.6	2264.4	2270.8	2267.7	2259.2
137.5°	2363.0	2389.4	2394.7	2392.6	2380.0
140°	2478.4	2504.9	2519.7	2519.7	2508.1
142.5°	2597.1	2623.5	2632.0	2635.1	2623.5
145°	2709.3	2730.5	2747.4	2750.6	2739.0
147.5°	2810.0	2836.4	2849.1	2854.4	2842.8
150°	2913.8	2931.7	2943.4	2952.9	2943.4
152.5°	3005.9	3023.8	3038.7	3050.4	3038.7
155°	3098.1	3106.4	3116.0	3130.9	3121.3
157.5°	3177.4	3183.8	3189.1	3210.3	3195.4
160°	3248.4	3254.8	3257.9	3276.0	3263.3
162.5°	3314.1	3314.1	3317.3	3337.4	3322.6
165°	3370.2	3367.0	3367.0	3388.2	3373.4
167.5°	3421.0	3411.5	3411.5	3432.7	3417.9
170°	3459.2	3450.7	3447.6	3468.7	3450.7
172.5°	3485.7	3477.2	3474.0	3495.2	3477.2
175°	3506.9	3498.4	3492.0	3513.2	3495.2
177.5°	3518.5	3510.0	3503.6	3521.7	3503.6
180°	3513.2	3513.2	3513.2	3513.2	3513.2

TEST NUMBER: P908174

CATALOG NUMBER: DFN2DIP-HX4F0-050D110US840-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.86	7.60	7.95	8.68	10.17	6.43	7.16	7.52	8.25	9.73
	3H	8.52	9.17	9.61	10.26	11.77	8.04	8.70	9.14	9.79	11.29
	4H	9.10	9.72	10.20	10.81	12.32	8.62	9.25	9.73	10.34	11.85
	6H	9.49	10.06	10.60	11.16	12.68	9.02	9.59	10.13	10.69	12.21
	8H	9.59	10.14	10.71	11.25	12.77	9.12	9.66	10.23	10.78	12.29
	12H	9.64	10.16	10.76	11.26	12.80	9.16	9.67	10.28	10.78	12.32
4H	2H	7.31	7.93	8.42	9.03	10.54	6.97	7.59	8.08	8.68	10.19
	3H	9.17	9.69	10.28	10.81	12.33	8.77	9.29	9.89	10.41	11.93
	4H	9.88	10.35	11.00	11.46	13.00	9.47	9.95	10.59	11.06	12.60
	6H	10.38	10.79	11.51	11.93	13.46	9.97	10.38	11.10	11.52	13.05
	8H	10.53	10.91	11.66	12.04	13.59	10.12	10.50	11.25	11.63	13.18
	12H	10.60	10.94	11.74	12.08	13.64	10.18	10.52	11.32	11.66	13.22
8H	4H	10.06	10.44	11.19	11.57	13.12	9.70	10.08	10.83	11.21	12.76
	6H	10.69	11.01	11.84	12.17	13.72	10.33	10.64	11.48	11.81	13.36
	8H	10.91	11.19	12.07	12.33	13.90	10.54	10.82	11.70	11.96	13.53
	12H	11.04	11.28	12.20	12.42	14.02	10.65	10.89	11.81	12.04	13.64
12H	4H	10.04	10.39	11.19	11.53	13.08	9.69	10.04	10.84	11.17	12.73
	6H	10.72	10.99	11.87	12.14	13.71	10.37	10.64	11.52	11.79	13.36
	8H	10.96	11.20	12.11	12.34	13.94	10.60	10.84	11.76	11.98	13.59

END OF REPORT