

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P927604

Luminaire Tested: DFN2DIP-HX4F0-060D070US840-FLLONL

Issue Date: 12/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P927604
REPORT IS A COMBINATION OF REPORTS P900877 AND P896187
Test Lab: INNOVATION CENTER
Issue Date: 12/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-060D070US840-FLLONL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12996.1 lumens
Efficiency: N/A
Efficacy: 122.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 106.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.099
Total Harmonic Distortion (THDi): 0.979
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P927604

CATALOG NUMBER: DFN2DIP-HX4F0-060D070US840-FLLONL

Luminous Intensity Polar Plot

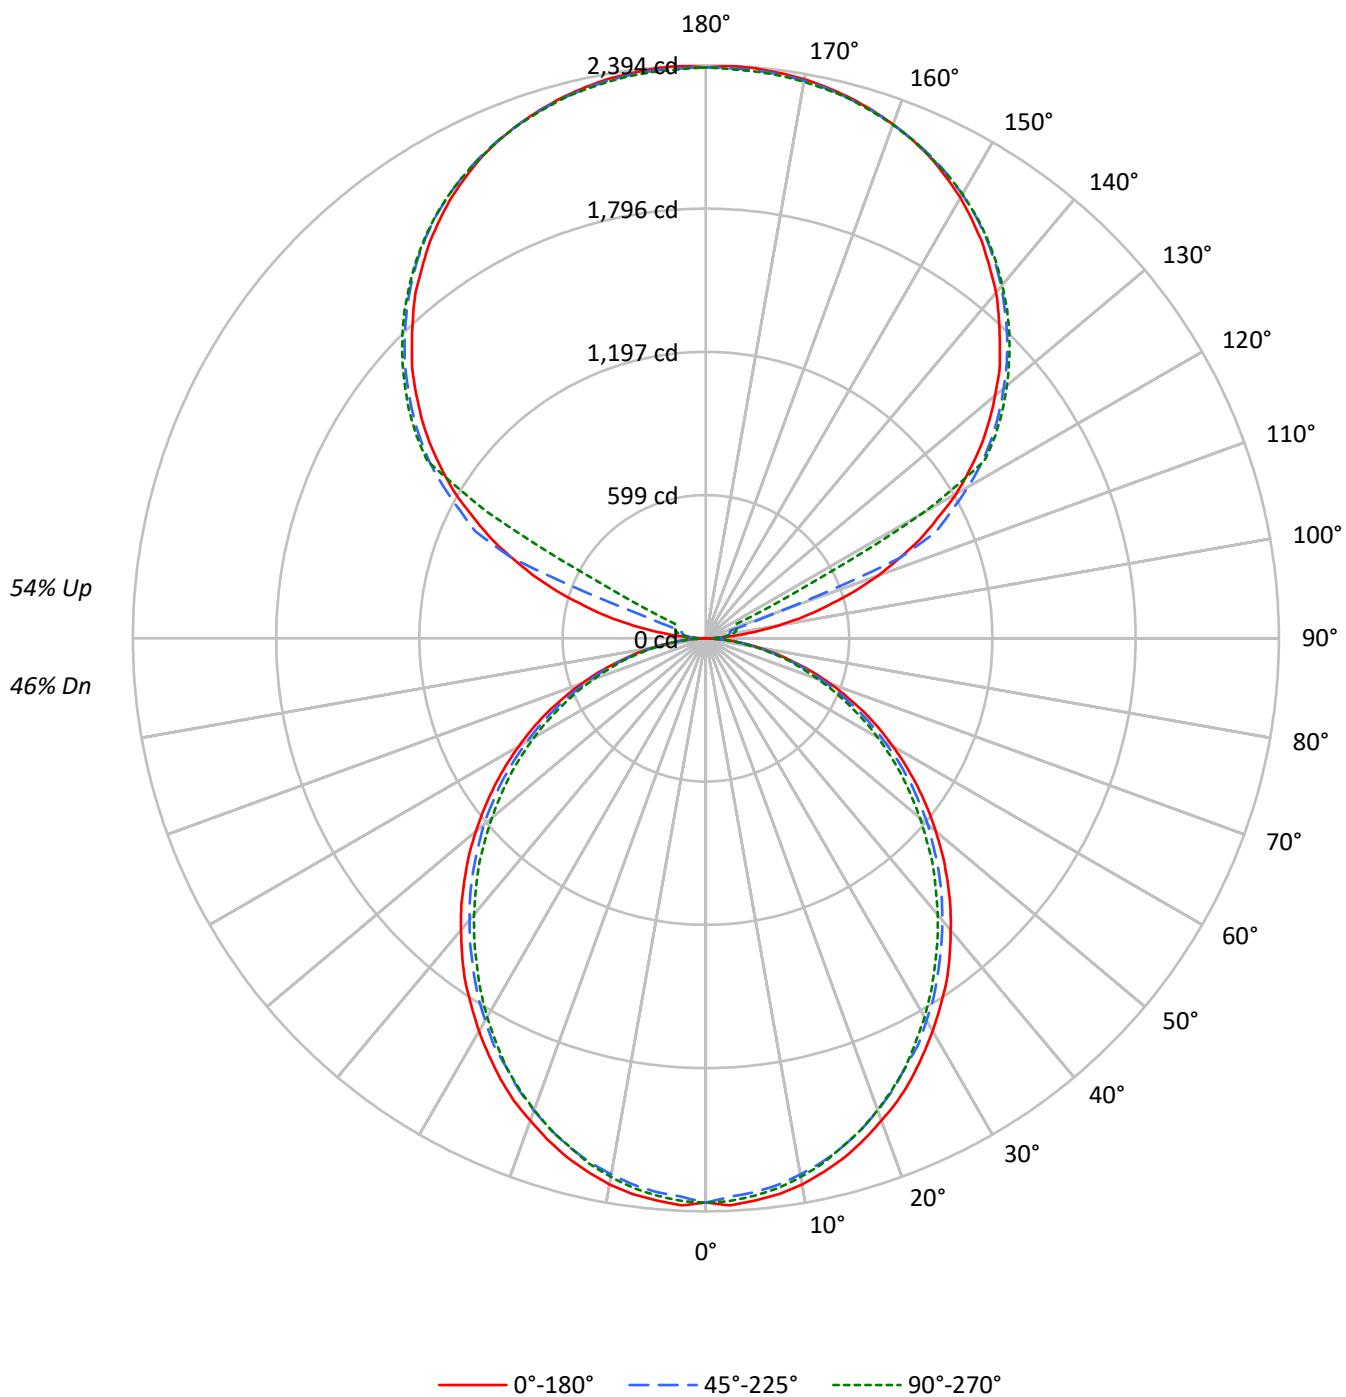

TEST NUMBER: P927604

CATALOG NUMBER: DFN2DIP-HX4F0-060D070US840-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53
1	97	93	89	85	89	85	82	79	71	69	67	58	57	55	46	45	44
2	88	81	75	70	81	74	69	65	62	59	55	51	48	46	41	39	37
3	81	71	64	58	74	66	59	54	55	50	46	45	42	39	36	34	32
4	74	63	55	49	67	58	51	46	49	44	40	40	37	33	32	30	27
5	68	56	48	42	62	52	45	39	44	38	34	36	32	29	29	26	24
6	62	50	42	36	57	46	39	34	39	34	30	33	29	25	26	23	21
7	58	45	37	32	53	42	35	30	36	30	26	30	26	22	24	21	19
8	53	41	33	28	49	38	31	26	33	27	23	27	23	20	22	19	17
9	50	38	30	25	46	35	28	24	30	24	21	25	21	18	21	17	15
10	46	34	27	22	43	32	26	21	27	22	19	23	19	16	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1753	1753	1753
5°	1756	1729	1740
10°	1742	1706	1717
15°	1716	1678	1680
20°	1682	1639	1643
25°	1648	1592	1599
30°	1605	1549	1544
35°	1564	1498	1485
40°	1514	1447	1429
45°	1464	1395	1372
50°	1409	1341	1306
55°	1352	1278	1246
60°	1287	1204	1176
65°	1217	1127	1094
70°	1127	1033	1006
75°	1002	920	925
80°	853	777	770
85°	619	529	512

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1464 cd/sqm

TEST NUMBER: P927604

CATALOG NUMBER: DFN2DIP-HX4F0-060D070US840-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	221.9	1.7
10°-20°	624.3	4.8
20°-30°	917.5	7.1
30°-40°	1065.6	8.2
40°-50°	1064.3	8.2
50°-60°	928.0	7.1
60°-70°	686.0	5.3
70°-80°	388.1	3.0
80°-90°	106.6	0.8
90°-100°	78.7	0.6
100°-110°	293.2	2.3
110°-120°	777.7	6.0
120°-130°	1289.9	9.9
130°-140°	1370.2	10.5
140°-150°	1273.4	9.8
150°-160°	1023.8	7.9
160°-170°	659.7	5.1
170°-180°	227.1	1.7
0°-30°	1763.7	13.6
0°-40°	2829.3	21.8
0°-60°	4821.6	37.1
0°-90°	6002.4	46.2
90°-120°	1149.6	8.8
90°-150°	5083.2	39.1
90°-180°	6994.0	53.8
0°-180°	12996.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2358	2358	2358	2358	2358	
5°	2358	2349	2324	2342	2337	224
15°	2244	2231	2201	2210	2199	632
25°	2031	2013	1975	1979	1975	935
35°	1752	1730	1693	1680	1668	1094
45°	1426	1410	1376	1351	1342	1101
55°	1079	1065	1038	1011	1000	965
65°	728	714	692	671	660	720
75°	381	376	365	351	356	406
85°	93	91	88	82	79	104
90°	2	21	34	43	47	12
95°	112	55	67	76	74	133
105°	525	577	105	124	131	561
115°	992	1022	1065	266	142	977
125°	1403	1426	1459	1471	1476	1252
135°	1737	1764	1780	1797	1794	1341
145°	2015	2013	2042	2054	2046	1260
155°	2218	2203	2223	2234	2220	1022
165°	2337	2327	2332	2344	2332	660
175°	2391	2379	2382	2394	2377	228
180°	2386	2386	2386	2386	2386	

TEST NUMBER: P927604

CATALOG NUMBER: DFN2DIP-HX4F0-060D070US840-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2357.5	2357.5	2357.5	2357.5	2357.5
2.5°	2371.2	2359.9	2334.9	2357.5	2353.1
5°	2357.5	2348.6	2323.5	2341.6	2337.3
7.5°	2341.6	2328.2	2303.2	2321.4	2316.9
10°	2316.9	2301.0	2273.8	2291.8	2285.1
12.5°	2282.8	2269.2	2242.1	2253.4	2248.8
15°	2244.2	2230.7	2201.2	2210.4	2199.0
17.5°	2196.6	2183.2	2153.6	2164.8	2153.6
20°	2144.4	2131.0	2099.2	2105.9	2097.1
22.5°	2092.5	2072.0	2042.4	2042.4	2037.9
25°	2031.1	2013.1	1974.6	1978.9	1974.6
27.5°	1963.1	1947.2	1917.8	1911.1	1899.8
30°	1895.3	1876.9	1843.1	1836.3	1827.1
32.5°	1822.6	1809.2	1772.8	1759.1	1750.0
35°	1752.4	1729.8	1693.4	1679.7	1668.4
37.5°	1673.0	1652.5	1616.3	1600.3	1589.0
40°	1591.4	1573.2	1536.9	1516.7	1507.5
42.5°	1512.1	1493.8	1457.7	1434.9	1421.4
45°	1426.0	1410.1	1376.0	1351.2	1342.0
47.5°	1342.0	1326.2	1289.9	1264.9	1251.3
50°	1253.6	1242.3	1210.5	1178.7	1167.4
52.5°	1167.4	1151.6	1122.2	1097.2	1081.4
55°	1079.2	1065.4	1038.3	1011.1	999.8
57.5°	990.7	979.4	949.8	922.7	913.5
60°	902.2	893.3	861.6	836.5	829.8
62.5°	816.0	800.2	777.5	754.9	745.8
65°	727.8	714.1	691.5	671.0	659.7
67.5°	637.1	625.6	605.4	589.5	580.3
70°	553.2	544.1	523.6	507.7	498.8
72.5°	467.0	457.9	446.6	430.8	424.0
75°	380.7	376.5	364.8	351.4	356.0
77.5°	303.7	294.7	290.0	283.3	276.6
80°	226.8	224.4	219.8	213.1	208.5
82.5°	154.2	154.2	152.0	142.9	142.9
85°	92.8	90.7	88.5	81.5	79.4
87.5°	40.9	36.4	31.7	25.0	22.6
90°	1.6	20.7	34.4	43.2	46.6
92.5°	43.2	36.3	41.4	44.9	46.6
95°	112.1	55.1	67.3	76.0	74.2
97.5°	201.9	60.5	88.0	93.3	94.9
100°	305.7	69.1	98.4	112.1	115.6
102.5°	419.4	416.1	101.9	120.8	126.0
105°	524.8	576.6	105.3	124.2	131.2
107.5°	647.3	690.4	108.9	127.7	134.7
110°	764.8	800.9	302.1	129.6	136.3

TEST NUMBER: P927604

CATALOG NUMBER: DFN2DIP-HX4F0-060D070US840-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	875.3	906.2	876.9	132.8	138.1
115°	992.5	1021.8	1065.0	265.9	141.7
117.5°	1094.4	1128.9	1158.3	911.3	459.2
120°	1208.3	1234.2	1265.4	1286.1	1053.0
122.5°	1304.9	1332.5	1367.3	1377.5	1379.3
125°	1403.3	1425.8	1458.7	1470.8	1475.8
127.5°	1493.1	1517.2	1543.3	1560.5	1562.2
130°	1577.7	1605.4	1624.3	1643.3	1641.7
132.5°	1664.0	1686.6	1705.5	1721.0	1719.4
135°	1736.6	1764.2	1779.7	1797.0	1793.6
137.5°	1812.4	1833.2	1850.6	1867.8	1862.7
140°	1886.6	1900.5	1919.4	1935.0	1926.4
142.5°	1948.9	1961.0	1983.3	1997.1	1988.5
145°	2014.6	2012.7	2042.0	2054.1	2045.6
147.5°	2071.3	2066.3	2095.5	2104.1	2097.4
150°	2126.6	2114.6	2142.3	2152.5	2143.9
152.5°	2173.2	2159.5	2185.3	2195.7	2183.7
155°	2218.1	2202.7	2223.4	2233.7	2219.9
157.5°	2254.4	2240.6	2256.2	2268.3	2254.4
160°	2285.6	2275.1	2285.6	2295.8	2283.7
162.5°	2313.0	2302.7	2311.3	2323.4	2307.9
165°	2337.2	2327.0	2332.0	2344.1	2332.0
167.5°	2356.3	2345.8	2351.1	2363.2	2347.7
170°	2371.8	2361.4	2364.9	2377.0	2361.4
172.5°	2382.1	2371.8	2375.4	2387.4	2371.8
175°	2390.7	2378.6	2382.1	2394.1	2377.0
177.5°	2394.1	2382.1	2383.9	2396.1	2380.4
180°	2385.6	2385.6	2385.6	2385.6	2385.6

TEST NUMBER: P927604

CATALOG NUMBER: DFN2DIP-HX4F0-060D070US840-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.86	9.69	9.85	10.69	12.01	8.43	9.26	9.42	10.26	11.58
	3H	10.52	11.26	11.52	12.27	13.62	10.05	10.79	11.05	11.80	13.14
	4H	11.11	11.81	12.12	12.82	14.18	10.63	11.33	11.64	12.35	13.70
	6H	11.50	12.15	12.53	13.17	14.54	11.03	11.68	12.05	12.69	14.06
	8H	11.61	12.22	12.64	13.26	14.62	11.13	11.75	12.16	12.78	14.15
	12H	11.66	12.24	12.69	13.27	14.66	11.17	11.76	12.21	12.79	14.18
4H	2H	9.32	10.02	10.34	11.03	12.39	8.97	9.68	9.99	10.69	12.04
	3H	11.18	11.77	12.21	12.81	14.18	10.79	11.38	11.82	12.42	13.78
	4H	11.90	12.43	12.93	13.47	14.86	11.49	12.03	12.53	13.06	14.45
	6H	12.41	12.87	13.46	13.93	15.32	12.00	12.46	13.05	13.52	14.91
	8H	12.56	12.99	13.61	14.04	15.44	12.15	12.58	13.19	13.63	15.03
	12H	12.63	13.02	13.70	14.09	15.49	12.21	12.60	13.27	13.66	15.07
8H	4H	12.09	12.52	13.14	13.57	14.97	11.73	12.16	12.78	13.21	14.61
	6H	12.72	13.08	13.79	14.17	15.57	12.36	12.72	13.43	13.81	15.21
	8H	12.94	13.26	14.02	14.33	15.75	12.57	12.89	13.65	13.96	15.38
	12H	13.07	13.35	14.15	14.42	15.88	12.69	12.96	13.77	14.04	15.49
12H	4H	12.07	12.47	13.14	13.53	14.94	11.72	12.11	12.79	13.18	14.58
	6H	12.75	13.07	13.83	14.14	15.56	12.40	12.71	13.48	13.79	15.21
	8H	12.99	13.27	14.07	14.34	15.80	12.64	12.91	13.72	13.98	15.44

END OF REPORT