

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P908194

Luminaire Tested: DFN2DIP-HX4F0-060D120US840-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P908194
REPORT IS A COMBINATION OF REPORTS P899447 AND P896188
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-060D120US840-FLLFLL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16723.4 lumens
Efficiency: N/A
Efficacy: 131.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 127.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.099
Total Harmonic Distortion (THDi): 0.979
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P908194

CATALOG NUMBER: DFN2DIP-HX4F0-060D120US840-FLLFLL

Luminous Intensity Polar Plot

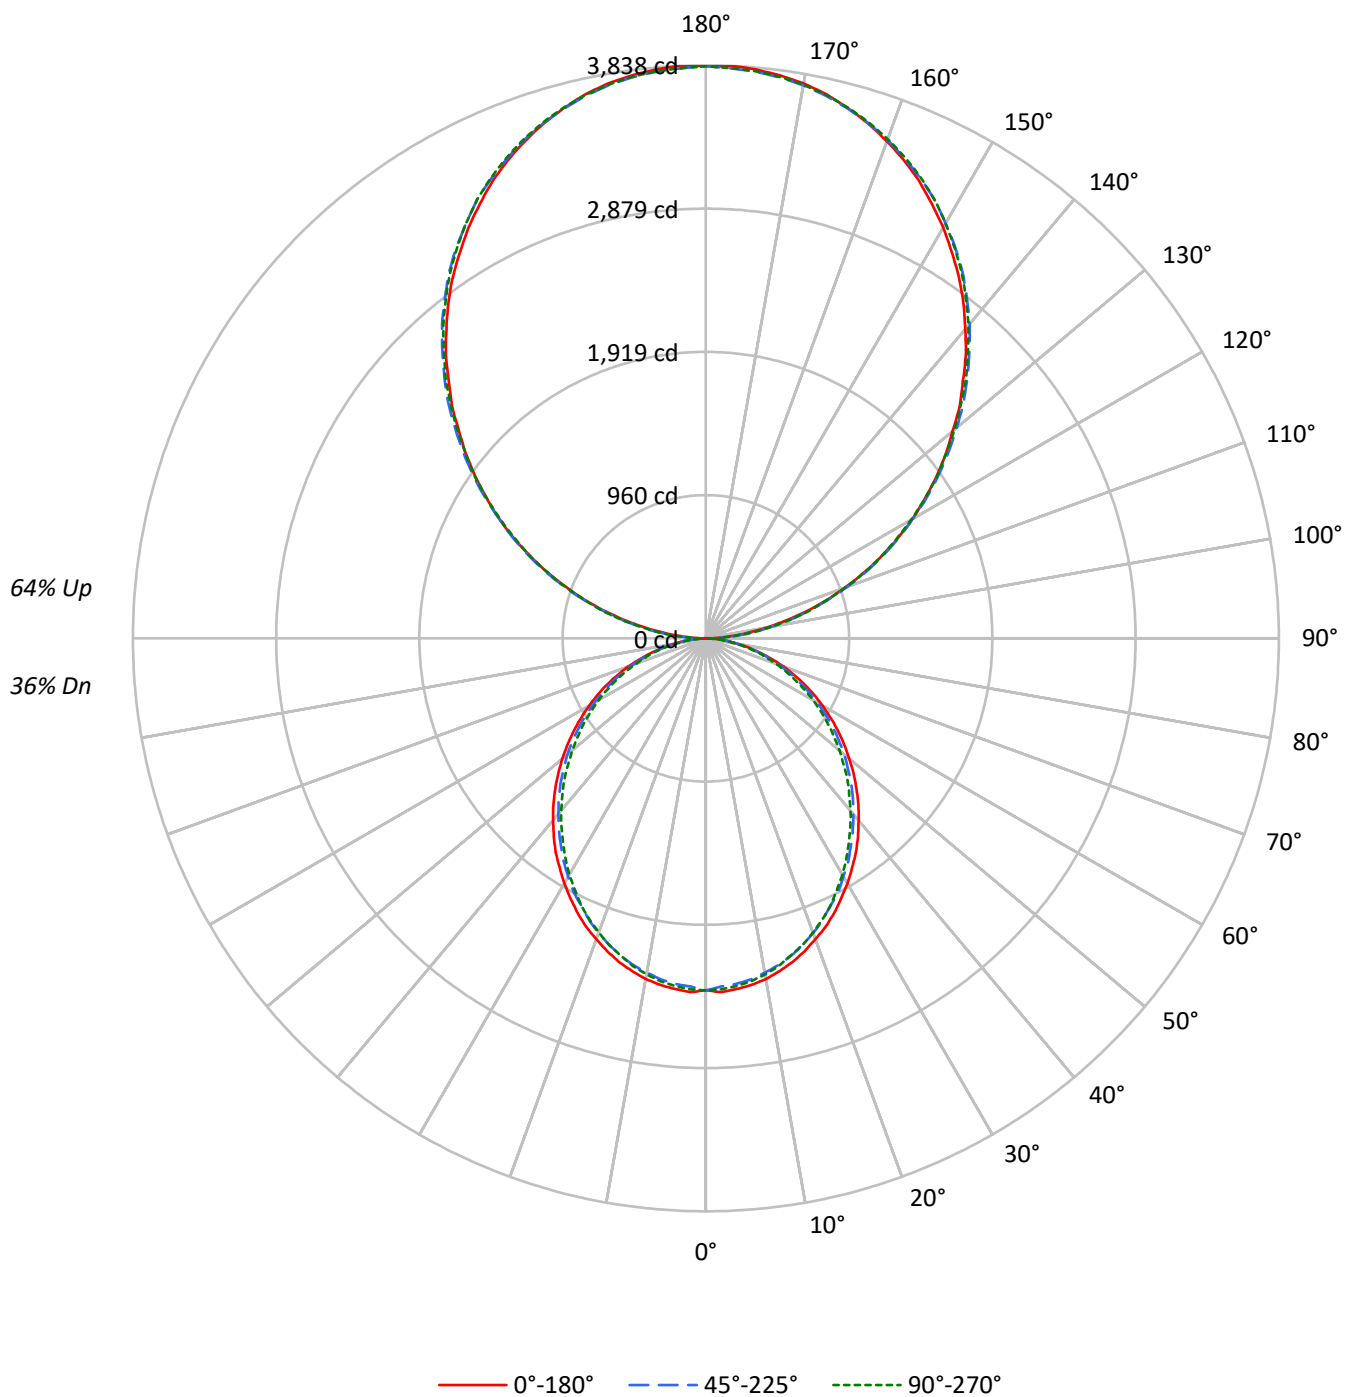

TEST NUMBER: P908194

CATALOG NUMBER: DFN2DIP-HX4F0-060D120US840-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	76	76	76	59	59	59	43	43	43
1	95	90	87	83	85	82	79	76	66	64	62	52	50	49	38	37	36
2	86	79	73	68	78	72	66	62	58	54	51	45	43	41	34	32	31
3	79	69	62	56	71	63	57	52	51	47	43	40	37	34	30	28	26
4	72	61	54	48	65	56	49	44	45	40	37	36	32	29	27	24	22
5	66	54	47	41	59	50	43	38	40	35	31	32	28	25	24	22	20
6	61	49	41	35	55	45	38	33	36	31	27	29	25	22	22	19	17
7	56	44	36	31	50	40	33	28	33	28	24	26	22	20	20	17	15
8	52	40	32	27	47	36	30	25	30	25	21	24	20	17	18	16	14
9	48	36	29	24	44	33	27	22	27	22	19	22	18	16	17	14	12
10	45	33	26	21	41	30	24	20	25	20	17	20	17	14	16	13	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1753	1753	1753
5°	1756	1729	1740
10°	1742	1706	1717
15°	1716	1678	1680
20°	1682	1639	1643
25°	1648	1592	1599
30°	1605	1549	1544
35°	1564	1498	1485
40°	1514	1447	1429
45°	1464	1395	1373
50°	1409	1341	1307
55°	1352	1278	1246
60°	1287	1204	1176
65°	1217	1127	1094
70°	1127	1033	1007
75°	1002	920	925
80°	853	777	770
85°	619	529	512

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2891 cd/sqm

TEST NUMBER: P908194

CATALOG NUMBER: DFN2DIP-HX4F0-060D120US840-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	221.9	1.3
10°-20°	624.4	3.7
20°-30°	917.5	5.5
30°-40°	1065.7	6.4
40°-50°	1064.4	6.4
50°-60°	928.1	5.5
60°-70°	686.1	4.1
70°-80°	388.2	2.3
80°-90°	113.3	0.7
90°-100°	237.2	1.4
100°-110°	753.5	4.5
110°-120°	1289.5	7.7
120°-130°	1696.0	10.1
130°-140°	1903.6	11.4
140°-150°	1866.7	11.2
150°-160°	1565.9	9.4
160°-170°	1038.5	6.2
170°-180°	363.0	2.2
0°-30°	1763.8	10.5
0°-40°	2829.5	16.9
0°-60°	4821.9	28.8
0°-90°	6009.5	35.9
90°-120°	2280.2	13.6
90°-150°	7746.5	46.3
90°-180°	10714.0	64.1
0°-180°	16723.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2358	2358	2358	2358	2358	
5°	2358	2349	2324	2342	2337	224
15°	2244	2231	2201	2210	2199	632
25°	2031	2013	1975	1979	1975	935
35°	1752	1730	1694	1680	1668	1094
45°	1426	1410	1376	1351	1342	1101
55°	1079	1066	1038	1011	1000	965
65°	728	714	692	671	660	720
75°	381	376	365	351	356	406
85°	93	91	88	82	79	104
90°	3	42	113	106	110	16
95°	169	201	207	207	201	188
105°	696	705	712	718	718	734
115°	1294	1313	1307	1303	1294	1280
125°	1882	1911	1902	1892	1888	1682
135°	2434	2470	2477	2474	2465	1882
145°	2956	2979	2997	3001	2988	1847
155°	3380	3389	3399	3416	3405	1556
165°	3677	3673	3673	3696	3680	1037
175°	3826	3816	3810	3832	3813	363
180°	3832	3832	3832	3832	3832	

TEST NUMBER: P908194

CATALOG NUMBER: DFN2DIP-HX4F0-060D120US840-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2357.6	2357.6	2357.6	2357.6	2357.6
2.5°	2371.4	2360.1	2335.0	2357.6	2353.3
5°	2357.6	2348.7	2323.7	2341.8	2337.4
7.5°	2341.8	2328.3	2303.3	2321.6	2317.0
10°	2317.0	2301.2	2273.9	2292.0	2285.2
12.5°	2282.9	2269.4	2242.2	2253.5	2249.0
15°	2244.3	2230.9	2201.3	2210.5	2199.2
17.5°	2196.8	2183.3	2153.7	2164.9	2153.7
20°	2144.6	2131.1	2099.3	2106.1	2097.2
22.5°	2092.6	2072.1	2042.6	2042.6	2038.0
25°	2031.2	2013.3	1974.7	1979.0	1974.7
27.5°	1963.2	1947.3	1917.9	1911.3	1900.0
30°	1895.4	1877.0	1843.2	1836.4	1827.3
32.5°	1822.7	1809.3	1772.9	1759.2	1750.1
35°	1752.5	1729.9	1693.5	1679.8	1668.5
37.5°	1673.1	1652.6	1616.4	1600.4	1589.1
40°	1591.5	1573.3	1537.0	1516.8	1507.6
42.5°	1512.2	1493.9	1457.8	1435.0	1421.5
45°	1426.1	1410.2	1376.0	1351.3	1342.1
47.5°	1342.1	1326.3	1290.0	1265.0	1251.4
50°	1253.6	1242.3	1210.6	1178.8	1167.5
52.5°	1167.5	1151.7	1122.3	1097.3	1081.5
55°	1079.2	1065.5	1038.3	1011.2	999.9
57.5°	990.8	979.5	949.9	922.7	913.5
60°	902.2	893.3	861.6	836.6	829.8
62.5°	816.1	800.2	777.6	755.0	745.9
65°	727.8	714.2	691.6	671.1	659.7
67.5°	637.1	625.6	605.4	589.6	580.4
70°	553.2	544.1	523.6	507.8	498.9
72.5°	467.1	458.0	446.7	430.8	424.0
75°	380.7	376.5	364.9	351.4	356.0
77.5°	303.8	294.7	290.0	283.4	276.6
80°	226.8	224.4	219.8	213.1	208.5
82.5°	154.2	154.2	152.0	142.9	142.9
85°	92.8	90.7	88.5	81.5	79.4
87.5°	40.9	36.4	31.7	25.0	22.6
90°	3.4	41.6	113.2	106.3	109.8
92.5°	71.6	97.0	100.5	104.0	104.0
95°	168.6	201.1	206.8	206.8	201.1
97.5°	280.7	310.8	323.6	323.6	323.6
100°	410.2	436.8	446.0	446.0	442.5
102.5°	546.5	566.1	578.9	582.4	578.9
105°	695.6	704.8	711.8	717.5	717.5
107.5°	843.4	857.4	857.4	859.6	843.4
110°	986.7	1005.2	1005.2	1005.2	996.0

TEST NUMBER: P908194

CATALOG NUMBER: DFN2DIP-HX4F0-060D120US840-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1141.6	1161.2	1157.7	1148.5	1141.6
115°	1294.0	1312.6	1306.8	1303.3	1294.0
117.5°	1445.4	1470.9	1454.7	1445.4	1436.2
120°	1598.0	1623.4	1598.0	1598.0	1587.6
122.5°	1736.7	1769.0	1752.8	1743.5	1736.7
125°	1882.2	1911.1	1901.9	1891.5	1887.9
127.5°	2024.4	2060.1	2047.4	2033.6	2024.4
130°	2157.2	2198.8	2193.0	2186.1	2173.3
132.5°	2306.2	2338.6	2340.9	2324.7	2315.5
135°	2434.5	2470.3	2477.3	2473.8	2464.6
137.5°	2577.8	2606.7	2612.4	2610.1	2596.3
140°	2703.7	2732.6	2748.8	2748.8	2736.0
142.5°	2833.2	2862.1	2871.2	2874.7	2862.1
145°	2955.6	2978.7	2997.2	3000.7	2988.0
147.5°	3065.3	3094.2	3108.2	3113.9	3101.2
150°	3178.7	3198.2	3211.0	3221.4	3211.0
152.5°	3279.1	3298.7	3315.0	3327.7	3315.0
155°	3379.6	3388.9	3399.3	3415.5	3405.1
157.5°	3466.4	3473.2	3479.0	3502.1	3486.0
160°	3543.7	3550.7	3554.1	3573.8	3559.9
162.5°	3615.3	3615.3	3618.9	3640.8	3624.6
165°	3676.6	3673.2	3673.2	3696.2	3680.1
167.5°	3732.1	3721.7	3721.7	3744.8	3728.6
170°	3773.7	3764.4	3760.9	3784.1	3764.4
172.5°	3802.5	3793.3	3789.8	3812.9	3793.3
175°	3825.7	3816.4	3809.5	3832.5	3812.9
177.5°	3838.4	3829.1	3822.1	3841.8	3822.1
180°	3832.5	3832.5	3832.5	3832.5	3832.5

TEST NUMBER: P908194

CATALOG NUMBER: DFN2DIP-HX4F0-060D120US840-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.76	8.51	8.83	9.58	11.04	7.33	8.08	8.40	9.15	10.60
	3H	9.41	10.08	10.49	11.16	12.64	8.94	9.61	10.02	10.69	12.17
	4H	9.99	10.63	11.08	11.71	13.19	9.52	10.16	10.61	11.24	12.72
	6H	10.39	10.97	11.49	12.06	13.55	9.91	10.50	11.01	11.58	13.08
	8H	10.49	11.05	11.59	12.15	13.64	10.02	10.57	11.12	11.67	13.16
	12H	10.54	11.06	11.64	12.16	13.67	10.05	10.58	11.16	11.68	13.19
4H	2H	8.21	8.84	9.30	9.92	11.41	7.86	8.50	8.96	9.58	11.06
	3H	10.06	10.59	11.17	11.70	13.20	9.67	10.20	10.77	11.31	12.81
	4H	10.77	11.26	11.88	12.36	13.88	10.37	10.86	11.48	11.95	13.47
	6H	11.28	11.70	12.40	12.82	14.33	10.87	11.29	11.99	12.41	13.92
	8H	11.43	11.82	12.55	12.93	14.46	11.02	11.41	12.13	12.52	14.05
	12H	11.50	11.85	12.63	12.98	14.51	11.08	11.43	12.21	12.56	14.09
8H	4H	10.96	11.35	12.08	12.47	13.99	10.60	10.99	11.72	12.11	13.63
	6H	11.59	11.91	12.73	13.07	14.59	11.23	11.55	12.36	12.70	14.23
	8H	11.81	12.09	12.95	13.23	14.77	11.44	11.72	12.58	12.86	14.40
	12H	11.94	12.19	13.08	13.32	14.90	11.55	11.80	12.70	12.93	14.51
12H	4H	10.94	11.30	12.08	12.42	13.95	10.59	10.94	11.72	12.07	13.60
	6H	11.62	11.90	12.76	13.04	14.58	11.27	11.55	12.41	12.69	14.23
	8H	11.86	12.11	13.00	13.24	14.82	11.50	11.75	12.65	12.88	14.46