

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P908202

Luminaire Tested: DFN2DIP-HX4F0-070D070US840-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P908202
REPORT IS A COMBINATION OF REPORTS P899359 AND P896188
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-070D070US840-FLLFLL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13254.5 lumens
Efficiency: N/A
Efficacy: 125.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 105.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P908202

CATALOG NUMBER: DFN2DIP-HX4F0-070D070US840-FLLFLL

Luminous Intensity Polar Plot

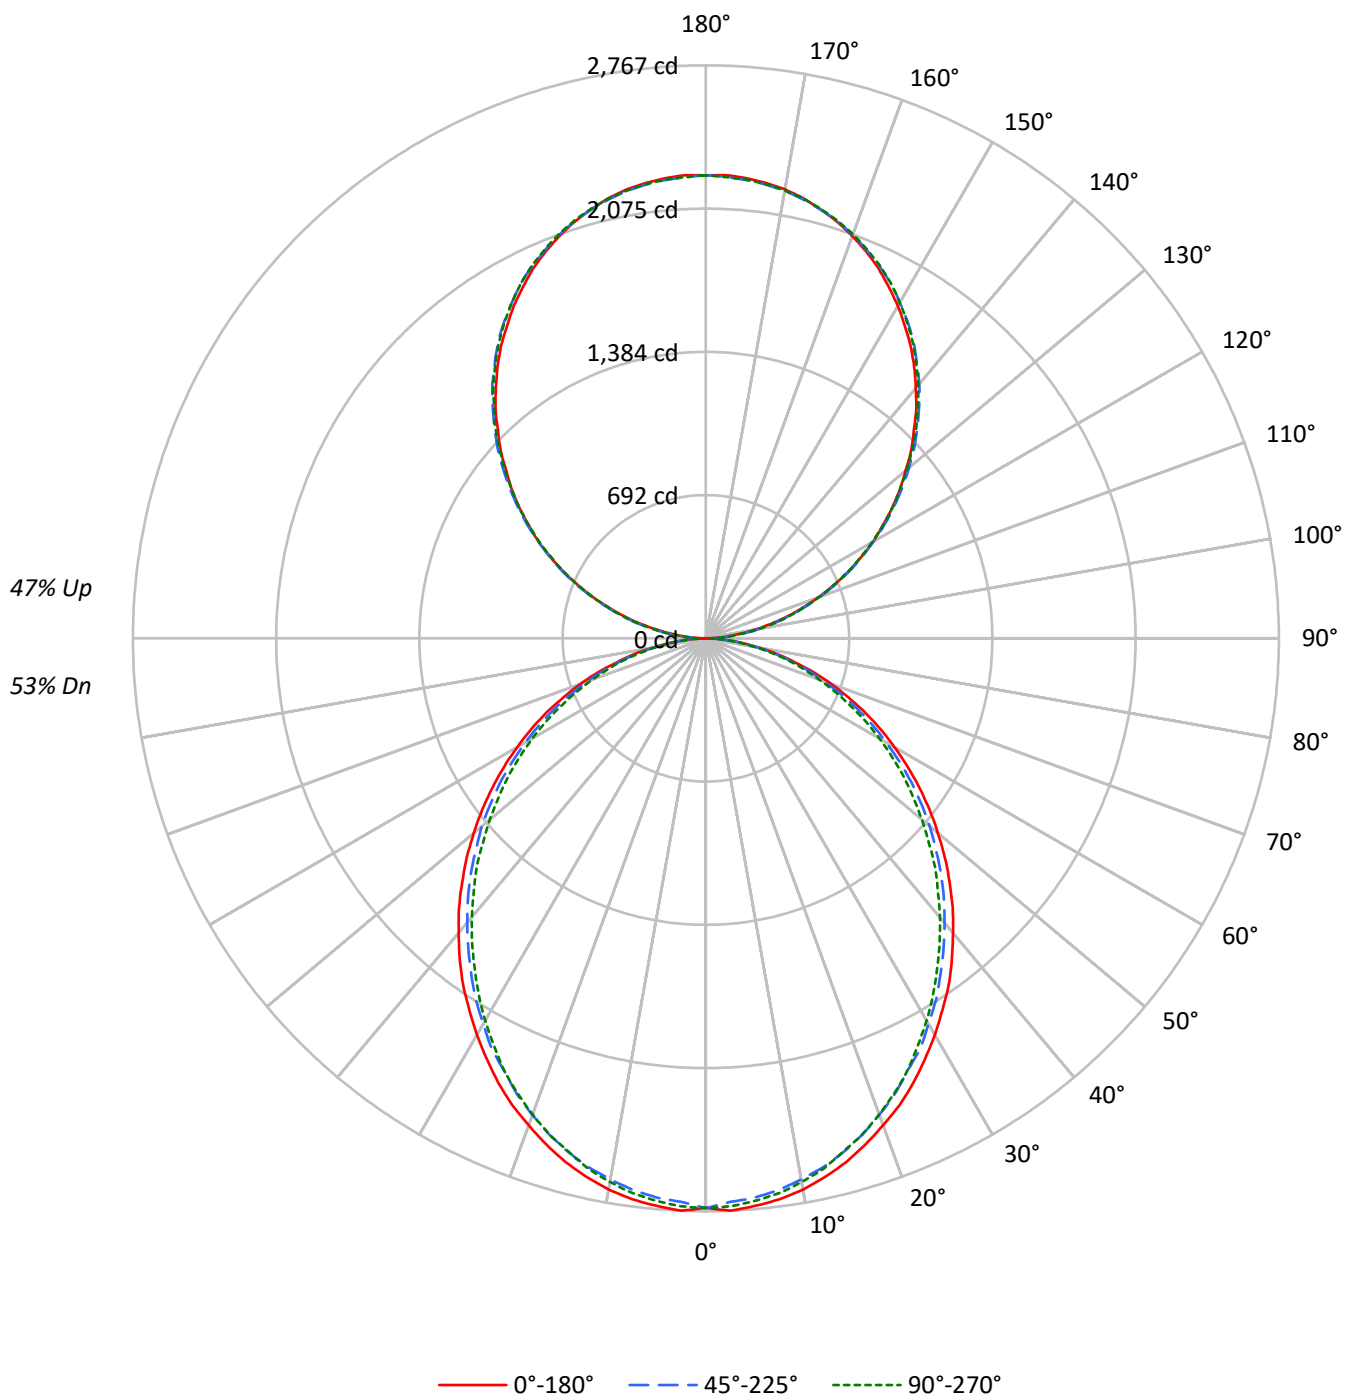

TEST NUMBER: P908202

CATALOG NUMBER: DFN2DIP-HX4F0-070D070US840-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85		71	71	71		59
1	98	94	90	87	91	87	84	81	74	72	70		63	61	59		52
2	90	82	76	71	83	76	71	66	65	61	58		55	52	50		46
3	82	72	65	59	75	67	61	55	58	53	49		49	45	42		41
4	75	64	56	50	69	60	52	47	51	46	41		43	39	36		36
5	69	57	49	43	63	53	46	40	46	40	36		39	35	31		33
6	63	51	43	37	58	48	40	35	41	36	31		35	31	27		30
7	59	46	38	33	54	43	36	31	37	32	28		32	28	24		27
8	54	42	34	29	50	39	32	27	34	29	24		29	25	22		25
9	51	38	31	26	47	36	29	24	31	26	22		27	23	19		23
10	47	35	28	23	44	33	26	22	29	23	20		25	21	18		21

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2045	2045	2045
5°	2049	2017	2030
10°	2032	1990	2003
15°	2003	1957	1960
20°	1962	1912	1916
25°	1922	1858	1866
30°	1872	1807	1801
35°	1825	1748	1733
40°	1766	1688	1668
45°	1708	1628	1601
50°	1644	1564	1524
55°	1577	1491	1454
60°	1502	1404	1373
65°	1420	1314	1277
70°	1315	1205	1174
75°	1169	1074	1080
80°	995	907	898
85°	723	618	597

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1708 cd/sqm

TEST NUMBER: P908202

CATALOG NUMBER: DFN2DIP-HX4F0-070D070US840-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	258.9	2.0
10°-20°	728.4	5.5
20°-30°	1070.5	8.1
30°-40°	1243.3	9.4
40°-50°	1241.7	9.4
50°-60°	1082.8	8.2
60°-70°	800.4	6.0
70°-80°	452.9	3.4
80°-90°	125.9	0.9
90°-100°	138.3	1.0
100°-110°	439.6	3.3
110°-120°	752.2	5.7
120°-130°	989.3	7.5
130°-140°	1110.5	8.4
140°-150°	1088.9	8.2
150°-160°	913.5	6.9
160°-170°	605.8	4.6
170°-180°	211.7	1.6
0°-30°	2057.8	15.5
0°-40°	3301.1	24.9
0°-60°	5625.6	42.4
0°-90°	7004.7	52.8
90°-120°	1330.1	10.0
90°-150°	4518.8	34.1
90°-180°	6250.0	47.2
0°-180°	13254.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2751	2751	2751	2751	2751	
5°	2751	2740	2711	2732	2727	261
15°	2618	2603	2568	2579	2566	737
25°	2370	2349	2304	2309	2304	1090
35°	2045	2018	1976	1960	1947	1277
45°	1664	1645	1605	1576	1566	1284
55°	1259	1243	1211	1180	1166	1126
65°	849	833	807	783	770	840
75°	444	439	426	410	415	474
85°	108	106	103	95	93	121
90°	2	24	66	62	64	13
95°	98	117	121	121	117	109
105°	406	411	415	419	419	428
115°	755	766	762	760	755	747
125°	1098	1115	1109	1103	1101	981
135°	1420	1441	1445	1443	1438	1098
145°	1724	1738	1748	1750	1743	1077
155°	1972	1977	1983	1992	1986	907
165°	2145	2143	2143	2156	2147	605
175°	2232	2226	2222	2236	2224	212
180°	2236	2236	2236	2236	2236	

TEST NUMBER: P908202

CATALOG NUMBER: DFN2DIP-HX4F0-070D070US840-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2750.6	2750.6	2750.6	2750.6	2750.6
2.5°	2766.6	2753.4	2724.2	2750.6	2745.5
5°	2750.6	2740.3	2711.1	2732.1	2727.0
7.5°	2732.1	2716.3	2687.2	2708.6	2703.2
10°	2703.2	2684.6	2652.9	2674.0	2666.1
12.5°	2663.3	2647.7	2616.0	2629.1	2623.7
15°	2618.5	2602.7	2568.2	2578.9	2565.7
17.5°	2562.8	2547.2	2512.6	2525.9	2512.6
20°	2501.9	2486.3	2449.2	2457.1	2446.7
22.5°	2441.3	2417.5	2383.0	2383.0	2377.6
25°	2369.9	2348.7	2303.9	2309.0	2303.9
27.5°	2290.4	2271.9	2237.7	2229.8	2216.6
30°	2211.3	2189.9	2150.4	2142.5	2131.8
32.5°	2126.5	2110.8	2068.4	2052.5	2041.7
35°	2044.6	2018.2	1975.8	1959.8	1946.6
37.5°	1952.0	1928.1	1885.7	1867.2	1854.0
40°	1856.8	1835.5	1793.1	1769.6	1758.9
42.5°	1764.2	1742.9	1700.8	1674.2	1658.4
45°	1663.8	1645.3	1605.4	1576.5	1565.8
47.5°	1565.8	1547.3	1504.9	1475.7	1460.1
50°	1462.6	1449.4	1412.3	1375.3	1362.1
52.5°	1362.1	1343.6	1309.4	1280.2	1261.6
55°	1259.1	1243.1	1211.4	1179.7	1166.5
57.5°	1155.9	1142.7	1108.1	1076.4	1065.8
60°	1052.6	1042.2	1005.2	976.0	968.2
62.5°	952.1	933.6	907.3	880.9	870.2
65°	849.2	833.1	806.8	782.9	769.7
67.5°	743.4	729.9	706.3	687.8	677.1
70°	645.4	634.8	610.9	592.4	582.0
72.5°	544.9	534.3	521.1	502.6	494.7
75°	444.2	439.2	425.7	410.0	415.4
77.5°	354.5	343.8	338.4	330.5	322.8
80°	264.6	261.9	256.5	248.6	243.3
82.5°	179.9	179.9	177.3	166.7	166.7
85°	108.4	105.8	103.3	95.1	92.6
87.5°	47.7	42.4	37.1	29.2	26.4
90°	2.0	24.2	66.0	62.0	64.0
92.5°	41.8	56.7	58.7	60.7	60.7
95°	98.4	117.2	120.7	120.7	117.2
97.5°	163.8	181.3	188.7	188.7	188.7
100°	239.2	254.8	260.1	260.1	258.1
102.5°	318.8	330.2	337.7	339.7	337.7
105°	405.8	411.1	415.2	418.6	418.6
107.5°	492.0	500.1	500.1	501.5	492.0
110°	575.6	586.4	586.4	586.4	581.0

TEST NUMBER: P908202

CATALOG NUMBER: DFN2DIP-HX4F0-070D070US840-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	665.9	677.4	675.4	669.9	665.9
115°	754.9	765.7	762.3	760.3	754.9
117.5°	843.1	858.0	848.6	843.1	837.8
120°	932.1	947.0	932.1	932.1	926.0
122.5°	1013.0	1031.9	1022.5	1017.0	1013.0
125°	1097.9	1114.8	1109.4	1103.4	1101.4
127.5°	1180.8	1201.7	1194.4	1186.3	1180.8
130°	1258.4	1282.6	1279.3	1275.3	1267.8
132.5°	1345.3	1364.2	1365.5	1356.1	1350.7
135°	1420.2	1441.0	1445.1	1443.0	1437.6
137.5°	1503.7	1520.6	1523.9	1522.6	1514.5
140°	1577.2	1594.1	1603.5	1603.5	1596.1
142.5°	1652.6	1669.5	1674.9	1676.9	1669.5
145°	1724.1	1737.6	1748.4	1750.4	1743.0
147.5°	1788.2	1805.0	1813.1	1816.4	1809.1
150°	1854.2	1865.6	1873.1	1879.2	1873.1
152.5°	1912.8	1924.3	1933.7	1941.2	1933.7
155°	1971.5	1976.8	1983.0	1992.4	1986.3
157.5°	2022.1	2026.1	2029.4	2043.0	2033.5
160°	2067.2	2071.2	2073.3	2084.7	2076.6
162.5°	2109.0	2109.0	2111.0	2123.7	2114.4
165°	2144.7	2142.6	2142.6	2156.2	2146.7
167.5°	2177.1	2171.0	2171.0	2184.4	2175.0
170°	2201.3	2196.0	2193.9	2207.4	2196.0
172.5°	2218.2	2212.7	2210.7	2224.2	2212.7
175°	2231.6	2226.2	2222.2	2235.6	2224.2
177.5°	2239.1	2233.6	2229.6	2241.1	2229.6
180°	2235.6	2235.6	2235.6	2235.6	2235.6

TEST NUMBER: P908202

CATALOG NUMBER: DFN2DIP-HX4F0-070D070US840-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.02	10.90	10.95	11.85	13.08	9.58	10.47	10.52	11.42	12.65
	3H	11.68	12.48	12.62	13.44	14.69	11.21	12.00	12.15	12.96	14.22
	4H	12.27	13.02	13.23	13.99	15.25	11.80	12.55	12.75	13.51	14.77
	6H	12.67	13.37	13.64	14.34	15.61	12.20	12.89	13.17	13.86	15.13
	8H	12.78	13.44	13.75	14.43	15.70	12.30	12.96	13.28	13.95	15.22
	12H	12.83	13.46	13.81	14.44	15.73	12.35	12.98	13.33	13.95	15.25
4H	2H	10.48	11.24	11.45	12.20	13.46	10.14	10.89	11.10	11.85	13.12
	3H	12.35	12.98	13.33	13.97	15.25	11.96	12.59	12.93	13.58	14.86
	4H	13.07	13.64	14.05	14.63	15.93	12.66	13.24	13.64	14.22	15.52
	6H	13.59	14.08	14.58	15.09	16.39	13.18	13.67	14.17	14.68	15.98
	8H	13.74	14.20	14.73	15.20	16.52	13.32	13.79	14.32	14.79	16.10
	12H	13.81	14.23	14.83	15.25	16.57	13.39	13.81	14.40	14.83	16.15
8H	4H	13.27	13.73	14.26	14.73	16.05	12.91	13.37	13.90	14.37	15.69
	6H	13.90	14.28	14.92	15.33	16.64	13.54	13.92	14.56	14.97	16.28
	8H	14.12	14.46	15.15	15.49	16.82	13.75	14.09	14.78	15.12	16.45
	12H	14.26	14.55	15.29	15.58	16.95	13.87	14.17	14.90	15.20	16.57
12H	4H	13.25	13.67	14.27	14.69	16.01	12.90	13.32	13.92	14.34	15.66
	6H	13.93	14.27	14.96	15.30	16.63	13.58	13.92	14.61	14.95	16.28
	8H	14.18	14.47	15.21	15.50	16.87	13.82	14.12	14.85	15.14	16.52

END OF REPORT