

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P927672

Luminaire Tested: DFN2DIP-HX4F0-080D060US840-FLLONL

Issue Date: 12/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P927672
REPORT IS A COMBINATION OF REPORTS P900863 AND P896187
Test Lab: INNOVATION CENTER
Issue Date: 12/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-080D060US840-FLLONL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13995.8 lumens
Efficiency: N/A
Efficacy: 116.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 120.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9613
Total Harmonic Distortion (THDi): 0.083
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P927672

CATALOG NUMBER: DFN2DIP-HX4F0-080D060US840-FLLONL

Luminous Intensity Polar Plot

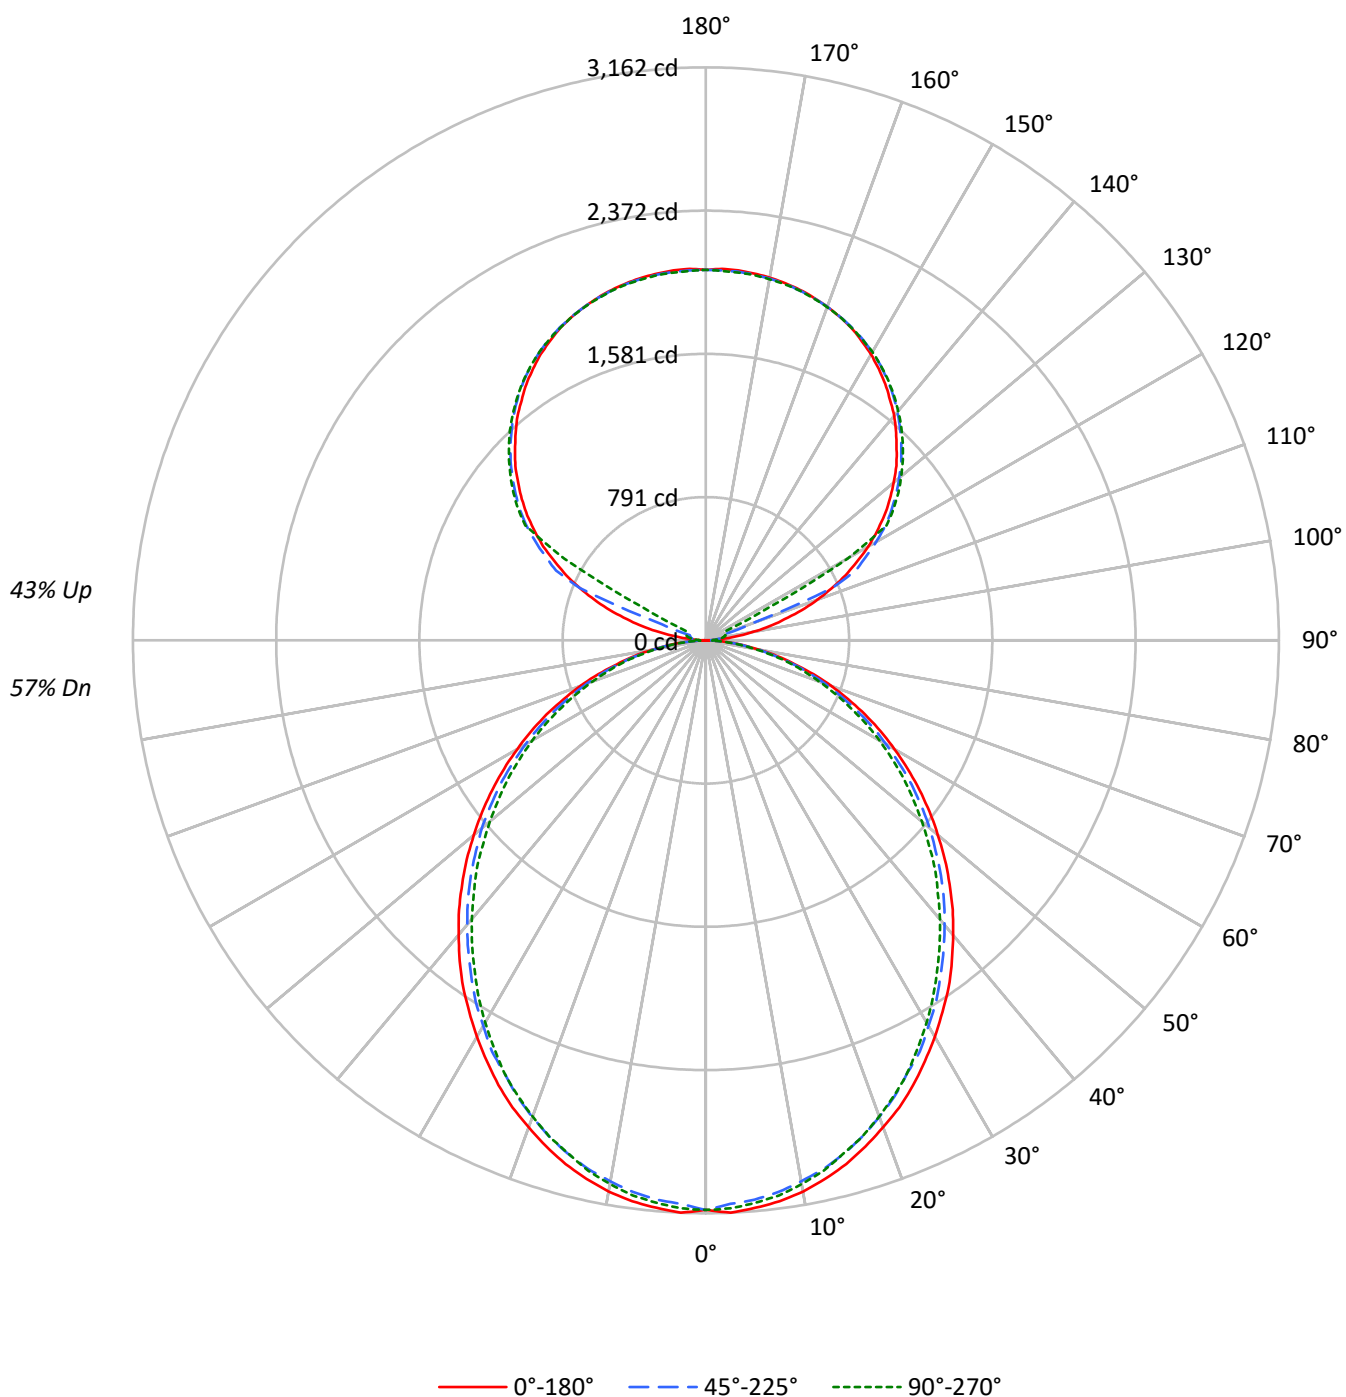

TEST NUMBER: P927672

CATALOG NUMBER: DFN2DIP-HX4F0-080D060US840-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	101	101	101	101	87	87	87	74	74	74	63	63	63
1	99	95	91	88	92	89	85	82	77	74	72	66	64	62	55	54	53
2	91	83	77	72	84	77	72	67	67	63	59	58	55	52	49	47	45
3	83	73	66	60	77	68	62	56	59	54	50	51	47	44	43	40	38
4	76	65	57	50	70	61	53	48	53	47	43	45	41	38	39	35	33
5	69	58	49	43	64	54	47	41	47	41	37	41	36	33	35	31	29
6	64	52	44	38	59	49	41	36	43	37	32	37	32	29	32	28	25
7	59	47	39	33	55	44	37	31	39	33	28	34	29	25	29	25	22
8	55	43	35	29	51	40	33	28	35	29	25	31	26	23	27	23	20
9	51	39	31	26	48	37	30	25	32	27	23	28	24	20	25	21	18
10	48	36	28	24	45	34	27	22	30	24	20	26	22	18	23	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2337	2337	2337
5°	2341	2305	2320
10°	2322	2274	2289
15°	2288	2237	2240
20°	2242	2185	2190
25°	2197	2123	2132
30°	2139	2065	2058
35°	2085	1997	1980
40°	2018	1929	1906
45°	1952	1860	1830
50°	1879	1788	1742
55°	1802	1704	1661
60°	1716	1605	1568
65°	1622	1502	1459
70°	1503	1377	1342
75°	1336	1227	1233
80°	1137	1036	1026
85°	825	706	682

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1952 cd/sqm

TEST NUMBER: P927672

CATALOG NUMBER: DFN2DIP-HX4F0-080D060US840-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	295.9	2.1
10°-20°	832.4	5.9
20°-30°	1223.3	8.7
30°-40°	1420.8	10.2
40°-50°	1419.1	10.1
50°-60°	1237.4	8.8
60°-70°	914.7	6.5
70°-80°	517.5	3.7
80°-90°	140.2	1.0
90°-100°	67.4	0.5
100°-110°	251.3	1.8
110°-120°	666.6	4.8
120°-130°	1105.6	7.9
130°-140°	1174.4	8.4
140°-150°	1091.5	7.8
150°-160°	877.5	6.3
160°-170°	565.5	4.0
170°-180°	194.6	1.4
0°-30°	2351.6	16.8
0°-40°	3772.4	27.0
0°-60°	6428.8	45.9
0°-90°	8001.2	57.2
90°-120°	985.4	7.0
90°-150°	4357.0	31.1
90°-180°	5995.0	42.8
0°-180°	13995.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3143	3143	3143	3143	3143	
5°	3143	3132	3098	3122	3116	298
15°	2992	2974	2935	2947	2932	843
25°	2708	2684	2633	2639	2633	1246
35°	2336	2306	2258	2240	2225	1459
45°	1901	1880	1835	1802	1790	1467
55°	1439	1421	1384	1348	1333	1286
65°	970	952	922	895	880	959
75°	508	502	486	468	475	542
85°	124	121	118	109	106	138
90°	1	18	30	37	40	13
95°	96	47	58	65	64	114
105°	450	494	90	106	112	481
115°	851	876	913	228	121	838
125°	1203	1222	1250	1261	1265	1073
135°	1488	1512	1525	1540	1537	1150
145°	1727	1725	1750	1761	1753	1080
155°	1901	1888	1906	1915	1903	876
165°	2003	1995	1999	2009	1999	566
175°	2049	2039	2042	2052	2037	195
180°	2045	2045	2045	2045	2045	

TEST NUMBER: P927672

CATALOG NUMBER: DFN2DIP-HX4F0-080D060US840-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3143.3	3143.3	3143.3	3143.3	3143.3
2.5°	3161.6	3146.5	3113.2	3143.3	3137.5
5°	3143.3	3131.5	3098.2	3122.2	3116.4
7.5°	3122.2	3104.2	3070.9	3095.2	3089.2
10°	3089.2	3068.0	3031.7	3055.8	3046.9
12.5°	3043.6	3025.7	2989.4	3004.5	2998.4
15°	2992.3	2974.4	2934.9	2947.1	2932.1
17.5°	2928.8	2910.8	2871.4	2886.5	2871.4
20°	2859.2	2841.3	2799.0	2808.0	2796.0
22.5°	2790.0	2762.7	2723.2	2723.2	2717.2
25°	2708.2	2684.1	2632.9	2638.6	2632.9
27.5°	2617.4	2596.3	2557.1	2548.1	2533.1
30°	2527.0	2502.6	2457.4	2448.5	2436.2
32.5°	2430.2	2412.2	2363.7	2345.5	2333.3
35°	2336.5	2306.4	2257.9	2239.6	2224.6
37.5°	2230.6	2203.4	2155.0	2133.8	2118.8
40°	2122.0	2097.6	2049.2	2022.2	2010.0
42.5°	2016.2	1991.7	1943.7	1913.2	1895.3
45°	1901.4	1880.1	1834.6	1801.6	1789.5
47.5°	1789.5	1768.3	1719.8	1686.5	1668.5
50°	1671.4	1656.4	1614.0	1571.7	1556.6
52.5°	1556.6	1535.4	1496.3	1463.0	1441.8
55°	1438.9	1420.6	1384.4	1348.2	1333.0
57.5°	1320.9	1305.9	1266.4	1230.1	1217.9
60°	1202.9	1191.1	1148.6	1115.3	1106.3
62.5°	1088.1	1067.0	1036.8	1006.7	994.5
65°	970.4	952.1	921.9	894.7	879.6
67.5°	849.4	834.1	807.1	786.0	773.8
70°	737.6	725.3	698.2	677.0	665.1
72.5°	622.7	610.6	595.5	574.4	565.4
75°	507.6	501.9	486.5	468.5	474.6
77.5°	405.0	392.8	386.8	377.8	368.8
80°	302.4	299.2	293.1	284.2	278.0
82.5°	205.6	205.6	202.7	190.4	190.4
85°	123.8	120.9	118.0	108.8	105.8
87.5°	54.5	48.5	42.3	33.3	30.2
90°	1.4	17.8	29.5	37.1	39.9
92.5°	37.1	31.1	35.4	38.5	39.9
95°	96.1	47.3	57.7	65.2	63.6
97.5°	173.1	51.8	75.3	80.0	81.4
100°	261.9	59.2	84.3	96.1	99.1
102.5°	359.5	356.7	87.3	103.5	108.0
105°	449.8	494.2	90.3	106.4	112.5
107.5°	554.9	591.7	93.3	109.5	115.4
110°	655.6	686.5	259.0	111.1	116.8

TEST NUMBER: P927672

CATALOG NUMBER: DFN2DIP-HX4F0-080D060US840-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	750.2	776.7	751.6	113.8	118.4
115°	850.8	875.9	913.0	227.9	121.4
117.5°	938.0	967.6	992.8	781.2	393.5
120°	1035.8	1057.9	1084.6	1102.3	902.6
122.5°	1118.5	1142.2	1171.9	1180.7	1182.3
125°	1202.9	1222.2	1250.2	1260.6	1265.0
127.5°	1279.8	1300.5	1322.8	1337.6	1339.0
130°	1352.3	1376.1	1392.2	1408.6	1407.2
132.5°	1426.3	1445.6	1461.8	1475.1	1473.7
135°	1488.5	1512.3	1525.4	1540.3	1537.3
137.5°	1553.5	1571.2	1586.2	1600.9	1596.6
140°	1617.1	1629.1	1645.3	1658.6	1651.2
142.5°	1670.5	1680.9	1700.1	1711.8	1704.4
145°	1726.8	1725.1	1750.3	1760.7	1753.3
147.5°	1775.4	1771.0	1796.1	1803.5	1797.7
150°	1822.9	1812.5	1836.2	1845.0	1837.6
152.5°	1862.8	1851.0	1873.1	1882.1	1871.7
155°	1901.3	1888.0	1905.8	1914.6	1902.8
157.5°	1932.4	1920.5	1933.9	1944.3	1932.4
160°	1959.0	1950.0	1959.0	1967.8	1957.5
162.5°	1982.5	1973.8	1981.1	1991.5	1978.2
165°	2003.3	1994.6	1998.9	2009.3	1998.9
167.5°	2019.6	2010.7	2015.3	2025.7	2012.2
170°	2033.0	2024.0	2027.1	2037.4	2024.0
172.5°	2041.8	2033.0	2036.0	2046.4	2033.0
175°	2049.2	2038.8	2041.8	2052.1	2037.4
177.5°	2052.1	2041.8	2043.3	2053.7	2040.4
180°	2044.7	2044.7	2044.7	2044.7	2044.7

TEST NUMBER: P927672

CATALOG NUMBER: DFN2DIP-HX4F0-080D060US840-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.86	11.79	11.75	12.70	13.87	10.43	11.36	11.32	12.27	13.44
	3H	12.53	13.36	13.43	14.28	15.47	12.05	12.89	12.96	13.81	15.00
	4H	13.12	13.91	14.04	14.83	16.03	12.64	13.43	13.56	14.36	15.56
	6H	13.52	14.25	14.45	15.18	16.40	13.05	13.77	13.98	14.71	15.92
	8H	13.63	14.32	14.57	15.27	16.48	13.15	13.85	14.09	14.80	16.01
	12H	13.68	14.34	14.62	15.28	16.52	13.20	13.86	14.14	14.80	16.04
4H	2H	11.33	12.12	12.26	13.05	14.25	10.98	11.77	11.91	12.70	13.90
	3H	13.20	13.86	14.14	14.82	16.03	12.81	13.47	13.75	14.43	15.64
	4H	13.92	14.52	14.87	15.48	16.71	13.52	14.12	14.46	15.07	16.31
	6H	14.44	14.96	15.40	15.94	17.18	14.03	14.55	14.99	15.53	16.77
	8H	14.59	15.08	15.55	16.05	17.30	14.18	14.66	15.14	15.64	16.89
	12H	14.67	15.11	15.65	16.09	17.35	14.25	14.68	15.23	15.67	16.93
8H	4H	14.12	14.61	15.09	15.58	16.83	13.76	14.25	14.72	15.22	16.47
	6H	14.76	15.16	15.75	16.17	17.42	14.40	14.80	15.38	15.81	17.06
	8H	14.98	15.34	15.98	16.34	17.61	14.61	14.97	15.61	15.97	17.24
	12H	15.12	15.43	16.12	16.42	17.74	14.73	15.04	15.73	16.04	17.35
12H	4H	14.11	14.55	15.09	15.54	16.80	13.76	14.20	14.74	15.19	16.44
	6H	14.79	15.14	15.79	16.15	17.42	14.44	14.79	15.43	15.79	17.06
	8H	15.04	15.35	16.04	16.34	17.66	14.68	14.99	15.68	15.99	17.30

END OF REPORT