

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P927784

Luminaire Tested: DFN2DIP-HX4F0-110D070US840-FLLONL

Issue Date: 12/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P927784
REPORT IS A COMBINATION OF REPORTS P900887 AND P896187
Test Lab: INNOVATION CENTER
Issue Date: 12/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-110D070US840-FLLONL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 17994.6 lumens
Efficiency: N/A
Efficacy: 109.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 164.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9967
Total Harmonic Distortion (THDi): 0.063
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P927784

CATALOG NUMBER: DFN2DIP-HX4F0-110D070US840-FLLONL

Luminous Intensity Polar Plot

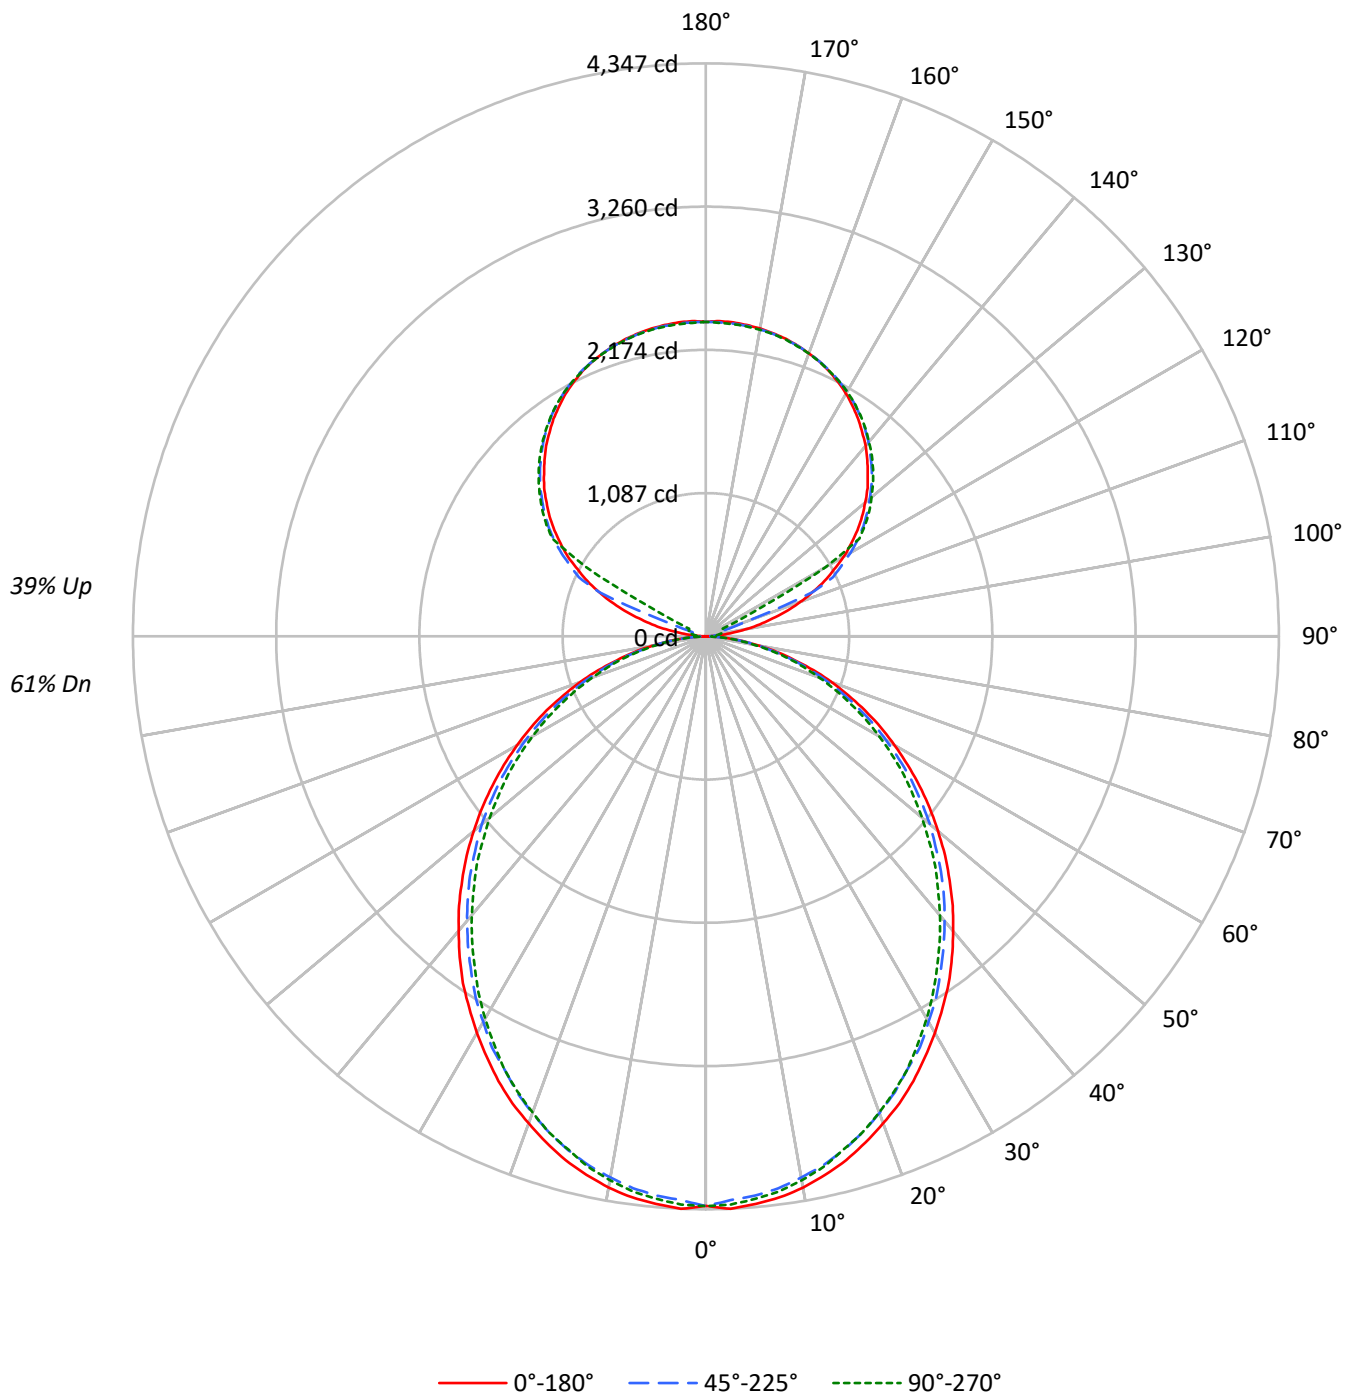

TEST NUMBER: P927784

CATALOG NUMBER: DFN2DIP-HX4F0-110D070US840-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	90	90	90	77	77	77	66	66	66
1	100	96	92	88	94	90	86	83	79	76	74	68	66	65	59	57	56
2	91	84	77	72	85	79	73	68	69	65	61	60	57	54	52	49	47
3	83	74	66	60	78	69	63	57	61	56	51	53	49	46	46	43	40
4	76	65	57	51	71	61	54	49	54	48	44	47	43	39	41	38	35
5	70	58	50	44	65	55	47	42	48	42	38	42	38	34	37	33	30
6	65	52	44	38	60	49	42	36	44	38	33	38	34	30	34	30	27
7	60	47	39	33	56	45	37	32	40	34	29	35	30	26	31	27	24
8	56	43	35	30	52	41	33	28	36	30	26	32	27	24	28	24	21
9	52	39	32	27	48	37	30	25	33	27	23	30	25	21	26	22	19
10	48	36	29	24	45	34	28	23	31	25	21	27	23	19	24	20	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3214	3214	3214
5°	3219	3169	3191
10°	3193	3127	3147
15°	3147	3076	3080
20°	3083	3005	3011
25°	3021	2919	2931
30°	2942	2840	2830
35°	2867	2746	2723
40°	2775	2652	2621
45°	2684	2557	2516
50°	2583	2458	2395
55°	2478	2343	2284
60°	2360	2206	2157
65°	2230	2065	2006
70°	2066	1893	1845
75°	1838	1687	1696
80°	1564	1425	1411
85°	1135	971	938

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2684 cd/sqm

TEST NUMBER: P927784

CATALOG NUMBER: DFN2DIP-HX4F0-110D070US840-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	406.8	2.3
10°-20°	1144.6	6.4
20°-30°	1682.1	9.3
30°-40°	1953.6	10.9
40°-50°	1951.2	10.8
50°-60°	1701.4	9.5
60°-70°	1257.7	7.0
70°-80°	711.6	4.0
80°-90°	192.0	1.1
90°-100°	78.7	0.4
100°-110°	293.2	1.6
110°-120°	777.7	4.3
120°-130°	1289.9	7.2
130°-140°	1370.2	7.6
140°-150°	1273.4	7.1
150°-160°	1023.8	5.7
160°-170°	659.7	3.7
170°-180°	227.1	1.3
0°-30°	3233.4	18.0
0°-40°	5187.0	28.8
0°-60°	8839.6	49.1
0°-90°	11000.9	61.1
90°-120°	1149.6	6.4
90°-150°	5083.2	28.2
90°-180°	6994.0	38.9
0°-180°	17994.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4322	4322	4322	4322	4322	
5°	4322	4306	4260	4293	4285	410
15°	4114	4090	4036	4052	4032	1159
25°	3724	3691	3620	3628	3620	1713
35°	3213	3171	3105	3080	3059	2006
45°	2614	2585	2523	2477	2460	2018
55°	1978	1953	1904	1854	1833	1769
65°	1334	1309	1268	1230	1210	1319
75°	698	690	669	644	653	745
85°	170	166	162	150	146	190
90°	2	21	34	43	47	17
95°	112	55	67	76	74	133
105°	525	577	105	124	131	561
115°	992	1022	1065	266	142	977
125°	1403	1426	1459	1471	1476	1252
135°	1737	1764	1780	1797	1794	1341
145°	2015	2013	2042	2054	2046	1260
155°	2218	2203	2223	2234	2220	1022
165°	2337	2327	2332	2344	2332	660
175°	2391	2379	2382	2394	2377	228
180°	2386	2386	2386	2386	2386	

TEST NUMBER: P927784

CATALOG NUMBER: DFN2DIP-HX4F0-110D070US840-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4322.1	4322.1	4322.1	4322.1	4322.1
2.5°	4347.2	4326.5	4280.6	4322.1	4314.2
5°	4322.1	4305.8	4259.9	4293.0	4285.1
7.5°	4293.0	4268.3	4222.5	4256.0	4247.6
10°	4247.6	4218.4	4168.7	4201.7	4189.4
12.5°	4185.0	4160.3	4110.5	4131.2	4122.8
15°	4114.4	4089.7	4035.5	4052.2	4031.5
17.5°	4027.1	4002.4	3948.2	3968.9	3948.2
20°	3931.5	3906.7	3848.5	3860.9	3844.6
22.5°	3836.2	3798.7	3744.4	3744.4	3736.1
25°	3723.7	3690.7	3620.1	3628.1	3620.1
27.5°	3598.9	3569.8	3516.0	3503.7	3483.0
30°	3474.6	3441.1	3378.9	3366.6	3349.8
32.5°	3341.4	3316.8	3250.1	3225.0	3208.2
35°	3212.7	3171.3	3104.6	3079.5	3058.8
37.5°	3067.2	3029.7	2963.2	2934.0	2913.3
40°	2917.7	2884.2	2817.6	2780.6	2763.8
42.5°	2772.2	2738.7	2672.5	2630.6	2606.0
45°	2614.4	2585.2	2522.6	2477.2	2460.5
47.5°	2460.5	2431.4	2364.7	2318.9	2294.2
50°	2298.2	2277.5	2219.2	2161.1	2140.4
52.5°	2140.4	2111.2	2057.5	2011.5	1982.4
55°	1978.5	1953.4	1903.6	1853.7	1833.0
57.5°	1816.2	1795.5	1741.3	1691.4	1674.7
60°	1654.0	1637.7	1579.4	1533.6	1521.3
62.5°	1496.1	1467.0	1425.5	1384.1	1367.4
65°	1334.2	1309.1	1267.7	1230.2	1209.5
67.5°	1168.0	1146.9	1109.9	1080.8	1064.0
70°	1014.1	997.4	959.9	930.8	914.5
72.5°	856.3	839.5	818.8	789.8	777.3
75°	698.0	690.1	668.9	644.3	652.6
77.5°	556.9	540.1	531.8	519.4	507.1
80°	415.8	411.4	403.0	390.7	382.3
82.5°	282.6	282.6	278.7	261.9	261.9
85°	170.3	166.2	162.3	149.5	145.5
87.5°	74.9	66.5	58.2	45.8	41.4
90°	1.6	20.7	34.4	43.2	46.6
92.5°	43.2	36.3	41.4	44.9	46.6
95°	112.1	55.1	67.3	76.0	74.2
97.5°	201.9	60.5	88.0	93.3	94.9
100°	305.7	69.1	98.4	112.1	115.6
102.5°	419.4	416.1	101.9	120.8	126.0
105°	524.8	576.6	105.3	124.2	131.2
107.5°	647.3	690.4	108.9	127.7	134.7
110°	764.8	800.9	302.1	129.6	136.3

TEST NUMBER: P927784

CATALOG NUMBER: DFN2DIP-HX4F0-110D070US840-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	875.3	906.2	876.9	132.8	138.1
115°	992.5	1021.8	1065.0	265.9	141.7
117.5°	1094.4	1128.9	1158.3	911.3	459.2
120°	1208.3	1234.2	1265.4	1286.1	1053.0
122.5°	1304.9	1332.5	1367.3	1377.5	1379.3
125°	1403.3	1425.8	1458.7	1470.8	1475.8
127.5°	1493.1	1517.2	1543.3	1560.5	1562.2
130°	1577.7	1605.4	1624.3	1643.3	1641.7
132.5°	1664.0	1686.6	1705.5	1721.0	1719.4
135°	1736.6	1764.2	1779.7	1797.0	1793.6
137.5°	1812.4	1833.2	1850.6	1867.8	1862.7
140°	1886.6	1900.5	1919.4	1935.0	1926.4
142.5°	1948.9	1961.0	1983.3	1997.1	1988.5
145°	2014.6	2012.7	2042.0	2054.1	2045.6
147.5°	2071.3	2066.3	2095.5	2104.1	2097.4
150°	2126.6	2114.6	2142.3	2152.5	2143.9
152.5°	2173.2	2159.5	2185.3	2195.7	2183.7
155°	2218.1	2202.7	2223.4	2233.7	2219.9
157.5°	2254.4	2240.6	2256.2	2268.3	2254.4
160°	2285.6	2275.1	2285.6	2295.8	2283.7
162.5°	2313.0	2302.7	2311.3	2323.4	2307.9
165°	2337.2	2327.0	2332.0	2344.1	2332.0
167.5°	2356.3	2345.8	2351.1	2363.2	2347.7
170°	2371.8	2361.4	2364.9	2377.0	2361.4
172.5°	2382.1	2371.8	2375.4	2387.4	2371.8
175°	2390.7	2378.6	2382.1	2394.1	2377.0
177.5°	2394.1	2382.1	2383.9	2396.1	2380.4
180°	2385.6	2385.6	2385.6	2385.6	2385.6

TEST NUMBER: P927784

CATALOG NUMBER: DFN2DIP-HX4F0-110D070US840-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.30	13.27	13.15	14.15	15.25	11.87	12.84	12.72	13.71	14.82
	3H	13.97	14.84	14.83	15.72	16.85	13.49	14.37	14.36	15.25	16.38
	4H	14.56	15.38	15.44	16.28	17.42	14.09	14.91	14.97	15.80	16.94
	6H	14.97	15.73	15.86	16.63	17.78	14.49	15.25	15.39	16.15	17.30
	8H	15.07	15.80	15.98	16.72	17.87	14.60	15.32	15.50	16.24	17.39
	12H	15.13	15.82	16.04	16.73	17.90	14.65	15.33	15.55	16.25	17.42
4H	2H	12.77	13.60	13.66	14.49	15.63	12.43	13.25	13.32	14.14	15.28
	3H	14.65	15.34	15.55	16.26	17.42	14.26	14.94	15.16	15.87	17.02
	4H	15.37	16.00	16.28	16.92	18.10	14.96	15.59	15.87	16.51	17.69
	6H	15.89	16.43	16.82	17.38	18.56	15.48	16.02	16.41	16.97	18.15
	8H	16.04	16.55	16.97	17.49	18.68	15.63	16.14	16.56	17.08	18.27
	12H	16.12	16.58	17.07	17.54	18.74	15.70	16.16	16.65	17.11	18.31
8H	4H	15.58	16.08	16.50	17.02	18.22	15.21	15.72	16.14	16.66	17.85
	6H	16.21	16.63	17.17	17.61	18.81	15.85	16.27	16.80	17.25	18.44
	8H	16.44	16.81	17.40	17.78	18.99	16.07	16.44	17.03	17.41	18.62
	12H	16.57	16.90	17.54	17.86	19.12	16.19	16.51	17.15	17.48	18.74
12H	4H	15.57	16.02	16.51	16.98	18.18	15.21	15.67	16.16	16.63	17.83
	6H	16.24	16.62	17.21	17.59	18.80	15.89	16.26	16.86	17.23	18.45
	8H	16.49	16.82	17.46	17.78	19.04	16.13	16.46	17.10	17.42	18.68

END OF REPORT