

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P910875

Luminaire Tested: DFN2DIP-HX4F0-040D060US850-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P910875
REPORT IS A COMBINATION OF REPORTS P899336 AND P896188
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-040D060US850-RLLFLL
Description: 4 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9659.4 lumens
Efficiency: N/A
Efficacy: 143.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 67.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P910875

CATALOG NUMBER: DFN2DIP-HX4F0-040D060US850-RLLFLL

Luminous Intensity Polar Plot

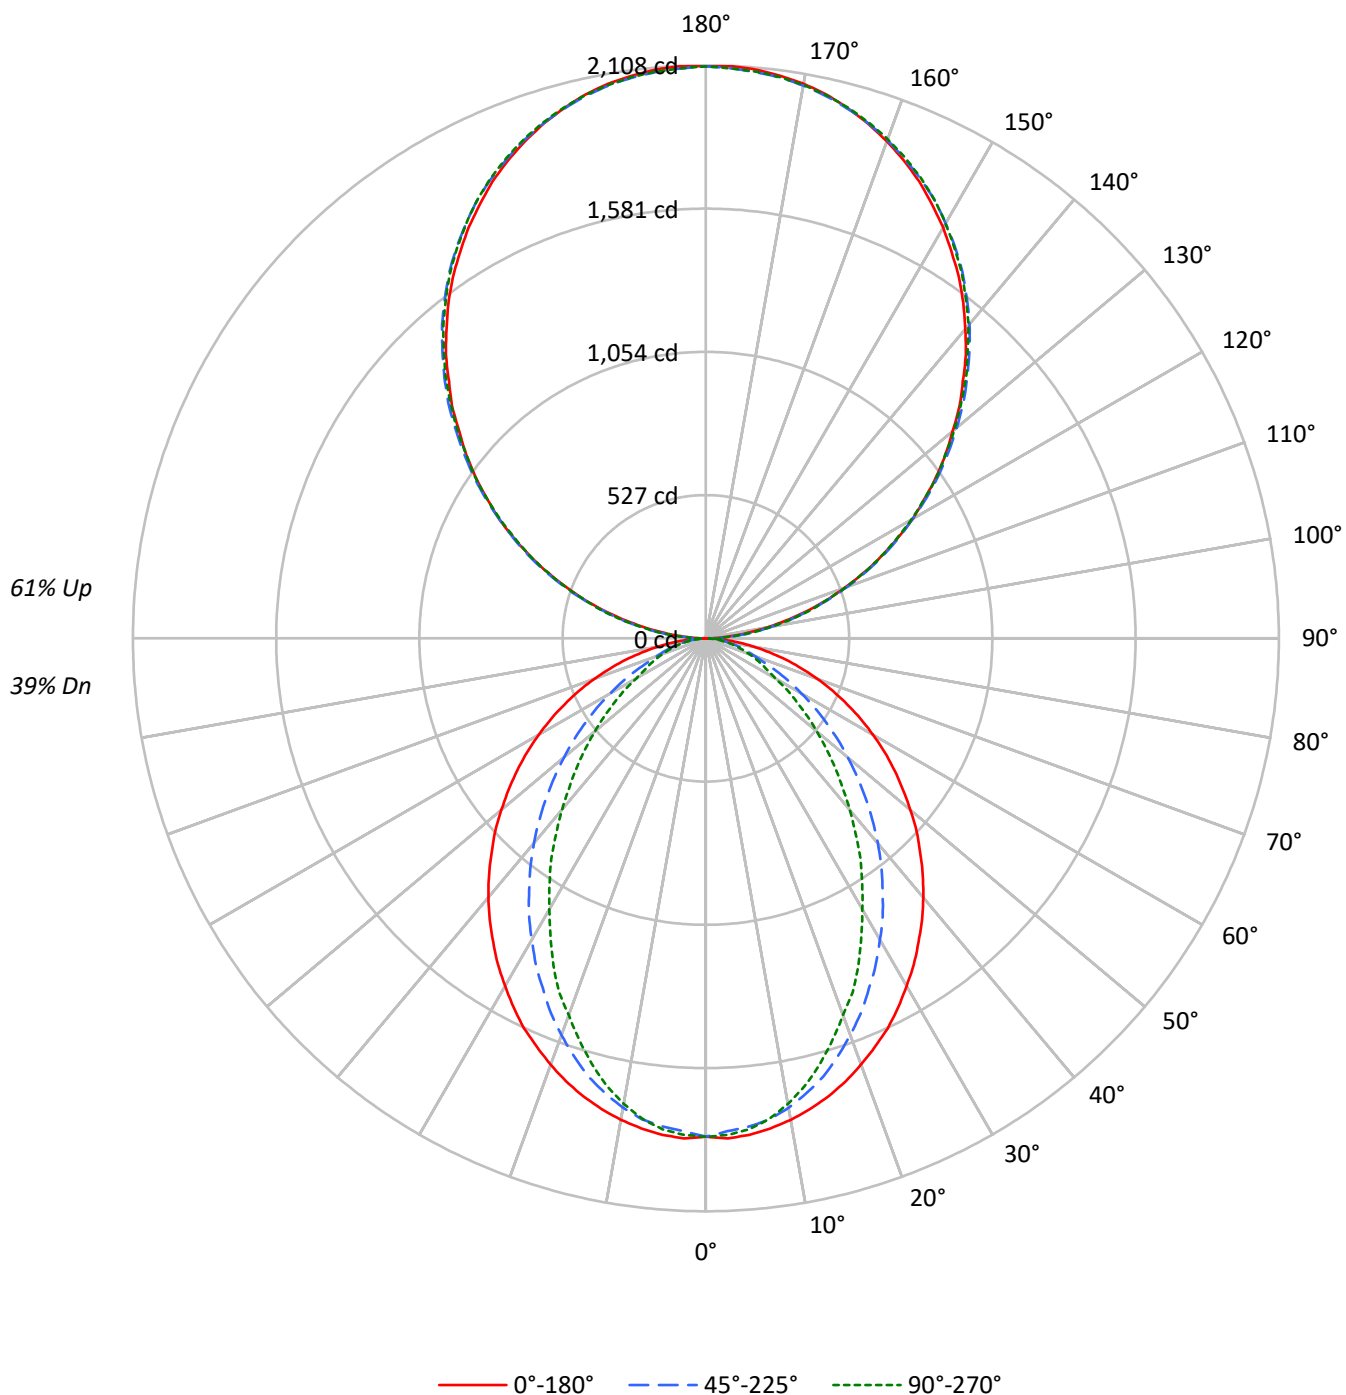

TEST NUMBER: P910875

CATALOG NUMBER: DFN2DIP-HX4F0-040D060US850-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	95	95	95	95	77	77	77	61	61	61	46	46	46
1	96	92	88	85	87	83	80	78	68	66	64	54	53	51	41	40	40
2	87	80	75	70	79	73	68	64	60	57	54	48	46	44	37	35	34
3	80	71	64	58	73	65	59	54	53	49	46	43	40	37	33	31	29
4	73	63	55	50	66	58	51	46	48	43	39	38	35	32	30	27	26
5	67	56	48	43	61	52	45	40	43	38	34	35	31	28	27	24	22
6	62	51	43	37	56	46	40	35	39	33	30	31	28	25	25	22	20
7	57	46	38	33	52	42	35	30	35	30	26	29	25	22	22	20	18
8	53	41	34	29	49	38	32	27	32	27	23	26	22	20	21	18	16
9	50	38	31	26	45	35	29	24	29	24	21	24	20	18	19	17	15
10	46	35	28	23	42	32	26	22	27	22	19	22	19	16	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1363	1363	1363
5°	1366	1342	1350
10°	1352	1316	1306
15°	1334	1272	1239
20°	1309	1212	1155
25°	1284	1145	1075
30°	1250	1077	973
35°	1217	1003	883
40°	1184	926	780
45°	1144	841	687
50°	1104	755	596
55°	1062	664	509
60°	1013	568	419
65°	957	470	377
70°	889	379	341
75°	803	335	311
80°	680	281	270
85°	475	188	203

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1585 cd/sqm

TEST NUMBER: P910875

CATALOG NUMBER: DFN2DIP-HX4F0-040D060US850-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	171.8	1.8
10°-20°	471.7	4.9
20°-30°	662.3	6.9
30°-40°	721.9	7.5
40°-50°	663.5	6.9
50°-60°	521.1	5.4
60°-70°	339.2	3.5
70°-80°	174.6	1.8
80°-90°	50.5	0.5
90°-100°	130.2	1.3
100°-110°	413.7	4.3
110°-120°	708.0	7.3
120°-130°	931.2	9.6
130°-140°	1045.3	10.8
140°-150°	1025.0	10.6
150°-160°	859.8	8.9
160°-170°	570.2	5.9
170°-180°	199.3	2.1
0°-30°	1305.8	13.5
0°-40°	2027.7	21.0
0°-60°	3212.2	33.3
0°-90°	3776.6	39.1
90°-120°	1252.0	13.0
90°-150°	4253.5	44.0
90°-180°	5883.0	60.9
0°-180°	9659.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1833	1833	1833	1833	1833	
5°	1833	1825	1804	1818	1814	174
15°	1744	1726	1669	1638	1621	491
25°	1583	1530	1420	1352	1327	728
35°	1364	1279	1133	1029	992	854
45°	1115	1004	830	712	672	861
55°	848	718	539	440	408	758
65°	572	438	289	232	227	568
75°	305	189	133	121	120	323
85°	71	36	32	32	32	82
90°	2	23	62	58	60	10
95°	93	110	114	114	110	103
105°	382	387	391	394	394	403
115°	710	721	718	716	710	703
125°	1034	1049	1044	1039	1037	924
135°	1337	1356	1360	1358	1353	1033
145°	1623	1636	1646	1648	1641	1014
155°	1856	1861	1866	1875	1870	854
165°	2019	2017	2017	2030	2021	569
175°	2101	2096	2092	2104	2094	200
180°	2104	2104	2104	2104	2104	

TEST NUMBER: P910875

CATALOG NUMBER: DFN2DIP-HX4F0-040D060US850-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1833.4	1833.4	1833.4	1833.4	1833.4
2.5°	1841.7	1833.4	1815.1	1831.8	1828.4
5°	1833.4	1825.1	1803.5	1818.4	1813.5
7.5°	1818.4	1808.6	1785.4	1791.8	1783.6
10°	1798.6	1786.9	1753.8	1748.7	1738.9
12.5°	1773.7	1758.8	1713.8	1704.0	1685.7
15°	1743.8	1725.5	1669.2	1637.7	1621.1
17.5°	1709.0	1682.4	1612.6	1576.2	1549.6
20°	1669.2	1635.9	1552.9	1511.6	1475.0
22.5°	1626.0	1587.9	1491.5	1435.2	1410.4
25°	1582.9	1529.8	1420.2	1352.3	1327.3
27.5°	1531.5	1475.0	1353.9	1275.9	1237.6
30°	1476.7	1413.5	1280.8	1196.3	1151.5
32.5°	1423.6	1347.2	1211.2	1111.7	1070.1
35°	1364.0	1279.2	1133.3	1028.7	992.1
37.5°	1305.8	1214.5	1060.2	945.6	904.3
40°	1244.4	1144.9	983.9	866.1	823.0
42.5°	1181.3	1075.2	907.6	784.7	743.4
45°	1115.0	1003.8	829.6	711.8	671.9
47.5°	1052.0	934.2	755.0	637.1	600.6
50°	982.2	864.5	681.9	567.4	532.7
52.5°	914.1	789.7	612.3	502.7	471.2
55°	847.8	718.4	539.2	439.7	408.2
57.5°	779.8	647.1	474.5	381.6	355.1
60°	710.1	577.3	406.4	321.9	295.4
62.5°	642.2	509.5	348.3	268.8	255.6
65°	572.5	437.9	288.7	232.3	227.2
67.5°	506.1	371.6	232.3	204.1	199.1
70°	436.4	307.0	192.4	175.9	169.1
72.5°	370.1	247.2	160.9	147.7	144.4
75°	305.2	189.1	132.7	121.1	119.6
77.5°	240.7	134.3	104.6	97.9	94.5
80°	180.8	96.3	79.5	73.1	73.1
82.5°	126.1	64.8	54.8	51.3	51.3
85°	71.3	36.5	31.5	31.5	31.5
87.5°	26.6	13.2	13.2	11.6	11.6
90°	1.9	22.8	62.2	58.3	60.2
92.5°	39.4	53.3	55.2	57.1	57.1
95°	92.6	110.3	113.6	113.6	110.3
97.5°	154.2	170.7	177.7	177.7	177.7
100°	225.2	239.8	244.9	244.9	243.0
102.5°	300.1	310.9	317.8	319.7	317.8
105°	381.9	387.0	390.8	394.0	394.0
107.5°	463.1	470.8	470.8	472.0	463.1
110°	541.9	551.9	551.9	551.9	546.8

TEST NUMBER: P910875

CATALOG NUMBER: DFN2DIP-HX4F0-040D060US850-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	626.8	637.6	635.7	630.6	626.8
115°	710.5	720.7	717.5	715.6	710.5
117.5°	793.7	807.7	798.7	793.7	788.6
120°	877.4	891.4	877.4	877.4	871.7
122.5°	953.5	971.3	962.4	957.4	953.5
125°	1033.5	1049.3	1044.2	1038.6	1036.7
127.5°	1111.6	1131.2	1124.2	1116.7	1111.6
130°	1184.5	1207.4	1204.2	1200.4	1193.4
132.5°	1266.4	1284.1	1285.3	1276.5	1271.4
135°	1336.8	1356.4	1360.2	1358.3	1353.2
137.5°	1415.4	1431.3	1434.5	1433.2	1425.6
140°	1484.6	1500.5	1509.3	1509.3	1502.4
142.5°	1555.6	1571.5	1576.6	1578.4	1571.5
145°	1622.9	1635.6	1645.8	1647.6	1640.7
147.5°	1683.1	1699.0	1706.6	1709.7	1702.8
150°	1745.3	1756.1	1763.1	1768.7	1763.1
152.5°	1800.5	1811.3	1820.2	1827.2	1820.2
155°	1855.7	1860.8	1866.4	1875.4	1869.7
157.5°	1903.3	1907.1	1910.3	1923.0	1914.1
160°	1945.9	1949.6	1951.5	1962.3	1954.7
162.5°	1985.1	1985.1	1987.0	1999.1	1990.2
165°	2018.7	2016.8	2016.8	2029.6	2020.7
167.5°	2049.2	2043.6	2043.6	2056.2	2047.3
170°	2072.1	2067.0	2065.1	2077.7	2067.0
172.5°	2087.9	2082.8	2080.9	2093.6	2082.8
175°	2100.6	2095.6	2091.7	2104.4	2093.6
177.5°	2107.5	2102.6	2098.7	2109.4	2098.7
180°	2104.4	2104.4	2104.4	2104.4	2104.4

TEST NUMBER: P910875

CATALOG NUMBER: DFN2DIP-HX4F0-040D060US850-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.11	7.86	8.16	8.91	10.33	3.08	3.83	4.14	4.88	6.31
	3H	8.78	9.45	9.84	10.51	11.95	4.27	4.94	5.33	6.00	7.44
	4H	9.39	10.02	10.46	11.09	12.53	4.72	5.35	5.79	6.41	7.86
	6H	9.81	10.39	10.89	11.46	12.92	5.04	5.62	6.12	6.68	8.14
	8H	9.93	10.49	11.02	11.57	13.02	5.12	5.68	6.21	6.76	8.21
	12H	9.99	10.52	11.08	11.59	13.07	5.17	5.69	6.26	6.77	8.24
4H	2H	7.12	7.75	8.20	8.82	10.26	3.67	4.30	4.75	5.37	6.81
	3H	8.94	9.47	10.03	10.56	12.02	5.01	5.54	6.10	6.63	8.09
	4H	9.63	10.12	10.72	11.20	12.68	5.56	6.04	6.65	7.13	8.61
	6H	10.14	10.56	11.24	11.66	13.14	5.98	6.39	7.08	7.50	8.97
	8H	10.32	10.71	11.42	11.80	13.29	6.11	6.49	7.21	7.59	9.08
	12H	10.41	10.76	11.53	11.87	13.36	6.17	6.52	7.28	7.63	9.12
8H	4H	9.59	9.98	10.69	11.08	12.57	5.84	6.22	6.94	7.32	8.81
	6H	10.16	10.48	11.28	11.62	13.10	6.35	6.67	7.47	7.81	9.30
	8H	10.38	10.66	11.50	11.77	13.28	6.55	6.82	7.67	7.94	9.45
	12H	10.51	10.76	11.64	11.87	13.42	6.66	6.91	7.79	8.02	9.57
12H	4H	9.54	9.89	10.66	11.00	12.50	5.84	6.19	6.95	7.30	8.79
	6H	10.13	10.41	11.26	11.53	13.04	6.40	6.68	7.53	7.80	9.31
	8H	10.35	10.60	11.48	11.71	13.26	6.61	6.86	7.74	7.97	9.52

END OF REPORT