

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P927904

Luminaire Tested: DFN2DIP-HX4F0-050D100US850-FLLONL

Issue Date: 12/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P927904
REPORT IS A COMBINATION OF REPORTS P900929 AND P896187
Test Lab: INNOVATION CENTER
Issue Date: 12/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-050D100US850-FLLONL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16468.7 lumens
Efficiency: N/A
Efficacy: 137.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 119.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P927904

CATALOG NUMBER: DFN2DIP-HX4F0-050D100US850-FLLONL

Luminous Intensity Polar Plot

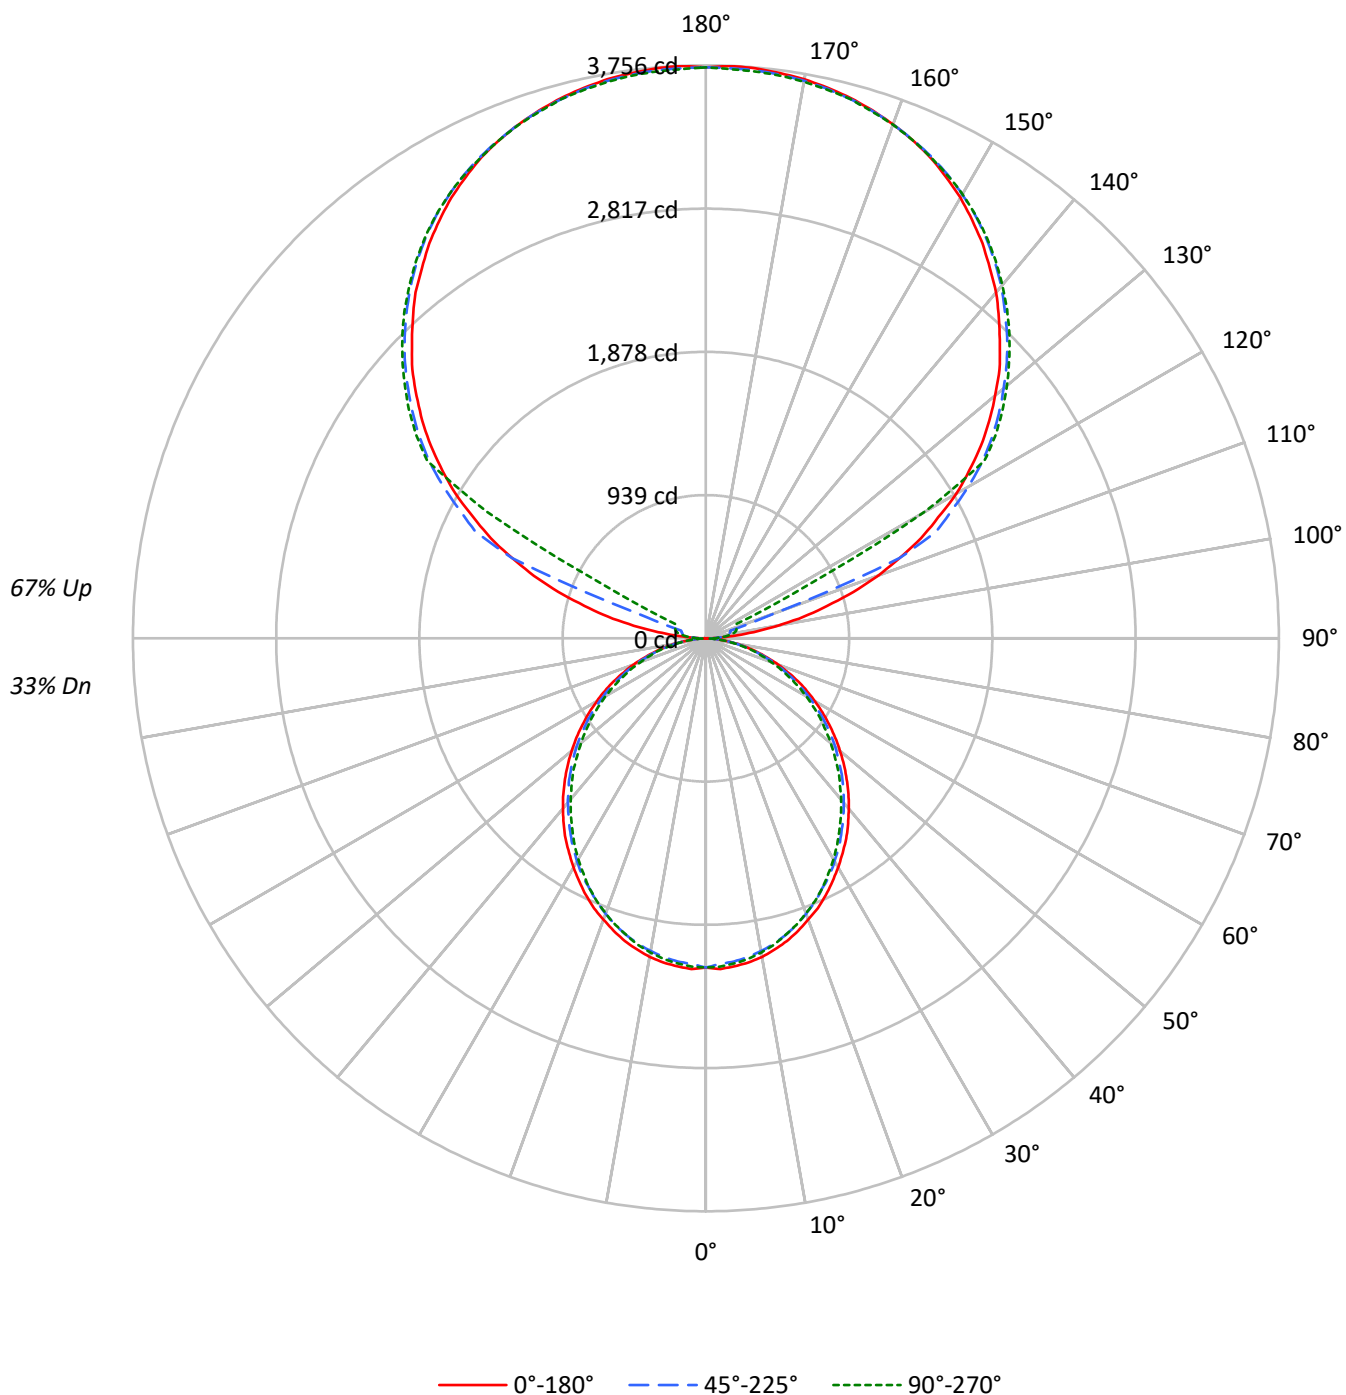

TEST NUMBER: P927904

CATALOG NUMBER: DFN2DIP-HX4F0-050D100US850-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	93	93	93	93	74	74	74	57	57	57	41	41	41
1	94	90	86	83	85	81	78	75	65	63	61	50	48	47	36	35	34
2	86	78	72	67	77	71	66	62	57	53	50	44	41	39	32	30	29
3	78	69	62	56	70	62	56	51	50	46	42	39	36	33	28	26	25
4	71	61	53	47	64	55	49	43	44	40	36	34	31	28	25	23	21
5	65	54	46	40	59	49	42	37	40	35	31	31	27	25	23	20	18
6	60	48	41	35	54	44	37	32	36	31	27	28	24	21	20	18	16
7	56	44	36	30	50	40	33	28	32	27	23	25	22	19	19	16	14
8	51	39	32	27	46	36	29	25	29	24	21	23	19	17	17	15	13
9	48	36	29	24	43	33	26	22	27	22	19	21	18	15	16	13	12
10	45	33	26	21	40	30	24	20	25	20	17	19	16	14	15	12	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1604	1604	1604
5°	1607	1582	1593
10°	1594	1561	1571
15°	1571	1535	1538
20°	1539	1500	1503
25°	1508	1457	1463
30°	1468	1418	1413
35°	1431	1371	1359
40°	1385	1324	1308
45°	1340	1277	1256
50°	1290	1227	1196
55°	1237	1170	1140
60°	1178	1102	1077
65°	1114	1031	1002
70°	1031	945	921
75°	917	842	847
80°	781	711	705
85°	566	485	468

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1922 cd/sqm

TEST NUMBER: P927904

CATALOG NUMBER: DFN2DIP-HX4F0-050D100US850-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	203.1	1.2
10°-20°	571.4	3.5
20°-30°	839.7	5.1
30°-40°	975.2	5.9
40°-50°	974.0	5.9
50°-60°	849.3	5.2
60°-70°	627.9	3.8
70°-80°	355.2	2.2
80°-90°	100.3	0.6
90°-100°	123.4	0.7
100°-110°	460.1	2.8
110°-120°	1220.2	7.4
120°-130°	2023.8	12.3
130°-140°	2149.7	13.1
140°-150°	1997.9	12.1
150°-160°	1606.3	9.8
160°-170°	1035.0	6.3
170°-180°	356.2	2.2
0°-30°	1614.1	9.8
0°-40°	2589.4	15.7
0°-60°	4412.7	26.8
0°-90°	5496.1	33.4
90°-120°	1803.7	11.0
90°-150°	7975.0	48.4
90°-180°	10973.0	66.6
0°-180°	16468.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2158	2158	2158	2158	2158	
5°	2158	2150	2126	2143	2139	205
15°	2054	2042	2014	2023	2012	578
25°	1859	1842	1807	1811	1807	855
35°	1604	1583	1550	1537	1527	1001
45°	1305	1290	1259	1237	1228	1007
55°	988	975	950	925	915	883
65°	666	654	633	614	604	659
75°	348	344	334	322	326	372
85°	85	83	81	75	73	95
90°	3	32	54	68	73	15
95°	176	86	106	119	116	208
105°	823	905	165	195	206	880
115°	1557	1603	1671	417	222	1533
125°	2202	2237	2288	2308	2316	1964
135°	2725	2768	2792	2819	2814	2105
145°	3161	3158	3204	3223	3209	1977
155°	3480	3456	3488	3504	3483	1604
165°	3667	3651	3659	3678	3659	1036
175°	3751	3732	3737	3756	3729	357
180°	3743	3743	3743	3743	3743	

TEST NUMBER: P927904

CATALOG NUMBER: DFN2DIP-HX4F0-050D100US850-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2157.6	2157.6	2157.6	2157.6	2157.6
2.5°	2170.1	2159.8	2136.9	2157.6	2153.7
5°	2157.6	2149.5	2126.5	2143.0	2139.2
7.5°	2143.0	2130.7	2107.9	2124.6	2120.4
10°	2120.4	2105.9	2081.0	2097.5	2091.4
12.5°	2089.1	2076.8	2052.0	2062.3	2058.1
15°	2053.9	2041.6	2014.5	2022.9	2012.5
17.5°	2010.3	1998.0	1970.9	1981.2	1970.9
20°	1962.6	1950.3	1921.2	1927.3	1919.2
22.5°	1915.0	1896.3	1869.2	1869.2	1865.0
25°	1858.9	1842.4	1807.1	1811.1	1807.1
27.5°	1796.6	1782.1	1755.2	1749.0	1738.7
30°	1734.5	1717.8	1686.8	1680.6	1672.3
32.5°	1668.0	1655.7	1622.5	1609.9	1601.6
35°	1603.7	1583.1	1549.8	1537.3	1527.0
37.5°	1531.1	1512.5	1479.2	1464.7	1454.3
40°	1456.6	1439.8	1406.5	1388.0	1379.7
42.5°	1383.9	1367.2	1334.1	1313.2	1300.9
45°	1305.1	1290.5	1259.3	1236.6	1228.2
47.5°	1228.2	1213.7	1180.5	1157.6	1145.3
50°	1147.3	1136.9	1107.9	1078.8	1068.4
52.5°	1068.4	1053.9	1027.0	1004.2	989.7
55°	987.7	975.1	950.2	925.3	915.0
57.5°	906.6	896.3	869.2	844.4	836.0
60°	825.7	817.6	788.5	765.5	759.4
62.5°	746.9	732.4	711.6	690.9	682.6
65°	666.1	653.5	632.8	614.2	603.7
67.5°	583.1	572.6	554.1	539.5	531.1
70°	506.3	497.9	479.2	464.7	456.6
72.5°	427.5	419.1	408.8	394.2	388.0
75°	348.4	344.5	333.9	321.6	325.8
77.5°	278.0	269.6	265.5	259.3	253.2
80°	207.6	205.4	201.2	195.1	190.9
82.5°	141.1	141.1	139.1	130.8	130.8
85°	84.9	83.0	81.0	74.6	72.6
87.5°	37.4	33.3	29.1	22.8	20.7
90°	2.6	32.5	54.0	67.9	73.0
92.5°	67.9	56.9	65.0	70.4	73.0
95°	175.9	86.5	105.5	119.3	116.4
97.5°	316.7	94.8	138.0	146.3	148.9
100°	479.5	108.3	154.4	175.9	181.4
102.5°	658.0	652.9	159.8	189.4	197.7
105°	823.3	904.6	165.4	194.9	205.8
107.5°	1015.6	1083.2	170.8	200.4	211.3
110°	1199.8	1256.5	474.0	203.3	213.8

TEST NUMBER: P927904

CATALOG NUMBER: DFN2DIP-HX4F0-050D100US850-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1373.2	1421.7	1375.8	208.4	216.8
115°	1557.1	1603.2	1671.0	417.1	222.2
117.5°	1717.0	1771.1	1817.3	1429.8	720.4
120°	1895.8	1936.3	1985.2	2017.7	1652.1
122.5°	2047.3	2090.7	2145.0	2161.1	2164.0
125°	2201.7	2237.1	2288.5	2307.5	2315.5
127.5°	2342.5	2380.5	2421.3	2448.3	2450.9
130°	2475.3	2518.8	2548.4	2578.2	2575.7
132.5°	2610.7	2646.1	2675.7	2700.1	2697.5
135°	2724.6	2768.0	2792.1	2819.4	2814.0
137.5°	2843.6	2876.1	2903.4	2930.4	2922.3
140°	2959.9	2981.9	3011.4	3035.9	3022.4
142.5°	3057.7	3076.7	3111.7	3133.3	3119.8
145°	3160.6	3157.8	3203.8	3222.8	3209.2
147.5°	3249.7	3241.7	3287.6	3301.2	3290.6
150°	3336.5	3317.6	3361.0	3377.1	3363.6
152.5°	3409.5	3388.0	3428.6	3444.9	3425.9
155°	3480.0	3455.9	3488.4	3504.4	3482.9
157.5°	3536.9	3515.4	3539.8	3558.8	3536.9
160°	3585.8	3569.4	3585.8	3601.9	3583.0
162.5°	3628.9	3612.8	3626.3	3645.3	3620.9
165°	3666.8	3650.7	3658.8	3677.8	3658.8
167.5°	3696.7	3680.3	3688.8	3707.7	3683.2
170°	3721.1	3704.8	3710.3	3729.2	3704.8
172.5°	3737.2	3721.1	3726.7	3745.6	3721.1
175°	3750.7	3731.8	3737.2	3756.3	3729.2
177.5°	3756.3	3737.2	3740.2	3759.2	3734.7
180°	3742.8	3742.8	3742.8	3742.8	3742.8

TEST NUMBER: P927904

CATALOG NUMBER: DFN2DIP-HX4F0-050D100US850-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.14	7.87	8.23	8.96	10.45	6.71	7.44	7.80	8.53	10.02
	3H	8.79	9.45	9.89	10.54	12.05	8.32	8.97	9.42	10.07	11.58
	4H	9.38	10.00	10.48	11.09	12.61	8.90	9.52	10.01	10.62	12.13
	6H	9.77	10.34	10.89	11.44	12.97	9.29	9.86	10.41	10.96	12.49
	8H	9.87	10.41	10.99	11.53	13.05	9.40	9.94	10.52	11.05	12.57
	12H	9.91	10.43	11.04	11.54	13.08	9.43	9.95	10.56	11.06	12.60
4H	2H	7.59	8.21	8.70	9.30	10.82	7.24	7.86	8.36	8.96	10.47
	3H	9.44	9.96	10.56	11.08	12.61	9.05	9.57	10.17	10.69	12.22
	4H	10.15	10.63	11.28	11.74	13.29	9.75	10.22	10.87	11.34	12.88
	6H	10.66	11.07	11.79	12.20	13.74	10.25	10.66	11.38	11.80	13.33
	8H	10.81	11.19	11.94	12.32	13.87	10.40	10.78	11.53	11.90	13.46
	12H	10.88	11.22	12.02	12.36	13.92	10.45	10.80	11.60	11.94	13.50
8H	4H	10.34	10.72	11.47	11.85	13.40	9.98	10.36	11.11	11.49	13.04
	6H	10.97	11.28	12.12	12.45	14.00	10.60	10.92	11.76	12.09	13.64
	8H	11.19	11.46	12.35	12.61	14.18	10.82	11.09	11.98	12.24	13.81
	12H	11.31	11.55	12.48	12.70	14.31	10.93	11.17	12.09	12.32	13.92
12H	4H	10.32	10.66	11.47	11.80	13.36	9.97	10.31	11.11	11.45	13.01
	6H	11.00	11.27	12.15	12.42	13.99	10.64	10.92	11.80	12.07	13.64
	8H	11.23	11.47	12.39	12.62	14.23	10.88	11.12	12.04	12.26	13.87

END OF REPORT