

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P928044

Luminaire Tested: DFN2DIP-HX4F0-090D090US850-FLLONL

Issue Date: 12/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P928044
REPORT IS A COMBINATION OF REPORTS P900919 AND P896187
Test Lab: INNOVATION CENTER
Issue Date: 12/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-090D090US850-FLLONL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 19762.4 lumens
Efficiency: N/A
Efficacy: 126.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 156.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9821
Total Harmonic Distortion (THDi): 0.08
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P928044

CATALOG NUMBER: DFN2DIP-HX4F0-090D090US850-FLLONL

Luminous Intensity Polar Plot

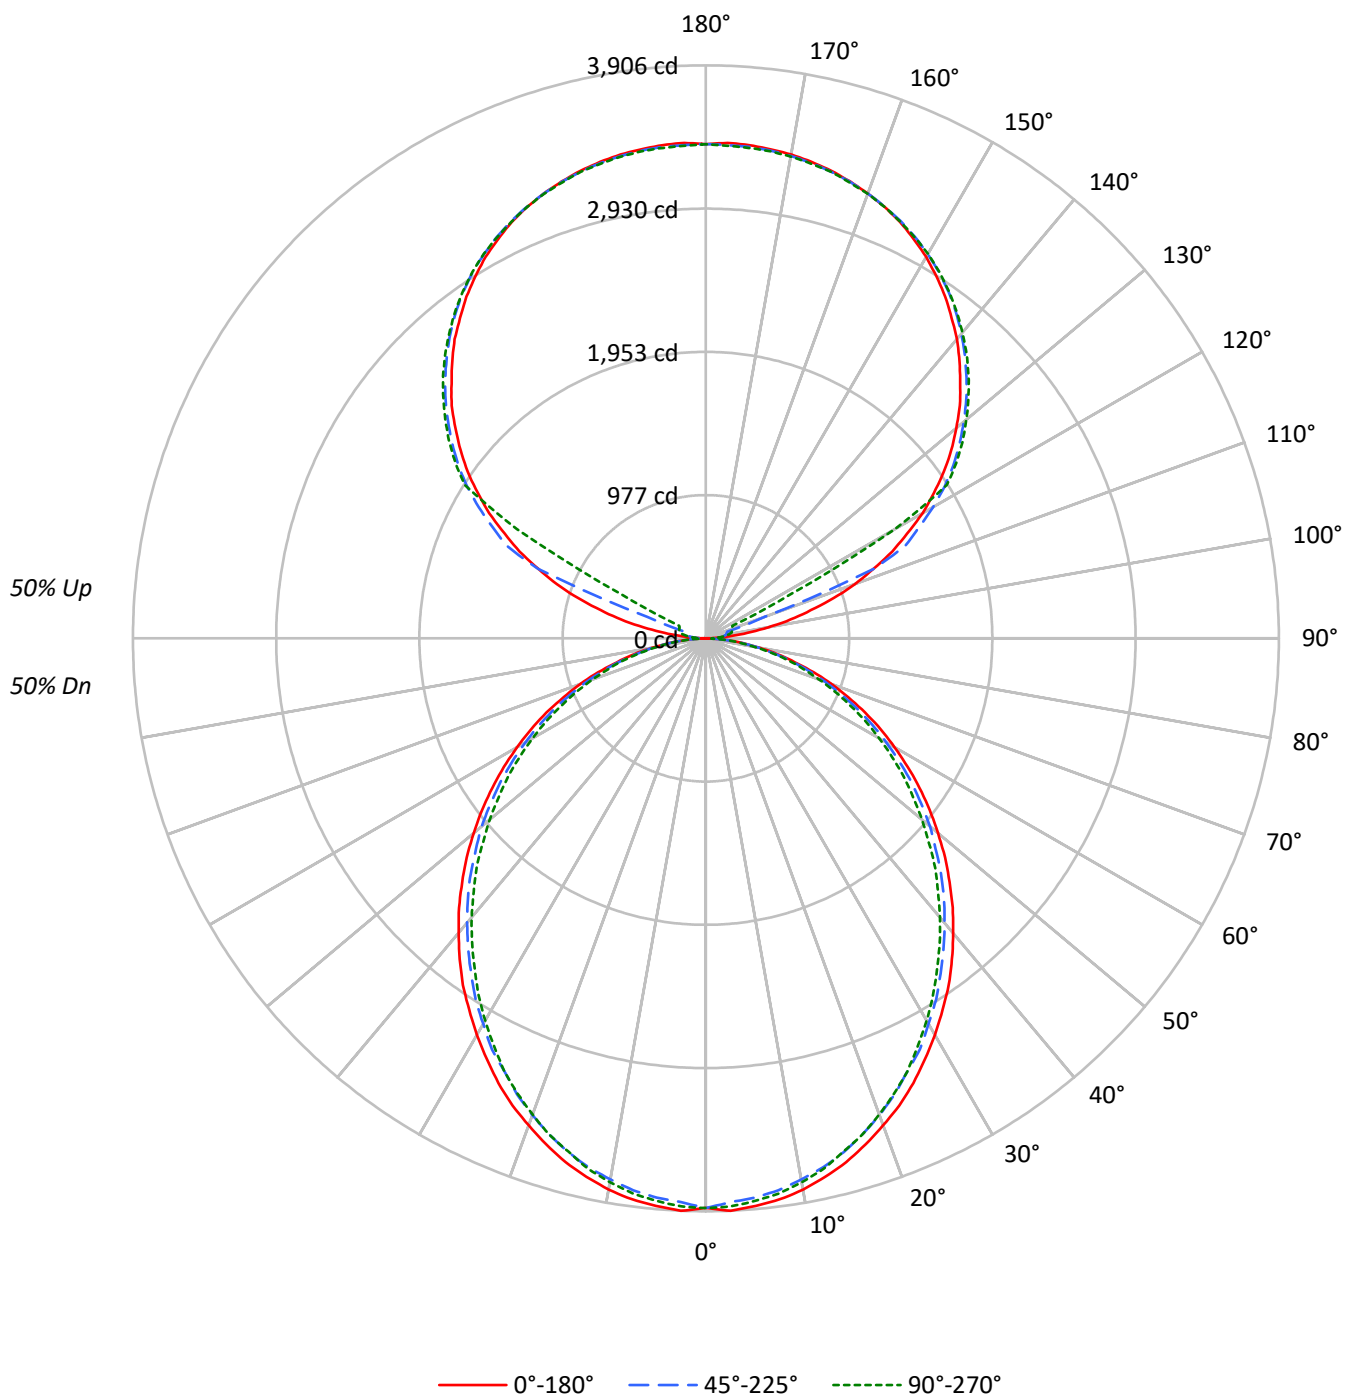

TEST NUMBER: P928044

CATALOG NUMBER: DFN2DIP-HX4F0-090D090US850-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2888	2888	2888
5°	2893	2848	2867
10°	2869	2810	2828
15°	2827	2764	2768
20°	2771	2700	2706
25°	2714	2623	2634
30°	2643	2552	2543
35°	2576	2468	2447
40°	2494	2383	2355
45°	2411	2298	2261
50°	2321	2209	2152
55°	2227	2105	2052
60°	2120	1983	1938
65°	2004	1856	1803
70°	1856	1701	1658
75°	1651	1516	1524
80°	1405	1280	1268
85°	1019	872	844

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2411 cd/sqm

TEST NUMBER: P928044

CATALOG NUMBER: DFN2DIP-HX4F0-090D090US850-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	365.5	1.8
10°-20°	1028.5	5.2
20°-30°	1511.4	7.6
30°-40°	1755.4	8.9
40°-50°	1753.3	8.9
50°-60°	1528.8	7.7
60°-70°	1130.1	5.7
70°-80°	639.4	3.2
80°-90°	174.7	0.9
90°-100°	111.1	0.6
100°-110°	414.0	2.1
110°-120°	1098.2	5.6
120°-130°	1821.4	9.2
130°-140°	1934.7	9.8
140°-150°	1798.1	9.1
150°-160°	1445.6	7.3
160°-170°	931.5	4.7
170°-180°	320.6	1.6
0°-30°	2905.4	14.7
0°-40°	4660.9	23.6
0°-60°	7942.9	40.2
0°-90°	9887.1	50.0
90°-120°	1623.3	8.2
90°-150°	7177.5	36.3
90°-180°	9875.0	50.0
0°-180°	19762.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3884	3884	3884	3884	3884	
5°	3884	3869	3828	3858	3850	369
15°	3697	3675	3626	3641	3622	1041
25°	3346	3316	3253	3260	3253	1540
35°	2887	2850	2790	2767	2748	1803
45°	2349	2323	2267	2226	2211	1813
55°	1778	1755	1710	1666	1647	1589
65°	1199	1176	1139	1106	1087	1185
75°	627	620	601	579	586	670
85°	153	149	146	134	131	171
90°	2	29	49	61	66	18
95°	158	78	95	107	105	188
105°	741	814	149	175	185	792
115°	1401	1443	1504	375	200	1380
125°	1982	2013	2060	2077	2084	1767
135°	2452	2491	2513	2538	2533	1894
145°	2845	2842	2883	2900	2888	1779
155°	3132	3110	3140	3154	3135	1443
165°	3300	3286	3293	3310	3293	932
175°	3376	3359	3364	3381	3356	321
180°	3368	3368	3368	3368	3368	

TEST NUMBER: P928044

CATALOG NUMBER: DFN2DIP-HX4F0-090D090US850-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3883.6	3883.6	3883.6	3883.6	3883.6
2.5°	3906.2	3887.6	3846.5	3883.6	3876.5
5°	3883.6	3869.0	3827.8	3857.5	3850.3
7.5°	3857.5	3835.4	3794.1	3824.3	3816.7
10°	3816.7	3790.6	3745.8	3775.5	3764.4
12.5°	3760.4	3738.2	3693.5	3712.0	3704.6
15°	3697.1	3674.9	3626.1	3641.2	3622.5
17.5°	3618.6	3596.4	3547.7	3566.3	3547.7
20°	3532.6	3510.4	3458.1	3469.2	3454.5
22.5°	3447.0	3413.4	3364.6	3364.6	3357.1
25°	3346.0	3316.2	3252.9	3260.0	3252.9
27.5°	3233.8	3207.7	3159.4	3148.3	3129.7
30°	3122.2	3092.0	3036.1	3025.0	3010.0
32.5°	3002.5	2980.3	2920.4	2897.9	2882.8
35°	2886.8	2849.6	2789.7	2767.2	2748.5
37.5°	2756.1	2722.4	2662.5	2636.4	2617.8
40°	2621.7	2591.6	2531.7	2498.5	2483.5
42.5°	2490.9	2460.9	2401.4	2363.8	2341.7
45°	2349.1	2323.0	2266.7	2225.9	2210.9
47.5°	2210.9	2184.7	2124.8	2083.7	2061.5
50°	2065.1	2046.4	1994.1	1941.9	1923.2
52.5°	1923.2	1897.1	1848.7	1807.6	1781.4
55°	1777.8	1755.2	1710.4	1665.7	1647.1
57.5°	1632.0	1613.4	1564.7	1519.9	1504.8
60°	1486.2	1471.5	1419.2	1378.0	1367.0
62.5°	1344.3	1318.2	1280.9	1243.7	1228.7
65°	1198.9	1176.3	1139.1	1105.5	1086.8
67.5°	1049.6	1030.6	997.2	971.2	956.1
70°	911.3	896.2	862.6	836.4	821.8
72.5°	769.4	754.3	735.7	709.6	698.6
75°	627.3	620.0	601.1	578.9	586.4
77.5°	500.4	485.4	477.9	466.8	455.7
80°	373.6	369.6	362.1	351.0	343.6
82.5°	254.0	254.0	250.4	235.3	235.3
85°	152.9	149.4	145.8	134.3	130.8
87.5°	67.3	59.8	52.3	41.3	37.3
90°	2.3	29.3	48.6	61.1	65.7
92.5°	61.1	51.2	58.4	63.4	65.7
95°	158.4	77.9	94.9	107.4	104.8
97.5°	285.1	85.4	124.2	131.6	134.0
100°	431.5	97.6	139.0	158.4	163.2
102.5°	592.2	587.5	143.8	170.5	178.0
105°	740.9	814.2	148.7	175.4	185.2
107.5°	914.0	974.8	153.7	180.3	190.2
110°	1079.8	1130.8	426.6	182.9	192.5

TEST NUMBER: P928044

CATALOG NUMBER: DFN2DIP-HX4F0-090D090US850-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1235.9	1279.6	1238.2	187.5	195.1
115°	1401.4	1442.8	1503.9	375.4	200.0
117.5°	1545.3	1594.0	1635.6	1286.9	648.3
120°	1706.2	1742.7	1786.7	1815.9	1486.8
122.5°	1842.6	1881.6	1930.5	1945.0	1947.6
125°	1981.5	2013.3	2059.6	2076.7	2083.9
127.5°	2108.2	2142.4	2179.2	2203.5	2205.8
130°	2227.8	2266.9	2293.5	2320.4	2318.1
132.5°	2349.6	2381.5	2408.1	2430.2	2427.8
135°	2452.1	2491.1	2512.9	2537.5	2532.6
137.5°	2559.2	2588.4	2613.0	2637.3	2630.1
140°	2663.9	2683.7	2710.3	2732.2	2720.2
142.5°	2752.0	2769.1	2800.6	2820.0	2807.9
145°	2844.6	2841.9	2883.4	2900.5	2888.3
147.5°	2924.8	2917.6	2958.9	2971.1	2961.5
150°	3003.0	2985.9	3024.9	3039.3	3027.2
152.5°	3068.6	3049.2	3085.7	3100.4	3083.4
155°	3132.0	3110.3	3139.5	3154.0	3134.6
157.5°	3183.3	3163.9	3185.8	3202.9	3183.3
160°	3227.2	3212.4	3227.2	3241.7	3224.6
162.5°	3266.0	3251.5	3263.7	3280.8	3258.8
165°	3300.2	3285.6	3293.0	3310.0	3293.0
167.5°	3327.1	3312.4	3319.8	3336.9	3314.9
170°	3349.1	3334.3	3339.2	3356.3	3334.3
172.5°	3363.6	3349.1	3353.9	3371.0	3349.1
175°	3375.7	3358.6	3363.6	3380.6	3356.3
177.5°	3380.6	3363.6	3366.1	3383.2	3361.3
180°	3368.5	3368.5	3368.5	3368.5	3368.5

TEST NUMBER: P928044

CATALOG NUMBER: DFN2DIP-HX4F0-090D090US850-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.96	11.82	11.92	12.79	14.06	10.53	11.39	11.49	12.36	13.63
	3H	12.62	13.39	13.59	14.38	15.67	12.15	12.92	13.12	13.90	15.20
	4H	13.21	13.94	14.19	14.93	16.23	12.74	13.47	13.72	14.45	15.75
	6H	13.61	14.28	14.60	15.27	16.59	13.13	13.81	14.13	14.80	16.11
	8H	13.72	14.36	14.71	15.36	16.68	13.24	13.88	14.24	14.89	16.20
	12H	13.76	14.37	14.77	15.38	16.71	13.28	13.89	14.29	14.89	16.23
4H	2H	11.42	12.15	12.41	13.14	14.44	11.08	11.81	12.07	12.79	14.10
	3H	13.29	13.90	14.29	14.91	16.23	12.90	13.51	13.89	14.52	15.84
	4H	14.00	14.56	15.01	15.57	16.91	13.60	14.16	14.60	15.16	16.50
	6H	14.52	15.00	15.54	16.03	17.37	14.11	14.59	15.13	15.62	16.96
	8H	14.67	15.12	15.69	16.14	17.50	14.26	14.71	15.28	15.73	17.08
	12H	14.74	15.15	15.78	16.19	17.55	14.32	14.73	15.36	15.77	17.12
8H	4H	14.20	14.65	15.22	15.68	17.03	13.84	14.29	14.86	15.31	16.67
	6H	14.83	15.21	15.88	16.27	17.62	14.47	14.84	15.51	15.91	17.26
	8H	15.06	15.38	16.11	16.43	17.80	14.69	15.01	15.74	16.07	17.43
	12H	15.19	15.48	16.24	16.52	17.93	14.80	15.09	15.86	16.14	17.55
12H	4H	14.19	14.59	15.22	15.63	16.99	13.84	14.24	14.87	15.28	16.64
	6H	14.87	15.19	15.92	16.24	17.61	14.51	14.84	15.56	15.89	17.26
	8H	15.11	15.40	16.16	16.44	17.85	14.75	15.04	15.80	16.08	17.49

END OF REPORT