

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P910982

Luminaire Tested: DFN2DIP-HX4F0-100D060US850-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P910982
REPORT IS A COMBINATION OF REPORTS P899347 AND P896188
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-100D060US850-FLLFLL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16867.9 lumens
Efficiency: N/A
Efficacy: 126.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 133.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P910982

CATALOG NUMBER: DFN2DIP-HX4F0-100D060US850-FLLFLL

Luminous Intensity Polar Plot

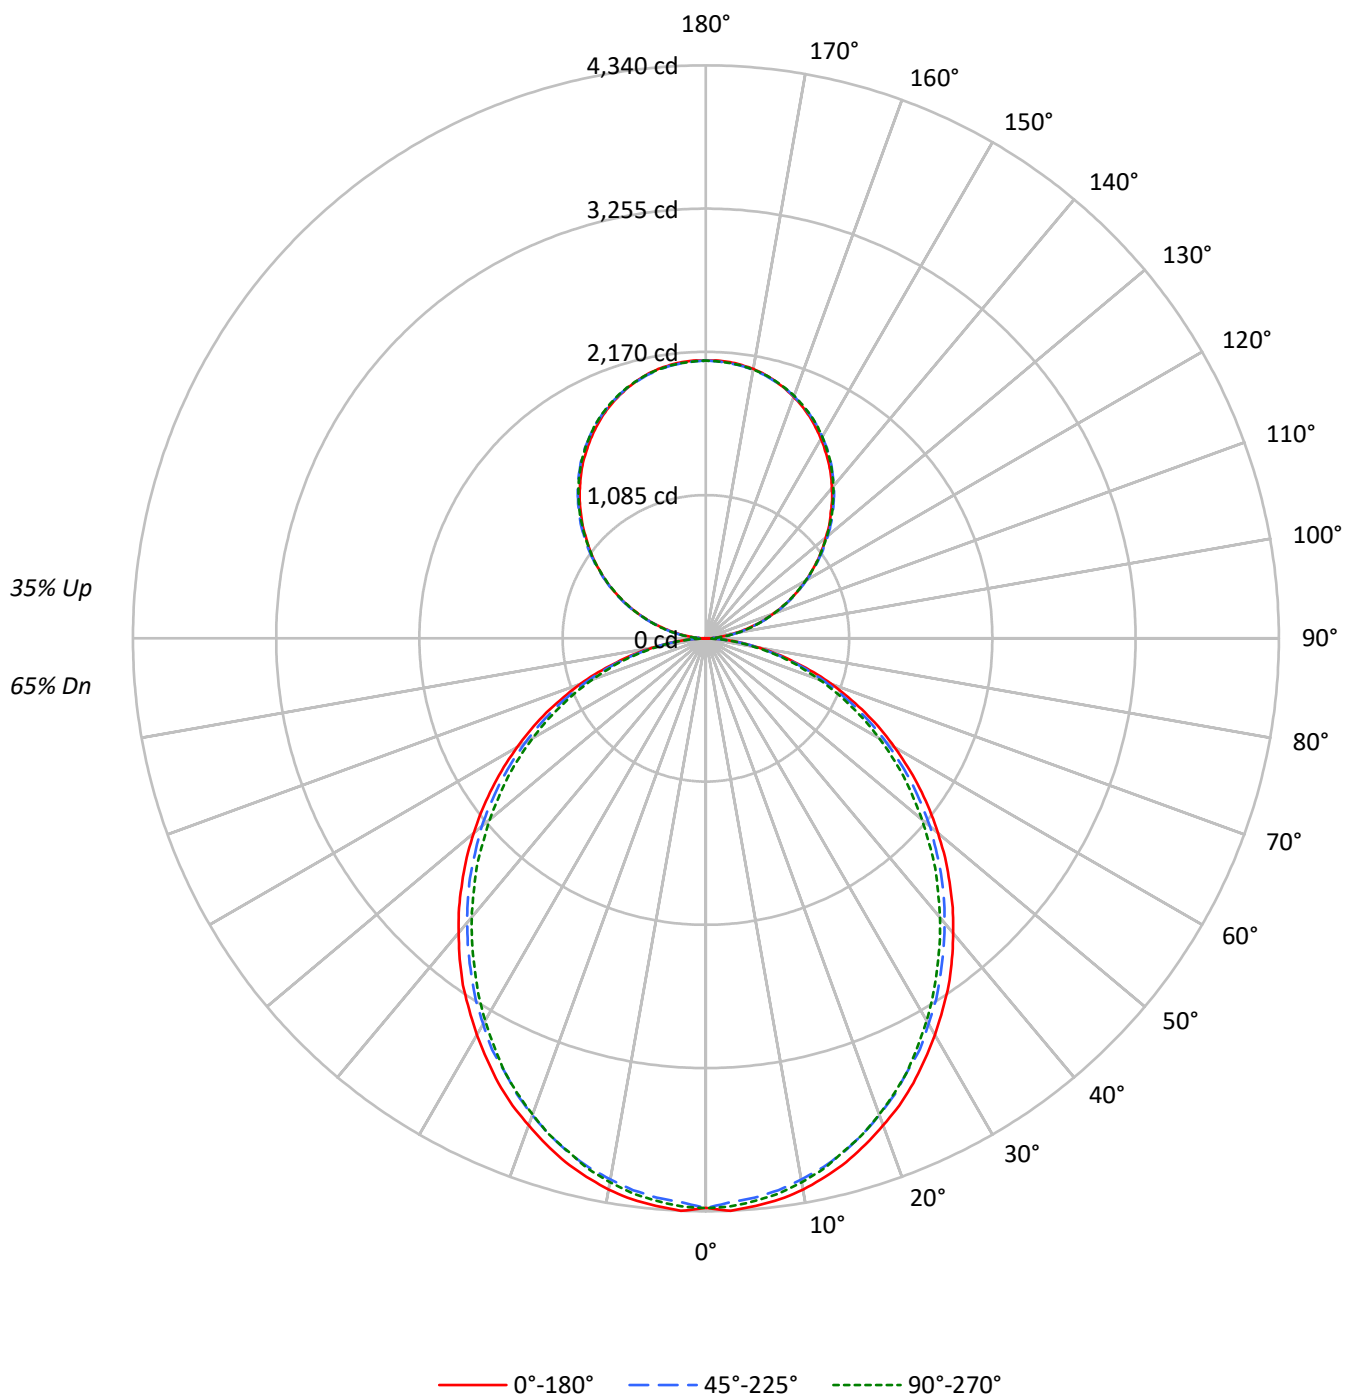

TEST NUMBER: P910982

CATALOG NUMBER: DFN2DIP-HX4F0-100D060US850-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	111	111	111	111	104	104	104	104	92	92	92	80	80	80	70	70	70
1	101	97	93	89	95	91	88	84	81	78	75	71	69	67	62	60	59
2	92	85	78	73	86	80	74	69	71	66	63	62	59	56	55	52	50
3	84	74	67	61	79	70	63	58	62	57	53	55	51	47	48	45	42
4	77	66	58	52	72	62	55	49	55	50	45	49	44	41	43	40	37
5	71	59	50	44	66	56	48	42	50	44	39	44	39	35	39	35	32
6	65	53	45	39	61	50	43	37	45	39	34	40	35	31	35	31	28
7	60	48	40	34	57	45	38	33	41	35	30	36	31	28	32	28	25
8	56	44	36	30	53	41	34	29	37	31	27	33	28	25	30	26	22
9	52	40	32	27	49	38	31	26	34	28	24	31	26	22	27	23	20
10	49	37	29	24	46	35	28	23	32	26	22	28	24	20	25	21	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3209	3209	3209
5°	3214	3164	3185
10°	3188	3122	3142
15°	3142	3071	3075
20°	3078	3000	3006
25°	3016	2915	2927
30°	2937	2835	2825
35°	2863	2742	2718
40°	2771	2648	2616
45°	2679	2553	2512
50°	2579	2454	2391
55°	2474	2339	2280
60°	2356	2203	2153
65°	2227	2062	2003
70°	2063	1890	1842
75°	1835	1684	1693
80°	1561	1422	1409
85°	1133	969	937

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2679 cd/sqm

TEST NUMBER: P910982

CATALOG NUMBER: DFN2DIP-HX4F0-100D060US850-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	406.1	2.4
10°-20°	1142.7	6.8
20°-30°	1679.4	10.0
30°-40°	1950.5	11.6
40°-50°	1948.1	11.5
50°-60°	1698.7	10.1
60°-70°	1255.7	7.4
70°-80°	710.4	4.2
80°-90°	193.5	1.1
90°-100°	130.2	0.8
100°-110°	413.7	2.5
110°-120°	708.0	4.2
120°-130°	931.2	5.5
130°-140°	1045.3	6.2
140°-150°	1025.0	6.1
150°-160°	859.8	5.1
160°-170°	570.2	3.4
170°-180°	199.3	1.2
0°-30°	3228.3	19.1
0°-40°	5178.7	30.7
0°-60°	8825.5	52.3
0°-90°	10985.1	65.1
90°-120°	1252.0	7.4
90°-150°	4253.5	25.2
90°-180°	5883.0	34.9
0°-180°	16867.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4315	4315	4315	4315	4315	
5°	4315	4299	4253	4286	4278	410
15°	4108	4083	4029	4046	4025	1157
25°	3718	3685	3614	3622	3614	1711
35°	3208	3166	3100	3075	3054	2003
45°	2610	2581	2518	2473	2456	2014
55°	1975	1950	1900	1851	1830	1766
65°	1332	1307	1266	1228	1208	1317
75°	697	689	668	643	652	744
85°	170	166	162	149	145	190
90°	2	23	62	58	60	16
95°	93	110	114	114	110	103
105°	382	387	391	394	394	403
115°	710	721	718	716	710	703
125°	1034	1049	1044	1039	1037	924
135°	1337	1356	1360	1358	1353	1033
145°	1623	1636	1646	1648	1641	1014
155°	1856	1861	1866	1875	1870	854
165°	2019	2017	2017	2030	2021	569
175°	2101	2096	2092	2104	2094	200
180°	2104	2104	2104	2104	2104	

TEST NUMBER: P910982

CATALOG NUMBER: DFN2DIP-HX4F0-100D060US850-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4315.2	4315.2	4315.2	4315.2	4315.2
2.5°	4340.3	4319.6	4273.8	4315.2	4307.2
5°	4315.2	4298.9	4253.1	4286.2	4278.2
7.5°	4286.2	4261.4	4215.6	4249.1	4240.8
10°	4240.8	4211.8	4162.0	4195.0	4182.7
12.5°	4178.3	4153.6	4103.9	4124.6	4116.2
15°	4107.8	4083.2	4029.0	4045.7	4025.1
17.5°	4020.7	3996.1	3941.8	3962.6	3941.8
20°	3925.1	3900.5	3842.4	3854.7	3838.4
22.5°	3830.0	3792.7	3738.4	3738.4	3730.1
25°	3717.8	3684.8	3614.3	3622.2	3614.3
27.5°	3593.2	3564.1	3510.4	3498.1	3477.4
30°	3469.1	3435.6	3373.5	3361.2	3344.4
32.5°	3336.1	3311.5	3244.9	3219.9	3203.1
35°	3207.6	3166.2	3099.7	3074.6	3053.9
37.5°	3062.3	3024.8	2958.4	2929.3	2908.6
40°	2913.0	2879.5	2813.1	2776.2	2759.4
42.5°	2767.7	2734.2	2668.3	2626.4	2601.8
45°	2610.1	2581.1	2518.5	2473.2	2456.5
47.5°	2456.5	2427.5	2361.0	2315.1	2290.5
50°	2294.5	2273.8	2215.7	2157.6	2136.9
52.5°	2136.9	2107.9	2054.1	2008.4	1979.3
55°	1975.4	1950.3	1900.5	1850.7	1830.1
57.5°	1813.3	1792.6	1738.5	1688.8	1672.0
60°	1651.3	1635.0	1576.9	1531.1	1518.8
62.5°	1493.7	1464.7	1423.3	1381.9	1365.2
65°	1332.1	1307.1	1265.7	1228.2	1207.6
67.5°	1166.2	1145.0	1108.1	1079.1	1062.3
70°	1012.5	995.8	958.4	929.3	913.0
72.5°	854.9	838.2	817.6	788.5	776.1
75°	696.9	689.0	667.8	643.2	651.5
77.5°	556.1	539.3	530.9	518.6	506.3
80°	415.1	410.8	402.3	390.0	381.7
82.5°	282.2	282.2	278.2	261.5	261.5
85°	169.9	166.0	162.0	149.3	145.3
87.5°	74.9	66.4	58.1	45.8	41.4
90°	1.9	22.8	62.2	58.3	60.2
92.5°	39.4	53.3	55.2	57.1	57.1
95°	92.6	110.3	113.6	113.6	110.3
97.5°	154.2	170.7	177.7	177.7	177.7
100°	225.2	239.8	244.9	244.9	243.0
102.5°	300.1	310.9	317.8	319.7	317.8
105°	381.9	387.0	390.8	394.0	394.0
107.5°	463.1	470.8	470.8	472.0	463.1
110°	541.9	551.9	551.9	551.9	546.8

TEST NUMBER: P910982

CATALOG NUMBER: DFN2DIP-HX4F0-100D060US850-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	626.8	637.6	635.7	630.6	626.8
115°	710.5	720.7	717.5	715.6	710.5
117.5°	793.7	807.7	798.7	793.7	788.6
120°	877.4	891.4	877.4	877.4	871.7
122.5°	953.5	971.3	962.4	957.4	953.5
125°	1033.5	1049.3	1044.2	1038.6	1036.7
127.5°	1111.6	1131.2	1124.2	1116.7	1111.6
130°	1184.5	1207.4	1204.2	1200.4	1193.4
132.5°	1266.4	1284.1	1285.3	1276.5	1271.4
135°	1336.8	1356.4	1360.2	1358.3	1353.2
137.5°	1415.4	1431.3	1434.5	1433.2	1425.6
140°	1484.6	1500.5	1509.3	1509.3	1502.4
142.5°	1555.6	1571.5	1576.6	1578.4	1571.5
145°	1622.9	1635.6	1645.8	1647.6	1640.7
147.5°	1683.1	1699.0	1706.6	1709.7	1702.8
150°	1745.3	1756.1	1763.1	1768.7	1763.1
152.5°	1800.5	1811.3	1820.2	1827.2	1820.2
155°	1855.7	1860.8	1866.4	1875.4	1869.7
157.5°	1903.3	1907.1	1910.3	1923.0	1914.1
160°	1945.9	1949.6	1951.5	1962.3	1954.7
162.5°	1985.1	1985.1	1987.0	1999.1	1990.2
165°	2018.7	2016.8	2016.8	2029.6	2020.7
167.5°	2049.2	2043.6	2043.6	2056.2	2047.3
170°	2072.1	2067.0	2065.1	2077.7	2067.0
172.5°	2087.9	2082.8	2080.9	2093.6	2082.8
175°	2100.6	2095.6	2091.7	2104.4	2093.6
177.5°	2107.5	2102.6	2098.7	2109.4	2098.7
180°	2104.4	2104.4	2104.4	2104.4	2104.4

TEST NUMBER: P910982

CATALOG NUMBER: DFN2DIP-HX4F0-100D060US850-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.61	13.63	13.43	14.47	15.50	12.18	13.20	13.00	14.03	15.07
	3H	14.28	15.20	15.11	16.04	17.11	13.81	14.72	14.64	15.57	16.64
	4H	14.88	15.74	15.73	16.60	17.67	14.41	15.27	15.25	16.12	17.20
	6H	15.29	16.08	16.15	16.95	18.04	14.81	15.61	15.67	16.47	17.56
	8H	15.40	16.16	16.26	17.04	18.13	14.92	15.68	15.79	16.56	17.65
	12H	15.45	16.17	16.32	17.05	18.16	14.97	15.69	15.84	16.57	17.68
4H	2H	13.09	13.95	13.94	14.81	15.89	12.75	13.61	13.60	14.47	15.54
	3H	14.97	15.69	15.83	16.58	17.67	14.58	15.30	15.44	16.19	17.28
	4H	15.70	16.35	16.57	17.24	18.35	15.29	15.95	16.16	16.83	17.95
	6H	16.22	16.79	17.11	17.70	18.82	15.81	16.38	16.70	17.29	18.41
	8H	16.37	16.90	17.27	17.81	18.94	15.96	16.49	16.85	17.39	18.53
	12H	16.46	16.93	17.37	17.86	19.00	16.03	16.51	16.94	17.43	18.57
8H	4H	15.90	16.43	16.80	17.34	18.47	15.54	16.07	16.44	16.98	18.11
	6H	16.54	16.98	17.46	17.93	19.06	16.18	16.62	17.10	17.57	18.70
	8H	16.77	17.16	17.70	18.09	19.24	16.40	16.79	17.33	17.72	18.88
	12H	16.91	17.25	17.84	18.18	19.38	16.52	16.86	17.45	17.79	19.00
12H	4H	15.90	16.38	16.81	17.30	18.44	15.55	16.02	16.46	16.95	18.09
	6H	16.58	16.97	17.50	17.90	19.05	16.22	16.61	17.15	17.55	18.70
	8H	16.83	17.17	17.76	18.10	19.30	16.47	16.81	17.40	17.74	18.94

END OF REPORT