

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P910992

Luminaire Tested: DFN2DIP-HX4F0-100D110US850-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P910992
REPORT IS A COMBINATION OF REPORTS P899437 AND P896188
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-100D110US850-FLLFLL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 21775.2 lumens
Efficiency: N/A
Efficacy: 132.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 164.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P910992

CATALOG NUMBER: DFN2DIP-HX4F0-100D110US850-FLLFLL

Luminous Intensity Polar Plot

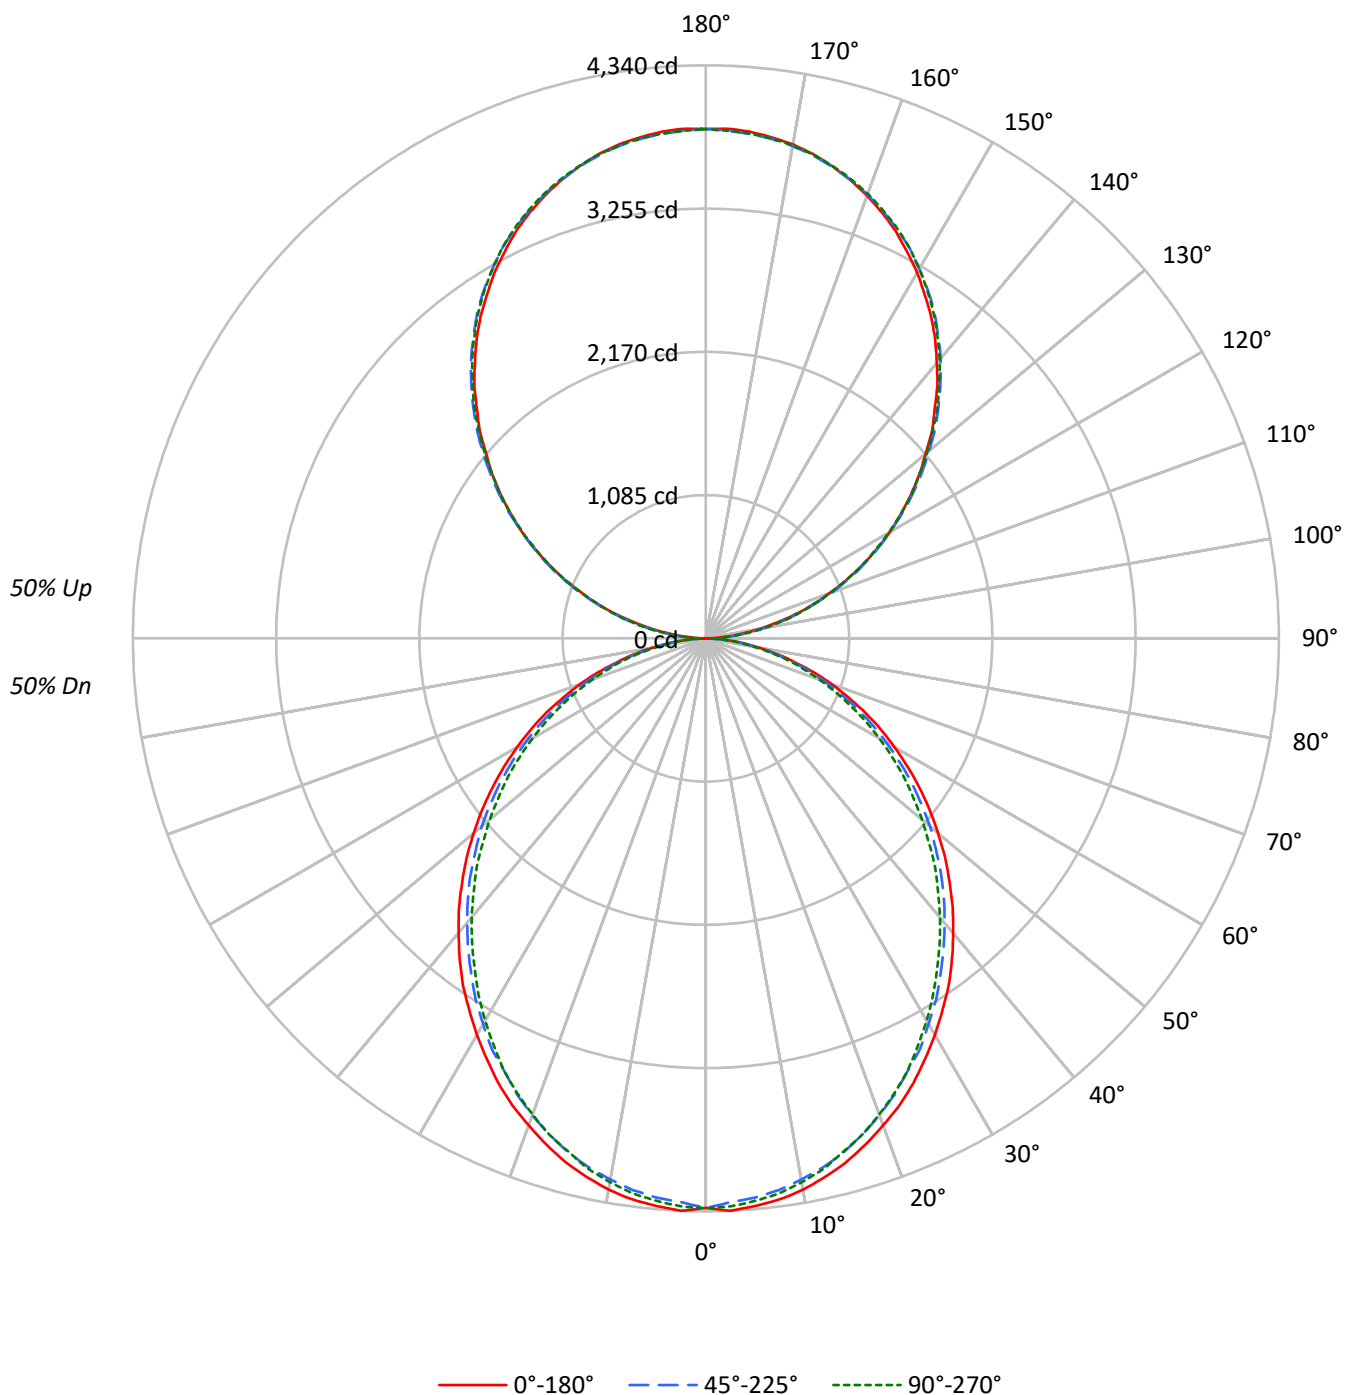

TEST NUMBER: P910992

CATALOG NUMBER: DFN2DIP-HX4F0-100D110US850-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	84	84	84	69	69	69	57	57	57
1	98	94	90	86	90	86	83	80	73	71	69	61	59	58	50	49	48
2	89	82	76	70	82	76	70	66	64	60	57	54	51	48	44	42	40
3	81	72	64	59	75	67	60	55	57	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	30
5	68	57	49	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	41	35	31	34	30	27	29	25	23
7	58	46	38	32	54	43	36	31	37	31	27	31	27	24	26	23	20
8	54	42	34	29	50	39	32	27	34	28	24	29	24	21	24	21	18
9	50	38	31	25	46	36	29	24	31	25	22	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3209	3209	3209
5°	3214	3164	3185
10°	3188	3122	3142
15°	3142	3071	3075
20°	3078	3000	3006
25°	3016	2915	2927
30°	2937	2835	2825
35°	2863	2742	2718
40°	2771	2648	2616
45°	2679	2553	2512
50°	2579	2454	2391
55°	2474	2339	2280
60°	2356	2203	2153
65°	2227	2062	2003
70°	2063	1890	1842
75°	1835	1684	1693
80°	1561	1422	1409
85°	1133	969	937

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2909 cd/sqm

TEST NUMBER: P910992

CATALOG NUMBER: DFN2DIP-HX4F0-100D110US850-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	406.1	1.9
10°-20°	1142.7	5.2
20°-30°	1679.4	7.7
30°-40°	1950.5	9.0
40°-50°	1948.1	8.9
50°-60°	1698.7	7.8
60°-70°	1255.7	5.8
70°-80°	710.4	3.3
80°-90°	198.5	0.9
90°-100°	238.7	1.1
100°-110°	758.6	3.5
110°-120°	1298.1	6.0
120°-130°	1707.2	7.8
130°-140°	1916.3	8.8
140°-150°	1879.1	8.6
150°-160°	1576.3	7.2
160°-170°	1045.4	4.8
170°-180°	365.4	1.7
0°-30°	3228.3	14.8
0°-40°	5178.7	23.8
0°-60°	8825.5	40.5
0°-90°	10990.1	50.5
90°-120°	2295.4	10.5
90°-150°	7798.0	35.8
90°-180°	10785.0	49.5
0°-180°	21775.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4315	4315	4315	4315	4315	
5°	4315	4299	4253	4286	4278	410
15°	4108	4083	4029	4046	4025	1157
25°	3718	3685	3614	3622	3614	1711
35°	3208	3166	3100	3075	3054	2003
45°	2610	2581	2518	2473	2456	2014
55°	1975	1950	1900	1851	1830	1766
65°	1332	1307	1266	1228	1208	1317
75°	697	689	668	643	652	744
85°	170	166	162	149	145	190
90°	3	42	114	107	110	21
95°	170	202	208	208	202	189
105°	700	710	716	722	722	739
115°	1303	1321	1316	1312	1303	1288
125°	1895	1924	1914	1904	1900	1693
135°	2451	2487	2494	2490	2481	1894
145°	2975	2998	3017	3021	3008	1859
155°	3402	3411	3422	3438	3428	1566
165°	3701	3698	3698	3721	3704	1044
175°	3851	3842	3835	3858	3838	366
180°	3858	3858	3858	3858	3858	

TEST NUMBER: P910992

CATALOG NUMBER: DFN2DIP-HX4F0-100D110US850-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4315.2	4315.2	4315.2	4315.2	4315.2
2.5°	4340.3	4319.6	4273.8	4315.2	4307.2
5°	4315.2	4298.9	4253.1	4286.2	4278.2
7.5°	4286.2	4261.4	4215.6	4249.1	4240.8
10°	4240.8	4211.8	4162.0	4195.0	4182.7
12.5°	4178.3	4153.6	4103.9	4124.6	4116.2
15°	4107.8	4083.2	4029.0	4045.7	4025.1
17.5°	4020.7	3996.1	3941.8	3962.6	3941.8
20°	3925.1	3900.5	3842.4	3854.7	3838.4
22.5°	3830.0	3792.7	3738.4	3738.4	3730.1
25°	3717.8	3684.8	3614.3	3622.2	3614.3
27.5°	3593.2	3564.1	3510.4	3498.1	3477.4
30°	3469.1	3435.6	3373.5	3361.2	3344.4
32.5°	3336.1	3311.5	3244.9	3219.9	3203.1
35°	3207.6	3166.2	3099.7	3074.6	3053.9
37.5°	3062.3	3024.8	2958.4	2929.3	2908.6
40°	2913.0	2879.5	2813.1	2776.2	2759.4
42.5°	2767.7	2734.2	2668.3	2626.4	2601.8
45°	2610.1	2581.1	2518.5	2473.2	2456.5
47.5°	2456.5	2427.5	2361.0	2315.1	2290.5
50°	2294.5	2273.8	2215.7	2157.6	2136.9
52.5°	2136.9	2107.9	2054.1	2008.4	1979.3
55°	1975.4	1950.3	1900.5	1850.7	1830.1
57.5°	1813.3	1792.6	1738.5	1688.8	1672.0
60°	1651.3	1635.0	1576.9	1531.1	1518.8
62.5°	1493.7	1464.7	1423.3	1381.9	1365.2
65°	1332.1	1307.1	1265.7	1228.2	1207.6
67.5°	1166.2	1145.0	1108.1	1079.1	1062.3
70°	1012.5	995.8	958.4	929.3	913.0
72.5°	854.9	838.2	817.6	788.5	776.1
75°	696.9	689.0	667.8	643.2	651.5
77.5°	556.1	539.3	530.9	518.6	506.3
80°	415.1	410.8	402.3	390.0	381.7
82.5°	282.2	282.2	278.2	261.5	261.5
85°	169.9	166.0	162.0	149.3	145.3
87.5°	74.9	66.4	58.1	45.8	41.4
90°	3.4	41.9	114.0	107.0	110.5
92.5°	72.1	97.7	101.1	104.7	104.7
95°	169.8	202.4	208.2	208.2	202.4
97.5°	282.7	312.8	325.7	325.7	325.7
100°	412.9	439.6	448.9	448.9	445.5
102.5°	550.2	569.9	582.8	586.2	582.8
105°	700.2	709.5	716.5	722.3	722.3
107.5°	849.1	863.0	863.0	865.4	849.1
110°	993.3	1012.0	1012.0	1012.0	1002.6

TEST NUMBER: P910992

CATALOG NUMBER: DFN2DIP-HX4F0-100D110US850-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1149.1	1168.9	1165.4	1156.1	1149.1
115°	1302.7	1321.3	1315.5	1312.1	1302.7
117.5°	1455.1	1480.6	1464.3	1455.1	1445.8
120°	1608.6	1634.2	1608.6	1608.6	1598.2
122.5°	1748.2	1780.7	1764.4	1755.1	1748.2
125°	1894.7	1923.8	1914.5	1904.0	1900.5
127.5°	2037.8	2073.8	2061.1	2047.1	2037.8
130°	2171.5	2213.5	2207.6	2200.6	2187.8
132.5°	2321.6	2354.2	2356.5	2340.2	2330.9
135°	2450.7	2486.7	2493.7	2490.3	2480.9
137.5°	2594.9	2624.0	2629.8	2627.4	2613.6
140°	2721.7	2750.8	2767.1	2767.1	2754.3
142.5°	2852.0	2881.1	2890.4	2893.8	2881.1
145°	2975.2	2998.5	3017.1	3020.6	3007.8
147.5°	3085.8	3114.8	3128.8	3134.6	3121.8
150°	3199.8	3219.5	3232.3	3242.8	3232.3
152.5°	3300.9	3320.7	3337.0	3349.8	3337.0
155°	3402.2	3411.4	3421.9	3438.2	3427.7
157.5°	3489.4	3496.3	3502.1	3525.4	3509.1
160°	3567.3	3574.3	3577.7	3597.6	3583.6
162.5°	3639.4	3639.4	3643.0	3665.0	3648.7
165°	3701.1	3697.5	3697.5	3720.8	3704.5
167.5°	3756.8	3746.4	3746.4	3769.7	3753.4
170°	3798.8	3789.5	3786.0	3809.2	3789.5
172.5°	3827.8	3818.5	3815.1	3838.4	3818.5
175°	3851.1	3841.8	3834.8	3858.1	3838.4
177.5°	3863.9	3854.6	3847.6	3867.4	3847.6
180°	3858.1	3858.1	3858.1	3858.1	3858.1

TEST NUMBER: P910992

CATALOG NUMBER: DFN2DIP-HX4F0-100D110US850-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.37	12.23	12.32	13.20	14.46	10.93	11.80	11.89	12.77	14.03
	3H	13.03	13.80	13.99	14.78	16.07	12.55	13.33	13.52	14.31	15.60
	4H	13.62	14.35	14.59	15.33	16.63	13.14	13.88	14.12	14.86	16.15
	6H	14.02	14.69	15.01	15.68	16.99	13.54	14.22	14.53	15.20	16.51
	8H	14.12	14.77	15.12	15.77	17.08	13.65	14.29	14.64	15.30	16.60
	12H	14.17	14.78	15.17	15.78	17.11	13.69	14.30	14.69	15.30	16.63
4H	2H	11.83	12.56	12.81	13.55	14.84	11.48	12.22	12.47	13.20	14.50
	3H	13.70	14.31	14.69	15.32	16.63	13.30	13.92	14.30	14.93	16.24
	4H	14.41	14.97	15.41	15.98	17.31	14.01	14.57	15.01	15.57	16.90
	6H	14.93	15.41	15.94	16.44	17.77	14.52	15.00	15.53	16.03	17.36
	8H	15.08	15.53	16.09	16.55	17.89	14.67	15.12	15.68	16.14	17.48
	12H	15.15	15.56	16.18	16.60	17.95	14.73	15.14	15.76	16.17	17.52
8H	4H	14.61	15.06	15.62	16.08	17.43	14.25	14.70	15.26	15.72	17.07
	6H	15.24	15.62	16.28	16.68	18.02	14.88	15.25	15.92	16.31	17.66
	8H	15.46	15.79	16.51	16.84	18.20	15.09	15.42	16.14	16.47	17.83
	12H	15.60	15.89	16.65	16.93	18.33	15.21	15.50	16.26	16.54	17.95
12H	4H	14.59	15.00	15.63	16.04	17.39	14.24	14.65	15.28	15.69	17.04
	6H	15.27	15.60	16.32	16.65	18.01	14.92	15.25	15.97	16.30	17.66
	8H	15.52	15.80	16.57	16.85	18.25	15.16	15.45	16.21	16.49	17.89

END OF REPORT