

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P911006

Luminaire Tested: DFN2DIP-HX4F0-110D090US850-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P911006
REPORT IS A COMBINATION OF REPORTS P899403 AND P896188
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-110D090US850-FLLFLL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 20910.2 lumens
Efficiency: N/A
Efficacy: 128.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 163.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9967
Total Harmonic Distortion (THDi): 0.063
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P911006

CATALOG NUMBER: DFN2DIP-HX4F0-110D090US850-FLLFLL

Luminous Intensity Polar Plot

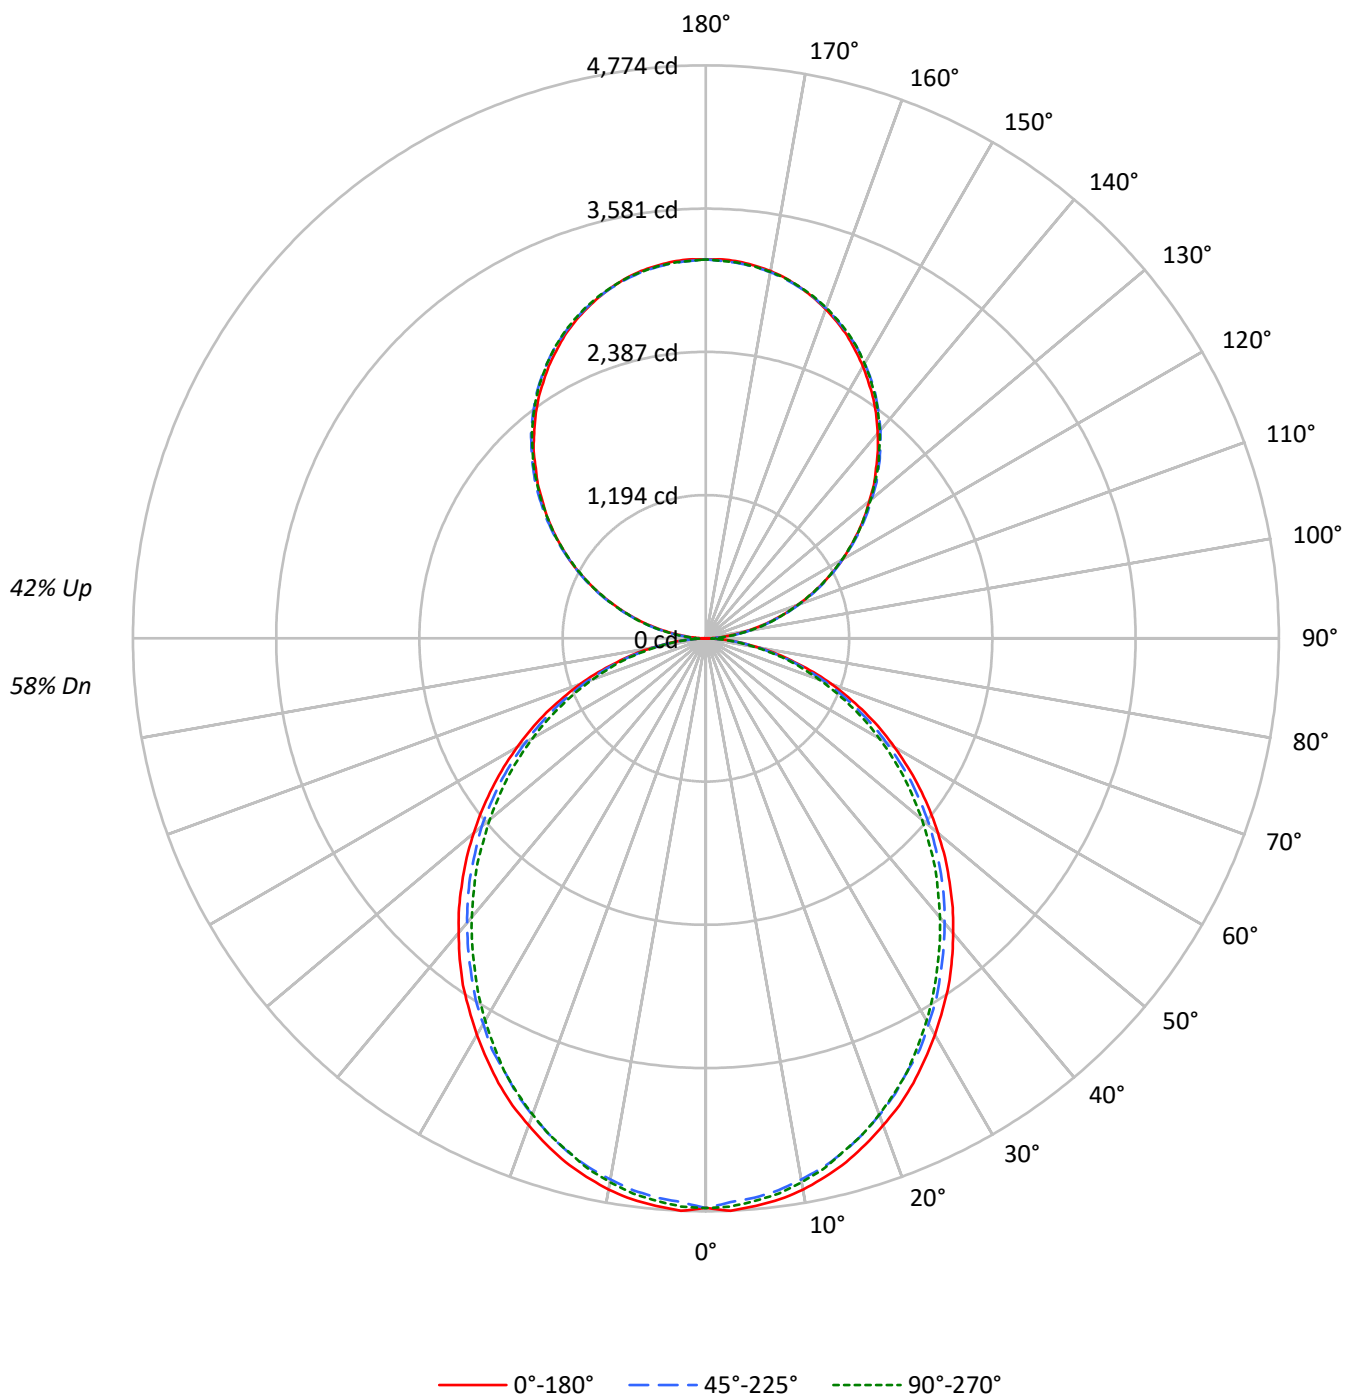

TEST NUMBER: P911006

CATALOG NUMBER: DFN2DIP-HX4F0-110D090US850-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	102	102	102	102	88	88	88	75	75	75	63	63	63
1	100	95	91	88	93	89	85	82	77	74	72	66	64	62	56	55	53
2	91	83	77	72	84	78	72	68	67	63	60	58	55	52	49	47	45
3	83	73	66	60	77	68	62	56	59	54	50	51	47	44	44	41	38
4	76	65	57	51	70	61	53	48	53	47	43	46	41	38	39	36	33
5	70	58	49	43	65	54	47	41	47	42	37	41	36	33	35	32	29
6	64	52	44	38	60	49	41	36	43	37	32	37	32	29	32	28	25
7	59	47	39	33	55	44	37	32	39	33	29	34	29	26	29	25	23
8	55	43	35	29	51	40	33	28	35	30	25	31	26	23	27	23	20
9	51	39	31	26	48	37	30	25	32	27	23	29	24	21	25	21	18
10	48	36	28	24	45	34	27	23	30	24	21	26	22	19	23	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3529	3529	3529
5°	3535	3481	3504
10°	3507	3434	3457
15°	3456	3378	3383
20°	3386	3300	3307
25°	3317	3206	3219
30°	3231	3119	3108
35°	3149	3016	2990
40°	3048	2913	2878
45°	2947	2809	2763
50°	2837	2699	2631
55°	2722	2573	2509
60°	2591	2423	2369
65°	2450	2268	2204
70°	2269	2079	2026
75°	2018	1853	1863
80°	1717	1565	1550
85°	1247	1066	1031

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2947 cd/sqm

TEST NUMBER: P911006

CATALOG NUMBER: DFN2DIP-HX4F0-110D090US850-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	446.8	2.1
10°-20°	1257.0	6.0
20°-30°	1847.3	8.8
30°-40°	2145.5	10.3
40°-50°	2142.9	10.2
50°-60°	1868.5	8.9
60°-70°	1381.3	6.6
70°-80°	781.5	3.7
80°-90°	215.2	1.0
90°-100°	195.3	0.9
100°-110°	620.6	3.0
110°-120°	1062.1	5.1
120°-130°	1396.8	6.7
130°-140°	1567.9	7.5
140°-150°	1537.5	7.4
150°-160°	1289.7	6.2
160°-170°	855.3	4.1
170°-180°	299.0	1.4
0°-30°	3551.1	17.0
0°-40°	5696.6	27.2
0°-60°	9708.0	46.4
0°-90°	12086.0	57.8
90°-120°	1878.1	9.0
90°-150°	6380.2	30.5
90°-180°	8824.0	42.2
0°-180°	20910.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4747	4747	4747	4747	4747	
5°	4747	4729	4678	4715	4706	451
15°	4519	4491	4432	4450	4428	1273
25°	4090	4053	3976	3984	3976	1882
35°	3528	3483	3410	3382	3359	2203
45°	2871	2839	2770	2721	2702	2216
55°	2173	2145	2091	2036	2013	1943
65°	1465	1438	1392	1351	1328	1449
75°	766	758	735	708	717	818
85°	187	182	178	164	160	209
90°	3	34	93	88	90	20
95°	139	166	170	170	166	155
105°	573	580	586	591	591	605
115°	1066	1081	1076	1074	1066	1054
125°	1550	1574	1566	1558	1555	1385
135°	2005	2035	2040	2038	2030	1550
145°	2434	2453	2468	2471	2461	1521
155°	2784	2791	2800	2813	2805	1281
165°	3028	3025	3025	3044	3031	854
175°	3151	3143	3138	3157	3140	299
180°	3157	3157	3157	3157	3157	

TEST NUMBER: P911006

CATALOG NUMBER: DFN2DIP-HX4F0-110D090US850-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4746.7	4746.7	4746.7	4746.7	4746.7
2.5°	4774.2	4751.5	4701.2	4746.7	4738.0
5°	4746.7	4728.8	4678.4	4714.7	4706.0
7.5°	4714.7	4687.6	4637.3	4674.1	4664.9
10°	4664.9	4632.8	4578.2	4614.4	4600.9
12.5°	4596.1	4569.0	4514.3	4537.0	4527.8
15°	4518.6	4491.4	4431.9	4450.3	4427.6
17.5°	4422.7	4395.6	4336.1	4358.8	4336.1
20°	4317.7	4290.5	4226.6	4240.2	4222.3
22.5°	4213.1	4171.8	4112.3	4112.3	4103.1
25°	4089.5	4053.3	3975.8	3984.5	3975.8
27.5°	3952.5	3920.5	3861.4	3847.9	3825.2
30°	3816.0	3779.1	3710.8	3697.3	3678.9
32.5°	3669.7	3642.6	3569.4	3541.8	3523.4
35°	3528.3	3482.8	3409.6	3382.0	3359.3
37.5°	3368.5	3327.3	3254.2	3222.2	3199.5
40°	3204.3	3167.5	3094.4	3053.7	3035.3
42.5°	3044.5	3007.7	2935.1	2889.1	2862.0
45°	2871.2	2839.2	2770.4	2720.6	2702.2
47.5°	2702.2	2670.3	2597.1	2546.7	2519.5
50°	2524.0	2501.2	2437.2	2373.4	2350.6
52.5°	2350.6	2318.6	2259.6	2209.1	2177.2
55°	2172.9	2145.2	2090.6	2035.8	2013.1
57.5°	1994.6	1971.9	1912.4	1857.6	1839.2
60°	1816.4	1798.6	1734.6	1684.2	1670.7
62.5°	1643.1	1611.2	1565.6	1520.1	1501.7
65°	1465.3	1437.7	1392.2	1351.1	1328.4
67.5°	1282.8	1259.6	1218.9	1187.0	1168.6
70°	1113.8	1095.4	1054.2	1022.3	1004.3
72.5°	940.4	922.0	899.3	867.3	853.7
75°	766.5	757.9	734.6	707.5	716.7
77.5°	611.6	593.2	584.0	570.5	556.9
80°	456.7	451.8	442.6	429.1	419.9
82.5°	310.4	310.4	306.1	287.7	287.7
85°	187.0	182.5	178.2	164.1	159.8
87.5°	82.3	73.1	63.9	50.3	45.5
90°	2.9	34.3	93.3	87.5	90.4
92.5°	59.0	80.0	82.8	85.6	85.6
95°	139.0	165.6	170.3	170.3	165.6
97.5°	231.2	256.0	266.5	266.5	266.5
100°	337.8	359.8	367.3	367.3	364.5
102.5°	450.1	466.3	476.8	479.6	476.8
105°	572.9	580.5	586.2	591.0	591.0
107.5°	694.7	706.1	706.1	708.0	694.7
110°	812.7	828.0	828.0	828.0	820.3

TEST NUMBER: P911006

CATALOG NUMBER: DFN2DIP-HX4F0-110D090US850-FLLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	940.2	956.4	953.5	946.0	940.2
115°	1065.9	1081.1	1076.3	1073.5	1065.9
117.5°	1190.5	1211.5	1198.2	1190.5	1182.9
120°	1316.2	1337.0	1316.2	1316.2	1307.5
122.5°	1430.3	1457.0	1443.7	1436.0	1430.3
125°	1550.3	1574.0	1566.5	1557.8	1555.0
127.5°	1667.3	1696.8	1686.3	1674.9	1667.3
130°	1776.7	1811.0	1806.2	1800.5	1790.0
132.5°	1899.5	1926.1	1928.0	1914.7	1907.1
135°	2005.1	2034.6	2040.3	2037.5	2029.9
137.5°	2123.1	2146.9	2151.7	2149.8	2138.4
140°	2226.9	2250.6	2263.9	2263.9	2253.5
142.5°	2333.4	2357.2	2364.8	2367.7	2357.2
145°	2434.4	2453.3	2468.5	2471.4	2461.0
147.5°	2524.7	2548.5	2559.9	2564.7	2554.2
150°	2618.0	2634.2	2644.6	2653.2	2644.6
152.5°	2700.7	2716.9	2730.2	2740.8	2730.2
155°	2783.6	2791.1	2799.8	2813.1	2804.6
157.5°	2854.9	2860.7	2865.4	2884.4	2871.1
160°	2918.7	2924.4	2927.3	2943.4	2932.0
162.5°	2977.7	2977.7	2980.5	2998.6	2985.3
165°	3028.1	3025.2	3025.2	3044.3	3031.0
167.5°	3073.8	3065.3	3065.3	3084.2	3070.9
170°	3108.1	3100.4	3097.7	3116.6	3100.4
172.5°	3131.8	3124.3	3121.4	3140.5	3124.3
175°	3150.9	3143.2	3137.6	3156.7	3140.5
177.5°	3161.3	3153.8	3148.0	3164.2	3148.0
180°	3156.7	3156.7	3156.7	3156.7	3156.7

TEST NUMBER: P911006

CATALOG NUMBER: DFN2DIP-HX4F0-110D090US850-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.34	13.28	13.23	14.19	15.34	11.91	12.85	12.80	13.76	14.91
	3H	14.01	14.85	14.91	15.77	16.95	13.54	14.38	14.44	15.29	16.48
	4H	14.60	15.40	15.52	16.32	17.51	14.13	14.92	15.04	15.85	17.04
	6H	15.01	15.74	15.93	16.67	17.87	14.53	15.26	15.46	16.19	17.40
	8H	15.11	15.81	16.05	16.76	17.96	14.64	15.34	15.57	16.28	17.48
	12H	15.17	15.83	16.10	16.77	18.00	14.68	15.35	15.62	16.29	17.52
4H	2H	12.81	13.61	13.73	14.53	15.72	12.47	13.26	13.39	14.19	15.38
	3H	14.69	15.35	15.62	16.31	17.51	14.30	14.96	15.23	15.91	17.12
	4H	15.41	16.01	16.35	16.96	18.19	15.00	15.61	15.94	16.55	17.78
	6H	15.93	16.45	16.88	17.42	18.65	15.52	16.04	16.47	17.01	18.24
	8H	16.08	16.57	17.04	17.53	18.78	15.67	16.16	16.62	17.12	18.36
	12H	16.16	16.60	17.13	17.58	18.83	15.73	16.17	16.71	17.16	18.41
8H	4H	15.61	16.10	16.57	17.06	18.31	15.25	15.74	16.21	16.70	17.95
	6H	16.25	16.65	17.23	17.66	18.90	15.88	16.29	16.87	17.29	18.54
	8H	16.47	16.83	17.46	17.82	19.08	16.10	16.46	17.09	17.45	18.71
	12H	16.60	16.92	17.60	17.91	19.22	16.22	16.53	17.21	17.52	18.83
12H	4H	15.60	16.04	16.58	17.02	18.27	15.25	15.69	16.22	16.67	17.92
	6H	16.28	16.63	17.27	17.63	18.89	15.93	16.28	16.92	17.28	18.54
	8H	16.52	16.84	17.52	17.83	19.13	16.17	16.48	17.16	17.47	18.78

END OF REPORT