

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P928258

Luminaire Tested: DFN2DIP-HX4F0-060D080US927-RLLONL

Issue Date: 12/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P928258
REPORT IS A COMBINATION OF REPORTS P900896 AND P896187
Test Lab: INNOVATION CENTER
Issue Date: 12/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-060D080US927-RLLONL
Description: 4 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10311.8 lumens
Efficiency: N/A
Efficacy: 91.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 112.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.099
Total Harmonic Distortion (THDi): 0.979
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P928258

CATALOG NUMBER: DFN2DIP-HX4F0-060D080US927-RLLONL

Luminous Intensity Polar Plot

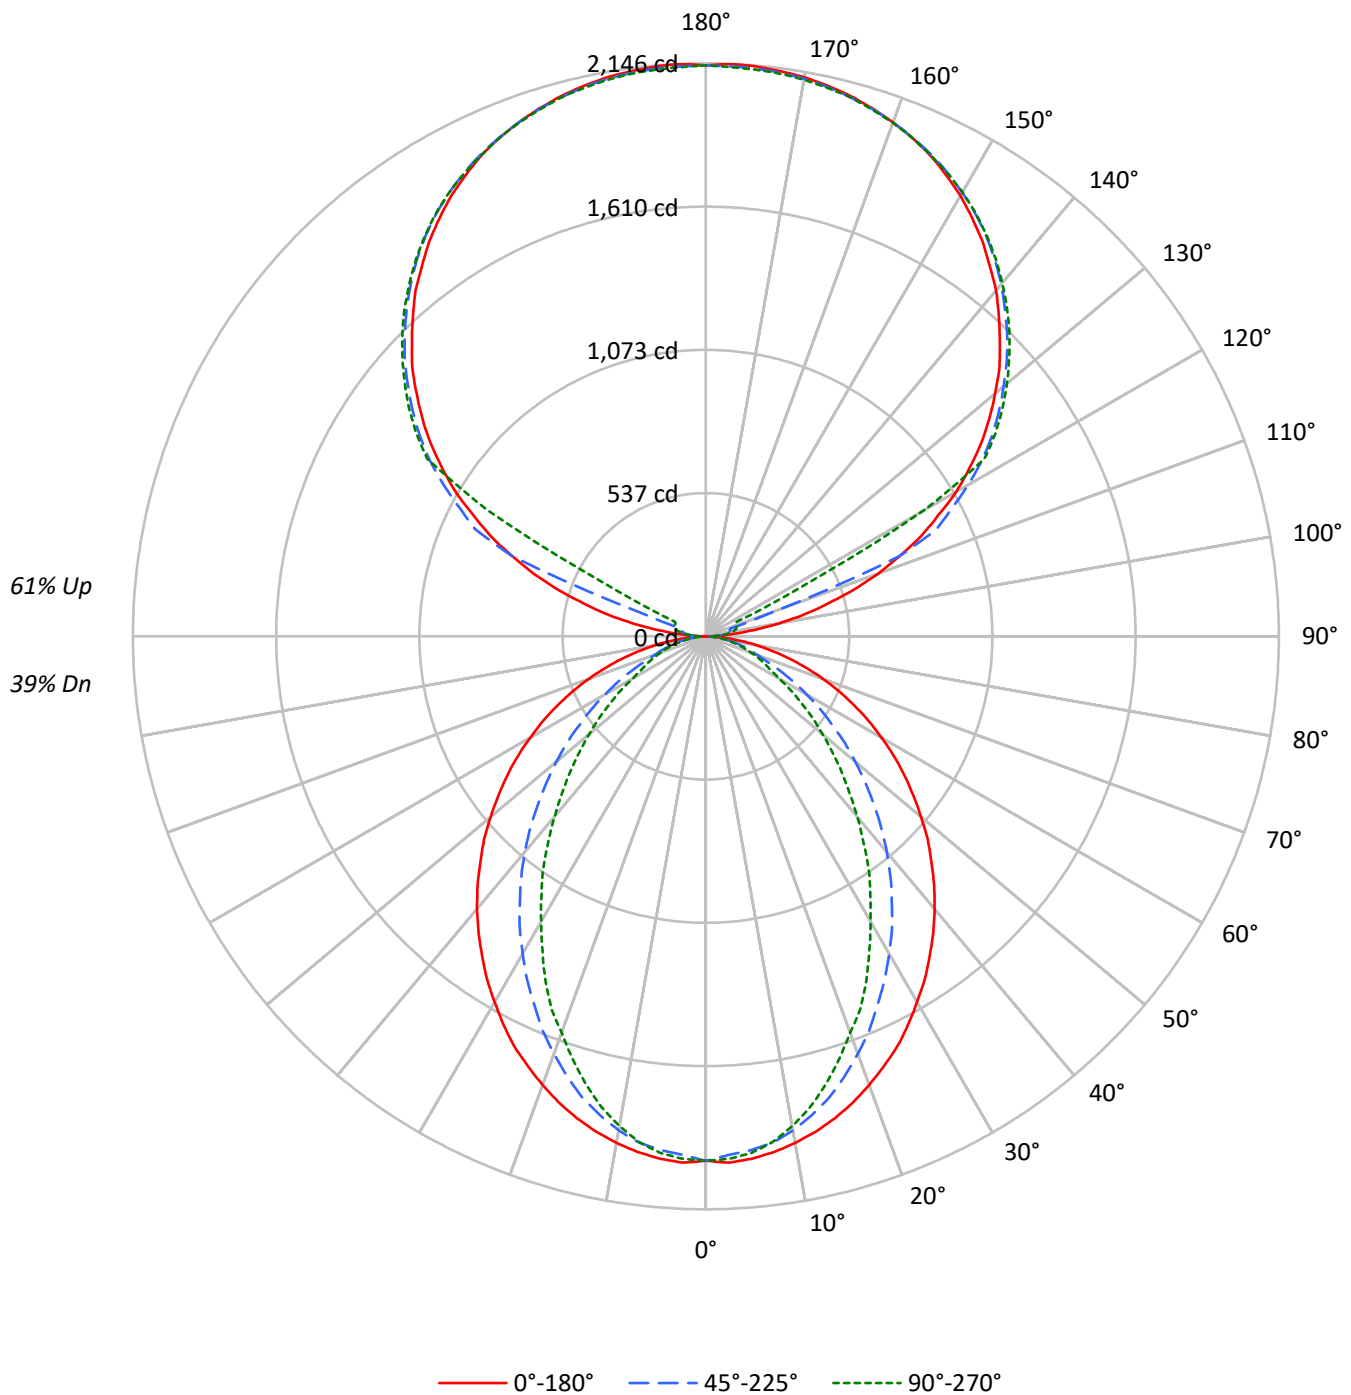

TEST NUMBER: P928258

CATALOG NUMBER: DFN2DIP-HX4F0-060D080US927-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	95	95	95	95	77	77	77	61	61	61	46	46	46
1	96	92	88	85	87	83	80	78	68	66	64	54	53	52	41	41	40
2	87	80	75	70	79	73	68	64	60	57	54	48	46	44	37	35	34
3	80	71	64	58	73	65	59	54	53	49	46	43	40	37	33	31	29
4	73	63	55	50	67	58	51	46	48	43	39	38	35	32	30	27	26
5	67	56	48	43	61	52	45	40	43	38	34	35	31	28	27	25	23
6	62	51	43	37	56	46	40	35	39	34	30	31	28	25	25	22	20
7	57	46	38	33	52	42	35	31	35	30	26	29	25	22	23	20	18
8	53	42	34	29	49	38	32	27	32	27	23	26	22	20	21	18	16
9	50	38	31	26	45	35	29	24	29	24	21	24	20	18	19	17	15
10	46	35	28	23	42	32	26	22	27	22	19	22	19	16	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1460	1460	1460
5°	1463	1437	1446
10°	1448	1409	1399
15°	1429	1363	1327
20°	1402	1299	1238
25°	1376	1227	1151
30°	1339	1153	1042
35°	1304	1074	946
40°	1268	992	836
45°	1226	901	736
50°	1183	809	639
55°	1138	711	545
60°	1085	608	449
65°	1025	504	404
70°	952	406	366
75°	861	359	333
80°	728	301	289
85°	509	202	217

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1226 cd/sqm

TEST NUMBER: P928258

CATALOG NUMBER: DFN2DIP-HX4F0-060D080US927-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	184.1	1.8
10°-20°	505.3	4.9
20°-30°	709.4	6.9
30°-40°	773.3	7.5
40°-50°	710.8	6.9
50°-60°	558.2	5.4
60°-70°	363.3	3.5
70°-80°	187.0	1.8
80°-90°	51.5	0.5
90°-100°	70.5	0.7
100°-110°	262.9	2.5
110°-120°	697.1	6.8
120°-130°	1156.2	11.2
130°-140°	1228.2	11.9
140°-150°	1141.5	11.1
150°-160°	917.7	8.9
160°-170°	591.3	5.7
170°-180°	203.5	2.0
0°-30°	1398.8	13.6
0°-40°	2172.1	21.1
0°-60°	3441.1	33.4
0°-90°	4042.9	39.2
90°-120°	1030.5	10.0
90°-150°	4556.4	44.2
90°-180°	6269.0	60.8
0°-180°	10311.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1964	1964	1964	1964	1964	
5°	1964	1955	1932	1948	1943	186
15°	1868	1848	1788	1754	1736	526
25°	1696	1639	1521	1449	1422	780
35°	1461	1370	1214	1102	1063	914
45°	1194	1075	889	762	720	922
55°	908	770	578	471	437	812
65°	613	469	309	249	244	608
75°	327	202	142	130	128	346
85°	76	39	34	34	34	88
90°	2	18	31	39	42	10
95°	100	49	60	68	66	119
105°	470	517	94	111	118	503
115°	890	916	955	238	127	876
125°	1258	1278	1307	1318	1323	1122
135°	1557	1581	1595	1611	1608	1202
145°	1806	1804	1830	1841	1834	1129
155°	1988	1974	1993	2002	1990	916
165°	2095	2086	2090	2101	2090	592
175°	2143	2132	2135	2146	2131	204
180°	2138	2138	2138	2138	2138	

TEST NUMBER: P928258

CATALOG NUMBER: DFN2DIP-HX4F0-060D080US927-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1964.0	1964.0	1964.0	1964.0	1964.0
2.5°	1972.9	1964.0	1944.4	1962.3	1958.7
5°	1964.0	1955.1	1931.9	1948.0	1942.7
7.5°	1948.0	1937.4	1912.5	1919.5	1910.6
10°	1926.6	1914.2	1878.8	1873.3	1862.7
12.5°	1900.1	1884.0	1835.9	1825.4	1805.8
15°	1868.0	1848.4	1788.0	1754.3	1736.5
17.5°	1830.7	1802.2	1727.5	1688.5	1660.0
20°	1788.0	1752.4	1663.6	1619.2	1580.0
22.5°	1741.8	1700.9	1597.8	1537.4	1510.8
25°	1695.7	1638.7	1521.4	1448.6	1421.9
27.5°	1640.6	1580.0	1450.3	1366.8	1325.9
30°	1581.9	1514.2	1372.1	1281.5	1233.5
32.5°	1525.0	1443.2	1297.6	1190.9	1146.3
35°	1461.1	1370.4	1214.1	1102.0	1062.8
37.5°	1398.8	1300.9	1135.8	1013.0	968.7
40°	1333.0	1226.5	1053.9	927.7	881.6
42.5°	1265.5	1151.8	972.3	840.6	796.4
45°	1194.4	1075.2	888.8	762.4	719.8
47.5°	1126.9	1000.8	808.8	682.5	643.4
50°	1052.3	926.1	730.5	607.8	570.6
52.5°	979.2	845.9	655.9	538.6	504.8
55°	908.2	769.6	577.6	471.1	437.3
57.5°	835.4	693.2	508.4	408.8	380.3
60°	760.7	618.6	435.4	344.9	316.4
62.5°	687.9	545.8	373.2	288.0	273.8
65°	613.2	469.2	309.3	248.9	243.5
67.5°	542.1	398.1	248.9	218.6	213.3
70°	467.4	328.8	206.1	188.4	181.2
72.5°	396.4	264.8	172.3	158.2	154.6
75°	327.0	202.5	142.2	129.7	128.1
77.5°	257.8	143.9	112.0	104.9	101.3
80°	193.6	103.1	85.2	78.2	78.2
82.5°	135.0	69.4	58.6	55.0	55.0
85°	76.3	39.0	33.7	33.7	33.7
87.5°	28.5	14.2	14.2	12.4	12.4
90°	1.5	18.5	30.9	38.7	41.7
92.5°	38.7	32.6	37.1	40.2	41.7
95°	100.5	49.4	60.3	68.2	66.5
97.5°	181.0	54.2	78.8	83.6	85.1
100°	274.0	61.9	88.2	100.5	103.6
102.5°	376.0	373.0	91.3	108.2	113.0
105°	470.4	516.9	94.4	111.4	117.6
107.5°	580.2	618.8	97.6	114.4	120.7
110°	685.6	717.9	270.9	116.1	122.2

TEST NUMBER: P928258

CATALOG NUMBER: DFN2DIP-HX4F0-060D080US927-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	784.6	812.3	786.1	119.0	123.9
115°	889.7	915.9	954.7	238.3	127.0
117.5°	981.0	1011.9	1038.3	816.9	411.6
120°	1083.1	1106.3	1134.2	1152.8	943.8
122.5°	1169.6	1194.5	1225.5	1234.7	1236.4
125°	1257.9	1278.1	1307.4	1318.3	1322.9
127.5°	1338.3	1360.0	1383.4	1398.8	1400.3
130°	1414.2	1439.0	1455.9	1473.0	1471.5
132.5°	1491.6	1511.8	1528.7	1542.7	1541.2
135°	1556.6	1581.4	1595.2	1610.8	1607.7
137.5°	1624.6	1643.2	1658.8	1674.2	1669.6
140°	1691.1	1703.6	1720.5	1734.5	1726.7
142.5°	1747.0	1757.8	1777.8	1790.2	1782.4
145°	1805.8	1804.1	1830.4	1841.2	1833.5
147.5°	1856.7	1852.1	1878.3	1886.1	1880.0
150°	1906.3	1895.4	1920.2	1929.4	1921.7
152.5°	1948.0	1935.6	1958.8	1968.2	1957.3
155°	1988.2	1974.5	1993.0	2002.2	1989.9
157.5°	2020.7	2008.4	2022.4	2033.2	2020.7
160°	2048.7	2039.3	2048.7	2057.9	2047.0
162.5°	2073.3	2064.1	2071.8	2082.6	2068.7
165°	2095.0	2085.8	2090.4	2101.2	2090.4
167.5°	2112.0	2102.7	2107.4	2118.3	2104.3
170°	2126.0	2116.6	2119.8	2130.6	2116.6
172.5°	2135.2	2126.0	2129.1	2140.0	2126.0
175°	2142.9	2132.1	2135.2	2146.0	2130.6
177.5°	2146.0	2135.2	2136.8	2147.7	2133.7
180°	2138.3	2138.3	2138.3	2138.3	2138.3

TEST NUMBER: P928258

CATALOG NUMBER: DFN2DIP-HX4F0-060D080US927-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.37	8.11	8.42	9.17	10.59	3.34	4.09	4.39	5.14	6.56
	3H	9.04	9.71	10.10	10.77	12.21	4.52	5.19	5.58	6.25	7.69
	4H	9.64	10.28	10.71	11.34	12.78	4.97	5.60	6.04	6.67	8.11
	6H	10.06	10.64	11.14	11.71	13.17	5.29	5.87	6.37	6.94	8.40
	8H	10.19	10.74	11.27	11.82	13.27	5.38	5.93	6.46	7.01	8.47
	12H	10.24	10.77	11.33	11.85	13.32	5.42	5.95	6.51	7.02	8.50
4H	2H	7.37	8.01	8.45	9.07	10.52	3.92	4.56	5.00	5.62	7.07
	3H	9.20	9.72	10.28	10.81	12.27	5.27	5.80	6.35	6.89	8.34
	4H	9.89	10.37	10.98	11.45	12.93	5.82	6.30	6.91	7.38	8.86
	6H	10.40	10.81	11.50	11.92	13.39	6.23	6.65	7.33	7.75	9.22
	8H	10.57	10.96	11.67	12.05	13.54	6.36	6.75	7.46	7.84	9.33
	12H	10.66	11.01	11.78	12.12	13.62	6.42	6.77	7.54	7.88	9.37
8H	4H	9.85	10.24	10.95	11.33	12.82	6.09	6.48	7.19	7.57	9.06
	6H	10.41	10.73	11.53	11.87	13.35	6.61	6.93	7.73	8.06	9.55
	8H	10.63	10.91	11.76	12.03	13.53	6.80	7.08	7.93	8.20	9.70
	12H	10.77	11.01	11.90	12.13	13.67	6.92	7.16	8.05	8.28	9.82
12H	4H	9.80	10.15	10.91	11.25	12.75	6.09	6.44	7.21	7.55	9.04
	6H	10.39	10.67	11.51	11.79	13.29	6.66	6.94	7.78	8.05	9.56
	8H	10.61	10.85	11.74	11.97	13.51	6.86	7.11	7.99	8.22	9.77

END OF REPORT