

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P913666

Luminaire Tested: DFN2DIP-HX4F0-070D110US927-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P913666
REPORT IS A COMBINATION OF REPORTS P899431 AND P896188
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-070D110US927-FLLFLL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13201.7 lumens
Efficiency: N/A
Efficacy: 100.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 131.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P913666

CATALOG NUMBER: DFN2DIP-HX4F0-070D110US927-FLLFLL

Luminous Intensity Polar Plot

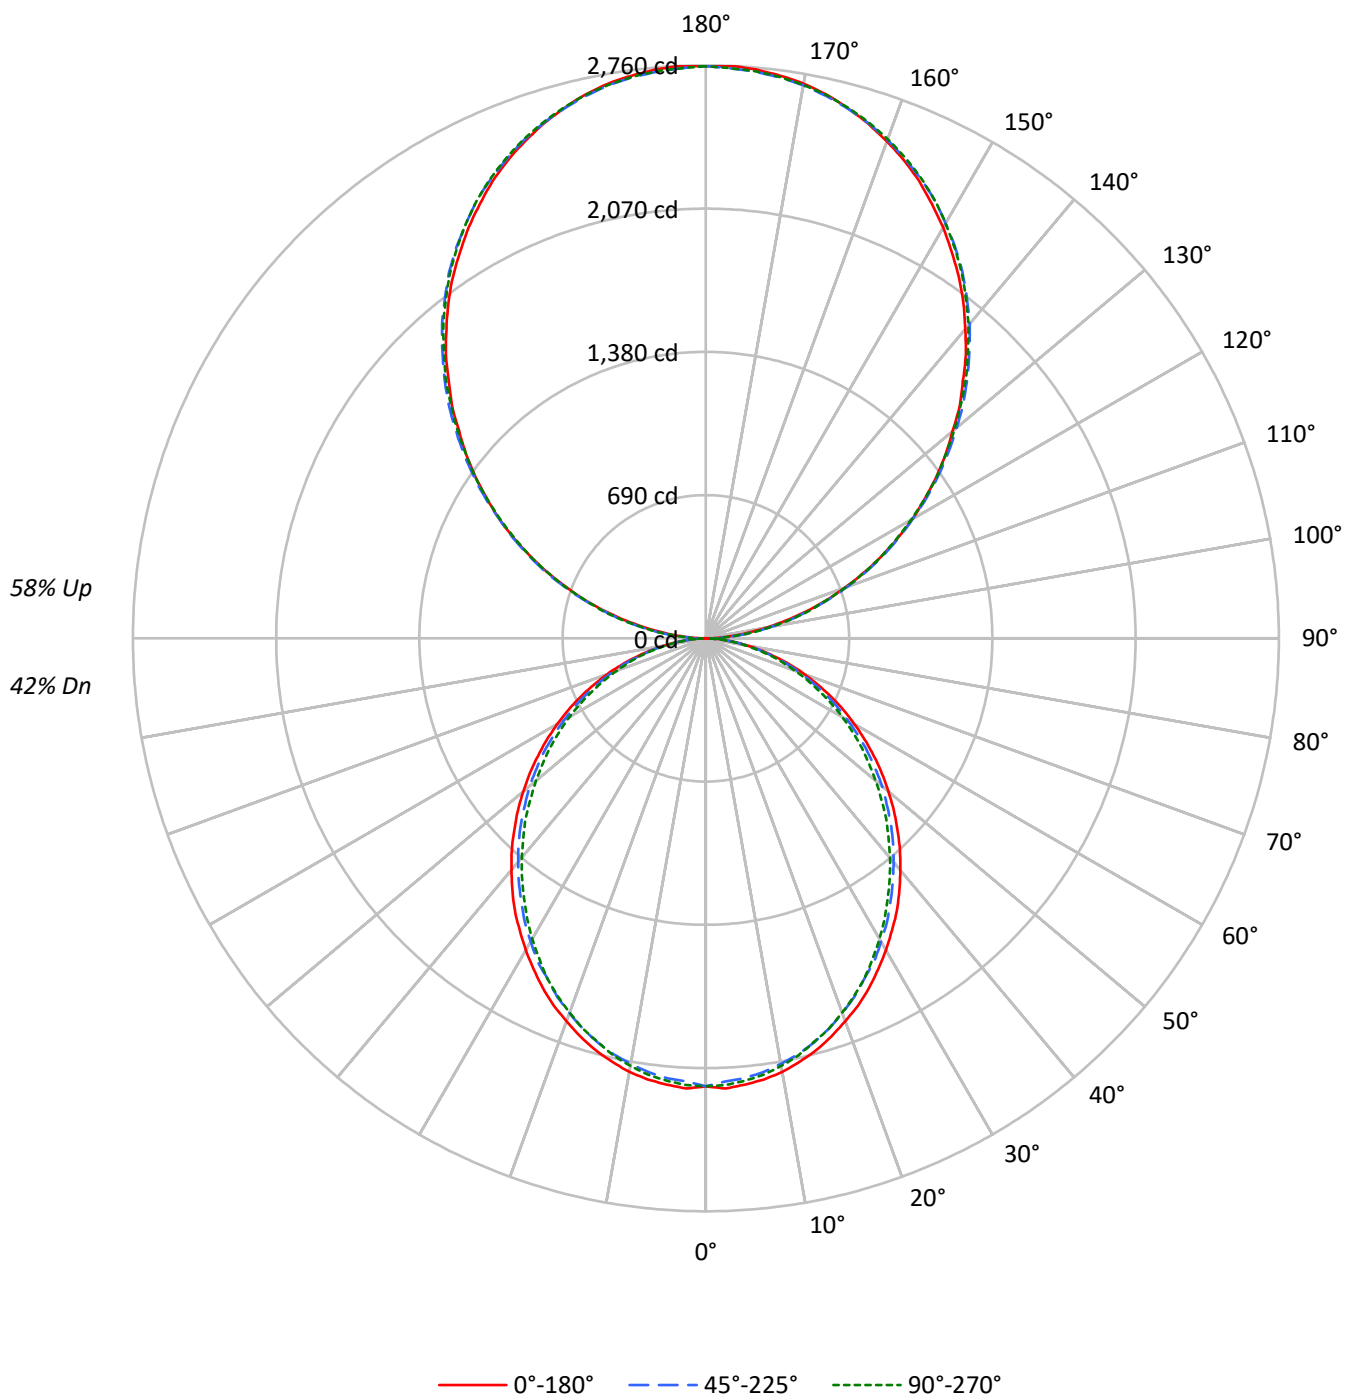

TEST NUMBER: P913666

CATALOG NUMBER: DFN2DIP-HX4F0-070D110US927-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	63	63	63	48	48	48
1	96	92	88	84	87	84	80	78	69	67	65	55	54	52	43	42	41
2	87	80	74	69	79	73	68	64	60	57	53	49	46	44	38	36	34
3	80	70	63	57	72	64	58	53	53	49	45	43	40	37	33	31	29
4	73	62	54	48	66	57	50	45	47	42	38	38	35	32	30	27	25
5	67	55	47	41	61	51	44	39	42	37	33	34	30	27	27	24	22
6	61	50	42	36	56	46	39	33	38	33	29	31	27	24	24	22	19
7	57	45	37	31	52	41	34	29	34	29	25	28	24	21	22	19	17
8	53	41	33	28	48	37	31	26	31	26	22	26	22	19	20	18	15
9	49	37	30	25	45	34	28	23	29	24	20	24	20	17	19	16	14
10	46	34	27	22	42	31	25	21	26	21	18	22	18	15	17	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1604	1604	1604
5°	1607	1582	1593
10°	1594	1561	1571
15°	1571	1535	1538
20°	1539	1500	1503
25°	1508	1457	1463
30°	1469	1418	1413
35°	1431	1371	1359
40°	1385	1324	1308
45°	1340	1277	1256
50°	1290	1227	1196
55°	1237	1170	1140
60°	1178	1102	1077
65°	1114	1031	1002
70°	1031	945	921
75°	917	842	847
80°	781	711	704
85°	567	485	468

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2077 cd/sqm

TEST NUMBER: P913666

CATALOG NUMBER: DFN2DIP-HX4F0-070D110US927-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	203.1	1.5
10°-20°	571.4	4.3
20°-30°	839.7	6.4
30°-40°	975.3	7.4
40°-50°	974.1	7.4
50°-60°	849.4	6.4
60°-70°	627.9	4.8
70°-80°	355.2	2.7
80°-90°	101.6	0.8
90°-100°	170.5	1.3
100°-110°	541.8	4.1
110°-120°	927.3	7.0
120°-130°	1219.5	9.2
130°-140°	1368.8	10.4
140°-150°	1342.3	10.2
150°-160°	1126.0	8.5
160°-170°	746.7	5.7
170°-180°	261.0	2.0
0°-30°	1614.2	12.2
0°-40°	2589.5	19.6
0°-60°	4412.9	33.4
0°-90°	5497.7	41.6
90°-120°	1639.7	12.4
90°-150°	5570.3	42.2
90°-180°	7704.0	58.4
0°-180°	13201.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2158	2158	2158	2158	2158	
5°	2158	2150	2127	2143	2139	205
15°	2054	2042	2015	2023	2013	578
25°	1859	1842	1807	1811	1807	855
35°	1604	1583	1550	1537	1527	1002
45°	1305	1291	1259	1237	1228	1007
55°	988	975	950	925	915	883
65°	666	654	633	614	604	659
75°	348	344	334	322	326	372
85°	85	83	81	75	73	95
90°	2	30	81	76	79	13
95°	121	145	149	149	145	135
105°	500	507	512	516	516	528
115°	931	944	940	937	931	920
125°	1353	1374	1368	1360	1358	1209
135°	1751	1776	1781	1779	1772	1353
145°	2125	2142	2155	2158	2149	1328
155°	2430	2437	2444	2456	2448	1119
165°	2644	2641	2641	2658	2646	746
175°	2751	2744	2739	2756	2742	261
180°	2756	2756	2756	2756	2756	

TEST NUMBER: P913666

CATALOG NUMBER: DFN2DIP-HX4F0-070D110US927-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2157.7	2157.7	2157.7	2157.7	2157.7
2.5°	2170.3	2159.9	2137.0	2157.7	2153.7
5°	2157.7	2149.6	2126.7	2143.2	2139.2
7.5°	2143.2	2130.8	2107.9	2124.7	2120.5
10°	2120.5	2105.9	2081.1	2097.6	2091.4
12.5°	2089.2	2076.9	2052.1	2062.4	2058.2
15°	2054.0	2041.7	2014.6	2023.0	2012.6
17.5°	2010.4	1998.1	1971.0	1981.4	1971.0
20°	1962.6	1950.4	1921.3	1927.5	1919.3
22.5°	1915.1	1896.4	1869.3	1869.3	1865.1
25°	1859.0	1842.5	1807.3	1811.2	1807.3
27.5°	1796.7	1782.2	1755.3	1749.1	1738.8
30°	1734.6	1717.8	1686.9	1680.7	1672.3
32.5°	1668.1	1655.8	1622.5	1610.0	1601.6
35°	1603.8	1583.2	1549.9	1537.4	1527.0
37.5°	1531.2	1512.5	1479.2	1464.7	1454.4
40°	1456.6	1439.9	1406.6	1388.1	1379.7
42.5°	1383.9	1367.2	1334.2	1313.3	1300.9
45°	1305.1	1290.6	1259.3	1236.7	1228.3
47.5°	1228.3	1213.8	1180.5	1157.6	1145.3
50°	1147.3	1136.9	1107.9	1078.9	1068.5
52.5°	1068.5	1054.0	1027.1	1004.2	989.7
55°	987.7	975.2	950.3	925.4	915.0
57.5°	906.7	896.4	869.3	844.4	836.1
60°	825.7	817.5	788.5	765.6	759.5
62.5°	746.9	732.4	711.7	691.0	682.6
65°	666.1	653.5	632.9	614.2	603.8
67.5°	583.1	572.6	554.1	539.6	531.2
70°	506.3	498.0	479.2	464.7	456.5
72.5°	427.5	419.1	408.8	394.3	388.1
75°	348.5	344.5	333.9	321.6	325.8
77.5°	278.1	269.7	265.5	259.3	253.2
80°	207.6	205.4	201.2	195.0	190.8
82.5°	141.1	141.1	139.1	130.8	130.8
85°	85.0	83.0	81.0	74.6	72.6
87.5°	37.4	33.3	29.1	22.9	20.7
90°	2.5	29.9	81.4	76.4	78.9
92.5°	51.5	69.8	72.2	74.8	74.8
95°	121.3	144.6	148.7	148.7	144.6
97.5°	201.9	223.5	232.7	232.7	232.7
100°	294.9	314.0	320.7	320.7	318.2
102.5°	393.0	407.1	416.3	418.7	416.3
105°	500.2	506.8	511.8	515.9	515.9
107.5°	606.5	616.5	616.5	618.1	606.5
110°	709.6	722.9	722.9	722.9	716.2

TEST NUMBER: P913666

CATALOG NUMBER: DFN2DIP-HX4F0-070D110US927-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	820.9	835.0	832.5	825.8	820.9
115°	930.6	943.8	939.7	937.2	930.6
117.5°	1039.4	1057.6	1046.0	1039.4	1032.8
120°	1149.1	1167.4	1149.1	1149.1	1141.6
122.5°	1248.8	1272.0	1260.4	1253.7	1248.8
125°	1353.4	1374.2	1367.5	1360.1	1357.6
127.5°	1455.6	1481.4	1472.3	1462.3	1455.6
130°	1551.2	1581.1	1576.9	1571.9	1562.8
132.5°	1658.4	1681.6	1683.3	1671.7	1665.0
135°	1750.6	1776.3	1781.3	1778.8	1772.2
137.5°	1853.6	1874.4	1878.5	1876.8	1866.9
140°	1944.2	1964.9	1976.6	1976.6	1967.5
142.5°	2037.3	2058.0	2064.7	2067.1	2058.0
145°	2125.3	2141.9	2155.2	2157.7	2148.6
147.5°	2204.2	2225.0	2235.0	2239.1	2230.0
150°	2285.7	2299.8	2308.9	2316.4	2308.9
152.5°	2357.9	2372.0	2383.7	2392.9	2383.7
155°	2430.3	2436.8	2444.4	2456.0	2448.5
157.5°	2492.5	2497.5	2501.6	2518.3	2506.6
160°	2548.2	2553.2	2555.7	2569.8	2559.9
162.5°	2599.7	2599.7	2602.2	2618.0	2606.4
165°	2643.7	2641.2	2641.2	2657.8	2646.2
167.5°	2683.6	2676.1	2676.1	2692.8	2681.1
170°	2713.5	2706.9	2704.4	2721.0	2706.9
172.5°	2734.3	2727.6	2725.2	2741.8	2727.6
175°	2750.9	2744.3	2739.3	2755.9	2741.8
177.5°	2760.0	2753.4	2748.4	2762.6	2748.4
180°	2755.9	2755.9	2755.9	2755.9	2755.9

TEST NUMBER: P913666

CATALOG NUMBER: DFN2DIP-HX4F0-070D110US927-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.09	8.88	9.11	9.91	11.30	7.66	8.45	8.68	9.48	10.87
	3H	9.74	10.45	10.78	11.50	12.90	9.27	9.98	10.31	11.02	12.43
	4H	10.33	11.00	11.38	12.05	13.46	9.86	10.53	10.90	11.57	12.98
	6H	10.73	11.35	11.78	12.39	13.82	10.25	10.87	11.31	11.92	13.34
	8H	10.83	11.42	11.89	12.48	13.90	10.35	10.94	11.42	12.01	13.43
	12H	10.88	11.44	11.94	12.49	13.94	10.39	10.95	11.46	12.01	13.46
4H	2H	8.54	9.21	9.60	10.26	11.67	8.20	8.87	9.25	9.91	11.33
	3H	10.40	10.96	11.46	12.04	13.46	10.01	10.57	11.07	11.64	13.07
	4H	11.11	11.63	12.18	12.69	14.14	10.71	11.22	11.78	12.29	13.73
	6H	11.63	12.07	12.70	13.16	14.60	11.22	11.66	12.29	12.75	14.19
	8H	11.78	12.19	12.85	13.27	14.72	11.36	11.78	12.44	12.85	14.31
	12H	11.85	12.22	12.94	13.31	14.77	11.42	11.80	12.52	12.89	14.35
8H	4H	11.31	11.72	12.38	12.80	14.26	10.95	11.36	12.02	12.44	13.90
	6H	11.94	12.28	13.04	13.40	14.85	11.57	11.91	12.67	13.03	14.49
	8H	12.16	12.46	13.26	13.56	15.03	11.79	12.09	12.89	13.19	14.66
	12H	12.29	12.55	13.40	13.65	15.16	11.90	12.16	13.01	13.26	14.78
12H	4H	11.29	11.66	12.38	12.75	14.22	10.94	11.31	12.03	12.40	13.87
	6H	11.97	12.27	13.07	13.37	14.84	11.61	11.91	12.72	13.02	14.49
	8H	12.21	12.47	13.32	13.57	15.08	11.85	12.11	12.96	13.21	14.72

END OF REPORT