

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P928408

Luminaire Tested: DFN2DIP-HX4F0-100D100US927-FLLONL

Issue Date: 12/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P928408
REPORT IS A COMBINATION OF REPORTS P900939 AND P896187
Test Lab: INNOVATION CENTER
Issue Date: 12/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-100D100US927-FLLONL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15681.6 lumens
Efficiency: N/A
Efficacy: 89.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 175.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P928408

CATALOG NUMBER: DFN2DIP-HX4F0-100D100US927-FLLONL

Luminous Intensity Polar Plot

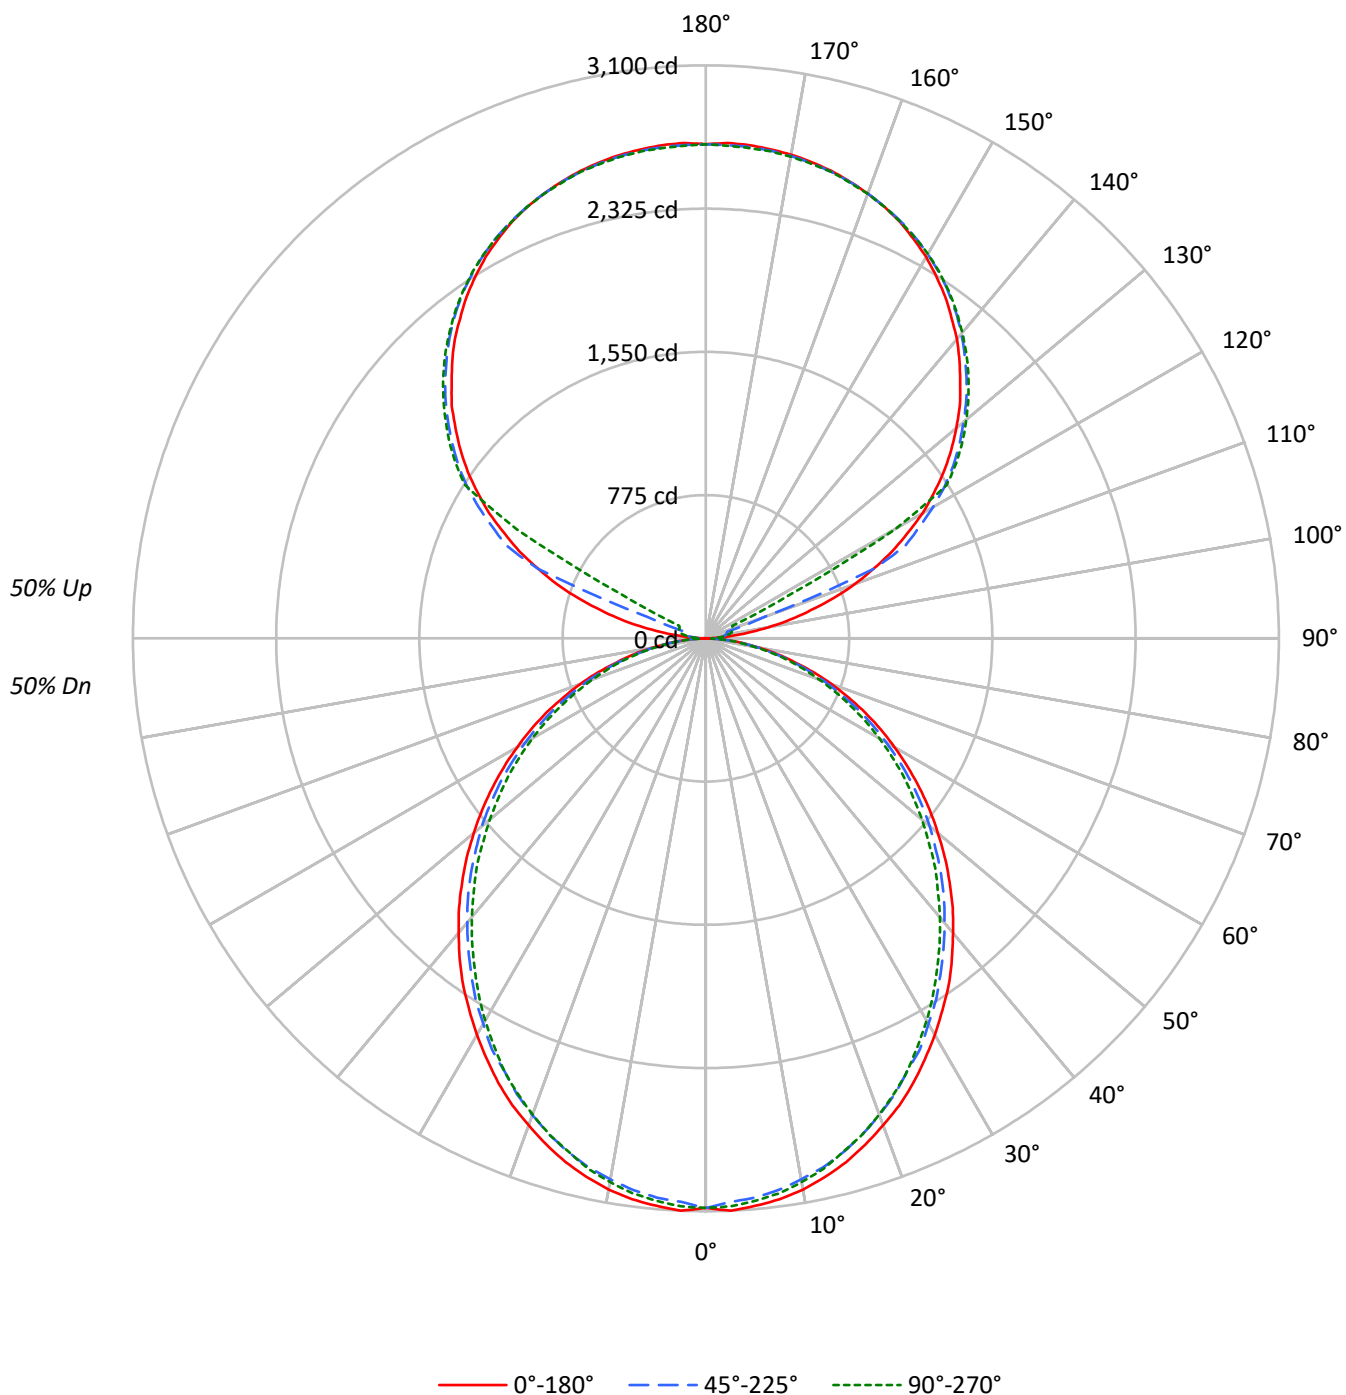

TEST NUMBER: P928408

CATALOG NUMBER: DFN2DIP-HX4F0-100D100US927-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2292	2292	2292
5°	2295	2260	2275
10°	2277	2230	2244
15°	2244	2193	2196
20°	2198	2142	2147
25°	2154	2082	2090
30°	2098	2025	2018
35°	2044	1958	1941
40°	1979	1891	1869
45°	1913	1823	1794
50°	1842	1753	1708
55°	1767	1671	1629
60°	1682	1573	1538
65°	1590	1473	1431
70°	1473	1350	1316
75°	1310	1203	1209
80°	1115	1016	1006
85°	809	692	669

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1913 cd/sqm

TEST NUMBER: P928408

CATALOG NUMBER: DFN2DIP-HX4F0-100D100US927-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	290.1	1.8
10°-20°	816.1	5.2
20°-30°	1199.3	7.6
30°-40°	1392.9	8.9
40°-50°	1391.2	8.9
50°-60°	1213.1	7.7
60°-70°	896.8	5.7
70°-80°	507.4	3.2
80°-90°	138.6	0.9
90°-100°	88.1	0.6
100°-110°	328.6	2.1
110°-120°	871.4	5.6
120°-130°	1445.3	9.2
130°-140°	1535.2	9.8
140°-150°	1426.8	9.1
150°-160°	1147.1	7.3
160°-170°	739.2	4.7
170°-180°	254.4	1.6
0°-30°	2305.5	14.7
0°-40°	3698.4	23.6
0°-60°	6302.7	40.2
0°-90°	7845.5	50.0
90°-120°	1288.1	8.2
90°-150°	5695.4	36.3
90°-180°	7836.0	50.0
0°-180°	15681.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3082	3082	3082	3082	3082	
5°	3082	3070	3037	3061	3055	293
15°	2934	2916	2877	2889	2875	826
25°	2655	2632	2581	2587	2581	1222
35°	2291	2261	2214	2196	2181	1430
45°	1864	1843	1799	1766	1754	1439
55°	1411	1393	1357	1322	1307	1261
65°	951	934	904	877	862	941
75°	498	492	477	459	465	531
85°	121	119	116	107	104	135
90°	2	23	39	48	52	14
95°	126	62	75	85	83	149
105°	588	646	118	139	147	628
115°	1112	1145	1193	298	159	1095
125°	1572	1598	1634	1648	1654	1402
135°	1946	1977	1994	2014	2010	1503
145°	2257	2255	2288	2302	2292	1412
155°	2485	2468	2491	2503	2487	1145
165°	2619	2607	2613	2626	2613	740
175°	2679	2665	2669	2683	2663	255
180°	2673	2673	2673	2673	2673	

TEST NUMBER: P928408

CATALOG NUMBER: DFN2DIP-HX4F0-100D100US927-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3081.8	3081.8	3081.8	3081.8	3081.8
2.5°	3099.7	3084.8	3052.1	3081.8	3076.0
5°	3081.8	3070.1	3037.4	3061.0	3055.3
7.5°	3061.0	3043.3	3010.6	3034.5	3028.6
10°	3028.6	3007.9	2972.3	2995.9	2987.1
12.5°	2983.9	2966.4	2930.8	2945.6	2939.6
15°	2933.6	2916.1	2877.3	2889.3	2874.6
17.5°	2871.4	2853.8	2815.1	2829.9	2815.1
20°	2803.1	2785.5	2744.0	2752.8	2741.2
22.5°	2735.3	2708.6	2669.8	2669.8	2663.9
25°	2655.1	2631.5	2581.2	2586.8	2581.2
27.5°	2566.1	2545.3	2507.0	2498.2	2483.4
30°	2477.5	2453.5	2409.2	2400.4	2388.4
32.5°	2382.5	2364.9	2317.4	2299.5	2287.5
35°	2290.7	2261.2	2213.6	2195.7	2180.9
37.5°	2186.9	2160.2	2112.7	2092.0	2077.2
40°	2080.3	2056.4	2009.0	1982.6	1970.7
42.5°	1976.6	1952.7	1905.6	1875.7	1858.1
45°	1864.1	1843.3	1798.6	1766.2	1754.4
47.5°	1754.4	1733.6	1686.1	1653.4	1635.8
50°	1638.6	1623.8	1582.3	1540.8	1526.1
52.5°	1526.1	1505.4	1466.9	1434.3	1413.6
55°	1410.7	1392.8	1357.3	1321.7	1307.0
57.5°	1295.0	1280.2	1241.5	1206.1	1194.1
60°	1179.3	1167.6	1126.1	1093.4	1084.6
62.5°	1066.7	1046.0	1016.5	986.9	975.0
65°	951.4	933.5	903.9	877.1	862.4
67.5°	832.9	817.7	791.4	770.6	758.7
70°	723.1	711.1	684.4	663.7	652.1
72.5°	610.6	598.6	583.9	563.1	554.2
75°	497.7	492.1	476.9	459.4	465.3
77.5°	397.1	385.1	379.1	370.3	361.5
80°	296.4	293.4	287.3	278.5	272.6
82.5°	201.6	201.6	198.7	186.8	186.8
85°	121.3	118.6	115.7	106.6	103.8
87.5°	53.5	47.4	41.5	32.7	29.5
90°	1.8	23.2	38.6	48.5	52.1
92.5°	48.5	40.6	46.4	50.3	52.1
95°	125.6	61.8	75.3	85.2	83.2
97.5°	226.2	67.7	98.5	104.5	106.4
100°	342.5	77.4	110.2	125.6	129.6
102.5°	469.9	466.3	114.1	135.3	141.2
105°	588.0	646.0	118.1	139.2	147.0
107.5°	725.3	773.5	122.0	143.1	150.9
110°	856.9	897.3	338.5	145.2	152.7

TEST NUMBER: P928408

CATALOG NUMBER: DFN2DIP-HX4F0-100D100US927-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	980.7	1015.3	982.6	148.8	154.8
115°	1112.0	1144.9	1193.4	297.9	158.7
117.5°	1226.2	1264.8	1297.9	1021.1	514.5
120°	1353.9	1382.8	1417.8	1441.0	1179.8
122.5°	1462.1	1493.1	1531.9	1543.4	1545.4
125°	1572.4	1597.6	1634.4	1647.9	1653.6
127.5°	1672.9	1700.0	1729.2	1748.5	1750.3
130°	1767.7	1798.8	1819.9	1841.2	1839.4
132.5°	1864.4	1889.7	1910.9	1928.3	1926.5
135°	1945.8	1976.8	1994.0	2013.5	2009.6
137.5°	2030.8	2054.0	2073.5	2092.8	2087.0
140°	2113.8	2129.5	2150.6	2168.1	2158.4
142.5°	2183.7	2197.2	2222.3	2237.6	2228.1
145°	2257.2	2255.1	2288.0	2301.6	2291.9
147.5°	2320.8	2315.1	2347.9	2357.5	2350.0
150°	2382.8	2369.3	2400.3	2411.8	2402.1
152.5°	2434.9	2419.6	2448.5	2460.2	2446.6
155°	2485.3	2468.0	2491.2	2502.7	2487.4
157.5°	2525.9	2510.6	2528.0	2541.5	2525.9
160°	2560.9	2549.1	2560.9	2572.3	2558.8
162.5°	2591.6	2580.1	2589.8	2603.3	2585.9
165°	2618.7	2607.2	2613.0	2626.5	2613.0
167.5°	2640.1	2628.3	2634.4	2647.9	2630.4
170°	2657.5	2645.8	2649.7	2663.3	2645.8
172.5°	2669.0	2657.5	2661.4	2675.0	2657.5
175°	2678.6	2665.1	2669.0	2682.6	2663.3
177.5°	2682.6	2669.0	2671.1	2684.6	2667.1
180°	2672.9	2672.9	2672.9	2672.9	2672.9

TEST NUMBER: P928408

CATALOG NUMBER: DFN2DIP-HX4F0-100D100US927-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.16	11.02	11.11	11.99	13.26	9.73	10.59	10.68	11.56	12.83
	3H	11.82	12.59	12.79	13.57	14.87	11.35	12.12	12.31	13.10	14.39
	4H	12.41	13.14	13.39	14.12	15.42	11.93	12.66	12.91	13.65	14.95
	6H	12.81	13.48	13.80	14.47	15.79	12.33	13.00	13.32	14.00	15.31
	8H	12.91	13.55	13.91	14.56	15.87	12.44	13.08	13.44	14.09	15.40
	12H	12.96	13.57	13.96	14.57	15.91	12.48	13.09	13.48	14.09	15.43
4H	2H	10.62	11.35	11.61	12.34	13.64	10.27	11.01	11.26	11.99	13.29
	3H	12.49	13.10	13.48	14.11	15.43	12.09	12.70	13.09	13.72	15.03
	4H	13.20	13.76	14.21	14.77	16.11	12.80	13.35	13.80	14.36	15.70
	6H	13.72	14.20	14.73	15.23	16.56	13.31	13.79	14.32	14.82	16.16
	8H	13.87	14.32	14.89	15.34	16.69	13.46	13.90	14.47	14.93	16.28
	12H	13.94	14.35	14.98	15.39	16.74	13.52	13.92	14.56	14.96	16.32
8H	4H	13.40	13.85	14.42	14.87	16.22	13.04	13.49	14.06	14.51	15.86
	6H	14.03	14.40	15.07	15.47	16.82	13.67	14.04	14.71	15.11	16.45
	8H	14.25	14.58	15.30	15.63	17.00	13.88	14.21	14.93	15.26	16.63
	12H	14.39	14.67	15.44	15.72	17.13	14.00	14.29	15.05	15.33	16.74
12H	4H	13.38	13.79	14.42	14.83	16.19	13.03	13.44	14.07	14.48	15.83
	6H	14.06	14.39	15.11	15.44	16.81	13.71	14.04	14.76	15.09	16.46
	8H	14.30	14.59	15.36	15.64	17.05	13.95	14.23	15.00	15.28	16.69