

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P928496

Luminaire Tested: DFN2DIP-HX4F0-040D050US930-FLLONL

Issue Date: 12/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P928496
REPORT IS A COMBINATION OF REPORTS P900837 AND P896187
Test Lab: INNOVATION CENTER
Issue Date: 12/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-040D050US930-FLLONL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7261.6 lumens
Efficiency: N/A
Efficacy: 102.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 70.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P928496

CATALOG NUMBER: DFN2DIP-HX4F0-040D050US930-FLLONL

Luminous Intensity Polar Plot

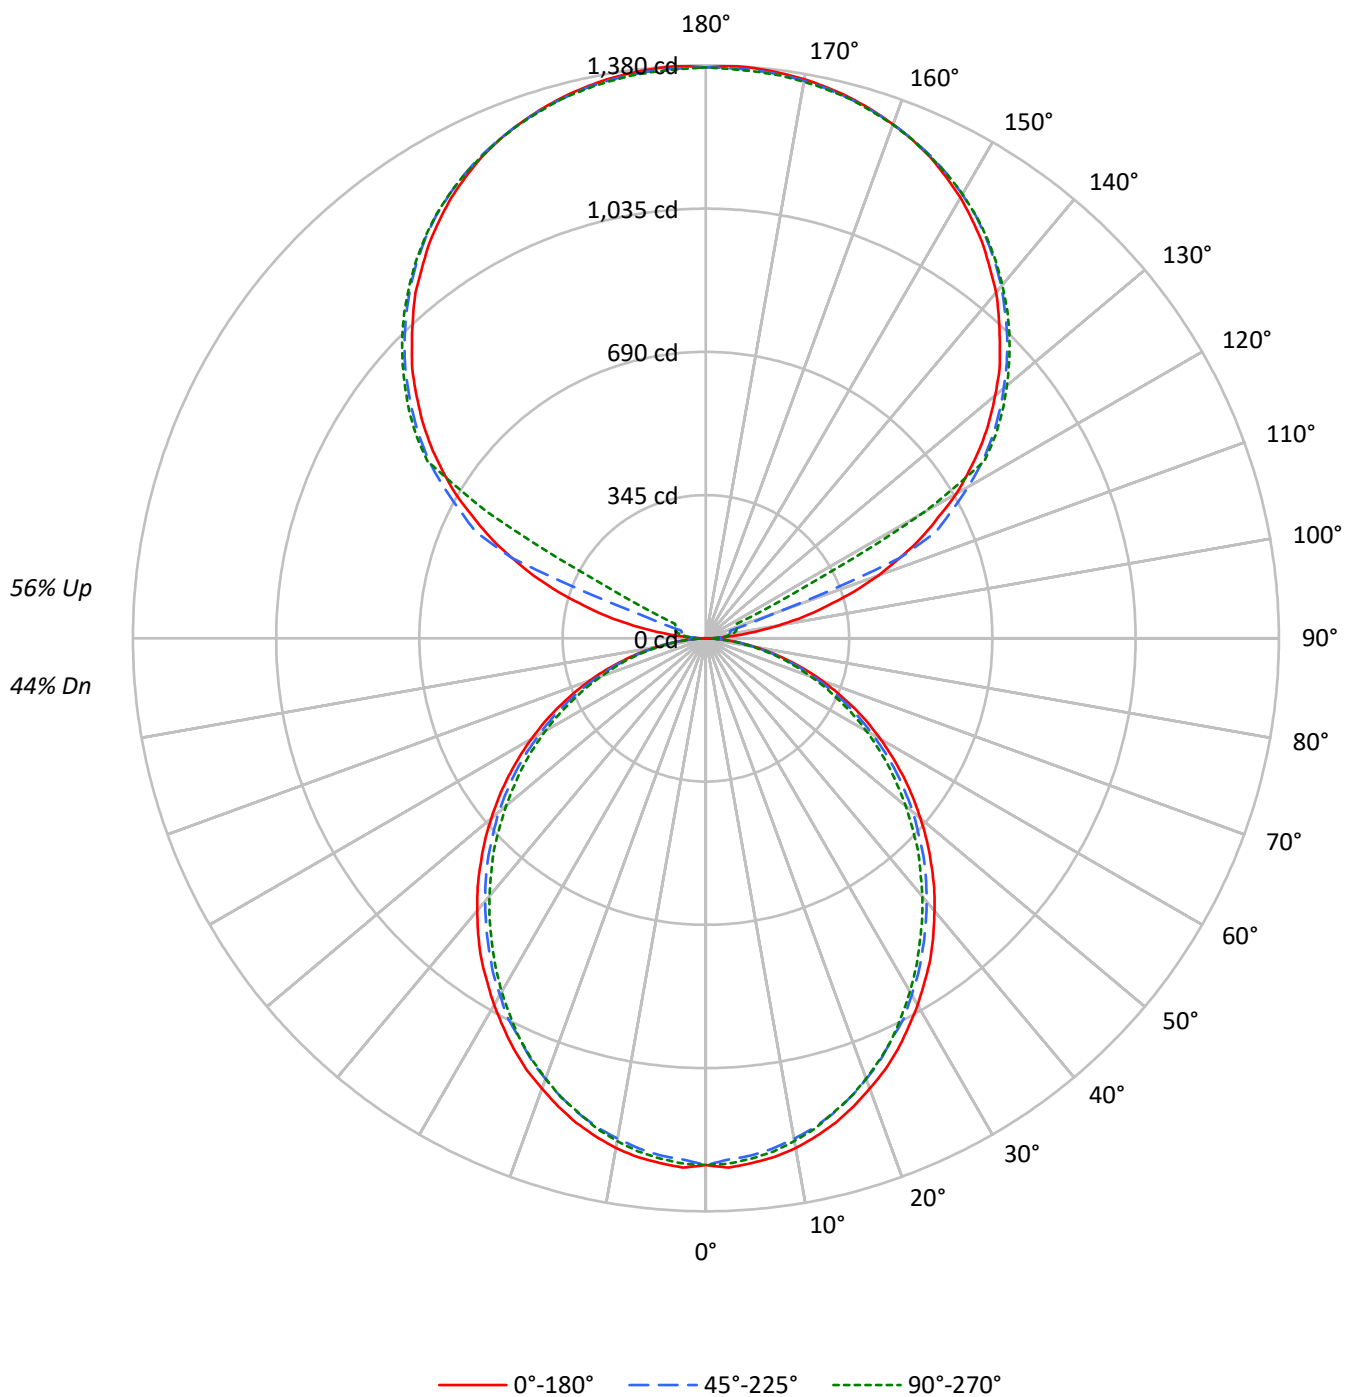

TEST NUMBER: P928496

CATALOG NUMBER: DFN2DIP-HX4F0-040D050US930-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	65	65	65	51	51	51
1	97	92	88	85	88	85	81	78	70	68	66	57	56	54	45	44	43
2	88	81	74	69	80	74	69	64	62	58	55	50	48	45	40	38	36
3	80	71	64	58	73	65	59	54	54	50	46	44	41	38	35	33	31
4	73	63	55	49	67	58	51	46	48	43	39	40	36	33	31	29	27
5	67	56	48	42	61	51	44	39	43	38	34	35	31	28	28	25	23
6	62	50	42	36	57	46	39	34	39	33	29	32	28	25	26	23	20
7	57	45	37	32	52	42	35	30	35	30	26	29	25	22	23	20	18
8	53	41	33	28	49	38	31	26	32	27	23	27	23	20	22	19	16
9	49	37	30	25	45	35	28	23	29	24	20	25	20	18	20	17	15
10	46	34	27	22	42	32	25	21	27	22	18	23	19	16	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	943	943	943
5°	945	930	936
10°	937	918	924
15°	923	903	904
20°	905	882	884
25°	886	857	860
30°	863	834	831
35°	841	806	799
40°	814	778	769
45°	787	751	738
50°	758	721	703
55°	727	688	670
60°	693	648	633
65°	655	606	589
70°	606	556	541
75°	539	495	498
80°	459	418	414
85°	333	285	275

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 787 cd/sqm

TEST NUMBER: P928496

CATALOG NUMBER: DFN2DIP-HX4F0-040D050US930-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	119.4	1.6
10°-20°	335.9	4.6
20°-30°	493.7	6.8
30°-40°	573.4	7.9
40°-50°	572.7	7.9
50°-60°	499.3	6.9
60°-70°	369.1	5.1
70°-80°	208.8	2.9
80°-90°	57.5	0.8
90°-100°	45.4	0.6
100°-110°	169.1	2.3
110°-120°	448.4	6.2
120°-130°	743.6	10.2
130°-140°	789.9	10.9
140°-150°	734.1	10.1
150°-160°	590.2	8.1
160°-170°	380.3	5.2
170°-180°	130.9	1.8
0°-30°	949.0	13.1
0°-40°	1522.3	21.0
0°-60°	2594.3	35.7
0°-90°	3229.8	44.5
90°-120°	662.8	9.1
90°-150°	2930.4	40.4
90°-180°	4032.0	55.5
0°-180°	7261.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1268	1268	1268	1268	1268	
5°	1268	1264	1250	1260	1258	120
15°	1208	1200	1184	1189	1183	340
25°	1093	1083	1062	1065	1062	503
35°	943	931	911	904	898	589
45°	767	759	740	727	722	592
55°	581	573	559	544	538	519
65°	392	384	372	361	355	387
75°	205	202	196	189	192	219
85°	50	49	48	44	43	56
90°	1	12	20	25	27	7
95°	65	32	39	44	43	77
105°	302	332	61	72	76	323
115°	572	589	614	153	82	563
125°	809	822	841	848	851	721
135°	1001	1017	1026	1036	1034	773
145°	1161	1160	1177	1184	1179	726
155°	1279	1270	1282	1288	1280	589
165°	1347	1342	1344	1351	1344	381
175°	1378	1371	1373	1380	1370	131
180°	1375	1375	1375	1375	1375	

TEST NUMBER: P928496

CATALOG NUMBER: DFN2DIP-HX4F0-040D050US930-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1268.5	1268.5	1268.5	1268.5	1268.5
2.5°	1275.9	1269.8	1256.3	1268.5	1266.2
5°	1268.5	1263.7	1250.2	1259.9	1257.6
7.5°	1259.9	1252.7	1239.2	1249.1	1246.6
10°	1246.6	1238.1	1223.5	1233.2	1229.5
12.5°	1228.2	1221.0	1206.4	1212.5	1209.9
15°	1207.5	1200.3	1184.4	1189.2	1183.2
17.5°	1181.9	1174.7	1158.8	1164.8	1158.8
20°	1153.8	1146.5	1129.5	1133.1	1128.4
22.5°	1125.8	1114.8	1098.9	1098.9	1096.5
25°	1092.8	1083.1	1062.4	1064.8	1062.4
27.5°	1056.2	1047.7	1032.0	1028.3	1022.3
30°	1019.7	1009.9	991.7	988.0	983.1
32.5°	980.7	973.4	953.9	946.5	941.6
35°	942.9	930.7	911.2	903.8	897.7
37.5°	900.2	889.2	869.6	861.1	855.0
40°	856.3	846.5	826.9	816.1	811.2
42.5°	813.6	803.8	784.4	772.0	764.8
45°	767.2	758.8	740.3	727.1	722.1
47.5°	722.1	713.5	694.1	680.6	673.4
50°	674.5	668.4	651.3	634.2	628.1
52.5°	628.1	619.6	603.8	590.4	581.8
55°	580.7	573.3	558.7	544.0	538.0
57.5°	533.0	527.0	511.0	496.4	491.5
60°	485.4	480.6	463.6	450.1	446.5
62.5°	439.1	430.6	418.4	406.2	401.3
65°	391.6	384.2	372.0	361.0	355.0
67.5°	342.8	336.6	325.8	317.2	312.3
70°	297.6	292.7	281.7	273.2	268.4
72.5°	251.3	246.4	240.3	231.8	228.1
75°	204.9	202.5	196.3	189.1	191.5
77.5°	163.4	158.5	156.1	152.4	148.8
80°	122.0	120.7	118.3	114.7	112.2
82.5°	83.0	83.0	81.8	76.9	76.9
85°	50.0	48.8	47.6	43.8	42.7
87.5°	22.0	19.6	17.1	13.4	12.1
90°	1.0	11.9	19.9	24.9	26.8
92.5°	24.9	20.9	23.9	25.9	26.8
95°	64.6	31.8	38.8	43.8	42.8
97.5°	116.4	34.9	50.7	53.8	54.7
100°	176.2	39.9	56.7	64.6	66.7
102.5°	241.8	239.9	58.8	69.6	72.7
105°	302.5	332.4	60.7	71.6	75.6
107.5°	373.2	398.0	62.8	73.6	77.7
110°	440.9	461.7	174.2	74.7	78.6

TEST NUMBER: P928496

CATALOG NUMBER: DFN2DIP-HX4F0-040D050US930-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	504.6	522.4	505.5	76.6	79.6
115°	572.2	589.1	614.0	153.3	81.7
117.5°	630.9	650.8	667.8	525.3	264.7
120°	696.6	711.5	729.4	741.4	607.0
122.5°	752.2	768.2	788.2	794.1	795.2
125°	809.0	822.0	840.9	847.8	850.9
127.5°	860.7	874.7	889.7	899.6	900.6
130°	909.5	925.5	936.4	947.4	946.5
132.5°	959.3	972.3	983.1	992.2	991.2
135°	1001.1	1017.1	1025.9	1036.0	1034.0
137.5°	1044.8	1056.8	1066.8	1076.8	1073.8
140°	1087.6	1095.7	1106.5	1115.5	1110.6
142.5°	1123.6	1130.6	1143.4	1151.4	1146.4
145°	1161.4	1160.3	1177.2	1184.2	1179.2
147.5°	1194.1	1191.1	1208.1	1213.0	1209.1
150°	1226.0	1219.1	1235.0	1240.9	1235.9
152.5°	1252.8	1244.9	1259.8	1265.9	1258.8
155°	1278.7	1269.9	1281.8	1287.7	1279.8
157.5°	1299.6	1291.7	1300.7	1307.7	1299.6
160°	1317.6	1311.6	1317.6	1323.5	1316.6
162.5°	1333.4	1327.6	1332.4	1339.5	1330.5
165°	1347.4	1341.5	1344.4	1351.4	1344.4
167.5°	1358.4	1352.3	1355.4	1362.4	1353.4
170°	1367.3	1361.3	1363.3	1370.3	1361.3
172.5°	1373.3	1367.3	1369.4	1376.3	1367.3
175°	1378.2	1371.2	1373.3	1380.2	1370.3
177.5°	1380.2	1373.3	1374.3	1381.3	1372.3
180°	1375.2	1375.2	1375.2	1375.2	1375.2

TEST NUMBER: P928496

CATALOG NUMBER: DFN2DIP-HX4F0-040D050US930-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.54	7.35	7.54	8.36	9.71	6.10	6.92	7.11	7.93	9.28
	3H	8.19	8.92	9.21	9.95	11.31	7.72	8.45	8.73	9.47	10.84
	4H	8.78	9.47	9.81	10.50	11.87	8.31	9.00	9.33	10.02	11.40
	6H	9.18	9.81	10.21	10.84	12.23	8.70	9.34	9.74	10.37	11.76
	8H	9.28	9.89	10.32	10.93	12.32	8.81	9.41	9.85	10.46	11.84
	12H	9.33	9.91	10.38	10.95	12.35	8.85	9.42	9.89	10.46	11.87
4H	2H	6.99	7.68	8.03	8.71	10.09	6.65	7.34	7.68	8.36	9.74
	3H	8.86	9.43	9.90	10.49	11.88	8.46	9.04	9.50	10.09	11.48
	4H	9.57	10.10	10.62	11.14	12.55	9.16	9.69	10.21	10.74	12.15
	6H	10.08	10.54	11.14	11.61	13.01	9.67	10.13	10.73	11.20	12.60
	8H	10.23	10.66	11.29	11.72	13.14	9.82	10.24	10.88	11.30	12.73
	12H	10.30	10.69	11.38	11.76	13.19	9.88	10.26	10.96	11.34	12.77
8H	4H	9.76	10.19	10.82	11.25	12.67	9.40	9.83	10.46	10.89	12.31
	6H	10.39	10.74	11.47	11.85	13.27	10.03	10.38	11.11	11.48	12.90
	8H	10.61	10.92	11.70	12.01	13.45	10.24	10.55	11.33	11.64	13.08
	12H	10.74	11.02	11.84	12.10	13.58	10.36	10.63	11.45	11.71	13.19
12H	4H	9.75	10.13	10.82	11.21	12.63	9.39	9.78	10.47	10.85	12.28
	6H	10.42	10.73	11.51	11.82	13.26	10.07	10.38	11.16	11.47	12.90
	8H	10.66	10.93	11.76	12.02	13.50	10.31	10.58	11.40	11.66	13.14

END OF REPORT