

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P928816

Luminaire Tested: DFN2DIP-HX4F0-040D040US935-FLLONL

Issue Date: 12/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P928816
REPORT IS A COMBINATION OF REPORTS P900819 AND P896187
Test Lab: INNOVATION CENTER
Issue Date: 12/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-040D040US935-FLLONL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6819.1 lumens
Efficiency: N/A
Efficacy: 107.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 63.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P928816

CATALOG NUMBER: DFN2DIP-HX4F0-040D040US935-FLLONL

Luminous Intensity Polar Plot

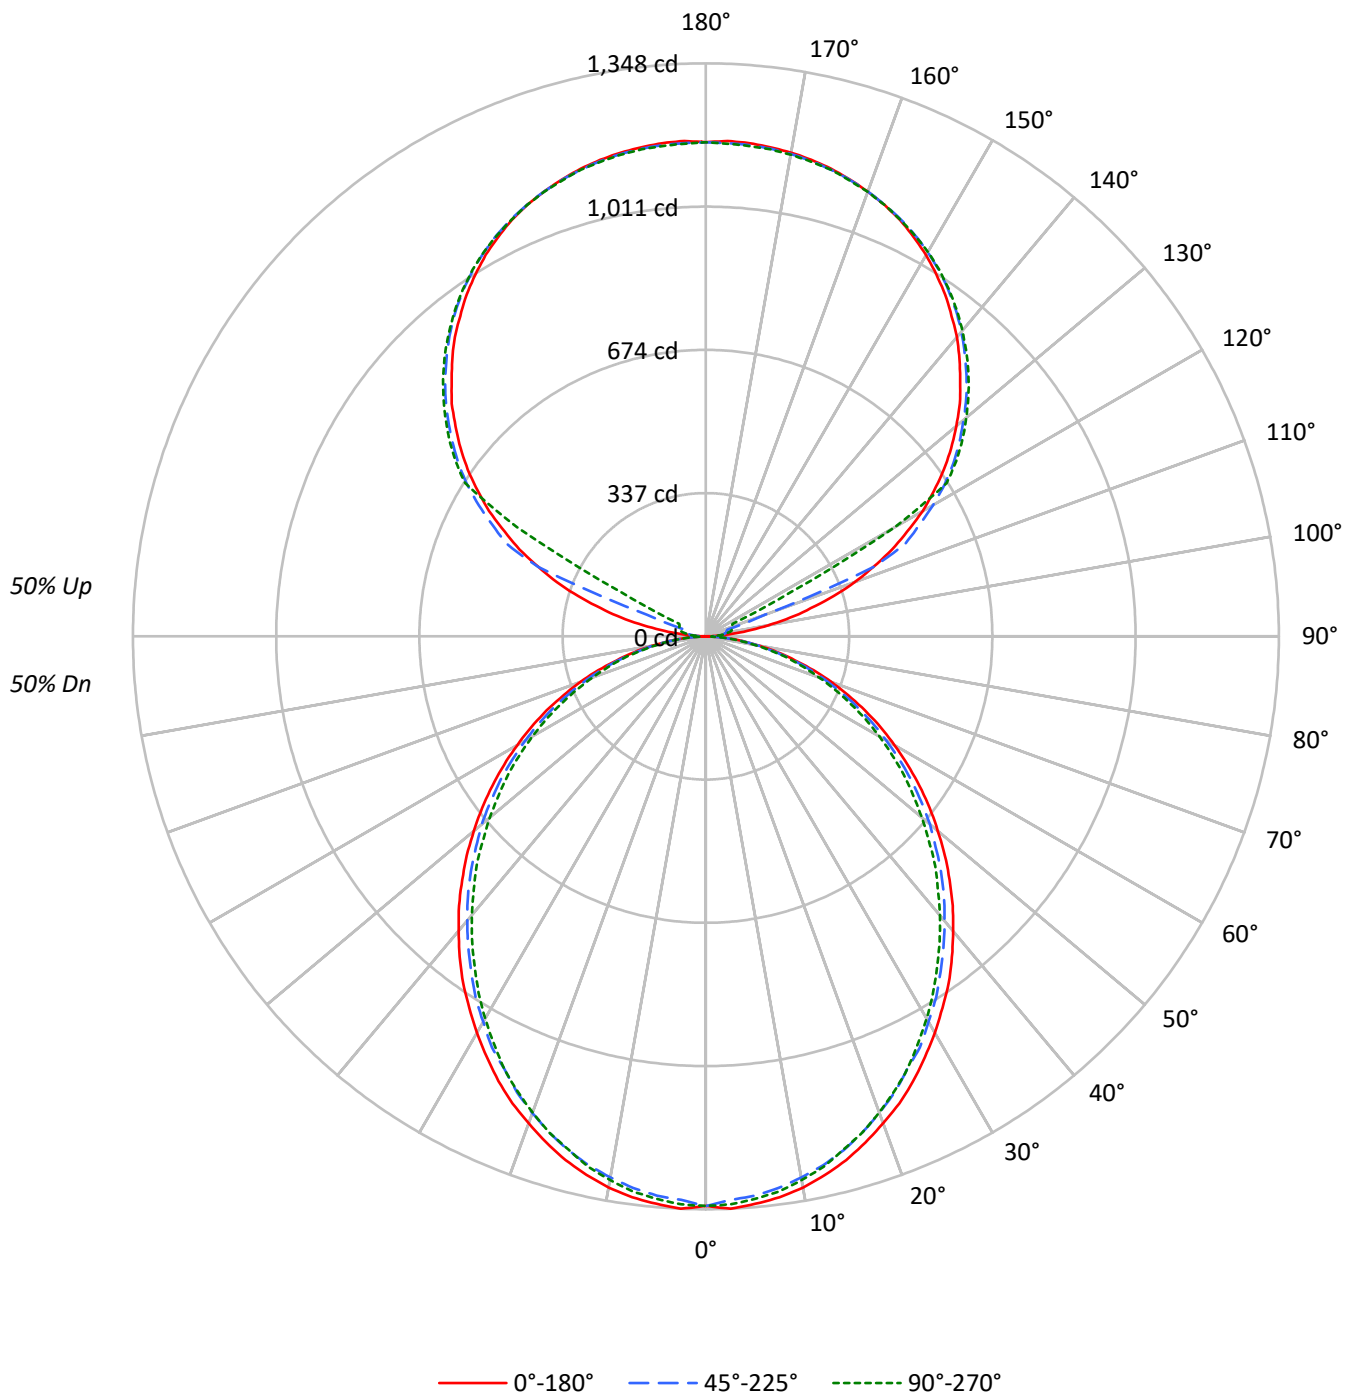

TEST NUMBER: P928816

CATALOG NUMBER: DFN2DIP-HX4F0-040D040US935-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	996	996	996
5°	998	983	989
10°	990	970	976
15°	976	954	955
20°	956	932	934
25°	937	905	909
30°	912	881	877
35°	889	852	844
40°	860	822	813
45°	832	793	780
50°	801	762	743
55°	768	726	708
60°	732	684	669
65°	692	640	622
70°	640	587	572
75°	570	523	526
80°	485	442	438
85°	352	301	291

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 832 cd/sqm

TEST NUMBER: P928816

CATALOG NUMBER: DFN2DIP-HX4F0-040D040US935-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	126.1	1.8
10°-20°	354.9	5.2
20°-30°	521.5	7.6
30°-40°	605.7	8.9
40°-50°	605.0	8.9
50°-60°	527.5	7.7
60°-70°	389.9	5.7
70°-80°	220.6	3.2
80°-90°	60.3	0.9
90°-100°	38.3	0.6
100°-110°	142.9	2.1
110°-120°	378.9	5.6
120°-130°	628.5	9.2
130°-140°	667.6	9.8
140°-150°	620.5	9.1
150°-160°	498.8	7.3
160°-170°	321.4	4.7
170°-180°	110.6	1.6
0°-30°	1002.5	14.7
0°-40°	1608.3	23.6
0°-60°	2740.7	40.2
0°-90°	3411.6	50.0
90°-120°	560.1	8.2
90°-150°	2476.6	36.3
90°-180°	3407.0	50.0
0°-180°	6819.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1340	1340	1340	1340	1340	
5°	1340	1335	1321	1331	1329	127
15°	1276	1268	1251	1256	1250	359
25°	1154	1144	1122	1125	1122	531
35°	996	983	963	955	948	622
45°	810	802	782	768	763	626
55°	614	606	590	575	568	548
65°	414	406	393	381	375	409
75°	216	214	207	200	202	231
85°	53	52	50	46	45	59
90°	1	10	17	21	23	6
95°	55	27	33	37	36	65
105°	256	281	51	60	64	273
115°	484	498	519	130	69	476
125°	684	695	711	717	719	610
135°	846	860	867	876	874	654
145°	982	981	995	1001	997	614
155°	1081	1073	1083	1088	1082	498
165°	1139	1134	1136	1142	1136	322
175°	1165	1159	1161	1166	1158	111
180°	1162	1162	1162	1162	1162	

TEST NUMBER: P928816

CATALOG NUMBER: DFN2DIP-HX4F0-040D040US935-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1340.1	1340.1	1340.1	1340.1	1340.1
2.5°	1347.9	1341.4	1327.2	1340.1	1337.6
5°	1340.1	1335.0	1320.8	1331.0	1328.6
7.5°	1331.0	1323.4	1309.2	1319.6	1317.0
10°	1317.0	1307.9	1292.5	1302.8	1298.9
12.5°	1297.5	1289.9	1274.5	1280.9	1278.2
15°	1275.7	1268.0	1251.2	1256.4	1250.0
17.5°	1248.6	1241.0	1224.2	1230.5	1224.2
20°	1218.9	1211.3	1193.3	1197.0	1192.1
22.5°	1189.4	1177.8	1161.0	1161.0	1158.4
25°	1154.5	1144.3	1122.4	1124.9	1122.4
27.5°	1115.9	1106.8	1090.2	1086.3	1080.0
30°	1077.3	1067.0	1047.7	1043.8	1038.6
32.5°	1036.0	1028.4	1007.7	1000.0	994.7
35°	996.1	983.3	962.6	954.8	948.4
37.5°	951.0	939.4	918.7	909.7	903.3
40°	904.7	894.2	873.6	862.1	857.0
42.5°	859.5	849.1	828.6	815.6	808.0
45°	810.5	801.6	782.1	768.1	762.8
47.5°	762.8	753.8	733.2	719.0	711.4
50°	712.6	706.1	688.1	670.0	663.6
52.5°	663.6	654.6	637.9	623.7	614.7
55°	613.5	605.6	590.2	574.7	568.3
57.5°	563.1	556.7	539.8	524.4	519.3
60°	512.8	507.7	489.7	475.5	471.7
62.5°	463.9	454.9	442.0	429.1	424.0
65°	413.7	405.9	393.0	381.4	375.1
67.5°	362.1	355.6	344.1	335.1	329.9
70°	314.4	309.3	297.6	288.6	283.5
72.5°	265.5	260.3	253.9	244.9	241.0
75°	216.5	214.0	207.4	199.8	202.3
77.5°	172.6	167.5	164.9	161.0	157.2
80°	128.9	127.5	124.9	121.1	118.6
82.5°	87.6	87.6	86.4	81.2	81.2
85°	52.8	51.6	50.3	46.3	45.1
87.5°	23.2	20.7	18.1	14.2	12.8
90°	0.8	10.1	16.8	21.1	22.6
92.5°	21.1	17.7	20.1	21.9	22.6
95°	54.6	26.9	32.7	37.0	36.2
97.5°	98.4	29.4	42.9	45.5	46.2
100°	148.9	33.7	48.0	54.6	56.3
102.5°	204.3	202.8	49.6	58.8	61.4
105°	255.6	280.9	51.3	60.5	63.9
107.5°	315.4	336.4	53.0	62.3	65.6
110°	372.6	390.2	147.2	63.1	66.4

TEST NUMBER: P928816

CATALOG NUMBER: DFN2DIP-HX4F0-040D040US935-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	426.5	441.5	427.2	64.7	67.3
115°	483.5	497.8	518.9	129.5	69.1
117.5°	533.2	550.0	564.4	444.0	223.7
120°	588.8	601.3	616.5	626.6	513.1
122.5°	635.8	649.3	666.2	671.1	672.0
125°	683.7	694.7	710.7	716.6	719.1
127.5°	727.5	739.3	751.9	760.3	761.1
130°	768.7	782.2	791.3	800.6	799.9
132.5°	810.7	821.7	831.0	838.5	837.8
135°	846.1	859.6	867.1	875.6	873.9
137.5°	883.0	893.1	901.6	910.0	907.5
140°	919.2	926.0	935.2	942.8	938.6
142.5°	949.6	955.5	966.4	973.0	968.9
145°	981.5	980.7	994.9	1000.8	996.6
147.5°	1009.2	1006.7	1021.0	1025.2	1021.9
150°	1036.1	1030.3	1043.8	1048.8	1044.6
152.5°	1058.9	1052.1	1064.7	1069.8	1063.9
155°	1080.7	1073.2	1083.3	1088.3	1081.6
157.5°	1098.4	1091.7	1099.3	1105.2	1098.4
160°	1113.5	1108.5	1113.5	1118.5	1112.7
162.5°	1127.0	1122.0	1126.2	1132.0	1124.5
165°	1138.8	1133.8	1136.3	1142.1	1136.3
167.5°	1148.1	1142.9	1145.6	1151.4	1143.8
170°	1155.6	1150.6	1152.2	1158.1	1150.6
172.5°	1160.6	1155.6	1157.4	1163.2	1155.6
175°	1164.8	1158.9	1160.6	1166.5	1158.1
177.5°	1166.5	1160.6	1161.5	1167.4	1159.9
180°	1162.4	1162.4	1162.4	1162.4	1162.4



TEST NUMBER: P928816

CATALOG NUMBER: DFN2DIP-HX4F0-040D040US935-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.26	8.12	8.22	9.10	10.37	6.83	7.69	7.79	8.67	9.94
	3H	8.92	9.70	9.89	10.68	11.97	8.45	9.22	9.42	10.21	11.50
	4H	9.51	10.24	10.49	11.23	12.53	9.04	9.77	10.02	10.76	12.06
	6H	9.91	10.59	10.91	11.58	12.89	9.44	10.11	10.43	11.10	12.42
	8H	10.02	10.66	11.02	11.67	12.98	9.54	10.18	10.54	11.19	12.50
	12H	10.07	10.68	11.07	11.68	13.01	9.59	10.20	10.59	11.20	12.53
4H	2H	7.73	8.46	8.71	9.44	10.74	7.38	8.11	8.37	9.10	10.40
	3H	9.59	10.20	10.59	11.22	12.53	9.20	9.81	10.20	10.82	12.14
	4H	10.31	10.87	11.31	11.87	13.21	9.90	10.46	10.91	11.47	12.81
	6H	10.82	11.30	11.84	12.34	13.67	10.41	10.89	11.43	11.93	13.26
	8H	10.97	11.42	11.99	12.45	13.80	10.56	11.01	11.58	12.03	13.39
	12H	11.05	11.45	12.08	12.49	13.85	10.63	11.03	11.66	12.07	13.43
8H	4H	10.51	10.95	11.52	11.98	13.33	10.14	10.59	11.16	11.62	12.97
	6H	11.14	11.51	12.18	12.57	13.92	10.77	11.15	11.82	12.21	13.56
	8H	11.36	11.69	12.41	12.74	14.10	10.99	11.32	12.04	12.37	13.74
	12H	11.49	11.78	12.55	12.83	14.24	11.11	11.39	12.16	12.44	13.85
12H	4H	10.49	10.90	11.53	11.94	13.29	10.14	10.54	11.18	11.58	12.94
	6H	11.17	11.50	12.22	12.55	13.91	10.82	11.14	11.87	12.19	13.56
	8H	11.41	11.70	12.46	12.74	14.15	11.05	11.34	12.11	12.39	13.80

END OF REPORT