

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P928864

Luminaire Tested: DFN2DIP-HX4F0-050D070US935-FLLONL

Issue Date: 12/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P928864
REPORT IS A COMBINATION OF REPORTS P900875 AND P896187
Test Lab: INNOVATION CENTER
Issue Date: 12/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-050D070US935-FLLONL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10228.7 lumens
Efficiency: N/A
Efficacy: 106.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 95.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P928864

CATALOG NUMBER: DFN2DIP-HX4F0-050D070US935-FLLONL

Luminous Intensity Polar Plot

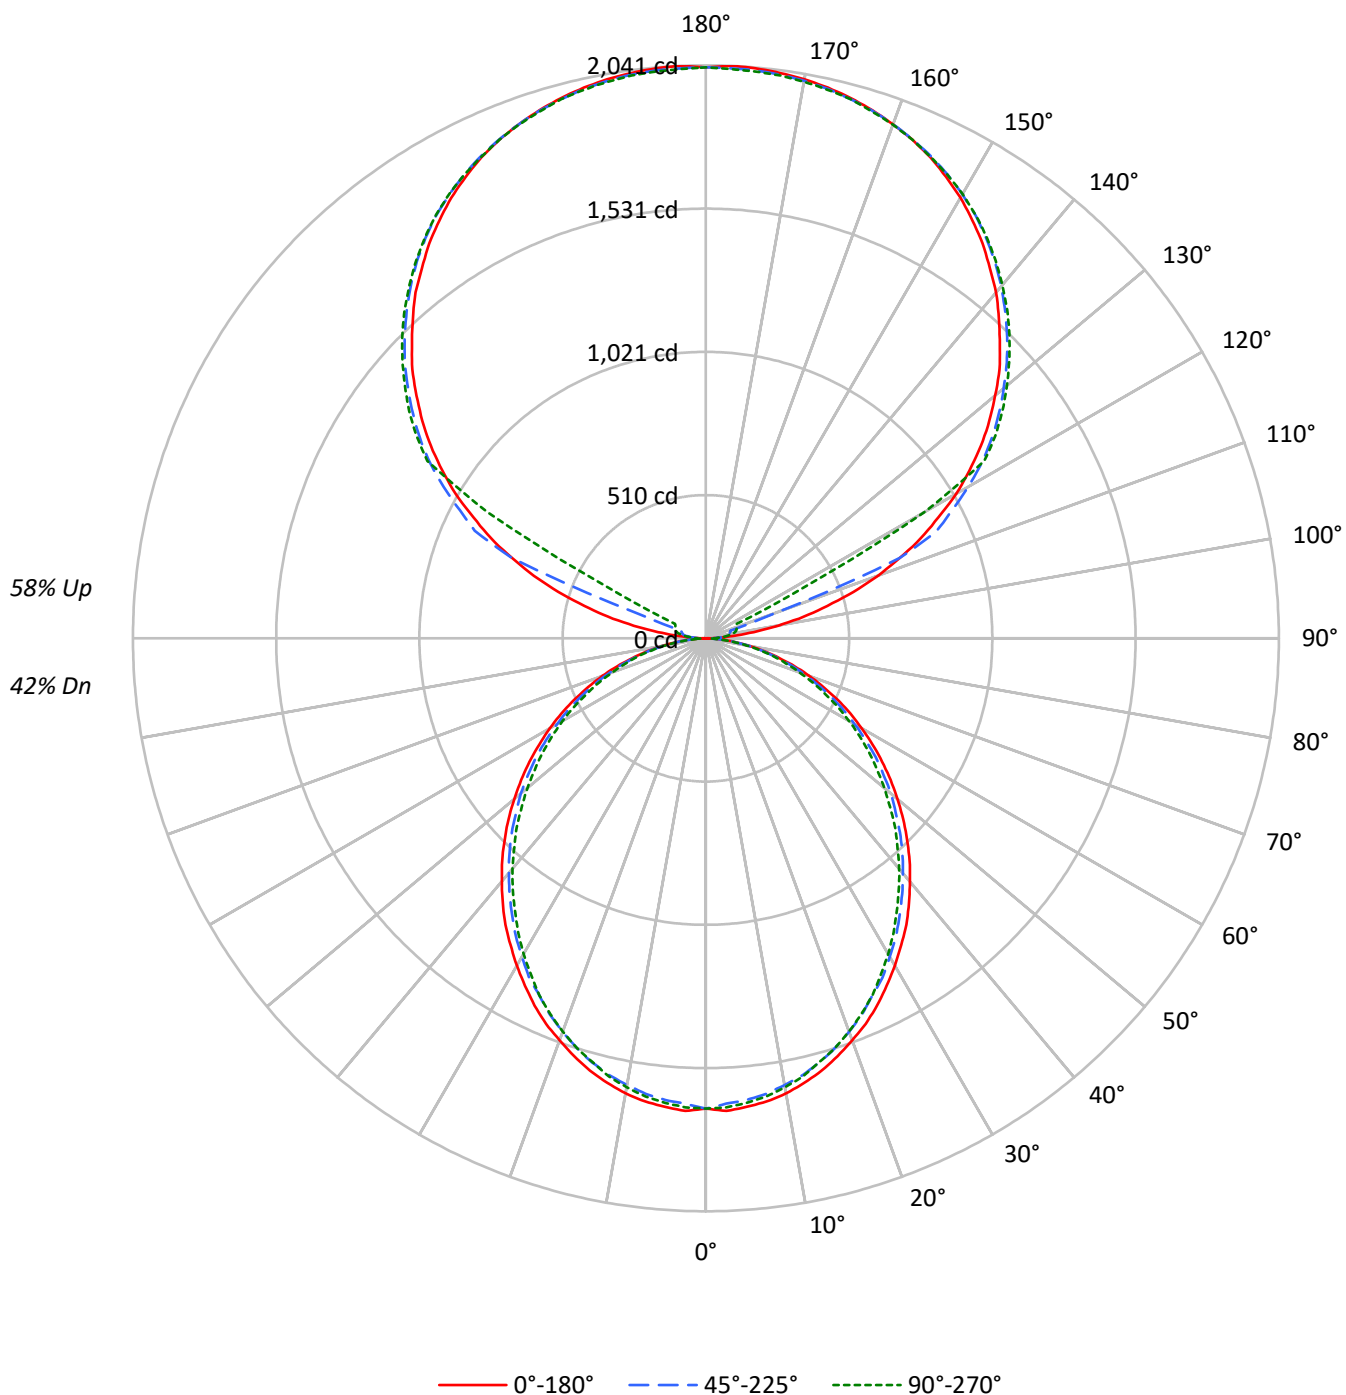

TEST NUMBER: P928864

CATALOG NUMBER: DFN2DIP-HX4F0-050D070US935-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	63	63	63	49	49	49
1	96	92	88	84	87	84	80	78	69	67	65	55	54	52	43	42	41
2	87	80	74	69	79	73	68	64	60	57	53	49	46	44	38	36	34
3	80	70	63	57	72	64	58	53	53	49	45	43	40	37	33	31	29
4	73	62	54	48	66	57	50	45	47	42	38	38	35	32	30	27	25
5	67	55	47	41	61	51	44	39	42	37	33	34	30	27	27	24	22
6	62	50	42	36	56	46	39	33	38	33	29	31	27	24	24	22	19
7	57	45	37	31	52	41	34	29	34	29	25	28	24	21	22	19	17
8	53	41	33	28	48	37	31	26	31	26	22	26	22	19	20	18	15
9	49	37	30	25	45	34	28	23	29	24	20	24	20	17	19	16	14
10	46	34	27	22	42	31	25	21	26	21	18	22	18	15	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1246	1246	1246
5°	1248	1228	1237
10°	1238	1212	1220
15°	1220	1192	1194
20°	1195	1164	1167
25°	1171	1131	1136
30°	1140	1101	1097
35°	1111	1064	1055
40°	1076	1028	1016
45°	1040	991	975
50°	1001	953	928
55°	960	908	885
60°	915	855	836
65°	864	800	778
70°	801	734	715
75°	712	654	658
80°	606	552	547
85°	440	376	364

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1045 cd/sqm

TEST NUMBER: P928864

CATALOG NUMBER: DFN2DIP-HX4F0-050D070US935-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	157.7	1.5
10°-20°	443.6	4.3
20°-30°	651.9	6.4
30°-40°	757.2	7.4
40°-50°	756.2	7.4
50°-60°	659.4	6.4
60°-70°	487.4	4.8
70°-80°	275.8	2.7
80°-90°	76.4	0.7
90°-100°	67.1	0.7
100°-110°	250.0	2.4
110°-120°	663.1	6.5
120°-130°	1099.8	10.8
130°-140°	1168.3	11.4
140°-150°	1085.8	10.6
150°-160°	872.9	8.5
160°-170°	562.5	5.5
170°-180°	193.6	1.9
0°-30°	1253.2	12.3
0°-40°	2010.3	19.7
0°-60°	3425.9	33.5
0°-90°	4265.5	41.7
90°-120°	980.3	9.6
90°-150°	4334.1	42.4
90°-180°	5963.0	58.3
0°-180°	10228.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1675	1675	1675	1675	1675	
5°	1675	1669	1651	1664	1661	159
15°	1595	1585	1564	1571	1562	449
25°	1443	1430	1403	1406	1403	664
35°	1245	1229	1203	1194	1186	778
45°	1013	1002	978	960	954	782
55°	767	757	738	718	710	686
65°	517	507	491	477	469	511
75°	270	267	259	250	253	289
85°	66	64	63	58	56	74
90°	1	18	29	37	40	9
95°	96	47	57	65	63	113
105°	448	492	90	106	112	478
115°	846	871	908	227	121	833
125°	1196	1216	1244	1254	1258	1067
135°	1481	1504	1517	1532	1529	1144
145°	1718	1716	1741	1751	1744	1074
155°	1891	1878	1896	1904	1893	872
165°	1993	1984	1988	1999	1988	563
175°	2038	2028	2031	2041	2027	194
180°	2034	2034	2034	2034	2034	

TEST NUMBER: P928864

CATALOG NUMBER: DFN2DIP-HX4F0-050D070US935-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1675.1	1675.1	1675.1	1675.1	1675.1
2.5°	1684.8	1676.8	1659.1	1675.1	1672.1
5°	1675.1	1668.8	1651.0	1663.8	1660.8
7.5°	1663.8	1654.2	1636.5	1649.5	1646.2
10°	1646.2	1635.0	1615.7	1628.4	1623.7
12.5°	1622.0	1612.4	1593.1	1601.1	1597.8
15°	1594.6	1585.0	1564.0	1570.6	1562.5
17.5°	1560.7	1551.2	1530.2	1538.2	1530.2
20°	1523.7	1514.2	1491.6	1496.3	1490.0
22.5°	1486.8	1472.2	1451.2	1451.2	1447.9
25°	1443.2	1430.4	1403.0	1406.1	1403.0
27.5°	1394.8	1383.5	1362.7	1357.9	1349.9
30°	1346.6	1333.7	1309.6	1304.8	1298.3
32.5°	1295.0	1285.5	1259.6	1249.9	1243.5
35°	1245.1	1229.1	1203.2	1193.5	1185.5
37.5°	1188.7	1174.2	1148.4	1137.1	1129.1
40°	1130.8	1117.8	1092.0	1077.6	1071.2
42.5°	1074.4	1061.4	1035.8	1019.5	1010.0
45°	1013.2	1001.9	977.7	960.1	953.6
47.5°	953.6	942.3	916.5	898.7	889.2
50°	890.7	882.7	860.1	837.6	829.5
52.5°	829.5	818.2	797.4	779.6	768.4
55°	766.8	757.1	737.7	718.4	710.4
57.5°	703.9	695.9	674.9	655.6	649.0
60°	641.0	634.7	612.2	594.3	589.6
62.5°	579.9	568.6	552.5	536.4	529.9
65°	517.1	507.4	491.3	476.8	468.7
67.5°	452.7	444.5	430.2	418.9	412.3
70°	393.0	386.6	372.0	360.8	354.5
72.5°	331.9	325.4	317.4	306.1	301.3
75°	270.5	267.4	259.2	249.7	253.0
77.5°	215.9	209.3	206.1	201.3	196.6
80°	161.2	159.5	156.2	151.4	148.2
82.5°	109.5	109.5	108.0	101.5	101.5
85°	66.0	64.4	62.9	57.9	56.4
87.5°	29.0	25.8	22.6	17.7	16.1
90°	1.4	17.7	29.4	36.9	39.7
92.5°	36.9	30.9	35.3	38.3	39.7
95°	95.6	47.0	57.3	64.8	63.3
97.5°	172.1	51.6	75.0	79.6	80.9
100°	260.6	58.9	83.9	95.6	98.6
102.5°	357.6	354.8	86.9	103.0	107.5
105°	447.5	491.6	89.8	105.9	111.8
107.5°	551.9	588.7	92.8	108.9	114.9
110°	652.1	682.9	257.6	110.5	116.2

TEST NUMBER: P928864

CATALOG NUMBER: DFN2DIP-HX4F0-050D070US935-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	746.3	772.7	747.7	113.2	117.8
115°	846.3	871.2	908.1	226.7	120.8
117.5°	933.2	962.5	987.7	777.1	391.5
120°	1030.3	1052.3	1078.9	1096.6	897.9
122.5°	1112.6	1136.2	1165.8	1174.5	1176.0
125°	1196.5	1215.7	1243.7	1254.0	1258.4
127.5°	1273.1	1293.7	1315.9	1330.6	1332.0
130°	1345.2	1368.8	1384.9	1401.2	1399.8
132.5°	1418.8	1438.0	1454.1	1467.4	1466.0
135°	1480.7	1504.3	1517.4	1532.2	1529.3
137.5°	1545.3	1563.1	1577.9	1592.6	1588.2
140°	1608.6	1620.5	1636.6	1649.8	1642.5
142.5°	1661.7	1672.1	1691.1	1702.8	1695.5
145°	1717.7	1716.1	1741.1	1751.4	1744.1
147.5°	1766.1	1761.8	1786.7	1794.1	1788.3
150°	1813.3	1803.0	1826.6	1835.3	1828.0
152.5°	1853.0	1841.2	1863.3	1872.2	1861.9
155°	1891.3	1878.1	1895.7	1904.5	1892.8
157.5°	1922.2	1910.5	1923.7	1934.1	1922.2
160°	1948.8	1939.8	1948.8	1957.5	1947.2
162.5°	1972.2	1963.4	1970.7	1981.1	1967.8
165°	1992.8	1984.1	1988.4	1998.7	1988.4
167.5°	2009.1	2000.1	2004.7	2015.0	2001.7
170°	2022.3	2013.4	2016.4	2026.7	2013.4
172.5°	2031.1	2022.3	2025.3	2035.6	2022.3
175°	2038.4	2028.1	2031.1	2041.3	2026.7
177.5°	2041.3	2031.1	2032.6	2043.0	2029.6
180°	2034.0	2034.0	2034.0	2034.0	2034.0

TEST NUMBER: P928864

CATALOG NUMBER: DFN2DIP-HX4F0-050D070US935-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.22	8.01	8.24	9.04	10.43	6.79	7.58	7.81	8.61	9.99
	3H	8.87	9.58	9.91	10.62	12.03	8.40	9.11	9.44	10.15	11.56
	4H	9.46	10.13	10.51	11.17	12.59	8.98	9.66	10.03	10.70	12.11
	6H	9.85	10.47	10.91	11.52	12.95	9.38	10.00	10.44	11.05	12.47
	8H	9.96	10.55	11.02	11.61	13.03	9.48	10.07	10.55	11.14	12.56
	12H	10.00	10.56	11.07	11.62	13.07	9.52	10.08	10.59	11.14	12.59
4H	2H	7.67	8.34	8.72	9.39	10.80	7.33	8.00	8.38	9.04	10.45
	3H	9.53	10.09	10.59	11.16	12.59	9.14	9.70	10.20	10.77	12.20
	4H	10.24	10.76	11.31	11.82	13.27	9.84	10.35	10.91	11.42	12.86
	6H	10.76	11.20	11.83	12.28	13.73	10.35	10.79	11.42	11.87	13.32
	8H	10.90	11.32	11.98	12.40	13.85	10.49	10.90	11.57	11.98	13.44
	12H	10.97	11.35	12.07	12.44	13.90	10.55	10.93	11.65	12.02	13.48
8H	4H	10.44	10.85	11.51	11.93	13.38	10.07	10.49	11.15	11.57	13.02
	6H	11.06	11.41	12.17	12.53	13.98	10.70	11.04	11.80	12.16	13.62
	8H	11.29	11.58	12.39	12.69	14.16	10.92	11.22	12.02	12.32	13.79
	12H	11.41	11.68	12.53	12.78	14.29	11.03	11.29	12.14	12.39	13.90
12H	4H	10.42	10.79	11.51	11.88	13.35	10.07	10.44	11.16	11.53	12.99
	6H	11.09	11.39	12.20	12.50	13.97	10.74	11.04	11.85	12.15	13.62
	8H	11.33	11.60	12.45	12.70	14.21	10.98	11.24	12.09	12.34	13.85

END OF REPORT