

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919088

Luminaire Tested: DFN2DIP-HX4F0-050D120US935-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919088
REPORT IS A COMBINATION OF REPORTS P899445 AND P896188
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-050D120US935-FLLFLL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13405.7 lumens
Efficiency: N/A
Efficacy: 114.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 116.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919088

CATALOG NUMBER: DFN2DIP-HX4F0-050D120US935-FLLFLL

Luminous Intensity Polar Plot

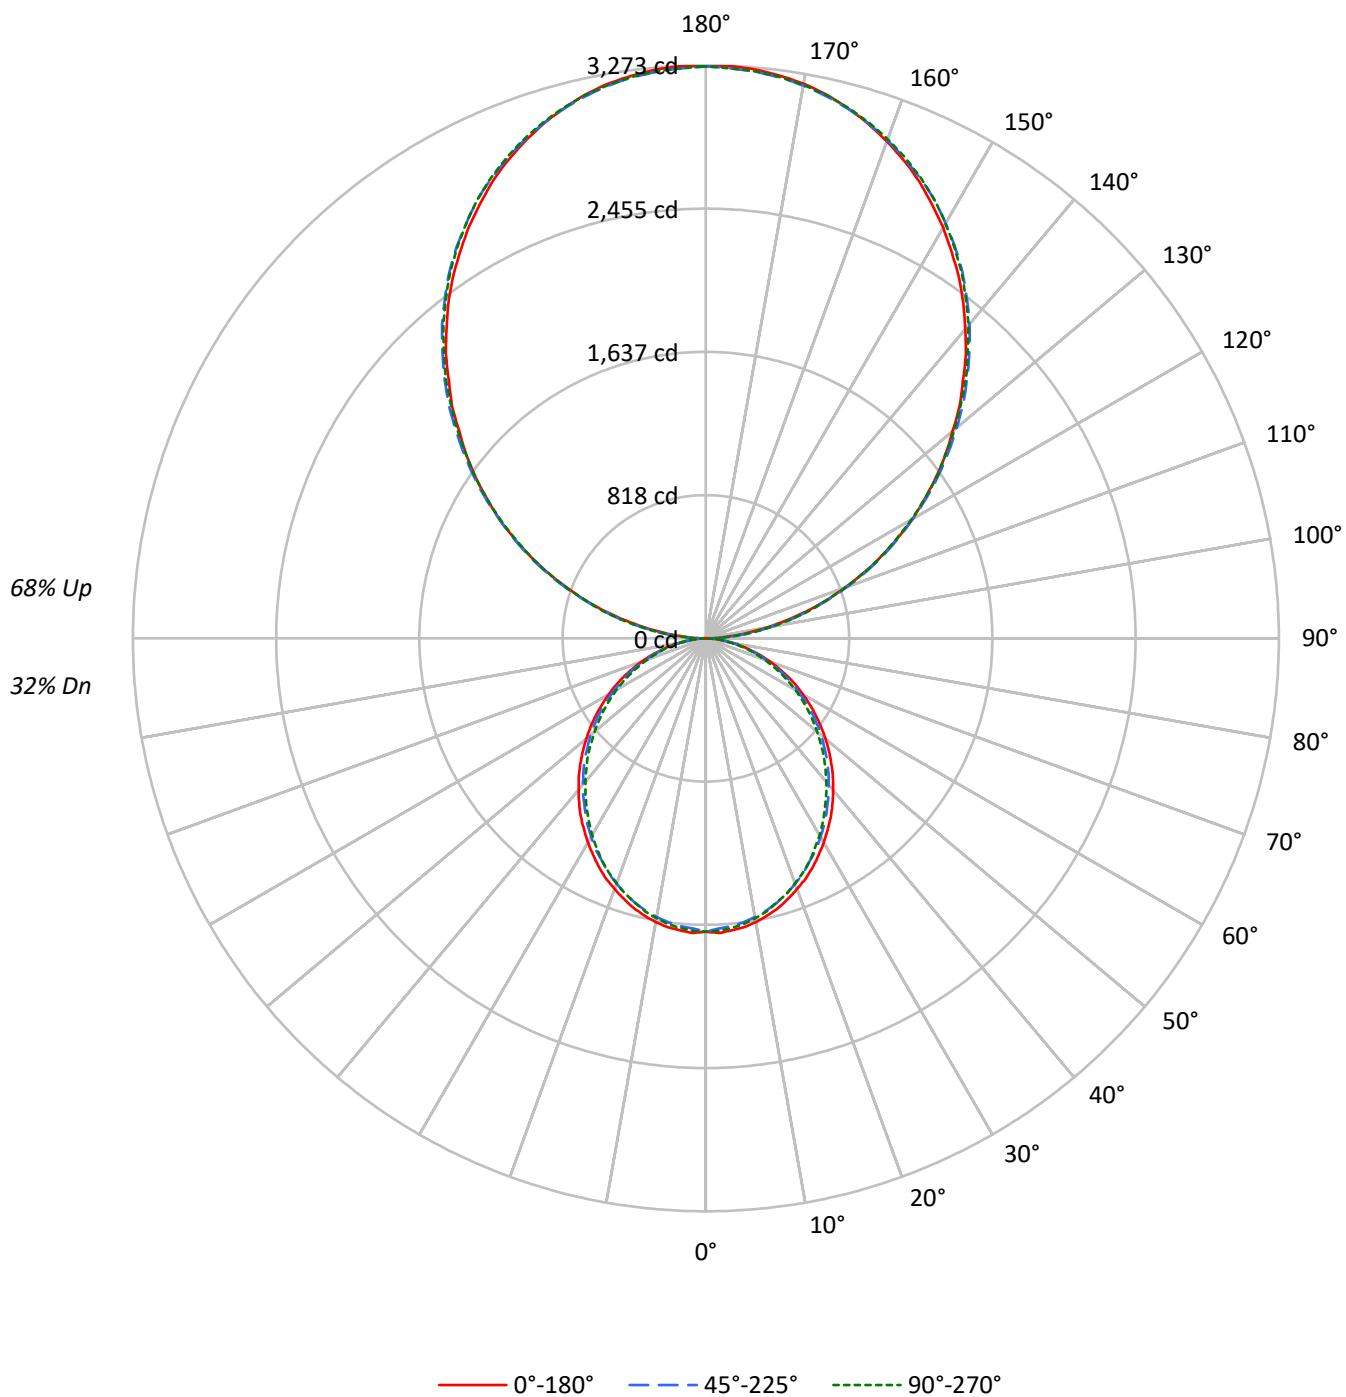

TEST NUMBER: P919088

CATALOG NUMBER: DFN2DIP-HX4F0-050D120US935-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	93	93	93	93	73	73	73	56	56	56	39	39	39
1	94	89	86	82	84	81	77	75	64	62	60	49	47	46	35	34	33
2	85	78	72	67	76	70	65	61	56	53	50	43	41	39	31	29	28
3	78	69	62	56	70	62	56	51	49	45	42	38	35	33	27	25	24
4	71	61	53	47	64	55	48	43	44	39	35	34	30	28	24	22	20
5	65	54	46	40	58	49	42	37	39	34	30	30	27	24	22	20	18
6	60	48	40	35	54	44	37	32	35	30	26	27	24	21	20	17	16
7	55	43	36	30	50	39	33	28	32	27	23	25	21	19	18	16	14
8	51	39	32	27	46	36	29	25	29	24	20	23	19	16	17	14	12
9	48	36	29	24	43	33	26	22	26	22	18	21	17	15	15	13	11
10	44	33	26	21	40	30	24	19	24	20	16	19	16	13	14	12	10

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1246	1246	1246
5°	1248	1228	1237
10°	1238	1212	1220
15°	1220	1192	1194
20°	1195	1164	1167
25°	1171	1131	1136
30°	1140	1101	1097
35°	1111	1064	1055
40°	1076	1028	1016
45°	1040	991	975
50°	1001	953	928
55°	960	908	885
60°	915	855	836
65°	864	800	778
70°	801	734	715
75°	712	654	658
80°	606	552	547
85°	440	376	364

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2464 cd/sqm

TEST NUMBER: P919088

CATALOG NUMBER: DFN2DIP-HX4F0-050D120US935-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	157.7	1.2
10°-20°	443.6	3.3
20°-30°	651.9	4.9
30°-40°	757.2	5.6
40°-50°	756.2	5.6
50°-60°	659.4	4.9
60°-70°	487.4	3.6
70°-80°	275.8	2.1
80°-90°	82.1	0.6
90°-100°	202.2	1.5
100°-110°	642.4	4.8
110°-120°	1099.4	8.2
120°-130°	1445.9	10.8
130°-140°	1623.0	12.1
140°-150°	1591.6	11.9
150°-160°	1335.1	10.0
160°-170°	885.4	6.6
170°-180°	309.5	2.3
0°-30°	1253.2	9.3
0°-40°	2010.3	15.0
0°-60°	3425.9	25.6
0°-90°	4271.2	31.9
90°-120°	1944.1	14.5
90°-150°	6604.6	49.3
90°-180°	9134.0	68.1
0°-180°	13405.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1675	1675	1675	1675	1675	
5°	1675	1669	1651	1664	1661	159
15°	1595	1585	1564	1570	1562	449
25°	1443	1430	1403	1406	1403	664
35°	1245	1229	1203	1194	1186	778
45°	1013	1002	978	960	954	782
55°	767	757	738	718	710	686
65°	517	507	491	477	469	511
75°	270	267	259	250	253	289
85°	66	64	63	58	56	74
90°	3	36	96	91	94	13
95°	144	171	176	176	171	160
105°	593	601	607	612	612	626
115°	1103	1119	1114	1111	1103	1091
125°	1605	1629	1622	1613	1610	1434
135°	2076	2106	2112	2109	2101	1604
145°	2520	2540	2555	2558	2548	1574
155°	2881	2889	2898	2912	2903	1326
165°	3135	3132	3132	3151	3138	884
175°	3262	3254	3248	3268	3251	310
180°	3268	3268	3268	3268	3268	

TEST NUMBER: P919088

CATALOG NUMBER: DFN2DIP-HX4F0-050D120US935-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1675.1	1675.1	1675.1	1675.1	1675.1
2.5°	1684.8	1676.8	1659.1	1675.1	1672.1
5°	1675.1	1668.8	1651.0	1663.8	1660.8
7.5°	1663.8	1654.2	1636.5	1649.5	1646.2
10°	1646.2	1634.9	1615.7	1628.4	1623.7
12.5°	1621.9	1612.4	1593.1	1601.1	1597.8
15°	1594.6	1585.0	1564.0	1570.5	1562.5
17.5°	1560.7	1551.2	1530.2	1538.2	1530.2
20°	1523.7	1514.2	1491.6	1496.3	1490.0
22.5°	1486.8	1472.2	1451.2	1451.2	1447.9
25°	1443.2	1430.4	1403.0	1406.1	1403.0
27.5°	1394.8	1383.5	1362.7	1357.9	1349.9
30°	1346.6	1333.7	1309.6	1304.8	1298.3
32.5°	1295.0	1285.5	1259.6	1249.9	1243.5
35°	1245.1	1229.1	1203.2	1193.5	1185.5
37.5°	1188.7	1174.2	1148.4	1137.1	1129.1
40°	1130.8	1117.8	1092.0	1077.6	1071.2
42.5°	1074.4	1061.4	1035.8	1019.5	1010.0
45°	1013.2	1001.9	977.7	960.1	953.6
47.5°	953.6	942.3	916.5	898.7	889.2
50°	890.7	882.7	860.1	837.6	829.5
52.5°	829.5	818.2	797.4	779.6	768.4
55°	766.8	757.1	737.7	718.4	710.4
57.5°	703.9	695.9	674.9	655.6	649.0
60°	641.0	634.7	612.2	594.3	589.6
62.5°	579.9	568.6	552.5	536.4	529.9
65°	517.1	507.4	491.3	476.8	468.7
67.5°	452.7	444.5	430.2	418.9	412.3
70°	393.0	386.6	372.0	360.8	354.5
72.5°	331.9	325.4	317.4	306.1	301.3
75°	270.5	267.4	259.2	249.7	253.0
77.5°	215.9	209.3	206.1	201.3	196.6
80°	161.2	159.5	156.2	151.4	148.2
82.5°	109.5	109.5	108.0	101.5	101.5
85°	66.0	64.4	62.9	57.9	56.4
87.5°	29.0	25.8	22.6	17.7	16.1
90°	2.9	35.5	96.5	90.7	93.6
92.5°	61.0	82.7	85.7	88.7	88.7
95°	143.8	171.4	176.3	176.3	171.4
97.5°	239.4	265.0	275.9	275.9	275.9
100°	349.7	372.4	380.2	380.2	377.3
102.5°	466.0	482.7	493.5	496.5	493.5
105°	593.1	600.9	606.8	611.7	611.7
107.5°	719.1	731.0	731.0	732.9	719.1
110°	841.3	857.0	857.0	857.0	849.2

TEST NUMBER: P919088

CATALOG NUMBER: DFN2DIP-HX4F0-050D120US935-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	973.3	990.1	987.0	979.2	973.3
115°	1103.3	1119.1	1114.1	1111.2	1103.3
117.5°	1232.3	1254.0	1240.3	1232.3	1224.5
120°	1362.4	1384.1	1362.4	1362.4	1353.6
122.5°	1480.7	1508.2	1494.4	1486.5	1480.7
125°	1604.7	1629.4	1621.5	1612.6	1609.6
127.5°	1726.0	1756.4	1745.6	1733.8	1726.0
130°	1839.2	1874.7	1869.7	1863.8	1853.0
132.5°	1966.3	1993.9	1995.8	1982.0	1974.2
135°	2075.6	2106.2	2112.1	2109.1	2101.3
137.5°	2197.8	2222.4	2227.3	2225.3	2213.5
140°	2305.1	2329.8	2343.6	2343.6	2332.7
142.5°	2415.5	2440.2	2448.0	2450.9	2440.2
145°	2519.9	2539.6	2555.4	2558.4	2547.5
147.5°	2613.5	2638.1	2650.0	2654.9	2644.0
150°	2710.1	2726.8	2737.6	2746.5	2737.6
152.5°	2795.7	2812.4	2826.3	2837.2	2826.3
155°	2881.4	2889.3	2898.2	2912.0	2903.1
157.5°	2955.4	2961.2	2966.1	2985.9	2972.1
160°	3021.3	3027.3	3030.2	3047.0	3035.1
162.5°	3082.4	3082.4	3085.4	3104.1	3090.3
165°	3134.6	3131.7	3131.7	3151.3	3137.6
167.5°	3181.9	3173.0	3173.0	3192.8	3179.0
170°	3217.4	3209.5	3206.5	3226.2	3209.5
172.5°	3242.0	3234.1	3231.2	3250.9	3234.1
175°	3261.7	3253.8	3247.9	3267.6	3250.9
177.5°	3272.6	3264.6	3258.7	3275.5	3258.7
180°	3267.6	3267.6	3267.6	3267.6	3267.6

TEST NUMBER: P919088

CATALOG NUMBER: DFN2DIP-HX4F0-050D120US935-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.07	6.79	7.17	7.88	9.39	5.63	6.35	6.73	7.45	8.96
	3H	7.72	8.36	8.82	9.47	10.99	7.24	7.89	8.35	8.99	10.52
	4H	8.30	8.91	9.42	10.02	11.55	7.83	8.44	8.94	9.54	11.07
	6H	8.69	9.25	9.82	10.36	11.91	8.22	8.78	9.34	9.89	11.43
	8H	8.79	9.33	9.92	10.45	11.99	8.32	8.85	9.45	9.98	11.51
	12H	8.84	9.35	9.97	10.46	12.02	8.36	8.86	9.49	9.98	11.54
4H	2H	6.51	7.12	7.64	8.23	9.76	6.17	6.78	7.29	7.88	9.41
	3H	8.37	8.88	9.50	10.01	11.55	7.97	8.48	9.10	9.61	11.16
	4H	9.07	9.54	10.21	10.66	12.23	8.67	9.14	9.80	10.26	11.82
	6H	9.58	9.98	10.72	11.13	12.68	9.17	9.58	10.31	10.72	12.27
	8H	9.73	10.10	10.87	11.24	12.81	9.32	9.69	10.46	10.83	12.40
	12H	9.80	10.14	10.95	11.28	12.86	9.37	9.71	10.53	10.86	12.44
8H	4H	9.26	9.64	10.40	10.77	12.34	8.90	9.28	10.04	10.41	11.98
	6H	9.89	10.20	11.05	11.37	12.94	9.52	9.83	10.69	11.01	12.58
	8H	10.11	10.38	11.27	11.53	13.12	9.74	10.01	10.90	11.17	12.75
	12H	10.23	10.47	11.40	11.62	13.25	9.85	10.09	11.02	11.24	12.86
12H	4H	9.24	9.58	10.40	10.73	12.30	8.89	9.23	10.04	10.37	11.95
	6H	9.92	10.19	11.08	11.34	12.93	9.56	9.84	10.73	10.99	12.58
	8H	10.15	10.39	11.32	11.54	13.17	9.79	10.03	10.97	11.19	12.81

END OF REPORT