

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P928892

Luminaire Tested: DFN2DIP-HX4F0-060D050US935-FLLONL

Issue Date: 12/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P928892
REPORT IS A COMBINATION OF REPORTS P900841 AND P896187
Test Lab: INNOVATION CENTER
Issue Date: 12/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-060D050US935-FLLONL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9376.3 lumens
Efficiency: N/A
Efficacy: 102.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 91.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.099
Total Harmonic Distortion (THDi): 0.979
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P928892

CATALOG NUMBER: DFN2DIP-HX4F0-060D050US935-FLLONL

Luminous Intensity Polar Plot

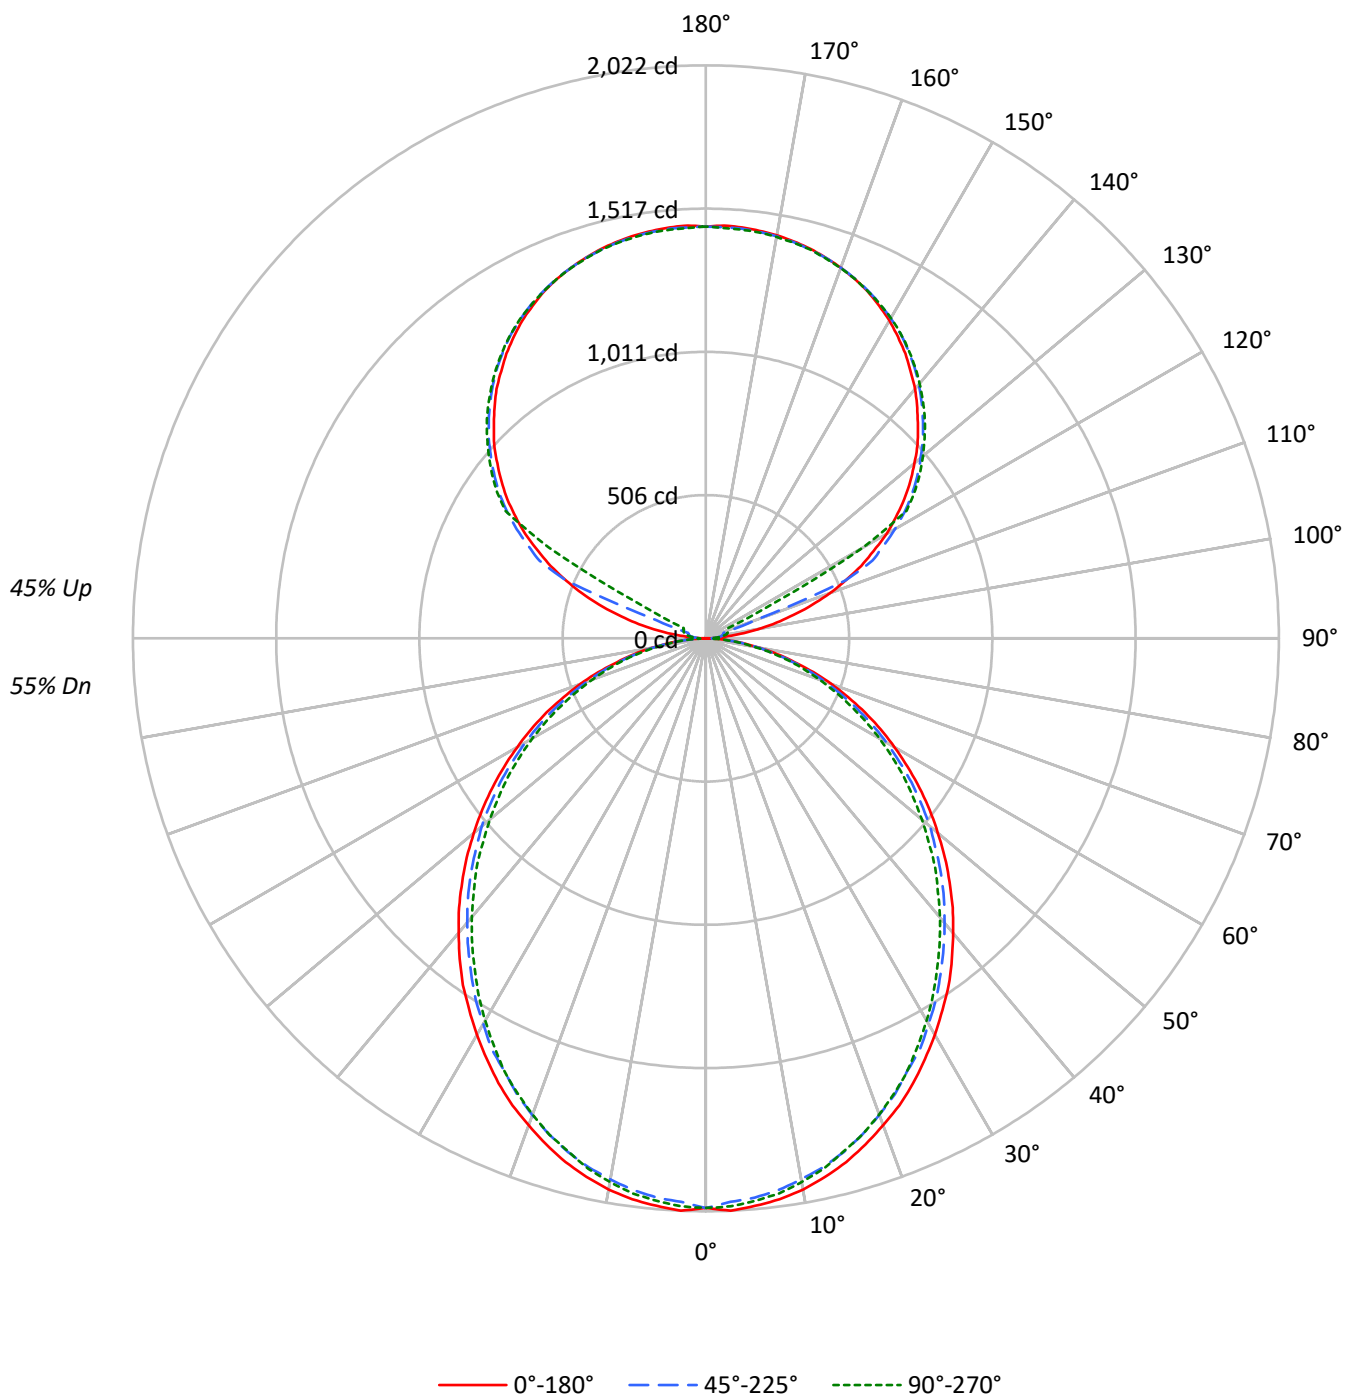

TEST NUMBER: P928892

CATALOG NUMBER: DFN2DIP-HX4F0-060D050US935-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	86	86	86	73	73	73	60	60	60
1	99	94	91	87	92	88	84	81	75	73	71	64	62	60	53	52	51
2	90	82	76	71	83	77	71	67	66	62	58	56	53	51	47	45	43
3	82	73	65	59	76	68	61	56	58	53	49	50	46	43	42	39	37
4	75	64	56	50	69	60	53	47	52	46	42	44	40	37	37	34	32
5	69	57	49	43	64	53	46	41	46	41	36	40	35	32	34	30	27
6	64	51	43	37	59	48	41	35	42	36	32	36	31	28	30	27	24
7	59	46	38	33	54	43	36	31	38	32	28	33	28	25	28	24	22
8	55	42	34	29	51	40	33	28	35	29	25	30	25	22	26	22	19
9	51	39	31	26	47	36	29	25	32	26	22	28	23	20	24	20	17
10	48	35	28	23	44	33	27	22	29	24	20	25	21	18	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1495	1495	1495
5°	1497	1474	1484
10°	1485	1454	1464
15°	1463	1430	1433
20°	1434	1397	1400
25°	1405	1358	1363
30°	1368	1321	1316
35°	1333	1277	1266
40°	1291	1233	1219
45°	1248	1189	1170
50°	1201	1143	1114
55°	1153	1090	1062
60°	1097	1026	1003
65°	1037	961	933
70°	961	880	858
75°	855	785	789
80°	727	662	656
85°	527	451	437

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1248 cd/sqm

TEST NUMBER: P928892

CATALOG NUMBER: DFN2DIP-HX4F0-060D050US935-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	189.2	2.0
10°-20°	532.3	5.7
20°-30°	782.3	8.3
30°-40°	908.6	9.7
40°-50°	907.5	9.7
50°-60°	791.3	8.4
60°-70°	584.9	6.2
70°-80°	330.9	3.5
80°-90°	89.9	1.0
90°-100°	47.9	0.5
100°-110°	178.6	1.9
110°-120°	473.7	5.1
120°-130°	785.6	8.4
130°-140°	834.5	8.9
140°-150°	775.6	8.3
150°-160°	623.5	6.7
160°-170°	401.8	4.3
170°-180°	138.3	1.5
0°-30°	1503.8	16.0
0°-40°	2412.4	25.7
0°-60°	4111.1	43.8
0°-90°	5116.9	54.6
90°-120°	700.2	7.5
90°-150°	3095.8	33.0
90°-180°	4259.0	45.4
0°-180°	9376.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2010	2010	2010	2010	2010	
5°	2010	2002	1981	1997	1993	191
15°	1914	1902	1877	1885	1875	539
25°	1732	1716	1684	1687	1684	797
35°	1494	1475	1444	1432	1422	933
45°	1216	1202	1173	1152	1144	938
55°	920	908	885	862	852	823
65°	620	609	590	572	562	614
75°	325	321	311	300	304	347
85°	79	77	75	70	68	88
90°	1	13	21	26	28	9
95°	68	34	41	46	45	81
105°	320	351	64	76	80	342
115°	604	622	649	162	86	595
125°	855	868	888	896	899	762
135°	1058	1074	1084	1094	1092	817
145°	1227	1226	1244	1251	1246	767
155°	1351	1342	1354	1360	1352	623
165°	1423	1417	1420	1428	1420	402
175°	1456	1449	1451	1458	1448	139
180°	1453	1453	1453	1453	1453	

TEST NUMBER: P928892

CATALOG NUMBER: DFN2DIP-HX4F0-060D050US935-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2010.1	2010.1	2010.1	2010.1	2010.1
2.5°	2021.8	2012.2	1990.8	2010.1	2006.4
5°	2010.1	2002.5	1981.2	1996.6	1992.9
7.5°	1996.6	1985.1	1963.8	1979.4	1975.5
10°	1975.5	1962.0	1938.7	1954.1	1948.4
12.5°	1946.4	1934.8	1911.7	1921.3	1917.4
15°	1913.5	1902.0	1876.8	1884.6	1875.0
17.5°	1872.9	1861.5	1836.3	1845.8	1836.3
20°	1828.4	1817.0	1789.8	1795.6	1788.0
22.5°	1784.2	1766.7	1741.5	1741.5	1737.6
25°	1731.8	1716.5	1683.6	1687.3	1683.6
27.5°	1673.8	1660.3	1635.2	1629.5	1619.9
30°	1616.0	1600.3	1571.5	1565.7	1557.9
32.5°	1554.0	1542.6	1511.6	1499.9	1492.1
35°	1494.2	1474.9	1443.9	1432.2	1422.5
37.5°	1426.5	1409.0	1378.1	1364.5	1354.9
40°	1356.9	1341.4	1310.4	1293.2	1285.4
42.5°	1289.3	1273.7	1242.9	1223.5	1211.9
45°	1215.9	1202.3	1173.2	1152.1	1144.3
47.5°	1144.3	1130.8	1099.8	1078.5	1067.0
50°	1068.8	1059.2	1032.2	1005.0	995.4
52.5°	995.4	981.9	956.8	935.6	922.0
55°	920.2	908.4	885.3	862.1	852.5
57.5°	844.7	835.1	809.9	786.7	778.9
60°	769.2	761.6	734.6	713.3	707.5
62.5°	695.8	682.3	663.0	643.7	635.9
65°	620.5	608.9	589.6	572.1	562.5
67.5°	543.2	533.4	516.2	502.7	494.8
70°	471.7	463.9	446.4	432.9	425.3
72.5°	398.2	390.5	380.8	367.3	361.5
75°	324.6	321.0	311.1	299.6	303.5
77.5°	259.0	251.2	247.3	241.6	235.8
80°	193.4	191.3	187.4	181.7	177.8
82.5°	131.5	131.5	129.6	121.8	121.8
85°	79.1	77.3	75.4	69.5	67.7
87.5°	34.9	31.0	27.0	21.4	19.3
90°	1.0	12.6	21.0	26.3	28.3
92.5°	26.3	22.1	25.2	27.4	28.3
95°	68.3	33.6	41.0	46.3	45.2
97.5°	123.0	36.9	53.6	56.8	57.8
100°	186.1	42.1	59.9	68.3	70.4
102.5°	255.5	253.4	62.1	73.5	76.8
105°	319.6	351.2	64.1	75.7	79.9
107.5°	394.3	420.4	66.3	77.7	82.1
110°	465.8	487.8	184.0	78.9	83.0



TEST NUMBER: P928892

CATALOG NUMBER: DFN2DIP-HX4F0-060D050US935-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	533.0	551.9	534.1	80.9	84.1
115°	604.5	622.3	648.7	162.0	86.3
117.5°	666.5	687.5	705.5	555.0	279.7
120°	735.9	751.7	770.6	783.3	641.3
122.5°	794.7	811.6	832.7	839.0	840.1
125°	854.6	868.4	888.4	895.7	898.9
127.5°	909.3	924.0	940.0	950.4	951.4
130°	960.9	977.8	989.2	1000.8	999.9
132.5°	1013.5	1027.2	1038.6	1048.2	1047.1
135°	1057.7	1074.5	1083.8	1094.5	1092.4
137.5°	1103.8	1116.5	1127.0	1137.6	1134.5
140°	1149.0	1157.5	1169.0	1178.5	1173.3
142.5°	1187.0	1194.4	1208.0	1216.3	1211.1
145°	1226.9	1225.8	1243.6	1251.0	1245.8
147.5°	1261.5	1258.4	1276.3	1281.5	1277.4
150°	1295.2	1287.9	1304.7	1311.0	1305.7
152.5°	1323.5	1315.2	1330.9	1337.3	1329.9
155°	1350.9	1341.5	1354.1	1360.4	1352.0
157.5°	1373.0	1364.6	1374.1	1381.5	1373.0
160°	1392.0	1385.6	1392.0	1398.2	1390.9
162.5°	1408.7	1402.5	1407.6	1415.1	1405.6
165°	1423.4	1417.2	1420.3	1427.6	1420.3
167.5°	1435.0	1428.7	1431.9	1439.2	1429.8
170°	1444.5	1438.1	1440.3	1447.6	1438.1
172.5°	1450.8	1444.5	1446.7	1454.0	1444.5
175°	1456.0	1448.6	1450.8	1458.1	1447.6
177.5°	1458.1	1450.8	1451.9	1459.2	1449.8
180°	1452.9	1452.9	1452.9	1452.9	1452.9

TEST NUMBER: P928892

CATALOG NUMBER: DFN2DIP-HX4F0-060D050US935-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.08	9.99	10.00	10.92	12.13	8.65	9.55	9.57	10.49	11.69
	3H	10.75	11.56	11.67	12.50	13.73	10.27	11.08	11.20	12.03	13.26
	4H	11.34	12.10	12.28	13.05	14.29	10.86	11.63	11.81	12.58	13.82
	6H	11.74	12.45	12.69	13.40	14.65	11.26	11.97	12.22	12.93	14.18
	8H	11.85	12.52	12.81	13.49	14.74	11.37	12.04	12.33	13.02	14.26
	12H	11.90	12.54	12.86	13.50	14.78	11.41	12.06	12.38	13.02	14.29
4H	2H	9.55	10.32	10.50	11.27	12.50	9.20	9.97	10.15	10.92	12.16
	3H	11.42	12.06	12.38	13.04	14.29	11.03	11.67	11.99	12.65	13.90
	4H	12.14	12.72	13.11	13.70	14.97	11.73	12.32	12.70	13.29	14.57
	6H	12.66	13.16	13.64	14.16	15.43	12.25	12.75	13.23	13.75	15.02
	8H	12.81	13.28	13.79	14.27	15.56	12.39	12.87	13.38	13.86	15.15
	12H	12.88	13.31	13.88	14.32	15.61	12.46	12.89	13.46	13.89	15.19
8H	4H	12.34	12.81	13.32	13.80	15.09	11.98	12.45	12.96	13.44	14.73
	6H	12.97	13.36	13.98	14.39	15.68	12.61	13.00	13.62	14.03	15.32
	8H	13.19	13.54	14.21	14.56	15.86	12.82	13.17	13.84	14.19	15.49
	12H	13.33	13.63	14.35	14.65	16.00	12.94	13.25	13.96	14.26	15.61
12H	4H	12.33	12.75	13.33	13.76	15.05	11.97	12.40	12.97	13.41	14.70
	6H	13.00	13.35	14.02	14.37	15.67	12.65	13.00	13.67	14.01	15.32
	8H	13.25	13.55	14.27	14.56	15.92	12.89	13.19	13.91	14.21	15.56