

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P928922

Luminaire Tested: DFN2DIP-HX4F0-060D120US935-RLLONL

Issue Date: 12/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P928922
REPORT IS A COMBINATION OF REPORTS P900968 AND P896187
Test Lab: INNOVATION CENTER
Issue Date: 12/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-060D120US935-RLLONL
Description: 4 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14619.8 lumens
Efficiency: N/A
Efficacy: 97.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 150.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.099
Total Harmonic Distortion (THDi): 0.979
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P928922

CATALOG NUMBER: DFN2DIP-HX4F0-060D120US935-RLLONL

Luminous Intensity Polar Plot

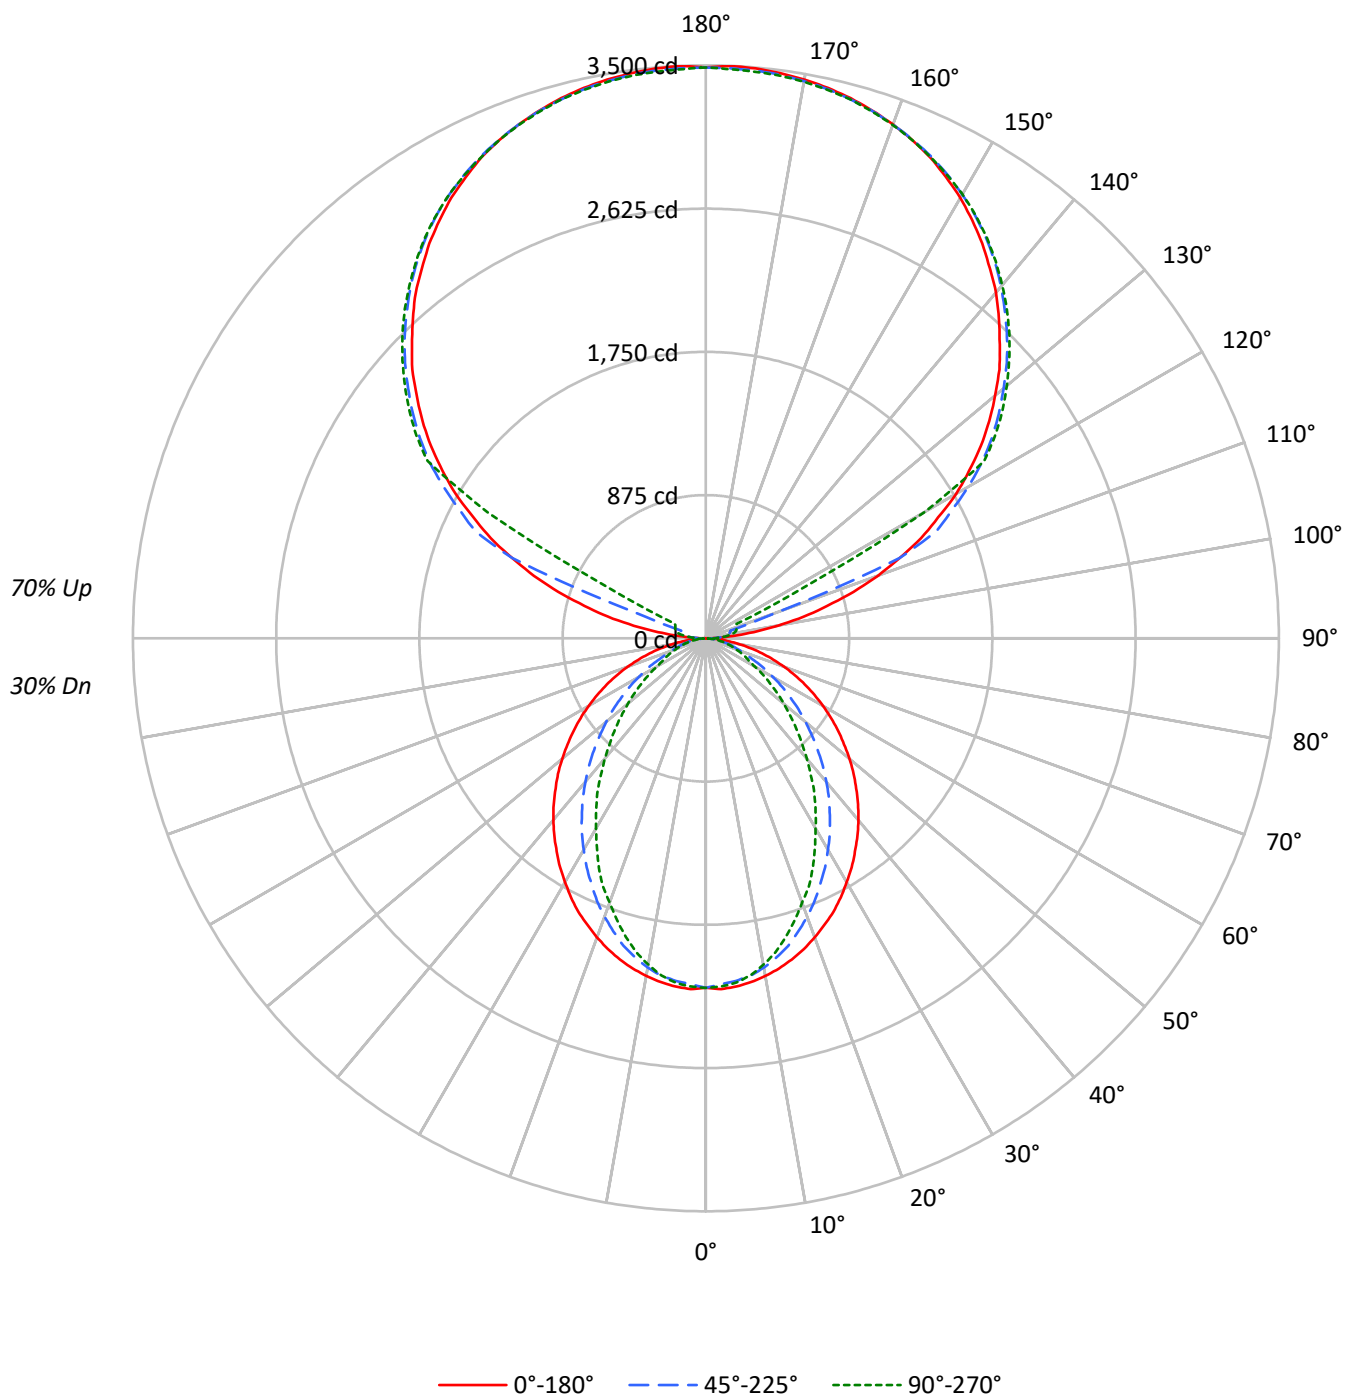

TEST NUMBER: P928922

CATALOG NUMBER: DFN2DIP-HX4F0-060D120US935-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	102	102	102	102	92	92	92	92	72	72	72	54	54	54	38	38	38
1	94	90	86	83	84	81	77	75	64	62	60	48	47	46	34	33	32
2	85	78	73	68	76	71	66	62	56	53	50	43	40	39	30	29	28
3	78	69	62	57	70	62	57	52	50	46	42	38	35	33	27	25	24
4	71	61	54	48	64	55	49	44	44	40	36	34	31	28	24	22	21
5	66	55	47	41	59	49	43	38	40	35	31	30	27	25	22	20	18
6	60	49	41	36	54	44	38	33	36	31	27	28	24	22	20	18	16
7	56	44	37	31	50	40	34	29	32	28	24	25	22	19	18	16	15
8	52	40	33	28	46	36	30	25	29	25	21	23	20	17	17	15	13
9	48	37	29	25	43	33	27	23	27	22	19	21	18	15	16	13	12
10	45	33	27	22	40	30	24	20	25	20	17	20	16	14	14	12	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1588	1588	1588
5°	1590	1563	1572
10°	1575	1532	1521
15°	1553	1482	1442
20°	1525	1412	1345
25°	1495	1334	1252
30°	1456	1254	1133
35°	1418	1168	1028
40°	1378	1078	909
45°	1333	980	800
50°	1286	880	694
55°	1237	773	592
60°	1180	661	488
65°	1115	548	439
70°	1035	442	397
75°	936	390	362
80°	792	327	314
85°	553	220	237

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1790 cd/sqm

TEST NUMBER: P928922

CATALOG NUMBER: DFN2DIP-HX4F0-060D120US935-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	200.1	1.4
10°-20°	549.3	3.8
20°-30°	771.2	5.3
30°-40°	840.7	5.8
40°-50°	772.7	5.3
50°-60°	606.8	4.2
60°-70°	395.0	2.7
70°-80°	203.3	1.4
80°-90°	58.0	0.4
90°-100°	115.0	0.8
100°-110°	428.6	2.9
110°-120°	1136.8	7.8
120°-130°	1885.4	12.9
130°-140°	2002.8	13.7
140°-150°	1861.3	12.7
150°-160°	1496.5	10.2
160°-170°	964.3	6.6
170°-180°	331.9	2.3
0°-30°	1520.7	10.4
0°-40°	2361.4	16.2
0°-60°	3740.9	25.6
0°-90°	4397.2	30.1
90°-120°	1680.4	11.5
90°-150°	7429.9	50.8
90°-180°	10223.0	69.9
0°-180°	14619.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2135	2135	2135	2135	2135	
5°	2135	2126	2100	2118	2112	202
15°	2031	2009	1944	1907	1888	572
25°	1843	1782	1654	1575	1546	848
35°	1588	1490	1320	1198	1155	994
45°	1298	1169	966	829	782	1003
55°	987	837	628	512	475	882
65°	667	510	336	271	265	661
75°	356	220	154	141	139	376
85°	83	42	37	37	37	95
90°	2	30	50	63	68	14
95°	164	81	98	111	108	194
105°	767	843	154	182	192	820
115°	1451	1494	1557	389	207	1428
125°	2051	2084	2132	2150	2157	1829
135°	2538	2579	2601	2627	2622	1961
145°	2945	2942	2985	3002	2990	1842
155°	3242	3220	3250	3265	3245	1494
165°	3416	3401	3409	3426	3409	965
175°	3494	3477	3482	3500	3474	333
180°	3487	3487	3487	3487	3487	

TEST NUMBER: P928922

CATALOG NUMBER: DFN2DIP-HX4F0-060D120US935-RLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2135.1	2135.1	2135.1	2135.1	2135.1
2.5°	2144.8	2135.1	2113.8	2133.2	2129.3
5°	2135.1	2125.5	2100.2	2117.7	2111.9
7.5°	2117.7	2106.2	2079.1	2086.7	2077.1
10°	2094.5	2081.0	2042.5	2036.5	2025.0
12.5°	2065.6	2048.1	1995.9	1984.4	1963.1
15°	2030.8	2009.4	1943.8	1907.1	1887.8
17.5°	1990.2	1959.2	1878.0	1835.6	1804.7
20°	1943.8	1905.0	1808.5	1760.3	1717.7
22.5°	1893.6	1849.1	1737.0	1671.4	1642.4
25°	1843.4	1781.5	1654.0	1574.9	1545.8
27.5°	1783.6	1717.7	1576.7	1485.8	1441.4
30°	1719.8	1646.1	1491.6	1393.2	1340.9
32.5°	1657.9	1568.9	1410.7	1294.6	1246.2
35°	1588.4	1489.8	1319.8	1198.0	1155.4
37.5°	1520.7	1414.3	1234.8	1101.3	1053.1
40°	1449.1	1333.3	1145.7	1008.6	958.4
42.5°	1375.8	1252.2	1057.0	913.9	865.7
45°	1298.5	1168.9	966.2	828.8	782.5
47.5°	1225.1	1088.0	879.3	741.9	699.5
50°	1143.9	1006.8	794.2	660.7	620.4
52.5°	1064.5	919.6	713.0	585.5	548.8
55°	987.3	836.6	627.9	512.1	475.4
57.5°	908.2	753.5	552.7	444.4	413.5
60°	827.0	672.4	473.4	375.0	344.0
62.5°	747.9	593.3	405.7	313.1	297.6
65°	666.7	510.1	336.2	270.6	264.7
67.5°	589.4	432.7	270.6	237.6	231.9
70°	508.2	357.5	224.0	204.8	197.0
72.5°	430.9	287.8	187.4	172.0	168.1
75°	355.5	220.2	154.5	141.0	139.2
77.5°	280.3	156.4	121.7	114.0	110.1
80°	210.5	112.1	92.6	85.1	85.1
82.5°	146.8	75.4	63.7	59.8	59.8
85°	83.0	42.4	36.7	36.7	36.7
87.5°	31.0	15.4	15.4	13.5	13.5
90°	2.4	30.2	50.4	63.2	68.0
92.5°	63.2	53.0	60.5	65.6	68.0
95°	163.8	80.6	98.2	111.2	108.5
97.5°	295.2	88.4	128.5	136.3	138.7
100°	446.7	101.0	143.8	163.8	169.0
102.5°	613.0	608.2	148.9	176.5	184.3
105°	767.0	842.8	154.0	181.6	191.7
107.5°	946.2	1009.1	159.1	186.7	196.8
110°	1117.8	1170.6	441.6	189.3	199.2

TEST NUMBER: P928922

CATALOG NUMBER: DFN2DIP-HX4F0-060D120US935-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1279.4	1324.6	1281.8	194.2	201.9
115°	1450.7	1493.6	1556.8	388.6	207.1
117.5°	1599.7	1650.0	1693.2	1332.1	671.1
120°	1766.3	1804.0	1849.5	1879.8	1539.1
122.5°	1907.4	1947.8	1998.5	2013.4	2016.1
125°	2051.2	2084.1	2132.1	2149.7	2157.2
127.5°	2182.4	2217.8	2255.8	2281.0	2283.4
130°	2306.1	2346.6	2374.1	2402.0	2399.6
132.5°	2432.2	2465.2	2492.8	2515.6	2513.2
135°	2538.3	2578.8	2601.3	2626.7	2621.7
137.5°	2649.2	2679.4	2704.9	2730.1	2722.6
140°	2757.7	2778.0	2805.6	2828.4	2815.8
142.5°	2848.7	2866.4	2899.1	2919.1	2906.6
145°	2944.6	2942.0	2984.7	3002.5	2989.8
147.5°	3027.6	3020.1	3063.0	3075.6	3065.7
150°	3108.5	3090.8	3131.3	3146.3	3133.7
152.5°	3176.5	3156.4	3194.2	3209.5	3191.8
155°	3242.1	3219.6	3249.9	3264.9	3244.9
157.5°	3295.1	3275.1	3297.9	3315.5	3295.1
160°	3340.7	3325.4	3340.7	3355.7	3338.0
162.5°	3380.9	3365.9	3378.5	3396.1	3373.4
165°	3416.2	3401.2	3408.7	3426.4	3408.7
167.5°	3444.1	3428.8	3436.6	3454.2	3431.5
170°	3466.8	3451.6	3456.7	3474.3	3451.6
172.5°	3481.8	3466.8	3472.0	3489.6	3466.8
175°	3494.4	3476.7	3481.8	3499.5	3474.3
177.5°	3499.5	3481.8	3484.6	3502.2	3479.5
180°	3487.0	3487.0	3487.0	3487.0	3487.0

TEST NUMBER: P928922

CATALOG NUMBER: DFN2DIP-HX4F0-060D120US935-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.53	7.22	7.65	8.33	9.86	2.51	3.20	3.62	4.30	5.83
	3H	8.20	8.82	9.32	9.93	11.48	3.69	4.30	4.81	5.42	6.97
	4H	8.80	9.39	9.94	10.50	12.06	4.13	4.72	5.26	5.83	7.39
	6H	9.22	9.76	10.36	10.88	12.44	4.45	4.98	5.59	6.10	7.67
	8H	9.34	9.85	10.49	10.99	12.54	4.53	5.05	5.68	6.18	7.74
	12H	9.40	9.88	10.55	11.01	12.59	4.57	5.06	5.72	6.19	7.77
4H	2H	6.53	7.12	7.67	8.24	9.79	3.08	3.67	4.23	4.79	6.34
	3H	8.35	8.84	9.50	9.98	11.55	4.42	4.91	5.57	6.05	7.62
	4H	9.04	9.49	10.19	10.62	12.20	4.97	5.42	6.12	6.55	8.13
	6H	9.55	9.93	10.70	11.08	12.66	5.38	5.76	6.54	6.92	8.49
	8H	9.72	10.08	10.87	11.22	12.82	5.51	5.87	6.66	7.01	8.60
	12H	9.81	10.13	10.98	11.29	12.89	5.57	5.89	6.74	7.05	8.65
8H	4H	9.00	9.35	10.15	10.50	12.09	5.24	5.60	6.39	6.74	8.33
	6H	9.56	9.85	10.73	11.04	12.63	5.75	6.05	6.93	7.24	8.83
	8H	9.78	10.03	10.96	11.20	12.81	5.94	6.20	7.12	7.37	8.98
	12H	9.91	10.13	11.09	11.30	12.94	6.06	6.29	7.24	7.45	9.09
12H	4H	8.94	9.27	10.11	10.42	12.02	5.24	5.56	6.41	6.72	8.31
	6H	9.53	9.79	10.71	10.96	12.57	5.80	6.06	6.98	7.23	8.84
	8H	9.75	9.97	10.93	11.14	12.78	6.01	6.23	7.19	7.40	9.04

END OF REPORT