

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P928936

Luminaire Tested: DFN2DIP-HX4F0-070D070US935-FLLONL

Issue Date: 12/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P928936
REPORT IS A COMBINATION OF REPORTS P900879 AND P896187
Test Lab: INNOVATION CENTER
Issue Date: 12/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-070D070US935-FLLONL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11933.5 lumens
Efficiency: N/A
Efficacy: 100.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 118.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P928936

CATALOG NUMBER: DFN2DIP-HX4F0-070D070US935-FLLONL

Luminous Intensity Polar Plot

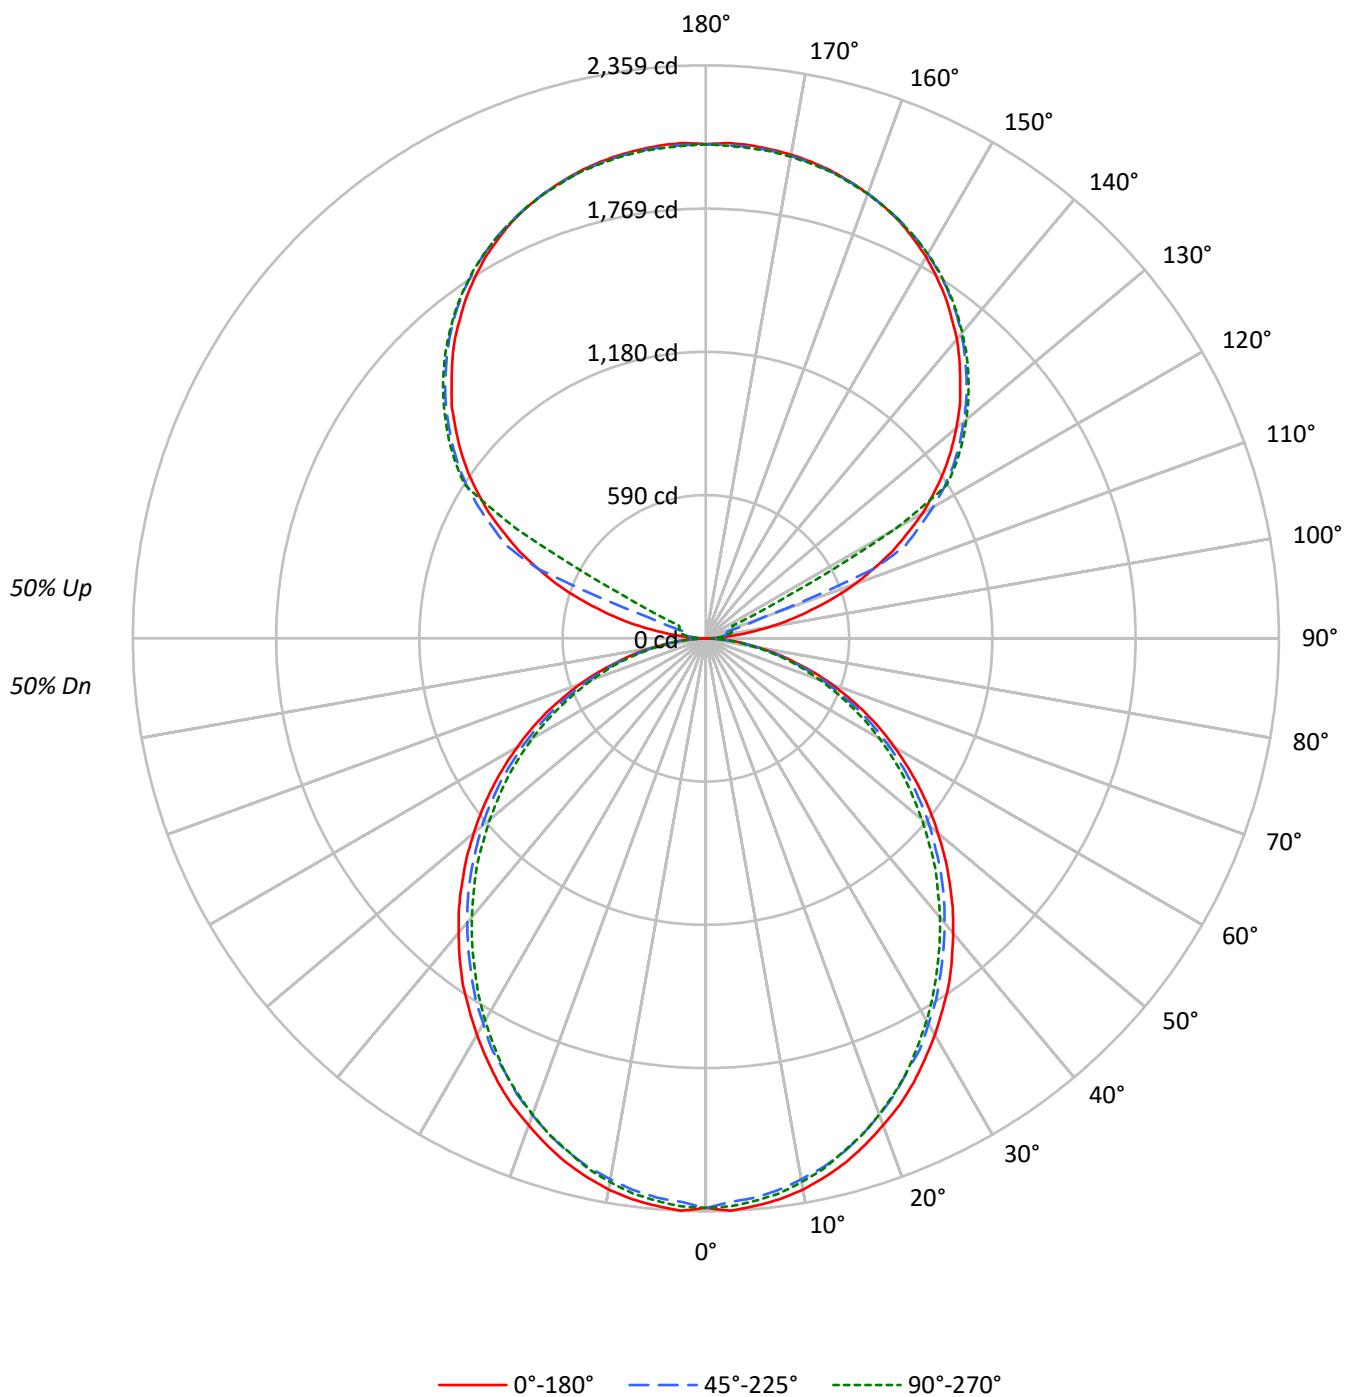

TEST NUMBER: P928936

CATALOG NUMBER: DFN2DIP-HX4F0-070D070US935-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1744	1744	1744
5°	1747	1720	1731
10°	1733	1697	1708
15°	1707	1669	1671
20°	1673	1630	1634
25°	1639	1584	1591
30°	1596	1541	1536
35°	1556	1490	1477
40°	1506	1439	1422
45°	1456	1388	1365
50°	1402	1334	1300
55°	1345	1271	1239
60°	1280	1197	1170
65°	1210	1121	1089
70°	1121	1027	1001
75°	997	915	920
80°	848	773	765
85°	616	527	510

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1456 cd/sqm

TEST NUMBER: P928936

CATALOG NUMBER: DFN2DIP-HX4F0-070D070US935-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	220.7	1.8
10°-20°	621.0	5.2
20°-30°	912.7	7.6
30°-40°	1060.0	8.9
40°-50°	1058.7	8.9
50°-60°	923.2	7.7
60°-70°	682.4	5.7
70°-80°	386.1	3.2
80°-90°	105.5	0.9
90°-100°	67.1	0.6
100°-110°	250.0	2.1
110°-120°	663.1	5.6
120°-130°	1099.8	9.2
130°-140°	1168.3	9.8
140°-150°	1085.8	9.1
150°-160°	872.9	7.3
160°-170°	562.5	4.7
170°-180°	193.6	1.6
0°-30°	1754.4	14.7
0°-40°	2814.5	23.6
0°-60°	4796.3	40.2
0°-90°	5970.3	50.0
90°-120°	980.3	8.2
90°-150°	4334.1	36.3
90°-180°	5963.0	50.0
0°-180°	11933.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2345	2345	2345	2345	2345	
5°	2345	2336	2311	2329	2325	223
15°	2232	2219	2190	2199	2188	629
25°	2020	2002	1964	1969	1964	930
35°	1743	1721	1684	1671	1660	1089
45°	1418	1403	1369	1344	1335	1095
55°	1074	1060	1033	1006	994	960
65°	724	710	688	668	656	716
75°	379	374	363	350	354	404
85°	92	90	88	81	79	103
90°	1	18	29	37	40	11
95°	96	47	57	65	63	113
105°	448	492	90	106	112	478
115°	846	871	908	227	121	833
125°	1196	1216	1244	1254	1258	1067
135°	1481	1504	1517	1532	1529	1144
145°	1718	1716	1741	1751	1744	1074
155°	1891	1878	1896	1904	1893	872
165°	1993	1984	1988	1999	1988	563
175°	2038	2028	2031	2041	2027	194
180°	2034	2034	2034	2034	2034	

TEST NUMBER: P928936

CATALOG NUMBER: DFN2DIP-HX4F0-070D070US935-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2345.1	2345.1	2345.1	2345.1	2345.1
2.5°	2358.8	2347.5	2322.6	2345.1	2340.8
5°	2345.1	2336.3	2311.4	2329.3	2325.0
7.5°	2329.3	2315.9	2291.0	2309.3	2304.7
10°	2304.7	2288.9	2261.8	2279.8	2273.1
12.5°	2270.7	2257.4	2230.3	2241.5	2237.0
15°	2232.5	2219.1	2189.6	2198.7	2187.5
17.5°	2185.0	2171.7	2142.3	2153.5	2142.3
20°	2133.1	2119.8	2088.2	2094.9	2086.0
22.5°	2081.5	2061.1	2031.7	2031.7	2027.1
25°	2020.5	2002.5	1964.3	1968.6	1964.3
27.5°	1952.7	1937.0	1907.8	1901.1	1889.8
30°	1885.3	1867.1	1833.4	1826.7	1817.6
32.5°	1813.0	1799.7	1763.5	1749.9	1740.8
35°	1743.2	1720.7	1684.5	1670.9	1659.7
37.5°	1664.2	1643.9	1607.7	1592.0	1580.7
40°	1583.1	1565.0	1528.8	1508.7	1499.6
42.5°	1504.2	1486.0	1450.1	1427.4	1413.9
45°	1418.5	1402.7	1368.7	1344.1	1335.0
47.5°	1335.0	1319.2	1283.1	1258.2	1244.8
50°	1247.0	1235.7	1204.1	1172.6	1161.3
52.5°	1161.3	1145.6	1116.4	1091.5	1075.6
55°	1073.5	1059.9	1032.9	1005.8	994.5
57.5°	985.5	974.2	944.8	917.7	908.7
60°	897.4	888.6	857.0	832.2	825.4
62.5°	811.8	796.0	773.5	751.1	741.9
65°	724.0	710.3	687.9	667.5	656.3
67.5°	633.8	622.3	602.2	586.4	577.3
70°	550.3	541.2	520.8	505.1	496.2
72.5°	464.6	455.6	444.3	428.5	421.8
75°	378.8	374.4	362.9	349.6	354.1
77.5°	302.2	293.1	288.5	281.8	275.2
80°	225.6	223.3	218.7	212.0	207.4
82.5°	153.3	153.3	151.2	142.2	142.2
85°	92.4	90.2	88.1	81.1	79.0
87.5°	40.6	36.2	31.6	24.9	22.5
90°	1.4	17.7	29.4	36.9	39.7
92.5°	36.9	30.9	35.3	38.3	39.7
95°	95.6	47.0	57.3	64.8	63.3
97.5°	172.1	51.6	75.0	79.6	80.9
100°	260.6	58.9	83.9	95.6	98.6
102.5°	357.6	354.8	86.9	103.0	107.5
105°	447.5	491.6	89.8	105.9	111.8
107.5°	551.9	588.7	92.8	108.9	114.9
110°	652.1	682.9	257.6	110.5	116.2

TEST NUMBER: P928936

CATALOG NUMBER: DFN2DIP-HX4F0-070D070US935-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	746.3	772.7	747.7	113.2	117.8
115°	846.3	871.2	908.1	226.7	120.8
117.5°	933.2	962.5	987.7	777.1	391.5
120°	1030.3	1052.3	1078.9	1096.6	897.9
122.5°	1112.6	1136.2	1165.8	1174.5	1176.0
125°	1196.5	1215.7	1243.7	1254.0	1258.4
127.5°	1273.1	1293.7	1315.9	1330.6	1332.0
130°	1345.2	1368.8	1384.9	1401.2	1399.8
132.5°	1418.8	1438.0	1454.1	1467.4	1466.0
135°	1480.7	1504.3	1517.4	1532.2	1529.3
137.5°	1545.3	1563.1	1577.9	1592.6	1588.2
140°	1608.6	1620.5	1636.6	1649.8	1642.5
142.5°	1661.7	1672.1	1691.1	1702.8	1695.5
145°	1717.7	1716.1	1741.1	1751.4	1744.1
147.5°	1766.1	1761.8	1786.7	1794.1	1788.3
150°	1813.3	1803.0	1826.6	1835.3	1828.0
152.5°	1853.0	1841.2	1863.3	1872.2	1861.9
155°	1891.3	1878.1	1895.7	1904.5	1892.8
157.5°	1922.2	1910.5	1923.7	1934.1	1922.2
160°	1948.8	1939.8	1948.8	1957.5	1947.2
162.5°	1972.2	1963.4	1970.7	1981.1	1967.8
165°	1992.8	1984.1	1988.4	1998.7	1988.4
167.5°	2009.1	2000.1	2004.7	2015.0	2001.7
170°	2022.3	2013.4	2016.4	2026.7	2013.4
172.5°	2031.1	2022.3	2025.3	2035.6	2022.3
175°	2038.4	2028.1	2031.1	2041.3	2026.7
177.5°	2041.3	2031.1	2032.6	2043.0	2029.6
180°	2034.0	2034.0	2034.0	2034.0	2034.0

TEST NUMBER: P928936

CATALOG NUMBER: DFN2DIP-HX4F0-070D070US935-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.21	10.07	10.16	11.04	12.31	8.78	9.64	9.73	10.61	11.88
	3H	10.87	11.64	11.84	12.62	13.92	10.40	11.17	11.36	12.15	13.44
	4H	11.46	12.19	12.44	13.17	14.48	10.98	11.71	11.97	12.70	14.00
	6H	11.86	12.53	12.85	13.52	14.84	11.38	12.06	12.37	13.05	14.36
	8H	11.96	12.60	12.96	13.61	14.92	11.49	12.13	12.49	13.14	14.45
	12H	12.01	12.62	13.02	13.62	14.96	11.53	12.14	12.53	13.14	14.48
4H	2H	9.67	10.40	10.66	11.39	12.69	9.33	10.06	10.31	11.04	12.34
	3H	11.54	12.15	12.53	13.16	14.48	11.14	11.75	12.14	12.77	14.08
	4H	12.25	12.81	13.26	13.82	15.16	11.85	12.40	12.85	13.41	14.75
	6H	12.77	13.25	13.79	14.28	15.62	12.36	12.84	13.38	13.87	15.21
	8H	12.92	13.37	13.94	14.39	15.74	12.51	12.96	13.52	13.98	15.33
	12H	12.99	13.40	14.03	14.44	15.79	12.57	12.98	13.61	14.02	15.37
8H	4H	12.45	12.90	13.47	13.92	15.27	12.09	12.54	13.11	13.56	14.91
	6H	13.08	13.45	14.12	14.52	15.87	12.72	13.09	13.76	14.16	15.50
	8H	13.30	13.63	14.35	14.68	16.05	12.93	13.26	13.98	14.31	15.68
	12H	13.44	13.72	14.49	14.77	16.18	13.05	13.34	14.11	14.39	15.80
12H	4H	12.44	12.84	13.47	13.88	15.24	12.08	12.49	13.12	13.53	14.88
	6H	13.11	13.44	14.16	14.49	15.86	12.76	13.09	13.81	14.14	15.51
	8H	13.36	13.64	14.41	14.69	16.10	13.00	13.29	14.05	14.33	15.74