

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919125

Luminaire Tested: DFN2DIP-HX4F0-070D120US935-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919125
REPORT IS A COMBINATION OF REPORTS P899450 AND P896188
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-070D120US935-RLLFLL
Description: 4 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14266.7 lumens
Efficiency: N/A
Efficacy: 102.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 139.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919125

CATALOG NUMBER: DFN2DIP-HX4F0-070D120US935-RLLFLL

Luminous Intensity Polar Plot

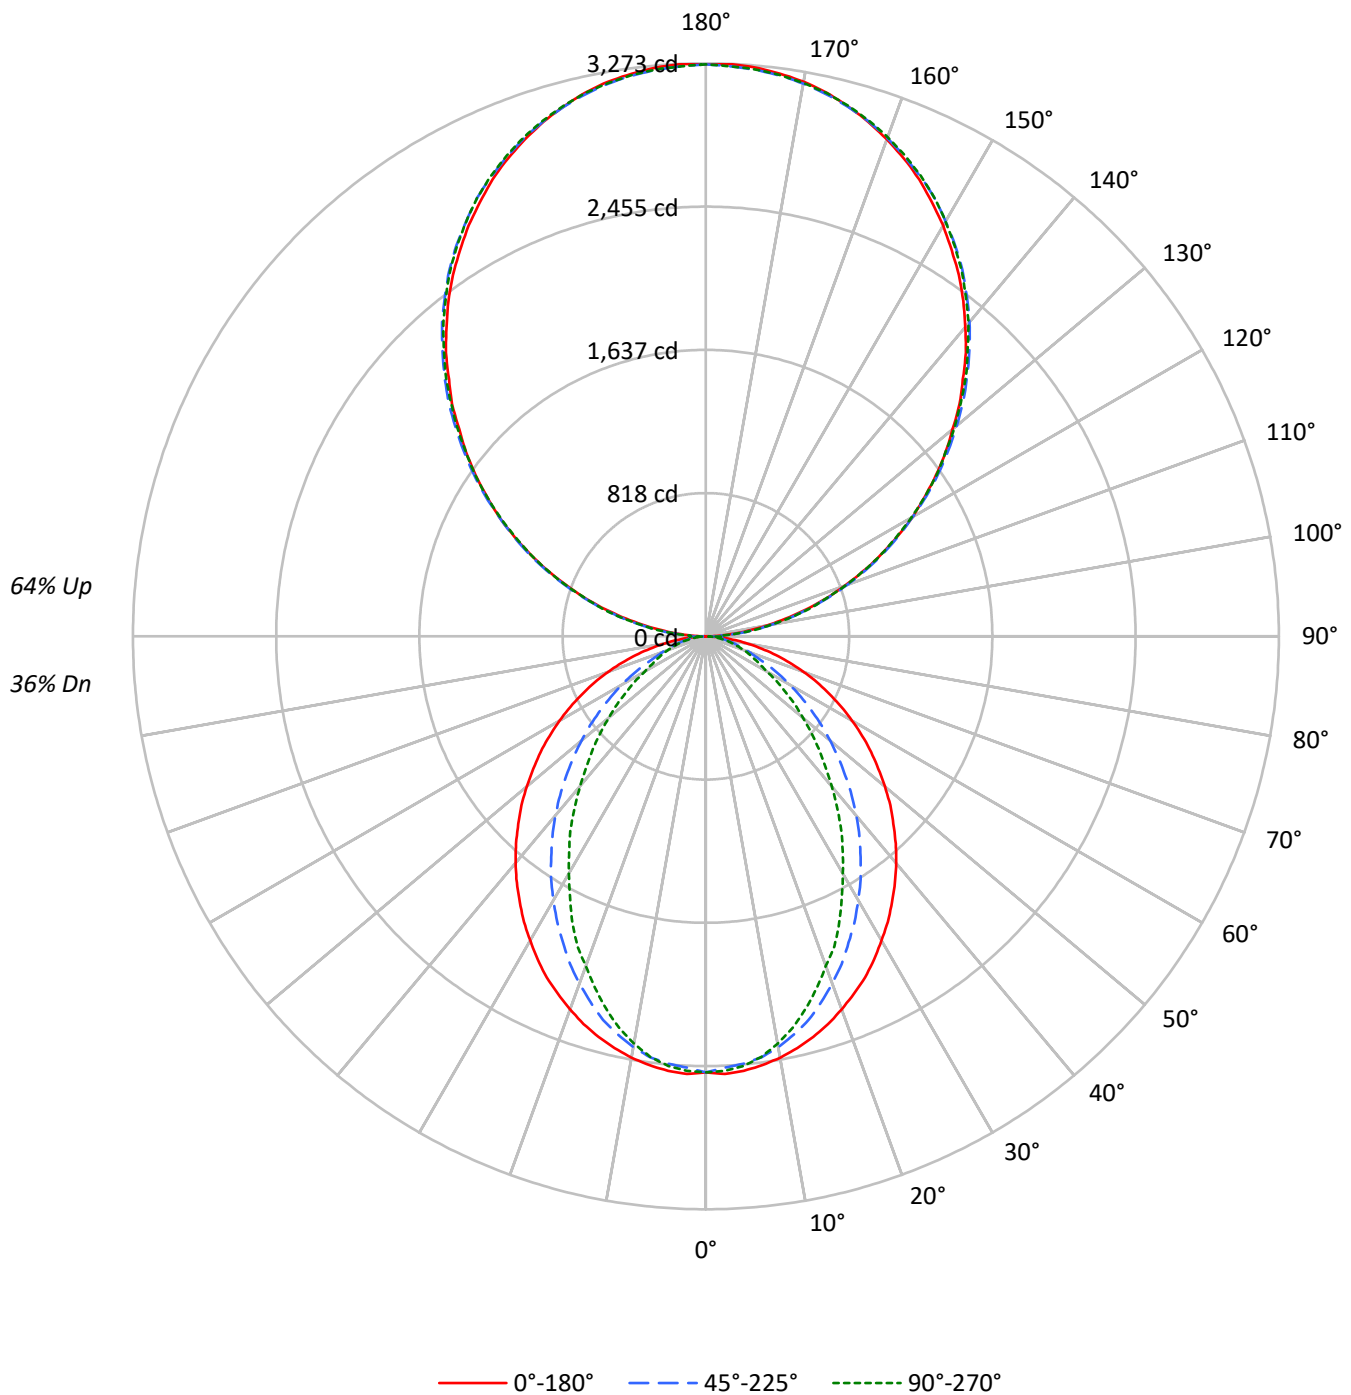

TEST NUMBER: P919125

CATALOG NUMBER: DFN2DIP-HX4F0-070D120US935-RLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	76	76	76	59	59	59	43	43	43
1	95	91	87	84	86	82	79	77	67	64	63	52	51	49	39	38	37
2	87	80	74	69	78	72	68	63	59	55	52	46	44	42	34	33	32
3	79	70	63	58	72	64	58	53	52	48	44	41	38	36	31	29	27
4	73	62	55	49	66	57	50	45	46	42	38	37	34	31	28	26	24
5	67	56	48	42	60	51	44	39	42	37	33	33	30	27	25	23	21
6	62	50	42	37	56	46	39	34	38	33	29	30	26	24	23	21	19
7	57	45	38	32	51	41	35	30	34	29	25	27	24	21	21	19	17
8	53	41	34	28	48	38	31	26	31	26	23	25	21	19	19	17	15
9	49	37	30	25	45	34	28	24	29	24	20	23	20	17	18	15	14
10	46	34	27	23	42	32	25	21	26	22	18	21	18	15	17	14	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1852	1852	1852
5°	1855	1823	1835
10°	1837	1787	1775
15°	1812	1728	1683
20°	1779	1647	1570
25°	1745	1556	1460
30°	1699	1463	1322
35°	1654	1362	1200
40°	1608	1258	1060
45°	1555	1143	934
50°	1500	1026	810
55°	1443	902	691
60°	1376	771	569
65°	1300	639	512
70°	1208	516	464
75°	1092	455	422
80°	924	382	367
85°	646	256	276

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2464 cd/sqm

TEST NUMBER: P919125

CATALOG NUMBER: DFN2DIP-HX4F0-070D120US935-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	233.5	1.6
10°-20°	640.9	4.5
20°-30°	899.8	6.3
30°-40°	980.8	6.9
40°-50°	901.5	6.3
50°-60°	708.0	5.0
60°-70°	460.8	3.2
70°-80°	237.2	1.7
80°-90°	69.8	0.5
90°-100°	202.2	1.4
100°-110°	642.4	4.5
110°-120°	1099.4	7.7
120°-130°	1445.9	10.1
130°-140°	1623.0	11.4
140°-150°	1591.6	11.2
150°-160°	1335.1	9.4
160°-170°	885.4	6.2
170°-180°	309.5	2.2
0°-30°	1774.1	12.4
0°-40°	2754.9	19.3
0°-60°	4364.3	30.6
0°-90°	5132.2	36.0
90°-120°	1944.1	13.6
90°-150°	6604.6	46.3
90°-180°	9134.0	64.0
0°-180°	14266.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2491	2491	2491	2491	2491	
5°	2491	2480	2450	2471	2464	236
15°	2369	2344	2268	2225	2202	668
25°	2151	2078	1930	1837	1803	989
35°	1853	1738	1540	1398	1348	1160
45°	1515	1364	1127	967	913	1170
55°	1152	976	732	597	555	1029
65°	778	595	392	316	309	771
75°	415	257	180	164	162	439
85°	97	50	43	43	43	111
90°	3	36	96	91	94	14
95°	144	171	176	176	171	160
105°	593	601	607	612	612	626
115°	1103	1119	1114	1111	1103	1091
125°	1605	1629	1622	1613	1610	1434
135°	2076	2106	2112	2109	2101	1604
145°	2520	2540	2555	2558	2548	1574
155°	2881	2889	2898	2912	2903	1326
165°	3135	3132	3132	3151	3138	884
175°	3262	3254	3248	3268	3251	310
180°	3268	3268	3268	3268	3268	

TEST NUMBER: P919125

CATALOG NUMBER: DFN2DIP-HX4F0-070D120US935-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2491.0	2491.0	2491.0	2491.0	2491.0
2.5°	2502.1	2491.0	2466.1	2488.8	2484.2
5°	2491.0	2479.7	2450.3	2470.6	2463.9
7.5°	2470.6	2457.2	2425.7	2434.5	2423.3
10°	2443.6	2427.8	2382.8	2375.9	2362.5
12.5°	2409.8	2389.5	2328.6	2315.1	2290.3
15°	2369.2	2344.3	2267.8	2225.0	2202.5
17.5°	2321.9	2285.8	2191.1	2141.5	2105.4
20°	2267.8	2222.6	2110.0	2053.7	2004.0
22.5°	2209.2	2157.3	2026.4	1949.9	1916.2
25°	2150.6	2078.4	1929.6	1837.3	1803.4
27.5°	2080.8	2004.0	1839.4	1733.5	1681.6
30°	2006.4	1920.5	1740.2	1625.4	1564.4
32.5°	1934.1	1830.4	1645.7	1510.4	1453.9
35°	1853.0	1738.0	1539.8	1397.7	1348.0
37.5°	1774.2	1650.0	1440.5	1284.8	1228.6
40°	1690.7	1555.6	1336.7	1176.7	1118.1
42.5°	1605.1	1460.9	1233.1	1066.2	1010.0
45°	1514.9	1363.7	1127.2	967.0	912.9
47.5°	1429.3	1269.3	1025.8	865.6	816.1
50°	1334.5	1174.6	926.5	770.9	723.8
52.5°	1242.0	1072.9	831.8	683.0	640.2
55°	1151.8	976.0	732.5	597.4	554.7
57.5°	1059.5	879.2	644.8	518.5	482.4
60°	964.8	784.5	552.2	437.5	401.3
62.5°	872.4	692.2	473.3	365.2	347.2
65°	777.7	595.0	392.3	315.7	308.8
67.5°	687.6	504.9	315.7	277.2	270.5
70°	592.9	417.1	261.4	238.9	229.8
72.5°	502.7	335.8	218.6	200.7	196.1
75°	414.7	256.8	180.3	164.5	162.4
77.5°	326.9	182.4	142.1	132.9	128.5
80°	245.6	130.8	108.1	99.3	99.3
82.5°	171.3	88.0	74.4	69.8	69.8
85°	96.9	49.5	42.8	42.8	42.8
87.5°	36.1	17.9	17.9	15.8	15.8
90°	2.9	35.5	96.5	90.7	93.6
92.5°	61.0	82.7	85.7	88.7	88.7
95°	143.8	171.4	176.3	176.3	171.4
97.5°	239.4	265.0	275.9	275.9	275.9
100°	349.7	372.4	380.2	380.2	377.3
102.5°	466.0	482.7	493.5	496.5	493.5
105°	593.1	600.9	606.8	611.7	611.7
107.5°	719.1	731.0	731.0	732.9	719.1
110°	841.3	857.0	857.0	857.0	849.2

TEST NUMBER: P919125

CATALOG NUMBER: DFN2DIP-HX4F0-070D120US935-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	973.3	990.1	987.0	979.2	973.3
115°	1103.3	1119.1	1114.1	1111.2	1103.3
117.5°	1232.3	1254.0	1240.3	1232.3	1224.5
120°	1362.4	1384.1	1362.4	1362.4	1353.6
122.5°	1480.7	1508.2	1494.4	1486.5	1480.7
125°	1604.7	1629.4	1621.5	1612.6	1609.6
127.5°	1726.0	1756.4	1745.6	1733.8	1726.0
130°	1839.2	1874.7	1869.7	1863.8	1853.0
132.5°	1966.3	1993.9	1995.8	1982.0	1974.2
135°	2075.6	2106.2	2112.1	2109.1	2101.3
137.5°	2197.8	2222.4	2227.3	2225.3	2213.5
140°	2305.1	2329.8	2343.6	2343.6	2332.7
142.5°	2415.5	2440.2	2448.0	2450.9	2440.2
145°	2519.9	2539.6	2555.4	2558.4	2547.5
147.5°	2613.5	2638.1	2650.0	2654.9	2644.0
150°	2710.1	2726.8	2737.6	2746.5	2737.6
152.5°	2795.7	2812.4	2826.3	2837.2	2826.3
155°	2881.4	2889.3	2898.2	2912.0	2903.1
157.5°	2955.4	2961.2	2966.1	2985.9	2972.1
160°	3021.3	3027.3	3030.2	3047.0	3035.1
162.5°	3082.4	3082.4	3085.4	3104.1	3090.3
165°	3134.6	3131.7	3131.7	3151.3	3137.6
167.5°	3181.9	3173.0	3173.0	3192.8	3179.0
170°	3217.4	3209.5	3206.5	3226.2	3209.5
172.5°	3242.0	3234.1	3231.2	3250.9	3234.1
175°	3261.7	3253.8	3247.9	3267.6	3250.9
177.5°	3272.6	3264.6	3258.7	3275.5	3258.7
180°	3267.6	3267.6	3267.6	3267.6	3267.6

TEST NUMBER: P919125

CATALOG NUMBER: DFN2DIP-HX4F0-070D120US935-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.82	8.54	8.89	9.62	11.08	3.79	4.52	4.86	5.59	7.05
	3H	9.49	10.14	10.57	11.22	12.70	4.97	5.62	6.06	6.70	8.18
	4H	10.09	10.71	11.19	11.79	13.27	5.42	6.04	6.51	7.12	8.60
	6H	10.51	11.08	11.61	12.16	13.66	5.74	6.30	6.84	7.39	8.89
	8H	10.63	11.17	11.74	12.27	13.76	5.82	6.36	6.93	7.46	8.96
	12H	10.69	11.20	11.80	12.30	13.81	5.87	6.38	6.98	7.47	8.99
4H	2H	7.82	8.44	8.92	9.52	11.01	4.37	4.99	5.47	6.07	7.56
	3H	9.64	10.16	10.75	11.27	12.76	5.72	6.23	6.82	7.34	8.83
	4H	10.33	10.80	11.44	11.90	13.42	6.26	6.73	7.37	7.83	9.35
	6H	10.84	11.25	11.96	12.37	13.88	6.68	7.08	7.80	8.20	9.71
	8H	11.02	11.39	12.14	12.51	14.03	6.80	7.18	7.92	8.29	9.82
	12H	11.11	11.45	12.24	12.57	14.11	6.87	7.21	8.00	8.33	9.86
8H	4H	10.29	10.67	11.41	11.78	13.31	6.53	6.91	7.65	8.02	9.55
	6H	10.86	11.17	12.00	12.32	13.85	7.05	7.36	8.19	8.52	10.04
	8H	11.07	11.34	12.22	12.48	14.02	7.24	7.51	8.39	8.65	10.19
	12H	11.21	11.45	12.36	12.58	14.16	7.36	7.60	8.51	8.73	10.31
12H	4H	10.24	10.58	11.38	11.71	13.24	6.53	6.87	7.67	8.00	9.53
	6H	10.83	11.10	11.98	12.24	13.78	7.10	7.37	8.25	8.51	10.05
	8H	11.05	11.29	12.20	12.42	14.00	7.31	7.55	8.46	8.68	10.26

END OF REPORT