

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P928984

Luminaire Tested: DFN2DIP-HX4F0-080D100US935-FLLONL

Issue Date: 12/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P928984
REPORT IS A COMBINATION OF REPORTS P900935 AND P896187
Test Lab: INNOVATION CENTER
Issue Date: 12/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-080D100US935-FLLONL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15343.0 lumens
Efficiency: N/A
Efficacy: 100.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 152.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9613
Total Harmonic Distortion (THDi): 0.083
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P928984

CATALOG NUMBER: DFN2DIP-HX4F0-080D100US935-FLLONL

Luminous Intensity Polar Plot

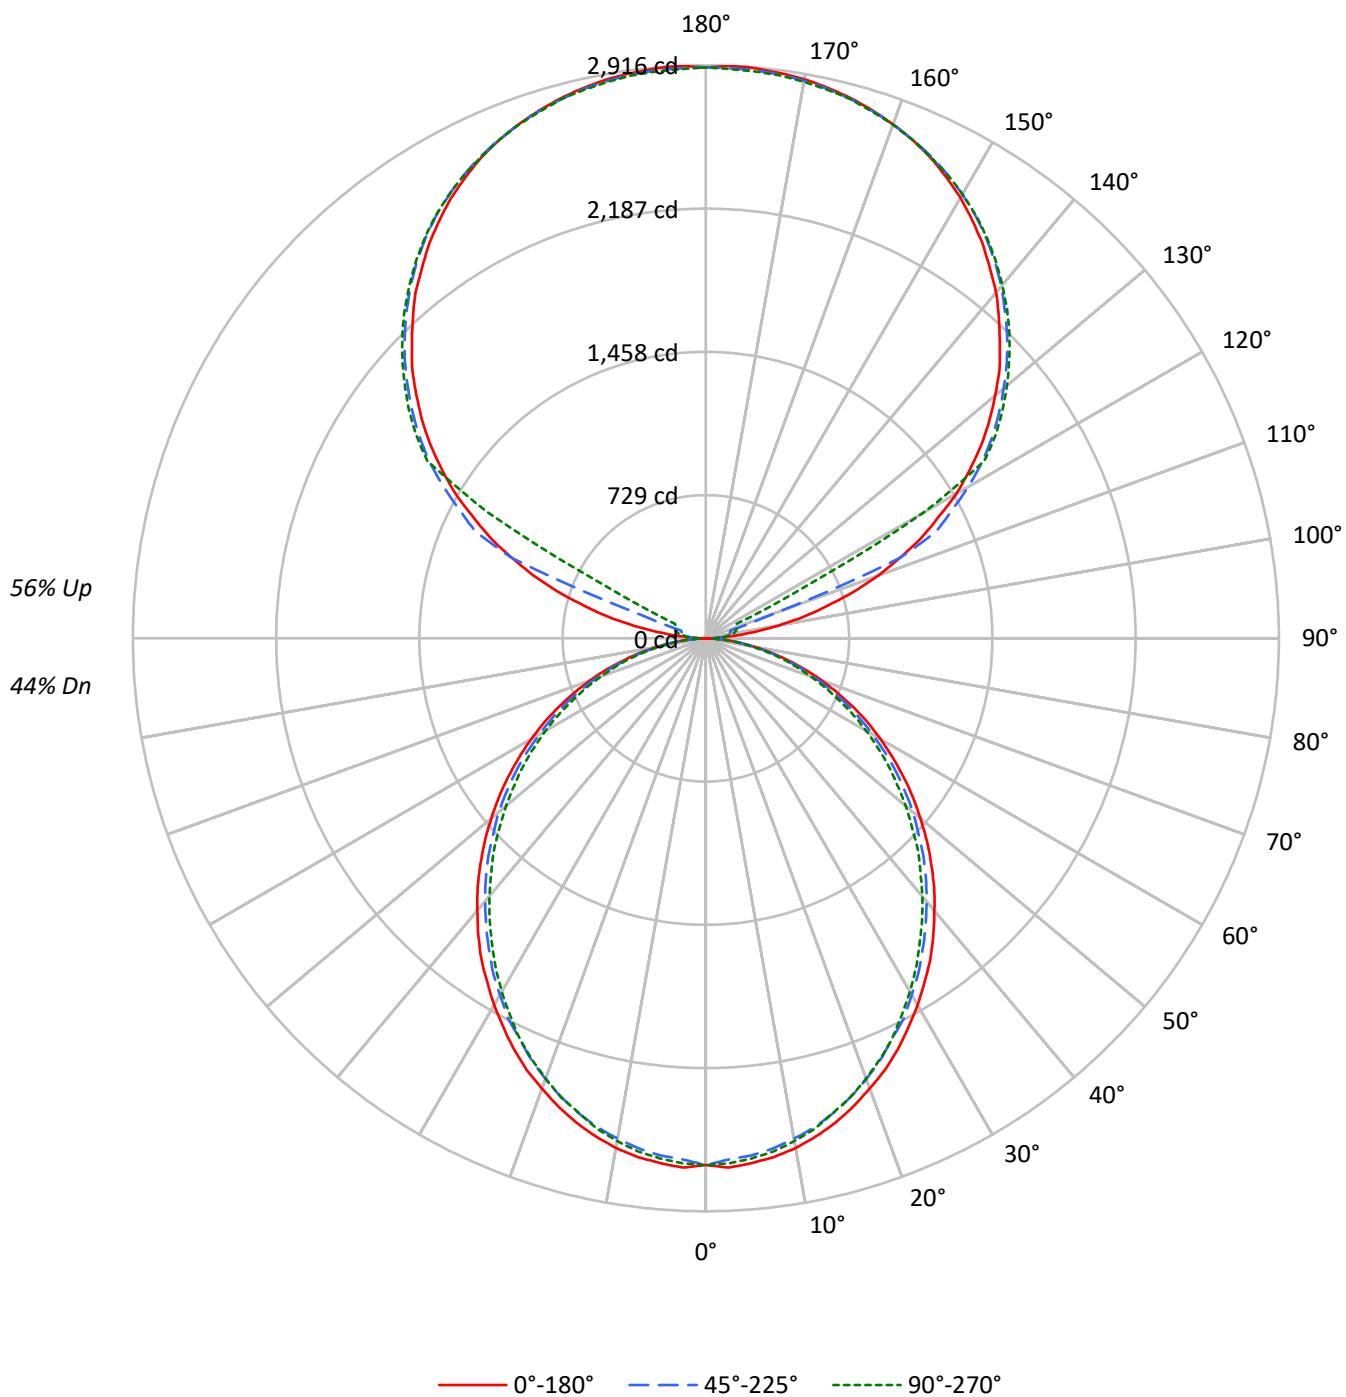

TEST NUMBER: P928984

CATALOG NUMBER: DFN2DIP-HX4F0-080D100US935-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	65	65	65	51	51	51
1	97	92	88	85	88	85	81	78	70	68	66	57	56	54	45	44	43
2	88	81	74	69	80	74	69	64	62	58	55	50	48	45	40	38	36
3	80	71	64	58	73	65	59	54	54	50	46	44	41	38	35	33	31
4	73	63	55	49	67	58	51	46	48	43	39	40	36	33	31	29	27
5	67	56	48	42	61	51	44	39	43	38	34	35	31	28	28	25	23
6	62	50	42	36	57	46	39	34	39	33	29	32	28	25	26	23	20
7	57	45	37	32	52	42	35	30	35	30	26	29	25	22	23	20	18
8	53	41	33	28	49	38	31	26	32	27	23	27	23	20	22	19	16
9	49	37	30	25	45	35	28	23	29	24	20	25	20	18	20	17	15
10	46	34	27	22	42	32	25	21	27	22	18	23	19	16	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1993	1993	1993
5°	1996	1965	1978
10°	1980	1939	1952
15°	1951	1907	1910
20°	1912	1863	1867
25°	1873	1810	1818
30°	1824	1761	1755
35°	1778	1703	1688
40°	1721	1645	1625
45°	1664	1586	1560
50°	1602	1524	1485
55°	1537	1453	1416
60°	1463	1368	1337
65°	1383	1281	1244
70°	1281	1174	1144
75°	1139	1046	1052
80°	970	883	875
85°	704	602	582

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1664 cd/sqm

TEST NUMBER: P928984

CATALOG NUMBER: DFN2DIP-HX4F0-080D100US935-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	252.3	1.6
10°-20°	709.8	4.6
20°-30°	1043.1	6.8
30°-40°	1211.4	7.9
40°-50°	1210.0	7.9
50°-60°	1055.0	6.9
60°-70°	779.9	5.1
70°-80°	441.2	2.9
80°-90°	121.6	0.8
90°-100°	95.8	0.6
100°-110°	357.2	2.3
110°-120°	947.3	6.2
120°-130°	1571.2	10.2
130°-140°	1669.0	10.9
140°-150°	1551.1	10.1
150°-160°	1247.1	8.1
160°-170°	803.6	5.2
170°-180°	276.6	1.8
0°-30°	2005.1	13.1
0°-40°	3216.5	21.0
0°-60°	5481.5	35.7
0°-90°	6824.2	44.5
90°-120°	1400.3	9.1
90°-150°	6191.6	40.4
90°-180°	8519.0	55.5
0°-180°	15343.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2680	2680	2680	2680	2680	
5°	2680	2670	2642	2662	2657	254
15°	2551	2536	2502	2513	2500	719
25°	2309	2289	2245	2250	2245	1063
35°	1992	1966	1925	1910	1897	1244
45°	1621	1603	1564	1536	1526	1251
55°	1227	1211	1180	1150	1137	1097
65°	827	812	786	763	750	818
75°	433	428	415	400	405	462
85°	106	103	101	93	90	118
90°	2	25	42	53	57	14
95°	137	67	82	93	90	162
105°	639	702	128	151	160	683
115°	1209	1245	1297	324	172	1190
125°	1709	1737	1777	1792	1798	1525
135°	2115	2149	2168	2189	2185	1634
145°	2454	2452	2487	2502	2492	1535
155°	2702	2683	2708	2721	2704	1245
165°	2847	2834	2841	2855	2841	804
175°	2912	2897	2902	2916	2895	277
180°	2906	2906	2906	2906	2906	

TEST NUMBER: P928984

CATALOG NUMBER: DFN2DIP-HX4F0-080D100US935-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2680.1	2680.1	2680.1	2680.1	2680.1
2.5°	2695.7	2682.9	2654.5	2680.1	2675.2
5°	2680.1	2670.0	2641.6	2662.1	2657.2
7.5°	2662.1	2646.8	2618.4	2639.1	2634.0
10°	2634.0	2615.9	2585.0	2605.5	2597.9
12.5°	2595.1	2579.8	2548.9	2561.7	2556.6
15°	2551.4	2536.1	2502.4	2512.8	2500.0
17.5°	2497.2	2481.9	2448.3	2461.2	2448.3
20°	2437.9	2422.6	2386.5	2394.2	2384.0
22.5°	2378.9	2355.6	2321.9	2321.9	2316.8
25°	2309.1	2288.6	2244.9	2249.8	2244.9
27.5°	2231.7	2213.7	2180.3	2172.6	2159.8
30°	2154.7	2133.8	2095.3	2087.7	2077.2
32.5°	2072.1	2056.8	2015.4	1999.8	1989.5
35°	1992.2	1966.5	1925.2	1909.6	1896.8
37.5°	1901.9	1878.7	1837.5	1819.4	1806.6
40°	1809.3	1788.5	1747.2	1724.2	1713.8
42.5°	1719.1	1698.2	1657.3	1631.3	1616.0
45°	1621.2	1603.1	1564.3	1536.1	1525.8
47.5°	1525.8	1507.7	1466.4	1438.0	1422.6
50°	1425.1	1412.3	1376.1	1340.1	1327.2
52.5°	1327.2	1309.2	1275.8	1247.4	1229.3
55°	1226.8	1211.3	1180.4	1149.5	1136.6
57.5°	1126.3	1113.4	1079.8	1048.9	1038.5
60°	1025.6	1015.5	979.4	951.0	943.3
62.5°	927.7	909.7	884.0	858.3	847.9
65°	827.4	811.8	786.1	762.8	750.0
67.5°	724.3	711.2	688.2	670.2	659.8
70°	628.9	618.5	595.3	577.2	567.1
72.5°	531.0	520.6	507.7	489.7	482.1
75°	432.8	427.9	414.8	399.5	404.7
77.5°	345.3	334.9	329.8	322.1	314.4
80°	257.9	255.1	249.9	242.3	237.0
82.5°	175.3	175.3	172.8	162.4	162.4
85°	105.6	103.1	100.7	92.7	90.2
87.5°	46.5	41.3	36.1	28.4	25.7
90°	2.0	25.2	41.9	52.7	56.7
92.5°	52.7	44.2	50.5	54.7	56.7
95°	136.6	67.2	81.9	92.6	90.4
97.5°	245.9	73.6	107.1	113.6	115.6
100°	372.3	84.1	119.9	136.6	140.9
102.5°	510.8	506.9	124.1	147.1	153.5
105°	639.2	702.3	128.4	151.3	159.8
107.5°	788.5	840.9	132.6	155.6	164.0
110°	931.5	975.5	368.0	157.8	166.0

TEST NUMBER: P928984

CATALOG NUMBER: DFN2DIP-HX4F0-080D100US935-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1066.1	1103.8	1068.2	161.8	168.3
115°	1208.9	1244.7	1297.4	323.8	172.5
117.5°	1333.0	1375.0	1410.9	1110.1	559.3
120°	1471.9	1503.3	1541.3	1566.5	1282.6
122.5°	1589.5	1623.2	1665.3	1677.8	1680.1
125°	1709.3	1736.8	1776.8	1791.5	1797.7
127.5°	1818.7	1848.1	1879.8	1900.8	1902.8
130°	1921.8	1955.5	1978.5	2001.7	1999.7
132.5°	2026.9	2054.3	2077.3	2096.3	2094.3
135°	2115.3	2149.0	2167.7	2188.9	2184.7
137.5°	2207.7	2232.9	2254.1	2275.1	2268.8
140°	2298.0	2315.1	2338.0	2357.0	2346.5
142.5°	2373.9	2388.7	2415.9	2432.6	2422.2
145°	2453.8	2451.6	2487.3	2502.1	2491.6
147.5°	2523.0	2516.8	2552.4	2562.9	2554.8
150°	2590.4	2575.7	2609.4	2621.9	2611.4
152.5°	2647.1	2630.4	2661.9	2674.5	2659.8
155°	2701.8	2683.0	2708.3	2720.8	2704.1
157.5°	2746.0	2729.3	2748.2	2762.9	2746.0
160°	2784.0	2771.2	2784.0	2796.4	2781.7
162.5°	2817.4	2804.9	2815.4	2830.1	2811.2
165°	2846.8	2834.3	2840.6	2855.3	2840.6
167.5°	2870.1	2857.3	2863.9	2878.6	2859.6
170°	2889.0	2876.3	2880.6	2895.3	2876.3
172.5°	2901.5	2889.0	2893.3	2908.0	2889.0
175°	2912.0	2897.3	2901.5	2916.3	2895.3
177.5°	2916.3	2901.5	2903.8	2918.5	2899.5
180°	2905.8	2905.8	2905.8	2905.8	2905.8

TEST NUMBER: P928984

CATALOG NUMBER: DFN2DIP-HX4F0-080D100US935-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.14	9.95	10.14	10.96	12.31	8.70	9.52	9.71	10.53	11.88
	3H	10.79	11.52	11.81	12.55	13.91	10.32	11.05	11.33	12.07	13.44
	4H	11.38	12.07	12.41	13.10	14.47	10.91	11.60	11.93	12.62	14.00
	6H	11.78	12.41	12.81	13.44	14.83	11.30	11.94	12.34	12.97	14.36
	8H	11.88	12.49	12.92	13.53	14.92	11.41	12.01	12.45	13.06	14.44
	12H	11.93	12.50	12.98	13.54	14.95	11.45	12.02	12.49	13.06	14.47
4H	2H	9.59	10.28	10.62	11.31	12.68	9.25	9.94	10.28	10.96	12.34
	3H	11.45	12.03	12.50	13.09	14.47	11.06	11.64	12.10	12.69	14.08
	4H	12.17	12.70	13.22	13.74	15.15	11.76	12.29	12.81	13.34	14.75
	6H	12.68	13.14	13.74	14.20	15.61	12.27	12.73	13.33	13.79	15.20
	8H	12.83	13.25	13.89	14.32	15.74	12.42	12.84	13.48	13.90	15.33
	12H	12.90	13.29	13.98	14.36	15.79	12.48	12.86	13.56	13.94	15.37
8H	4H	12.36	12.79	13.42	13.85	15.27	12.00	12.43	13.06	13.49	14.91
	6H	12.99	13.34	14.07	14.45	15.87	12.63	12.98	13.71	14.08	15.50
	8H	13.21	13.52	14.30	14.61	16.05	12.84	13.15	13.93	14.24	15.68
	12H	13.34	13.61	14.44	14.70	16.18	12.96	13.23	14.05	14.31	15.79
12H	4H	12.35	12.73	13.42	13.80	15.23	11.99	12.38	13.07	13.45	14.88
	6H	13.02	13.33	14.11	14.42	15.86	12.67	12.98	13.76	14.06	15.50
	8H	13.26	13.53	14.36	14.62	16.09	12.91	13.18	14.00	14.26	15.74

END OF REPORT