

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919144

Luminaire Tested: DFN2DIP-HX4F0-090D040US935-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919144
REPORT IS A COMBINATION OF REPORTS P899309 AND P896188
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-090D040US935-FLLFLL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10719.5 lumens
Efficiency: N/A
Efficacy: 95.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 112.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9821
Total Harmonic Distortion (THDi): 0.08
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919144

CATALOG NUMBER: DFN2DIP-HX4F0-090D040US935-FLLFLL

Luminous Intensity Polar Plot

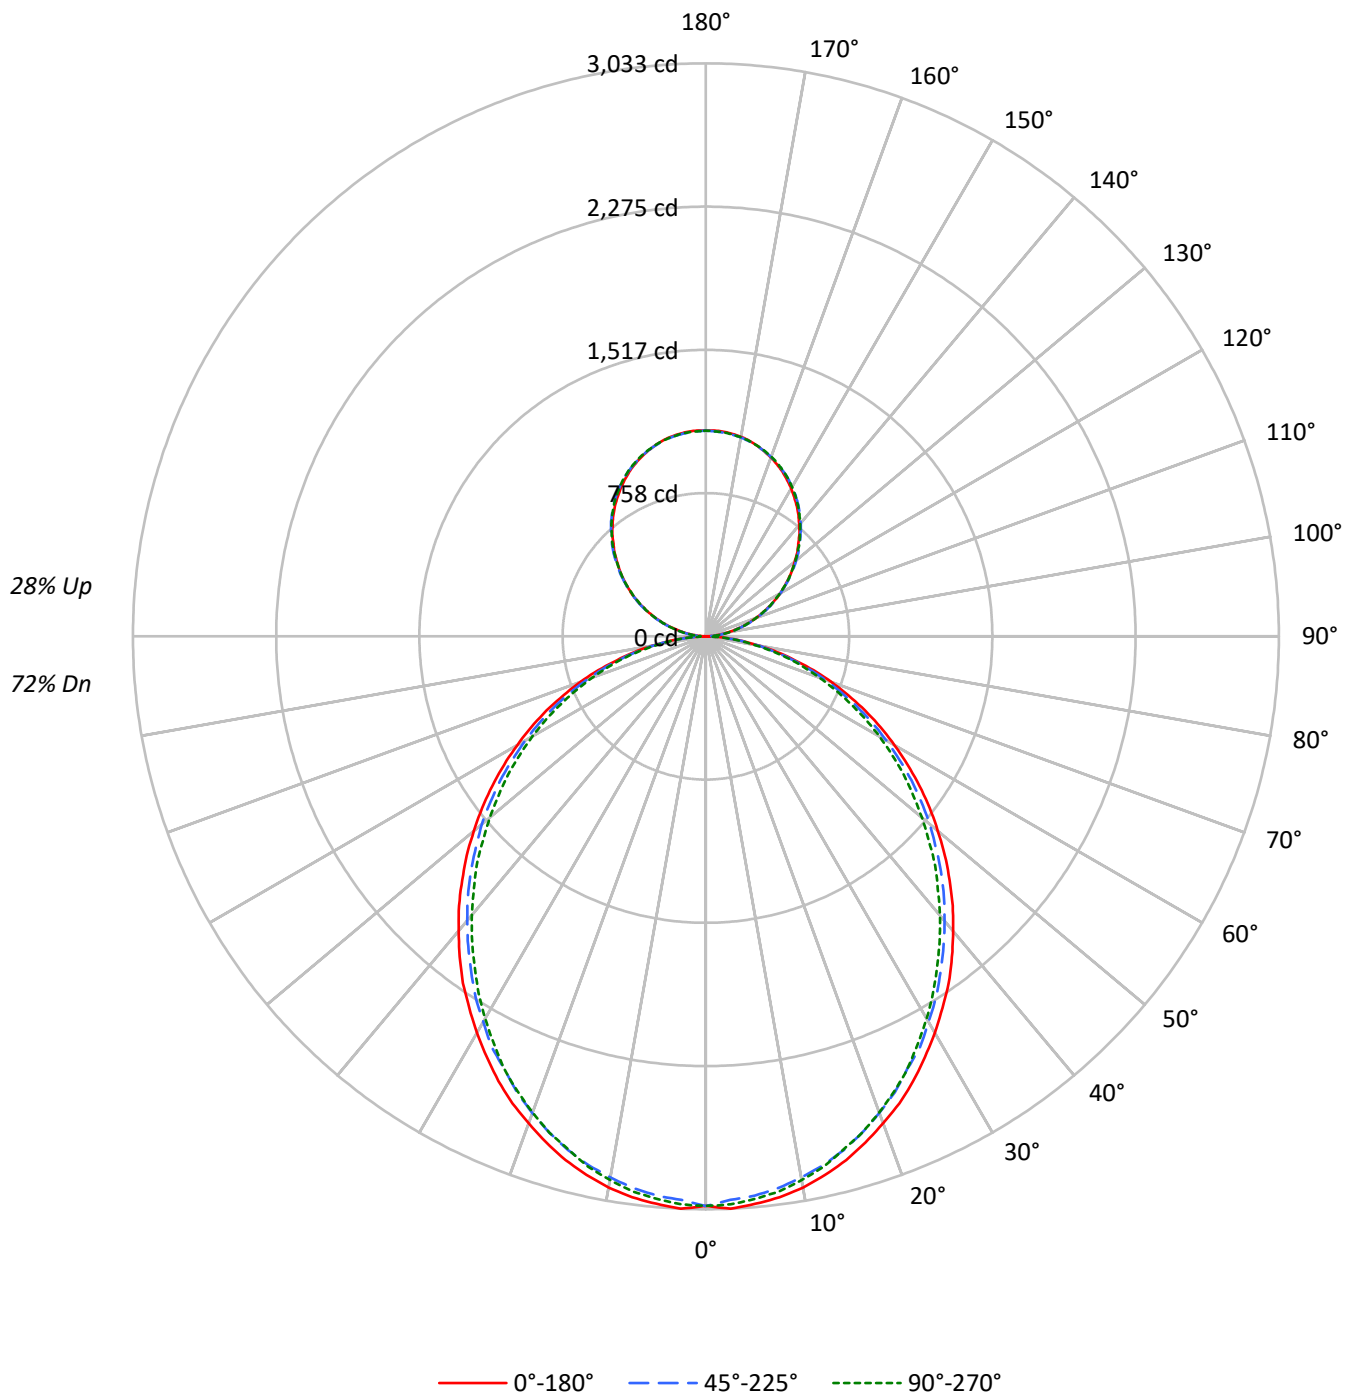

TEST NUMBER: P919144

CATALOG NUMBER: DFN2DIP-HX4F0-090D040US935-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	106	106	106	106	95	95	95	85	85	85	76	76	76
1	103	98	94	91	97	93	90	86	84	81	79	75	73	71	67	66	64
2	93	86	79	74	88	81	76	71	73	69	65	66	63	59	59	56	54
3	85	75	68	62	81	72	65	59	65	59	55	58	54	50	52	49	46
4	78	67	59	52	74	64	56	51	58	52	47	52	47	43	47	43	40
5	72	60	51	45	68	57	49	44	52	45	41	47	42	38	42	38	35
6	66	54	45	39	63	51	44	38	47	40	35	42	37	33	38	34	31
7	61	49	40	35	58	47	39	34	42	36	31	39	33	29	35	31	27
8	57	44	36	31	54	42	35	30	39	33	28	35	30	26	32	28	24
9	53	41	33	28	50	39	32	27	36	30	25	33	27	24	30	25	22
10	50	37	30	25	47	36	29	24	33	27	23	30	25	21	28	23	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2242	2242	2242
5°	2246	2211	2226
10°	2228	2181	2196
15°	2195	2146	2149
20°	2151	2096	2101
25°	2107	2037	2045
30°	2052	1981	1974
35°	2000	1916	1899
40°	1936	1850	1828
45°	1872	1784	1755
50°	1802	1715	1671
55°	1729	1634	1594
60°	1646	1539	1505
65°	1556	1441	1400
70°	1441	1321	1287
75°	1282	1177	1183
80°	1091	994	984
85°	791	677	655

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1872 cd/sqm

TEST NUMBER: P919144

CATALOG NUMBER: DFN2DIP-HX4F0-090D040US935-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	283.8	2.6
10°-20°	798.5	7.4
20°-30°	1173.4	10.9
30°-40°	1362.9	12.7
40°-50°	1361.2	12.7
50°-60°	1186.9	11.1
60°-70°	877.4	8.2
70°-80°	496.4	4.6
80°-90°	134.1	1.3
90°-100°	67.4	0.6
100°-110°	214.2	2.0
110°-120°	366.5	3.4
120°-130°	482.0	4.5
130°-140°	541.0	5.0
140°-150°	530.5	4.9
150°-160°	445.0	4.2
160°-170°	295.1	2.8
170°-180°	103.2	1.0
0°-30°	2255.7	21.0
0°-40°	3618.6	33.8
0°-60°	6166.7	57.5
0°-90°	7674.6	71.6
90°-120°	648.0	6.0
90°-150°	2201.5	20.5
90°-180°	3045.0	28.4
0°-180°	10719.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3015	3015	3015	3015	3015	
5°	3015	3004	2972	2995	2989	286
15°	2870	2853	2815	2827	2812	808
25°	2598	2575	2526	2531	2526	1195
35°	2241	2212	2166	2148	2134	1400
45°	1824	1804	1760	1728	1716	1408
55°	1380	1363	1328	1293	1279	1234
65°	931	913	884	858	844	920
75°	487	481	467	449	455	520
85°	119	116	113	104	102	132
90°	1	12	32	30	31	10
95°	48	57	59	59	57	53
105°	198	200	202	204	204	209
115°	368	373	371	370	368	364
125°	535	543	540	538	537	478
135°	692	702	704	703	700	535
145°	840	846	852	853	849	525
155°	960	963	966	971	968	442
165°	1045	1044	1044	1050	1046	295
175°	1087	1085	1083	1089	1084	103
180°	1089	1089	1089	1089	1089	

TEST NUMBER: P919144

CATALOG NUMBER: DFN2DIP-HX4F0-090D040US935-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3015.1	3015.1	3015.1	3015.1	3015.1
2.5°	3032.7	3018.2	2986.3	3015.1	3009.6
5°	3015.1	3003.8	2971.8	2994.9	2989.3
7.5°	2994.9	2977.7	2945.6	2969.1	2963.2
10°	2963.2	2942.9	2908.1	2931.2	2922.6
12.5°	2919.5	2902.3	2867.6	2881.9	2876.2
15°	2870.3	2853.1	2815.2	2826.9	2812.4
17.5°	2809.3	2792.1	2754.3	2768.8	2754.3
20°	2742.6	2725.4	2684.8	2693.4	2682.0
22.5°	2676.2	2650.1	2612.2	2612.2	2606.3
25°	2597.7	2574.6	2525.5	2531.0	2525.5
27.5°	2510.7	2490.4	2452.9	2444.3	2429.8
30°	2424.0	2400.5	2357.2	2348.5	2336.9
32.5°	2331.1	2313.8	2267.4	2249.9	2238.2
35°	2241.3	2212.3	2165.8	2148.4	2133.9
37.5°	2139.8	2113.6	2067.1	2046.9	2032.4
40°	2035.4	2012.1	1965.6	1939.7	1928.1
42.5°	1933.9	1910.6	1864.4	1835.2	1818.0
45°	1823.8	1803.5	1759.8	1728.1	1716.5
47.5°	1716.5	1696.2	1649.7	1617.7	1600.5
50°	1603.3	1588.8	1548.2	1507.6	1493.1
52.5°	1493.1	1472.8	1435.3	1403.3	1383.0
55°	1380.3	1362.7	1327.9	1293.2	1278.8
57.5°	1267.0	1252.6	1214.8	1180.0	1168.3
60°	1153.8	1142.5	1101.8	1069.9	1061.3
62.5°	1043.7	1023.4	994.5	965.6	953.9
65°	930.8	913.3	884.3	858.2	843.8
67.5°	814.8	800.1	774.2	754.0	742.3
70°	707.5	695.8	669.7	649.4	638.0
72.5°	597.4	585.7	571.2	551.0	542.3
75°	487.0	481.4	466.7	449.4	455.3
77.5°	388.5	376.9	371.0	362.4	353.8
80°	290.1	287.0	281.1	272.5	266.7
82.5°	197.2	197.2	194.4	182.7	182.7
85°	118.7	116.0	113.2	104.3	101.5
87.5°	52.3	46.4	40.6	32.0	28.9
90°	0.9	11.8	32.2	30.2	31.2
92.5°	20.3	27.6	28.6	29.5	29.5
95°	48.0	57.2	58.8	58.8	57.2
97.5°	79.8	88.3	92.0	92.0	92.0
100°	116.6	124.2	126.7	126.7	125.8
102.5°	155.3	160.9	164.5	165.5	164.5
105°	197.7	200.3	202.2	203.9	203.9
107.5°	239.7	243.7	243.7	244.3	239.7
110°	280.4	285.7	285.7	285.7	283.1

TEST NUMBER: P919144

CATALOG NUMBER: DFN2DIP-HX4F0-090D040US935-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	324.4	330.0	329.0	326.4	324.4
115°	367.7	373.1	371.3	370.4	367.7
117.5°	410.8	418.0	413.5	410.8	408.2
120°	454.2	461.3	454.2	454.2	451.2
122.5°	493.5	502.7	498.2	495.5	493.5
125°	534.9	543.1	540.5	537.5	536.6
127.5°	575.3	585.5	581.9	577.9	575.3
130°	613.0	624.9	623.3	621.3	617.7
132.5°	655.4	664.6	665.3	660.6	658.1
135°	691.9	702.1	704.0	703.0	700.4
137.5°	732.6	740.8	742.4	741.7	737.9
140°	768.4	776.6	781.2	781.2	777.6
142.5°	805.2	813.4	816.0	817.0	813.4
145°	840.0	846.5	851.8	852.8	849.2
147.5°	871.2	879.3	883.3	884.9	881.3
150°	903.4	909.0	912.6	915.5	912.6
152.5°	931.9	937.5	942.1	945.7	942.1
155°	960.4	963.1	966.0	970.7	967.7
157.5°	985.2	987.0	988.7	995.3	990.7
160°	1007.1	1009.1	1010.0	1015.6	1011.7
162.5°	1027.4	1027.4	1028.5	1034.7	1030.1
165°	1044.9	1043.9	1043.9	1050.4	1045.9
167.5°	1060.7	1057.6	1057.6	1064.3	1059.6
170°	1072.5	1069.8	1068.8	1075.4	1069.8
172.5°	1080.6	1078.1	1077.0	1083.7	1078.1
175°	1087.3	1084.6	1082.6	1089.2	1083.7
177.5°	1090.9	1088.2	1086.2	1091.8	1086.2
180°	1089.2	1089.2	1089.2	1089.2	1089.2

TEST NUMBER: P919144

CATALOG NUMBER: DFN2DIP-HX4F0-090D040US935-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.87	12.96	12.61	13.73	14.66	11.44	12.53	12.18	13.30	14.23
	3H	13.55	14.53	14.31	15.31	16.27	13.07	14.06	13.83	14.84	15.79
	4H	14.14	15.07	14.92	15.86	16.83	13.67	14.60	14.45	15.39	16.36
	6H	14.56	15.42	15.35	16.21	17.19	14.08	14.94	14.87	15.74	16.72
	8H	14.67	15.49	15.47	16.30	17.29	14.19	15.01	14.99	15.83	16.81
	12H	14.73	15.51	15.53	16.31	17.32	14.24	15.02	15.05	15.83	16.84
4H	2H	12.36	13.29	13.14	14.07	15.04	12.01	12.94	12.79	13.73	14.70
	3H	14.25	15.02	15.04	15.84	16.83	13.85	14.63	14.65	15.45	16.44
	4H	14.97	15.68	15.78	16.50	17.51	14.56	15.27	15.37	16.09	17.10
	6H	15.50	16.11	16.33	16.96	17.98	15.09	15.70	15.92	16.55	17.57
	8H	15.66	16.23	16.48	17.07	18.10	15.24	15.81	16.07	16.66	17.69
	12H	15.74	16.26	16.59	17.12	18.15	15.32	15.83	16.17	16.70	17.73
8H	4H	15.19	15.76	16.02	16.60	17.63	14.83	15.40	15.66	16.24	17.27
	6H	15.83	16.30	16.69	17.19	18.22	15.47	15.94	16.32	16.82	17.85
	8H	16.05	16.47	16.92	17.35	18.40	15.68	16.10	16.55	16.98	18.03
	12H	16.20	16.57	17.07	17.44	18.54	15.81	16.18	16.68	17.05	18.15
12H	4H	15.18	15.70	16.03	16.56	17.60	14.83	15.35	15.68	16.21	17.24
	6H	15.86	16.28	16.73	17.16	18.21	15.51	15.93	16.38	16.81	17.86
	8H	16.12	16.49	16.99	17.36	18.46	15.76	16.13	16.63	17.00	18.10