

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P929002

Luminaire Tested: DFN2DIP-HX4F0-090D050US935-RLLONL

Issue Date: 12/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P929002
REPORT IS A COMBINATION OF REPORTS P900848 AND P896187
Test Lab: INNOVATION CENTER
Issue Date: 12/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-090D050US935-RLLONL
Description: 4 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10848.7 lumens
Efficiency: N/A
Efficacy: 85.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 126.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9821
Total Harmonic Distortion (THDi): 0.08
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P929002

CATALOG NUMBER: DFN2DIP-HX4F0-090D050US935-RLLONL

Luminous Intensity Polar Plot

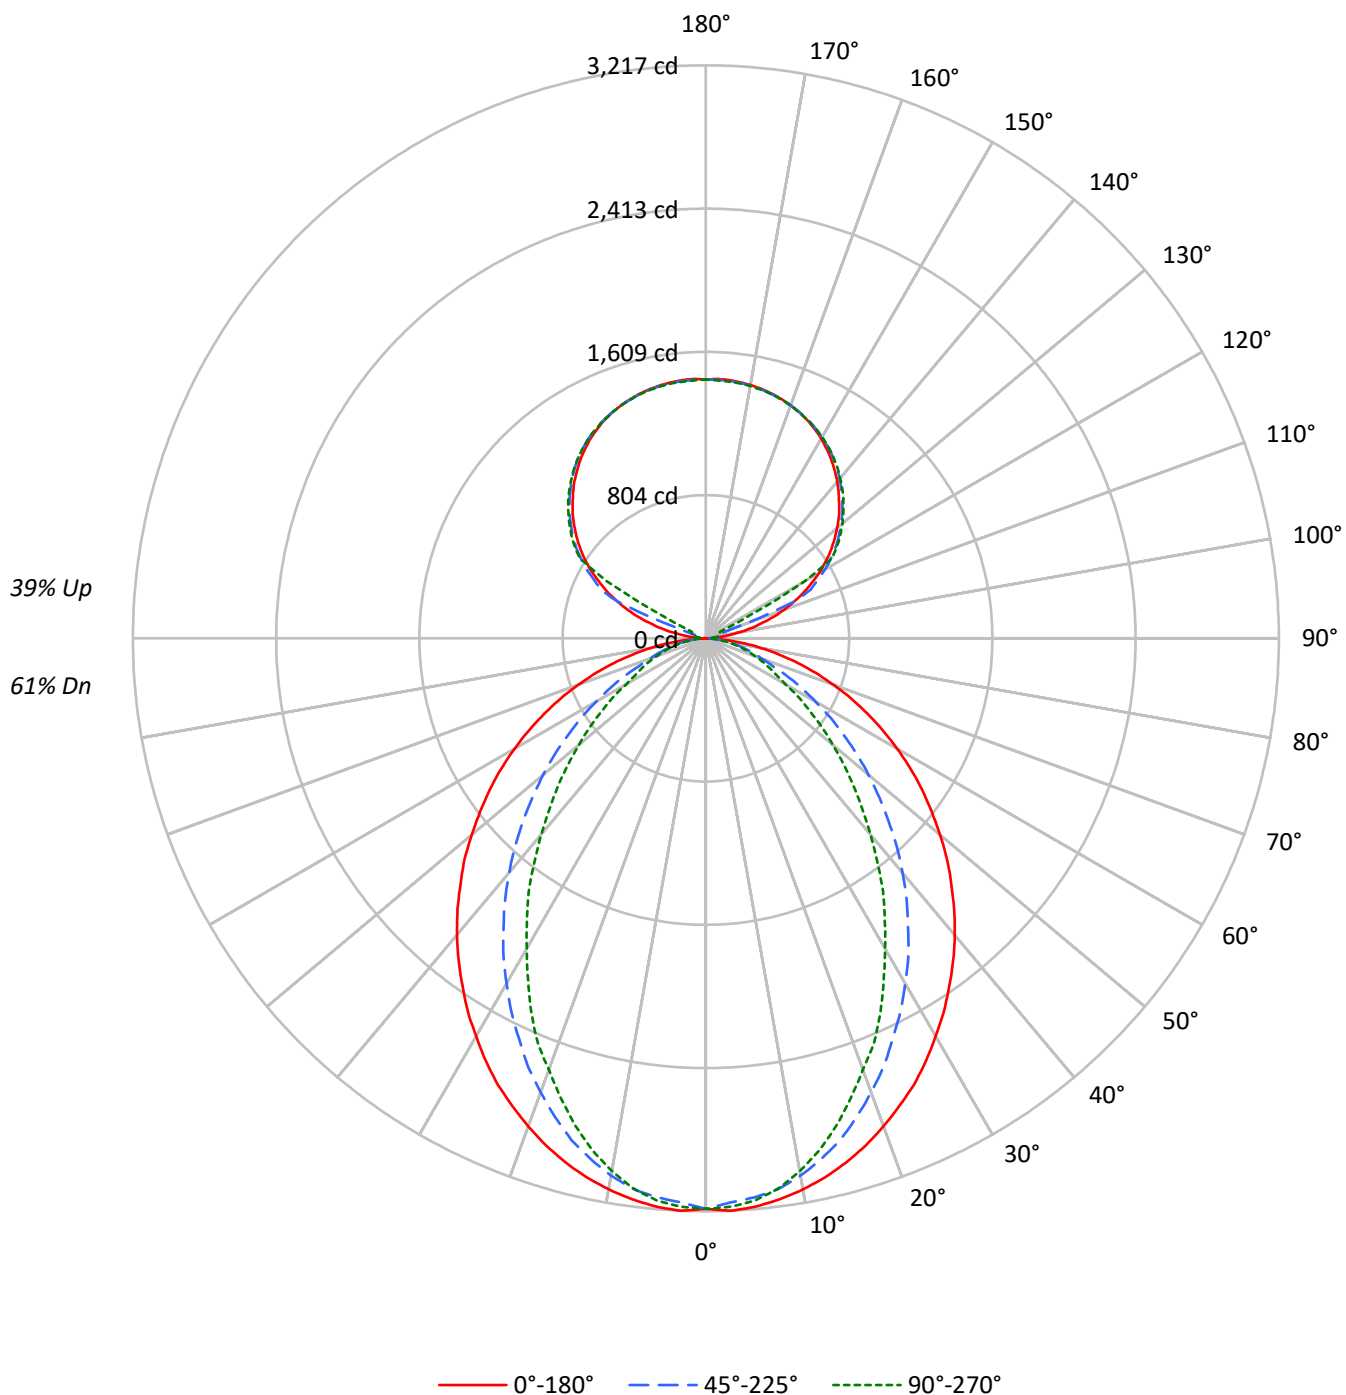

TEST NUMBER: P929002

CATALOG NUMBER: DFN2DIP-HX4F0-090D050US935-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	89	89	89	77	77	77	66	66	66
1	101	97	93	90	94	91	87	84	79	77	75	69	67	65	59	58	57
2	92	85	79	74	86	80	75	70	70	66	63	61	58	56	53	51	49
3	85	75	68	62	79	71	65	59	62	58	53	55	51	48	47	45	42
4	78	67	59	53	73	63	56	51	56	50	46	49	45	41	43	40	37
5	72	60	52	46	67	57	50	44	50	45	40	44	40	36	39	35	33
6	66	54	46	41	62	51	44	39	46	40	35	40	36	32	35	32	29
7	61	49	41	36	57	47	39	34	42	36	32	37	32	29	33	29	26
8	57	45	37	32	53	43	36	31	38	32	28	34	29	26	30	26	23
9	53	41	34	29	50	39	32	28	35	30	26	31	27	23	28	24	21
10	50	38	31	26	47	36	30	25	33	27	23	29	25	21	26	22	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2381	2381	2381
5°	2385	2344	2359
10°	2362	2298	2282
15°	2330	2222	2164
20°	2287	2118	2018
25°	2243	2001	1878
30°	2184	1881	1699
35°	2126	1751	1543
40°	2068	1618	1363
45°	1999	1469	1200
50°	1929	1319	1041
55°	1855	1159	889
60°	1770	992	732
65°	1672	822	659
70°	1553	663	596
75°	1404	585	543
80°	1188	491	471
85°	830	329	355

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1999 cd/sqm

TEST NUMBER: P929002

CATALOG NUMBER: DFN2DIP-HX4F0-090D050US935-RLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	300.2	2.8
10°-20°	824.0	7.6
20°-30°	1156.9	10.7
30°-40°	1261.0	11.6
40°-50°	1159.0	10.7
50°-60°	910.3	8.4
60°-70°	592.5	5.5
70°-80°	305.0	2.8
80°-90°	80.4	0.7
90°-100°	47.9	0.4
100°-110°	178.6	1.6
110°-120°	473.7	4.4
120°-130°	785.6	7.2
130°-140°	834.5	7.7
140°-150°	775.6	7.1
150°-160°	623.5	5.7
160°-170°	401.8	3.7
170°-180°	138.3	1.3
0°-30°	2281.0	21.0
0°-40°	3542.1	32.6
0°-60°	5611.3	51.7
0°-90°	6589.2	60.7
90°-120°	700.2	6.5
90°-150°	3095.8	28.5
90°-180°	4259.0	39.3
0°-180°	10848.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3203	3203	3203	3203	3203	
5°	3203	3188	3150	3176	3168	304
15°	3046	3014	2916	2861	2832	858
25°	2765	2672	2481	2362	2319	1272
35°	2383	2235	1980	1797	1733	1491
45°	1948	1753	1449	1243	1174	1504
55°	1481	1255	942	768	713	1323
65°	1000	765	504	406	397	991
75°	533	330	232	212	209	564
85°	124	64	55	55	55	143
90°	1	13	21	26	28	10
95°	68	34	41	46	45	81
105°	320	351	64	76	80	342
115°	604	622	649	162	86	595
125°	855	868	888	896	899	762
135°	1058	1074	1084	1094	1092	817
145°	1227	1226	1244	1251	1246	767
155°	1351	1342	1354	1360	1352	623
165°	1423	1417	1420	1428	1420	402
175°	1456	1449	1451	1458	1448	139
180°	1453	1453	1453	1453	1453	

TEST NUMBER: P929002

CATALOG NUMBER: DFN2DIP-HX4F0-090D050US935-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3202.7	3202.7	3202.7	3202.7	3202.7
2.5°	3217.1	3202.7	3170.6	3199.9	3194.1
5°	3202.7	3188.2	3150.4	3176.5	3167.9
7.5°	3176.5	3159.3	3118.7	3130.1	3115.6
10°	3141.8	3121.5	3063.7	3054.7	3037.5
12.5°	3098.4	3072.3	2993.9	2976.6	2944.6
15°	3046.1	3014.2	2915.8	2860.7	2831.8
17.5°	2985.3	2938.9	2817.0	2753.4	2707.0
20°	2915.8	2857.7	2712.8	2640.5	2576.5
22.5°	2840.4	2773.7	2605.5	2507.1	2463.8
25°	2765.1	2672.2	2481.0	2362.2	2318.6
27.5°	2675.3	2576.5	2365.0	2228.8	2162.1
30°	2579.6	2469.3	2237.4	2089.8	2011.4
32.5°	2486.7	2353.3	2115.9	1941.9	1869.3
35°	2382.6	2234.6	1979.7	1797.1	1733.1
37.5°	2281.0	2121.5	1852.1	1651.9	1579.7
40°	2173.8	2000.0	1718.6	1512.9	1437.6
42.5°	2063.6	1878.3	1585.4	1370.9	1298.6
45°	1947.8	1753.4	1449.2	1243.2	1173.7
47.5°	1837.6	1631.9	1318.9	1112.8	1049.2
50°	1715.9	1510.1	1191.3	991.1	930.5
52.5°	1596.9	1379.5	1069.5	878.2	823.2
55°	1480.9	1254.9	941.8	768.2	713.1
57.5°	1362.3	1130.4	829.1	666.7	620.3
60°	1240.4	1008.6	710.1	562.4	516.0
62.5°	1121.8	889.9	608.6	469.6	446.5
65°	1000.0	765.1	504.3	405.9	397.0
67.5°	884.1	649.1	405.9	356.4	347.8
70°	762.3	536.3	336.1	307.2	295.5
72.5°	646.4	431.7	281.0	258.0	252.2
75°	533.2	330.3	231.9	211.5	208.8
77.5°	420.3	234.6	182.6	171.0	165.1
80°	315.8	168.2	139.0	127.6	127.6
82.5°	220.2	113.1	95.7	89.8	89.8
85°	124.5	63.6	55.0	55.0	55.0
87.5°	46.4	23.1	23.1	20.3	20.3
90°	1.0	12.6	21.0	26.3	28.3
92.5°	26.3	22.1	25.2	27.4	28.3
95°	68.3	33.6	41.0	46.3	45.2
97.5°	123.0	36.9	53.6	56.8	57.8
100°	186.1	42.1	59.9	68.3	70.4
102.5°	255.5	253.4	62.1	73.5	76.8
105°	319.6	351.2	64.1	75.7	79.9
107.5°	394.3	420.4	66.3	77.7	82.1
110°	465.8	487.8	184.0	78.9	83.0

TEST NUMBER: P929002

CATALOG NUMBER: DFN2DIP-HX4F0-090D050US935-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	533.0	551.9	534.1	80.9	84.1
115°	604.5	622.3	648.7	162.0	86.3
117.5°	666.5	687.5	705.5	555.0	279.7
120°	735.9	751.7	770.6	783.3	641.3
122.5°	794.7	811.6	832.7	839.0	840.1
125°	854.6	868.4	888.4	895.7	898.9
127.5°	909.3	924.0	940.0	950.4	951.4
130°	960.9	977.8	989.2	1000.8	999.9
132.5°	1013.5	1027.2	1038.6	1048.2	1047.1
135°	1057.7	1074.5	1083.8	1094.5	1092.4
137.5°	1103.8	1116.5	1127.0	1137.6	1134.5
140°	1149.0	1157.5	1169.0	1178.5	1173.3
142.5°	1187.0	1194.4	1208.0	1216.3	1211.1
145°	1226.9	1225.8	1243.6	1251.0	1245.8
147.5°	1261.5	1258.4	1276.3	1281.5	1277.4
150°	1295.2	1287.9	1304.7	1311.0	1305.7
152.5°	1323.5	1315.2	1330.9	1337.3	1329.9
155°	1350.9	1341.5	1354.1	1360.4	1352.0
157.5°	1373.0	1364.6	1374.1	1381.5	1373.0
160°	1392.0	1385.6	1392.0	1398.2	1390.9
162.5°	1408.7	1402.5	1407.6	1415.1	1405.6
165°	1423.4	1417.2	1420.3	1427.6	1420.3
167.5°	1435.0	1428.7	1431.9	1439.2	1429.8
170°	1444.5	1438.1	1440.3	1447.6	1438.1
172.5°	1450.8	1444.5	1446.7	1454.0	1444.5
175°	1456.0	1448.6	1450.8	1458.1	1447.6
177.5°	1458.1	1450.8	1451.9	1459.2	1449.8
180°	1452.9	1452.9	1452.9	1452.9	1452.9

TEST NUMBER: P929002

CATALOG NUMBER: DFN2DIP-HX4F0-090D050US935-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.11	12.04	11.98	12.92	14.03	7.08	8.01	7.95	8.89	10.00
	3H	12.80	13.62	13.68	14.52	15.66	8.28	9.11	9.16	10.00	11.14
	4H	13.41	14.19	14.30	15.09	16.24	8.74	9.52	9.63	10.42	11.57
	6H	13.84	14.56	14.74	15.46	16.62	9.06	9.78	9.97	10.69	11.85
	8H	13.97	14.65	14.88	15.57	16.73	9.16	9.84	10.07	10.77	11.93
	12H	14.03	14.68	14.95	15.60	16.78	9.21	9.86	10.13	10.77	11.96
4H	2H	11.14	11.92	12.04	12.82	13.97	7.69	8.47	8.59	9.37	10.52
	3H	12.98	13.63	13.89	14.56	15.72	9.05	9.70	9.96	10.63	11.79
	4H	13.68	14.27	14.60	15.19	16.38	9.60	10.20	10.53	11.12	12.31
	6H	14.20	14.71	15.13	15.66	16.85	10.03	10.54	10.97	11.49	12.68
	8H	14.38	14.85	15.31	15.79	17.00	10.16	10.64	11.10	11.58	12.78
	12H	14.48	14.90	15.43	15.86	17.07	10.23	10.66	11.19	11.62	12.83
8H	4H	13.65	14.13	14.59	15.07	16.27	9.89	10.37	10.83	11.31	12.51
	6H	14.22	14.61	15.19	15.60	16.80	10.42	10.81	11.38	11.79	13.00
	8H	14.44	14.79	15.41	15.76	16.98	10.61	10.96	11.58	11.93	13.15
	12H	14.58	14.89	15.56	15.86	17.13	10.73	11.04	11.71	12.01	13.28
12H	4H	13.61	14.04	14.56	15.00	16.21	9.90	10.33	10.86	11.29	12.50
	6H	14.20	14.55	15.17	15.52	16.74	10.47	10.81	11.44	11.79	13.01
	8H	14.42	14.73	15.40	15.70	16.97	10.68	10.99	11.66	11.96	13.23

END OF REPORT