

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P929006

Luminaire Tested: DFN2DIP-HX4F0-090D060US935-RLLONL

Issue Date: 12/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P929006
REPORT IS A COMBINATION OF REPORTS P900866 AND P896187
Test Lab: INNOVATION CENTER
Issue Date: 12/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-090D060US935-RLLONL
Description: 4 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11701.0 lumens
Efficiency: N/A
Efficacy: 88.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 132.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9821
Total Harmonic Distortion (THDi): 0.08
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P929006

CATALOG NUMBER: DFN2DIP-HX4F0-090D060US935-RLLONL

Luminous Intensity Polar Plot

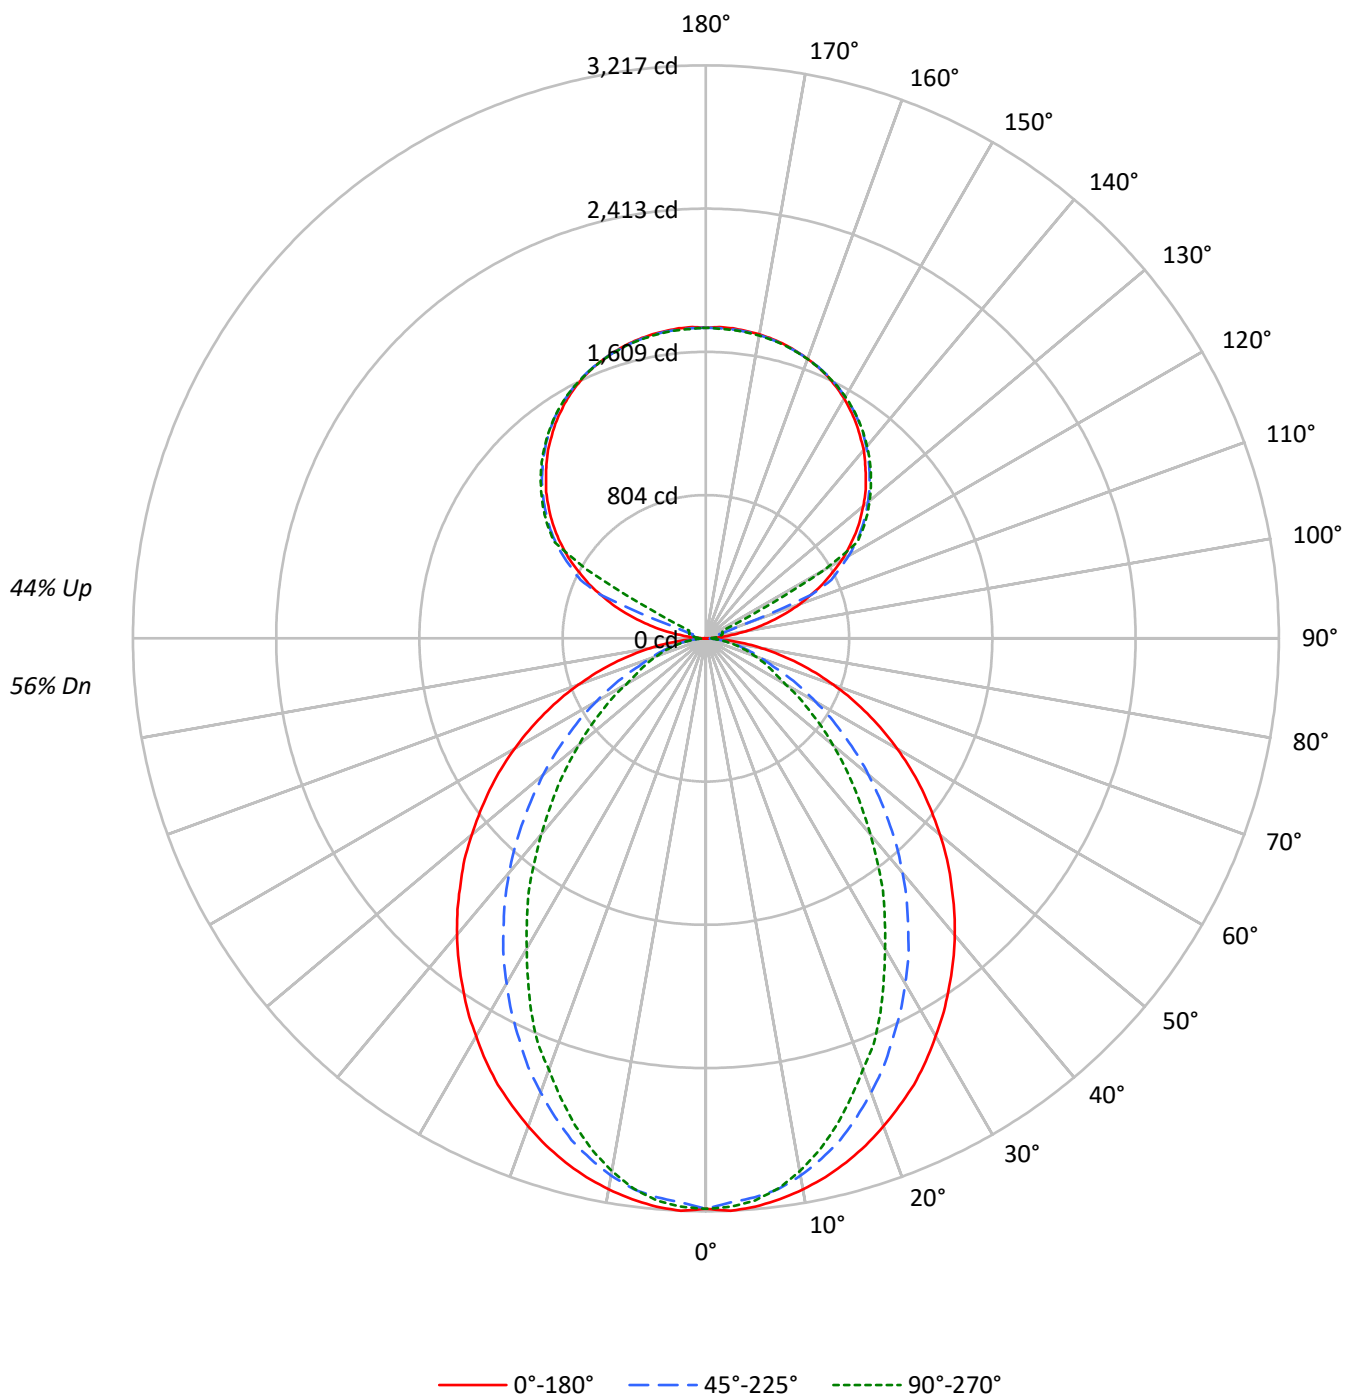

TEST NUMBER: P929006

CATALOG NUMBER: DFN2DIP-HX4F0-090D060US935-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	101	101	101	101	87	87	87	74	74	74	62	62	62
1	100	96	92	88	93	89	86	83	77	75	72	66	64	63	56	54	53
2	91	84	78	73	85	79	73	69	68	64	61	58	56	53	50	48	46
3	84	74	67	62	78	70	63	58	61	56	52	52	49	46	44	42	40
4	77	66	59	53	71	62	55	50	54	49	45	47	43	40	40	37	35
5	71	59	51	46	66	56	49	43	49	43	39	42	38	35	36	33	31
6	65	54	46	40	61	50	43	38	44	39	34	39	34	31	33	30	27
7	61	49	41	35	56	46	39	34	40	35	30	35	31	27	30	27	24
8	56	44	37	31	52	42	35	30	37	31	27	32	28	25	28	25	22
9	53	41	33	28	49	38	32	27	34	28	25	30	25	22	26	23	20
10	49	37	30	25	46	35	29	24	31	26	22	28	23	20	24	21	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2381	2381	2381
5°	2385	2344	2359
10°	2362	2298	2282
15°	2330	2222	2164
20°	2287	2118	2018
25°	2243	2001	1878
30°	2184	1881	1699
35°	2126	1751	1543
40°	2068	1618	1363
45°	1999	1469	1200
50°	1929	1319	1041
55°	1855	1159	889
60°	1770	992	732
65°	1672	822	659
70°	1553	663	596
75°	1404	585	543
80°	1188	491	471
85°	830	329	355

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1999 cd/sqm

TEST NUMBER: P929006

CATALOG NUMBER: DFN2DIP-HX4F0-090D060US935-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	300.2	2.6
10°-20°	824.0	7.0
20°-30°	1156.9	9.9
30°-40°	1261.0	10.8
40°-50°	1159.0	9.9
50°-60°	910.3	7.8
60°-70°	592.5	5.1
70°-80°	305.0	2.6
80°-90°	80.9	0.7
90°-100°	57.5	0.5
100°-110°	214.3	1.8
110°-120°	568.4	4.9
120°-130°	942.7	8.1
130°-140°	1001.4	8.6
140°-150°	930.7	8.0
150°-160°	748.2	6.4
160°-170°	482.1	4.1
170°-180°	165.9	1.4
0°-30°	2281.0	19.5
0°-40°	3542.1	30.3
0°-60°	5611.3	48.0
0°-90°	6589.7	56.3
90°-120°	840.2	7.2
90°-150°	3714.9	31.7
90°-180°	5111.0	43.7
0°-180°	11701.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3203	3203	3203	3203	3203	
5°	3203	3188	3150	3176	3168	304
15°	3046	3014	2916	2861	2832	858
25°	2765	2672	2481	2362	2319	1272
35°	2383	2235	1980	1797	1733	1491
45°	1948	1753	1449	1243	1174	1504
55°	1481	1255	942	768	713	1323
65°	1000	765	504	406	397	991
75°	533	330	232	212	209	564
85°	124	64	55	55	55	143
90°	1	15	25	32	34	11
95°	82	40	49	56	54	97
105°	384	421	77	91	96	410
115°	725	747	778	194	104	714
125°	1026	1042	1066	1075	1079	915
135°	1269	1289	1301	1313	1311	980
145°	1472	1471	1492	1501	1495	921
155°	1621	1610	1625	1632	1622	747
165°	1708	1701	1704	1713	1704	483
175°	1747	1738	1741	1750	1737	166
180°	1743	1743	1743	1743	1743	

TEST NUMBER: P929006

CATALOG NUMBER: DFN2DIP-HX4F0-090D060US935-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3202.7	3202.7	3202.7	3202.7	3202.7
2.5°	3217.1	3202.7	3170.6	3199.9	3194.1
5°	3202.7	3188.2	3150.4	3176.5	3167.9
7.5°	3176.5	3159.3	3118.7	3130.1	3115.6
10°	3141.8	3121.5	3063.7	3054.7	3037.5
12.5°	3098.4	3072.3	2993.9	2976.6	2944.6
15°	3046.1	3014.2	2915.8	2860.7	2831.8
17.5°	2985.3	2938.9	2817.0	2753.4	2707.0
20°	2915.8	2857.7	2712.8	2640.5	2576.5
22.5°	2840.4	2773.7	2605.5	2507.1	2463.8
25°	2765.1	2672.2	2481.0	2362.2	2318.6
27.5°	2675.3	2576.5	2365.0	2228.8	2162.1
30°	2579.6	2469.3	2237.4	2089.8	2011.4
32.5°	2486.7	2353.3	2115.9	1941.9	1869.3
35°	2382.6	2234.6	1979.7	1797.1	1733.1
37.5°	2281.0	2121.5	1852.1	1651.9	1579.7
40°	2173.8	2000.0	1718.6	1512.9	1437.6
42.5°	2063.6	1878.3	1585.4	1370.9	1298.6
45°	1947.8	1753.4	1449.2	1243.2	1173.7
47.5°	1837.6	1631.9	1318.9	1112.8	1049.2
50°	1715.9	1510.1	1191.3	991.1	930.5
52.5°	1596.9	1379.5	1069.5	878.2	823.2
55°	1480.9	1254.9	941.8	768.2	713.1
57.5°	1362.3	1130.4	829.1	666.7	620.3
60°	1240.4	1008.6	710.1	562.4	516.0
62.5°	1121.8	889.9	608.6	469.6	446.5
65°	1000.0	765.1	504.3	405.9	397.0
67.5°	884.1	649.1	405.9	356.4	347.8
70°	762.3	536.3	336.1	307.2	295.5
72.5°	646.4	431.7	281.0	258.0	252.2
75°	533.2	330.3	231.9	211.5	208.8
77.5°	420.3	234.6	182.6	171.0	165.1
80°	315.8	168.2	139.0	127.6	127.6
82.5°	220.2	113.1	95.7	89.8	89.8
85°	124.5	63.6	55.0	55.0	55.0
87.5°	46.4	23.1	23.1	20.3	20.3
90°	1.2	15.2	25.1	31.6	34.0
92.5°	31.6	26.5	30.2	32.8	34.0
95°	82.0	40.3	49.2	55.6	54.2
97.5°	147.6	44.2	64.2	68.2	69.4
100°	223.3	50.5	71.9	82.0	84.5
102.5°	306.5	304.1	74.5	88.3	92.1
105°	383.5	421.4	77.0	90.7	95.9
107.5°	473.1	504.5	79.6	93.3	98.4
110°	559.0	585.3	220.8	94.7	99.6

TEST NUMBER: P929006

CATALOG NUMBER: DFN2DIP-HX4F0-090D060US935-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	639.6	662.3	640.8	97.0	101.0
115°	725.4	746.8	778.4	194.3	103.5
117.5°	799.8	825.0	846.5	666.1	335.5
120°	883.1	902.0	924.8	939.9	769.6
122.5°	953.6	973.9	999.2	1006.7	1008.1
125°	1025.6	1042.1	1066.0	1074.9	1078.6
127.5°	1091.2	1108.9	1127.9	1140.5	1141.7
130°	1153.1	1173.3	1187.1	1201.0	1199.8
132.5°	1216.2	1232.6	1246.4	1257.7	1256.5
135°	1269.2	1289.4	1300.6	1313.4	1310.8
137.5°	1324.6	1339.7	1352.5	1365.0	1361.3
140°	1378.8	1389.1	1402.8	1414.2	1407.9
142.5°	1424.4	1433.2	1449.6	1459.6	1453.3
145°	1472.3	1470.9	1492.4	1501.2	1495.0
147.5°	1513.8	1510.0	1531.5	1537.7	1532.8
150°	1554.3	1545.4	1565.6	1573.1	1566.8
152.5°	1588.3	1578.2	1597.1	1604.7	1595.9
155°	1621.1	1609.8	1625.0	1632.5	1622.4
157.5°	1647.6	1637.5	1648.9	1657.8	1647.6
160°	1670.3	1662.7	1670.3	1677.8	1669.0
162.5°	1690.4	1682.9	1689.2	1698.1	1686.7
165°	1708.1	1700.6	1704.3	1713.2	1704.3
167.5°	1722.0	1714.4	1718.3	1727.2	1715.7
170°	1733.5	1725.8	1728.4	1737.2	1725.8
172.5°	1740.9	1733.5	1735.9	1744.8	1733.5
175°	1747.2	1738.4	1740.9	1749.7	1737.2
177.5°	1749.7	1740.9	1742.2	1751.1	1739.7
180°	1743.4	1743.4	1743.4	1743.4	1743.4

TEST NUMBER: P929006

CATALOG NUMBER: DFN2DIP-HX4F0-090D060US935-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.73	11.62	11.64	12.54	13.72	6.71	7.59	7.61	8.51	9.69
	3H	12.42	13.21	13.34	14.14	15.34	7.90	8.69	8.82	9.62	10.83
	4H	13.03	13.77	13.96	14.71	15.93	8.36	9.10	9.29	10.04	11.25
	6H	13.45	14.14	14.40	15.08	16.31	8.68	9.37	9.63	10.31	11.54
	8H	13.58	14.24	14.53	15.19	16.42	8.77	9.43	9.73	10.39	11.61
	12H	13.65	14.27	14.60	15.22	16.47	8.82	9.44	9.78	10.40	11.65
4H	2H	10.76	11.51	11.70	12.44	13.66	7.31	8.06	8.25	8.99	10.21
	3H	12.59	13.21	13.54	14.18	15.41	8.67	9.29	9.62	10.25	11.48
	4H	13.29	13.85	14.25	14.82	16.07	9.22	9.78	10.18	10.75	12.00
	6H	13.81	14.29	14.78	15.28	16.53	9.64	10.13	10.61	11.11	12.37
	8H	13.98	14.44	14.96	15.42	16.69	9.77	10.23	10.75	11.21	12.47
	12H	14.08	14.49	15.08	15.49	16.76	9.84	10.25	10.83	11.25	12.52
8H	4H	13.26	13.72	14.24	14.69	15.96	9.50	9.96	10.48	10.94	12.20
	6H	13.83	14.21	14.83	15.23	16.49	10.03	10.40	11.02	11.42	12.69
	8H	14.05	14.38	15.06	15.39	16.67	10.22	10.55	11.23	11.56	12.84
	12H	14.19	14.48	15.20	15.48	16.81	10.34	10.63	11.35	11.63	12.96
12H	4H	13.22	13.63	14.21	14.62	15.89	9.51	9.92	10.50	10.91	12.19
	6H	13.81	14.14	14.81	15.15	16.43	10.07	10.41	11.08	11.41	12.70
	8H	14.03	14.32	15.04	15.32	16.65	10.29	10.58	11.30	11.58	12.91

END OF REPORT