

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919152

Luminaire Tested: DFN2DIP-HX4F0-090D080US935-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919152
REPORT IS A COMBINATION OF REPORTS P899381 AND P896188
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-090D080US935-FLLFLL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13767.4 lumens
Efficiency: N/A
Efficacy: 102.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 134
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9821
Total Harmonic Distortion (THDi): 0.08
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919152

CATALOG NUMBER: DFN2DIP-HX4F0-090D080US935-FLLFLL

Luminous Intensity Polar Plot

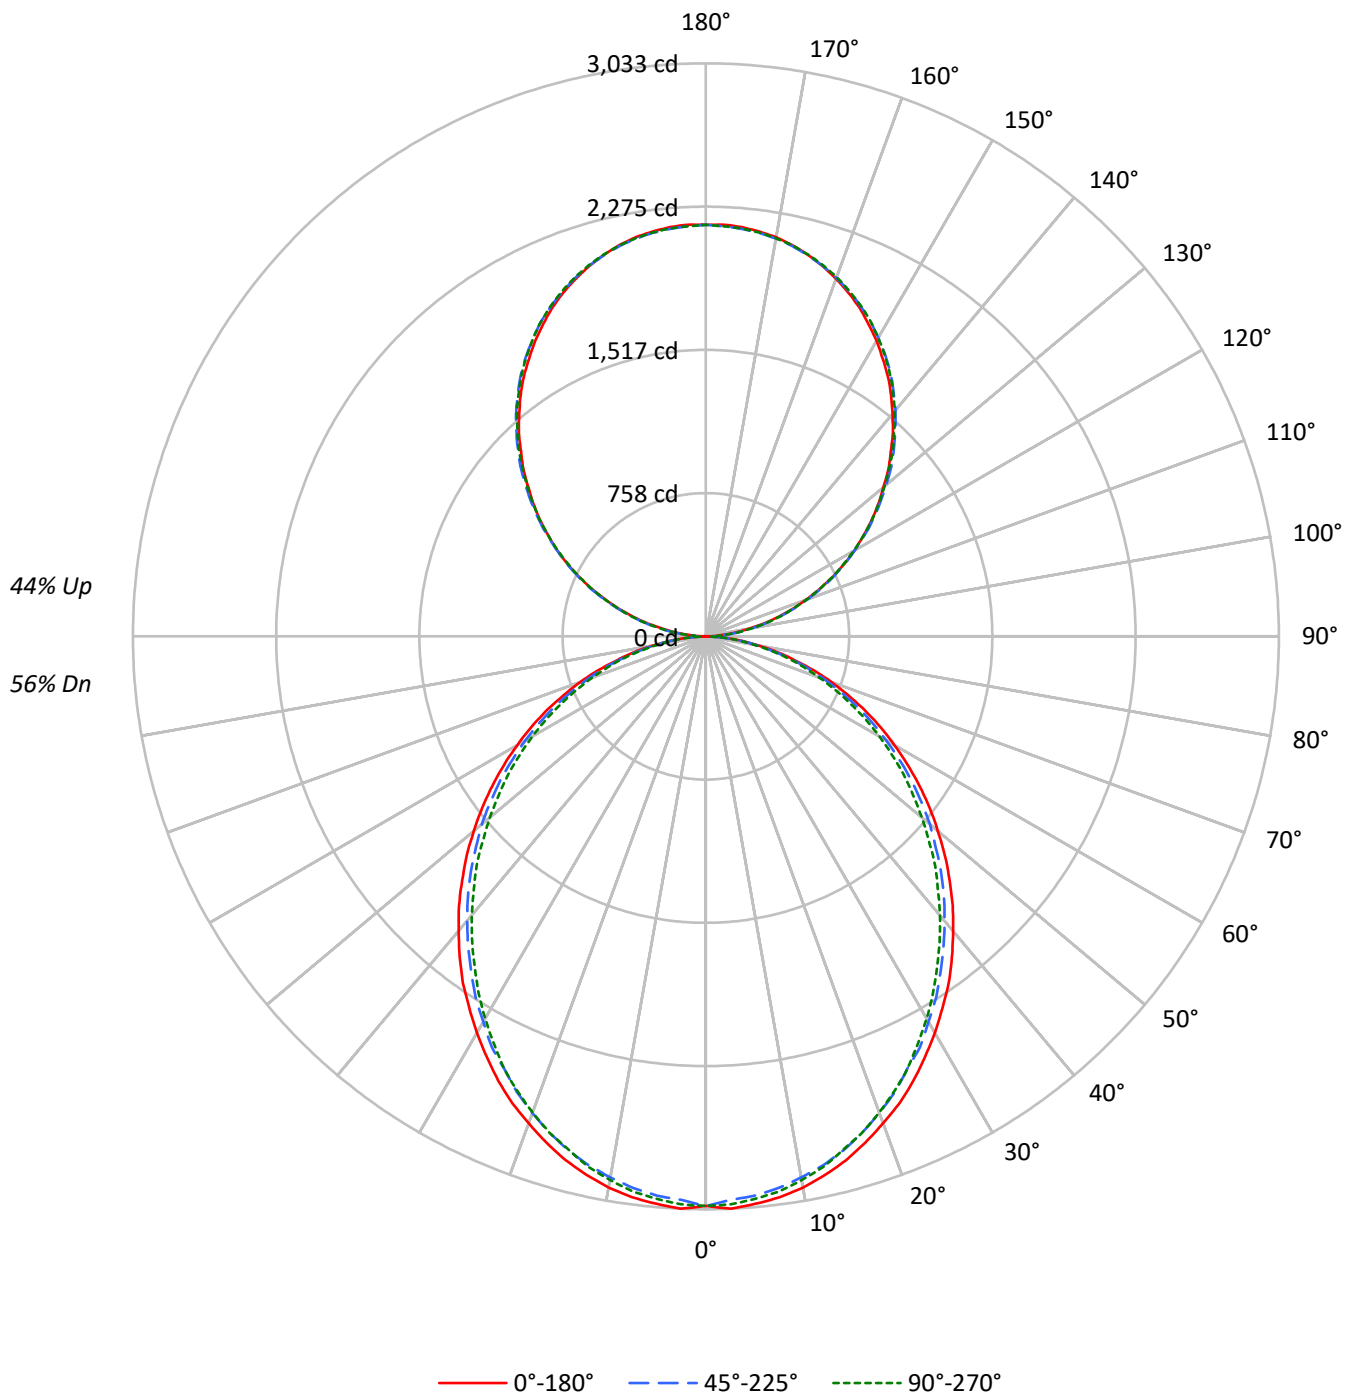

TEST NUMBER: P919152

CATALOG NUMBER: DFN2DIP-HX4F0-090D080US935-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	101	101	101	101	87	87	87	73	73	73	61	61	61
1	99	95	91	87	92	88	85	82	76	73	71	65	63	61	54	53	52
2	90	83	77	71	84	77	72	67	67	62	59	57	54	51	48	46	44
3	82	73	65	59	76	68	61	56	59	54	50	50	46	43	42	40	37
4	75	64	56	50	70	60	53	48	52	47	42	45	41	37	38	35	32
5	69	57	49	43	64	54	46	41	47	41	36	40	36	32	34	31	28
6	64	52	43	37	59	48	41	36	42	36	32	36	32	28	31	27	25
7	59	47	39	33	55	44	36	31	38	32	28	33	28	25	28	25	22
8	55	42	35	29	51	40	33	28	35	29	25	30	26	22	26	22	20
9	51	39	31	26	47	36	30	25	32	26	22	28	23	20	24	20	18
10	48	36	28	23	44	33	27	22	30	24	20	26	21	18	22	19	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2242	2242	2242
5°	2246	2211	2226
10°	2228	2181	2196
15°	2195	2146	2149
20°	2151	2096	2101
25°	2107	2037	2045
30°	2052	1981	1974
35°	2000	1916	1899
40°	1936	1850	1828
45°	1872	1784	1755
50°	1802	1715	1671
55°	1729	1634	1594
60°	1646	1539	1505
65°	1556	1441	1400
70°	1441	1321	1287
75°	1282	1177	1183
80°	1091	994	984
85°	791	677	655

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1872 cd/sqm

TEST NUMBER: P919152

CATALOG NUMBER: DFN2DIP-HX4F0-090D080US935-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	283.8	2.1
10°-20°	798.5	5.8
20°-30°	1173.4	8.5
30°-40°	1362.9	9.9
40°-50°	1361.2	9.9
50°-60°	1186.9	8.6
60°-70°	877.4	6.4
70°-80°	496.4	3.6
80°-90°	137.2	1.0
90°-100°	134.8	1.0
100°-110°	428.3	3.1
110°-120°	733.0	5.3
120°-130°	964.0	7.0
130°-140°	1082.0	7.9
140°-150°	1061.0	7.7
150°-160°	890.1	6.5
160°-170°	590.3	4.3
170°-180°	206.3	1.5
0°-30°	2255.7	16.4
0°-40°	3618.6	26.3
0°-60°	6166.7	44.8
0°-90°	7677.7	55.8
90°-120°	1296.1	9.4
90°-150°	4403.1	32.0
90°-180°	6090.0	44.2
0°-180°	13767.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3015	3015	3015	3015	3015	
5°	3015	3004	2972	2995	2989	286
15°	2870	2853	2815	2827	2812	808
25°	2598	2575	2526	2531	2526	1195
35°	2241	2212	2166	2148	2134	1400
45°	1824	1804	1760	1728	1716	1408
55°	1380	1363	1328	1293	1279	1234
65°	931	913	884	858	844	920
75°	487	481	467	449	455	520
85°	119	116	113	104	102	132
90°	2	24	64	60	62	13
95°	96	114	118	118	114	107
105°	395	401	405	408	408	417
115°	736	746	743	741	736	728
125°	1070	1086	1081	1075	1073	956
135°	1384	1404	1408	1406	1401	1070
145°	1680	1693	1704	1706	1698	1050
155°	1921	1926	1932	1941	1935	884
165°	2090	2088	2088	2101	2092	590
175°	2174	2169	2165	2178	2167	207
180°	2178	2178	2178	2178	2178	

TEST NUMBER: P919152

CATALOG NUMBER: DFN2DIP-HX4F0-090D080US935-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3015.1	3015.1	3015.1	3015.1	3015.1
2.5°	3032.7	3018.2	2986.3	3015.1	3009.6
5°	3015.1	3003.8	2971.8	2994.9	2989.3
7.5°	2994.9	2977.7	2945.6	2969.1	2963.2
10°	2963.2	2942.9	2908.1	2931.2	2922.6
12.5°	2919.5	2902.3	2867.6	2881.9	2876.2
15°	2870.3	2853.1	2815.2	2826.9	2812.4
17.5°	2809.3	2792.1	2754.3	2768.8	2754.3
20°	2742.6	2725.4	2684.8	2693.4	2682.0
22.5°	2676.2	2650.1	2612.2	2612.2	2606.3
25°	2597.7	2574.6	2525.5	2531.0	2525.5
27.5°	2510.7	2490.4	2452.9	2444.3	2429.8
30°	2424.0	2400.5	2357.2	2348.5	2336.9
32.5°	2331.1	2313.8	2267.4	2249.9	2238.2
35°	2241.3	2212.3	2165.8	2148.4	2133.9
37.5°	2139.8	2113.6	2067.1	2046.9	2032.4
40°	2035.4	2012.1	1965.6	1939.7	1928.1
42.5°	1933.9	1910.6	1864.4	1835.2	1818.0
45°	1823.8	1803.5	1759.8	1728.1	1716.5
47.5°	1716.5	1696.2	1649.7	1617.7	1600.5
50°	1603.3	1588.8	1548.2	1507.6	1493.1
52.5°	1493.1	1472.8	1435.3	1403.3	1383.0
55°	1380.3	1362.7	1327.9	1293.2	1278.8
57.5°	1267.0	1252.6	1214.8	1180.0	1168.3
60°	1153.8	1142.5	1101.8	1069.9	1061.3
62.5°	1043.7	1023.4	994.5	965.6	953.9
65°	930.8	913.3	884.3	858.2	843.8
67.5°	814.8	800.1	774.2	754.0	742.3
70°	707.5	695.8	669.7	649.4	638.0
72.5°	597.4	585.7	571.2	551.0	542.3
75°	487.0	481.4	466.7	449.4	455.3
77.5°	388.5	376.9	371.0	362.4	353.8
80°	290.1	287.0	281.1	272.5	266.7
82.5°	197.2	197.2	194.4	182.7	182.7
85°	118.7	116.0	113.2	104.3	101.5
87.5°	52.3	46.4	40.6	32.0	28.9
90°	2.0	23.7	64.4	60.4	62.4
92.5°	40.7	55.2	57.2	59.1	59.1
95°	95.9	114.3	117.5	117.5	114.3
97.5°	159.6	176.7	183.9	183.9	183.9
100°	233.2	248.2	253.5	253.5	251.5
102.5°	310.6	321.8	329.0	331.0	329.0
105°	395.4	400.6	404.6	407.9	407.9
107.5°	479.4	487.3	487.3	488.6	479.4
110°	560.9	571.4	571.4	571.4	566.1

TEST NUMBER: P919152

CATALOG NUMBER: DFN2DIP-HX4F0-090D080US935-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	648.8	660.0	658.1	652.8	648.8
115°	735.6	746.1	742.8	740.8	735.6
117.5°	821.6	836.0	826.8	821.6	816.3
120°	908.3	922.7	908.3	908.3	902.3
122.5°	987.0	1005.5	996.3	991.0	987.0
125°	1069.8	1086.2	1081.0	1075.0	1073.1
127.5°	1150.6	1171.0	1163.7	1155.9	1150.6
130°	1226.1	1249.7	1246.5	1242.6	1235.4
132.5°	1310.9	1329.2	1330.6	1321.4	1316.1
135°	1383.7	1404.1	1408.1	1406.1	1400.8
137.5°	1465.2	1481.6	1484.9	1483.6	1475.7
140°	1536.8	1553.2	1562.4	1562.4	1555.1
142.5°	1610.3	1626.8	1632.0	1634.0	1626.8
145°	1680.0	1693.1	1703.6	1705.6	1698.3
147.5°	1742.3	1758.8	1766.6	1770.0	1762.7
150°	1806.7	1817.8	1825.1	1831.0	1825.1
152.5°	1863.8	1875.0	1884.2	1891.4	1884.2
155°	1921.0	1926.2	1932.2	1941.3	1935.4
157.5°	1970.2	1974.2	1977.5	1990.5	1981.4
160°	2014.2	2018.2	2020.2	2031.3	2023.4
162.5°	2054.9	2054.9	2056.9	2069.4	2060.2
165°	2089.7	2087.7	2087.7	2100.9	2091.7
167.5°	2121.2	2115.4	2115.4	2128.5	2119.3
170°	2144.9	2139.7	2137.7	2150.9	2139.7
172.5°	2161.4	2156.1	2154.1	2167.2	2156.1
175°	2174.5	2169.2	2165.2	2178.4	2167.2
177.5°	2181.7	2176.4	2172.5	2183.7	2172.5
180°	2178.4	2178.4	2178.4	2178.4	2178.4

TEST NUMBER: P919152

CATALOG NUMBER: DFN2DIP-HX4F0-090D080US935-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.59	11.51	11.50	12.43	13.62	10.16	11.08	11.07	12.00	13.19
	3H	12.26	13.08	13.18	14.01	15.23	11.79	12.61	12.70	13.54	14.75
	4H	12.85	13.63	13.78	14.57	15.79	12.38	13.15	13.31	14.09	15.31
	6H	13.25	13.97	14.20	14.91	16.15	12.78	13.49	13.72	14.44	15.67
	8H	13.36	14.04	14.31	15.00	16.24	12.88	13.57	13.84	14.53	15.76
	12H	13.41	14.06	14.37	15.02	16.27	12.93	13.58	13.89	14.53	15.79
4H	2H	11.06	11.84	12.00	12.78	14.00	10.72	11.49	11.66	12.43	13.65
	3H	12.93	13.58	13.88	14.55	15.79	12.54	13.19	13.49	14.16	15.39
	4H	13.65	14.24	14.61	15.21	16.47	13.25	13.84	14.20	14.80	16.06
	6H	14.17	14.68	15.14	15.67	16.93	13.76	14.27	14.73	15.26	16.52
	8H	14.32	14.80	15.30	15.78	17.05	13.91	14.39	14.88	15.37	16.64
	12H	14.40	14.83	15.39	15.83	17.11	13.98	14.41	14.97	15.41	16.68
8H	4H	13.85	14.33	14.83	15.31	16.58	13.49	13.97	14.47	14.95	16.22
	6H	14.49	14.88	15.49	15.91	17.18	14.12	14.52	15.12	15.54	16.81
	8H	14.71	15.06	15.72	16.07	17.36	14.34	14.69	15.35	15.70	16.99
	12H	14.84	15.15	15.86	16.16	17.49	14.46	14.77	15.47	15.77	17.11
12H	4H	13.84	14.27	14.83	15.27	16.55	13.49	13.92	14.48	14.92	16.20
	6H	14.52	14.87	15.53	15.88	17.17	14.17	14.52	15.17	15.53	16.82
	8H	14.76	15.07	15.78	16.08	17.41	14.41	14.71	15.42	15.72	17.05

END OF REPORT