

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P929012

Luminaire Tested: DFN2DIP-HX4F0-090D080US935-FLLONL

Issue Date: 12/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P929012
REPORT IS A COMBINATION OF REPORTS P900901 AND P896187
Test Lab: INNOVATION CENTER
Issue Date: 12/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-090D080US935-FLLONL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14490.7 lumens
Efficiency: N/A
Efficacy: 98.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 147
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9821
Total Harmonic Distortion (THDi): 0.08
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P929012

CATALOG NUMBER: DFN2DIP-HX4F0-090D080US935-FLLONL

Luminous Intensity Polar Plot

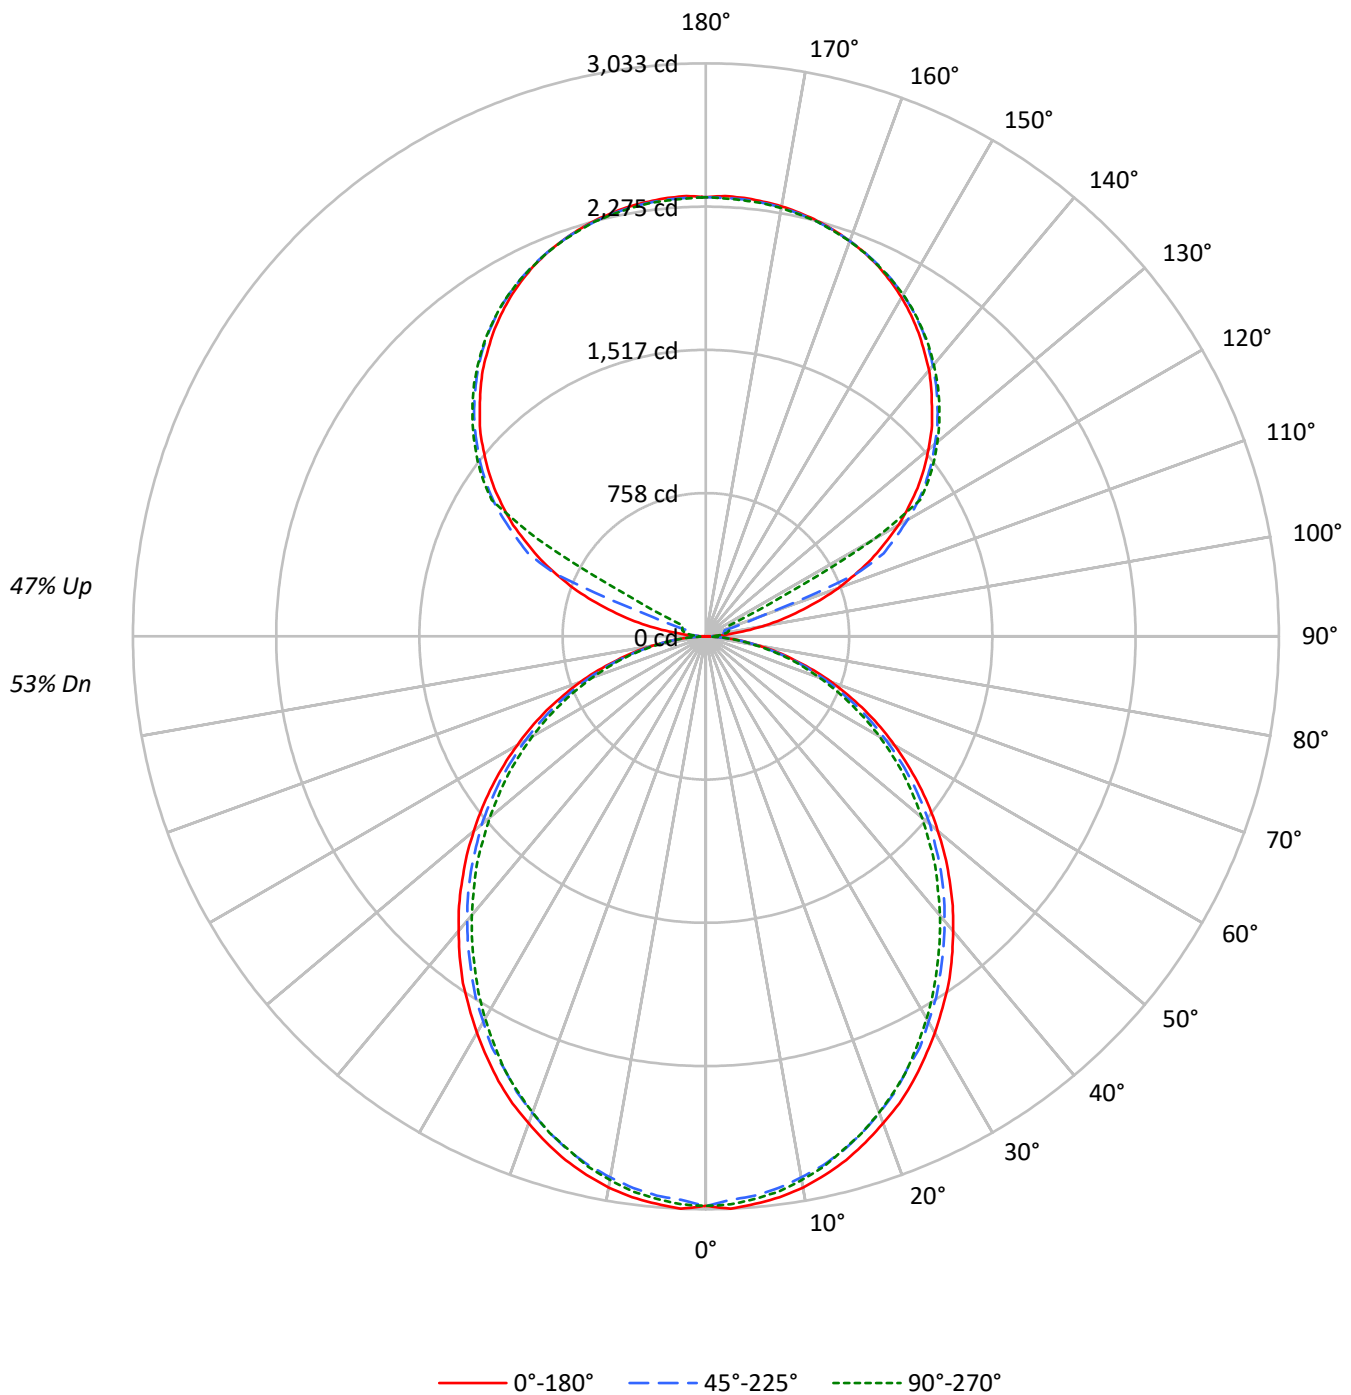

TEST NUMBER: P929012

CATALOG NUMBER: DFN2DIP-HX4F0-090D080US935-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85		71	71	71		59
1	98	94	90	87	91	87	84	81	75	72	70		63	61	59		52
2	90	82	76	71	83	76	71	66	65	61	58		55	52	50		46
3	82	72	65	59	75	67	61	55	58	53	49		49	45	42		41
4	75	64	56	50	69	60	53	47	51	46	41		43	39	36		36
5	69	57	49	43	63	53	46	40	46	40	36		39	35	31		33
6	63	51	43	37	58	48	40	35	41	36	31		35	31	27		30
7	59	46	38	33	54	43	36	31	37	32	28		32	28	24		27
8	54	42	34	29	50	39	32	27	34	29	24		29	25	22		25
9	51	38	31	26	47	36	29	24	31	26	22		27	23	19		23
10	47	35	28	23	44	33	26	22	29	24	20		25	21	18		21

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2242	2242	2242
5°	2246	2211	2226
10°	2228	2181	2196
15°	2195	2146	2149
20°	2151	2096	2101
25°	2107	2037	2045
30°	2052	1981	1974
35°	2000	1916	1899
40°	1936	1850	1828
45°	1872	1784	1755
50°	1802	1715	1671
55°	1729	1634	1594
60°	1646	1539	1505
65°	1556	1441	1400
70°	1441	1321	1287
75°	1282	1177	1183
80°	1091	994	984
85°	791	677	655

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1872 cd/sqm

TEST NUMBER: P929012

CATALOG NUMBER: DFN2DIP-HX4F0-090D080US935-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	283.8	2.0
10°-20°	798.5	5.5
20°-30°	1173.4	8.1
30°-40°	1362.9	9.4
40°-50°	1361.2	9.4
50°-60°	1186.9	8.2
60°-70°	877.4	6.1
70°-80°	496.4	3.4
80°-90°	135.1	0.9
90°-100°	76.7	0.5
100°-110°	285.7	2.0
110°-120°	757.9	5.2
120°-130°	1256.9	8.7
130°-140°	1335.2	9.2
140°-150°	1240.9	8.6
150°-160°	997.6	6.9
160°-170°	642.8	4.4
170°-180°	221.3	1.5
0°-30°	2255.7	15.6
0°-40°	3618.6	25.0
0°-60°	6166.7	42.6
0°-90°	7675.6	53.0
90°-120°	1120.2	7.7
90°-150°	4953.3	34.2
90°-180°	6815.0	47.0
0°-180°	14490.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3015	3015	3015	3015	3015	
5°	3015	3004	2972	2995	2989	286
15°	2870	2853	2815	2827	2812	808
25°	2598	2575	2526	2531	2526	1195
35°	2241	2212	2166	2148	2134	1400
45°	1824	1804	1760	1728	1716	1408
55°	1380	1363	1328	1293	1279	1234
65°	931	913	884	858	844	920
75°	487	481	467	449	455	520
85°	119	116	113	104	102	132
90°	2	20	34	42	45	13
95°	109	54	66	74	72	129
105°	511	562	103	121	128	546
115°	967	996	1038	259	138	952
125°	1367	1389	1421	1433	1438	1220
135°	1692	1719	1734	1751	1748	1307
145°	1963	1961	1990	2002	1993	1228
155°	2162	2146	2167	2177	2163	996
165°	2278	2268	2272	2284	2272	643
175°	2330	2318	2321	2333	2316	222
180°	2325	2325	2325	2325	2325	

TEST NUMBER: P929012

CATALOG NUMBER: DFN2DIP-HX4F0-090D080US935-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3015.1	3015.1	3015.1	3015.1	3015.1
2.5°	3032.7	3018.2	2986.3	3015.1	3009.6
5°	3015.1	3003.8	2971.8	2994.9	2989.3
7.5°	2994.9	2977.7	2945.7	2969.1	2963.2
10°	2963.2	2942.9	2908.1	2931.2	2922.6
12.5°	2919.5	2902.3	2867.6	2881.9	2876.2
15°	2870.3	2853.1	2815.2	2826.9	2812.5
17.5°	2809.4	2792.1	2754.3	2768.8	2754.3
20°	2742.6	2725.4	2684.8	2693.4	2682.0
22.5°	2676.2	2650.1	2612.2	2612.2	2606.3
25°	2597.7	2574.6	2525.5	2531.0	2525.5
27.5°	2510.7	2490.4	2452.9	2444.3	2429.8
30°	2424.0	2400.6	2357.2	2348.5	2336.9
32.5°	2331.1	2313.9	2267.4	2249.9	2238.2
35°	2241.3	2212.3	2165.8	2148.4	2133.9
37.5°	2139.8	2113.6	2067.1	2046.9	2032.4
40°	2035.4	2012.1	1965.6	1939.7	1928.1
42.5°	1933.9	1910.6	1864.4	1835.2	1818.0
45°	1823.8	1803.5	1759.8	1728.1	1716.5
47.5°	1716.5	1696.2	1649.7	1617.7	1600.5
50°	1603.3	1588.8	1548.2	1507.6	1493.1
52.5°	1493.1	1472.8	1435.3	1403.3	1383.0
55°	1380.3	1362.7	1327.9	1293.2	1278.8
57.5°	1267.0	1252.6	1214.8	1180.0	1168.3
60°	1153.8	1142.5	1101.8	1069.9	1061.3
62.5°	1043.7	1023.4	994.5	965.6	953.9
65°	930.8	913.3	884.3	858.2	843.8
67.5°	814.9	800.1	774.2	754.0	742.3
70°	707.5	695.8	669.7	649.4	638.0
72.5°	597.4	585.7	571.2	551.0	542.3
75°	487.0	481.4	466.7	449.4	455.3
77.5°	388.5	376.9	371.0	362.4	353.8
80°	290.1	287.0	281.1	272.5	266.7
82.5°	197.2	197.2	194.4	182.7	182.7
85°	118.7	116.0	113.2	104.3	101.5
87.5°	52.3	46.4	40.6	32.0	28.9
90°	1.6	20.1	33.6	42.1	45.4
92.5°	42.1	35.4	40.4	43.7	45.4
95°	109.3	53.7	65.5	74.1	72.3
97.5°	196.7	58.9	85.7	90.9	92.5
100°	297.8	67.3	95.9	109.3	112.6
102.5°	408.7	405.4	99.3	117.6	122.9
105°	511.3	561.9	102.6	121.1	127.9
107.5°	630.8	672.7	106.1	124.4	131.2
110°	745.3	780.4	294.5	126.2	132.9

TEST NUMBER: P929012

CATALOG NUMBER: DFN2DIP-HX4F0-090D080US935-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	852.9	883.0	854.5	129.4	134.7
115°	967.2	995.7	1037.8	259.1	138.0
117.5°	1066.4	1100.0	1128.8	888.0	447.5
120°	1177.5	1202.6	1233.0	1253.2	1026.1
122.5°	1271.5	1298.6	1332.3	1342.3	1344.1
125°	1367.4	1389.4	1421.3	1433.1	1438.1
127.5°	1454.9	1478.5	1503.9	1520.6	1522.2
130°	1537.4	1564.4	1582.8	1601.4	1599.7
132.5°	1621.5	1643.5	1661.9	1677.1	1675.4
135°	1692.2	1719.2	1734.1	1751.2	1747.7
137.5°	1766.2	1786.3	1803.3	1820.1	1815.1
140°	1838.4	1852.0	1870.4	1885.6	1877.2
142.5°	1899.2	1910.9	1932.7	1946.1	1937.7
145°	1963.1	1961.3	1989.9	2001.7	1993.2
147.5°	2018.4	2013.4	2041.9	2050.4	2043.8
150°	2072.3	2060.5	2087.5	2097.5	2089.1
152.5°	2117.7	2104.3	2129.4	2139.7	2127.9
155°	2161.5	2146.5	2166.6	2176.6	2163.3
157.5°	2196.8	2183.4	2198.6	2210.4	2196.8
160°	2227.1	2217.0	2227.1	2237.1	2225.3
162.5°	2253.9	2243.9	2252.3	2264.1	2248.9
165°	2277.5	2267.5	2272.5	2284.2	2272.5
167.5°	2296.0	2285.9	2291.0	2302.8	2287.7
170°	2311.3	2301.0	2304.5	2316.3	2301.0
172.5°	2321.3	2311.3	2314.6	2326.4	2311.3
175°	2329.6	2317.8	2321.3	2333.0	2316.3
177.5°	2333.0	2321.3	2323.0	2334.8	2319.6
180°	2324.6	2324.6	2324.6	2324.6	2324.6

TEST NUMBER: P929012

CATALOG NUMBER: DFN2DIP-HX4F0-090D080US935-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.35	11.24	11.28	12.19	13.41	9.92	10.81	10.85	11.75	12.98
	3H	12.01	12.81	12.95	13.77	15.02	11.54	12.34	12.48	13.29	14.55
	4H	12.60	13.36	13.56	14.32	15.58	12.13	12.88	13.08	13.84	15.10
	6H	13.00	13.70	13.97	14.67	15.94	12.53	13.22	13.50	14.19	15.46
	8H	13.11	13.77	14.08	14.76	16.03	12.63	13.30	13.61	14.28	15.55
	12H	13.16	13.79	14.14	14.77	16.06	12.68	13.31	13.66	14.29	15.58
4H	2H	10.81	11.57	11.78	12.53	13.79	10.47	11.22	11.43	12.19	13.45
	3H	12.68	13.31	13.66	14.31	15.58	12.29	12.92	13.26	13.91	15.19
	4H	13.40	13.98	14.38	14.96	16.26	12.99	13.57	13.98	14.56	15.85
	6H	13.92	14.41	14.91	15.42	16.72	13.51	14.00	14.50	15.01	16.31
	8H	14.07	14.53	15.06	15.53	16.85	13.66	14.12	14.65	15.12	16.43
	12H	14.14	14.56	15.16	15.58	16.90	13.72	14.14	14.74	15.16	16.47
8H	4H	13.60	14.06	14.59	15.07	16.38	13.24	13.70	14.23	14.70	16.02
	6H	14.23	14.62	15.25	15.66	16.97	13.87	14.25	14.89	15.30	16.61
	8H	14.46	14.79	15.48	15.82	17.15	14.09	14.42	15.11	15.45	16.78
	12H	14.59	14.89	15.62	15.91	17.28	14.20	14.50	15.24	15.53	16.90
12H	4H	13.59	14.00	14.60	15.02	16.34	13.23	13.65	14.25	14.67	15.99
	6H	14.26	14.60	15.29	15.63	16.96	13.91	14.25	14.94	15.28	16.61
	8H	14.51	14.81	15.54	15.83	17.20	14.15	14.45	15.18	15.47	16.85

END OF REPORT