

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P929032

Luminaire Tested: DFN2DIP-HX4F0-100D040US935-FLLONL

Issue Date: 12/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P929032
REPORT IS A COMBINATION OF REPORTS P900831 AND P896187
Test Lab: INNOVATION CENTER
Issue Date: 12/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-100D040US935-FLLONL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11933.4 lumens
Efficiency: N/A
Efficacy: 92.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 129.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P929032

CATALOG NUMBER: DFN2DIP-HX4F0-100D040US935-FLLONL

Luminous Intensity Polar Plot

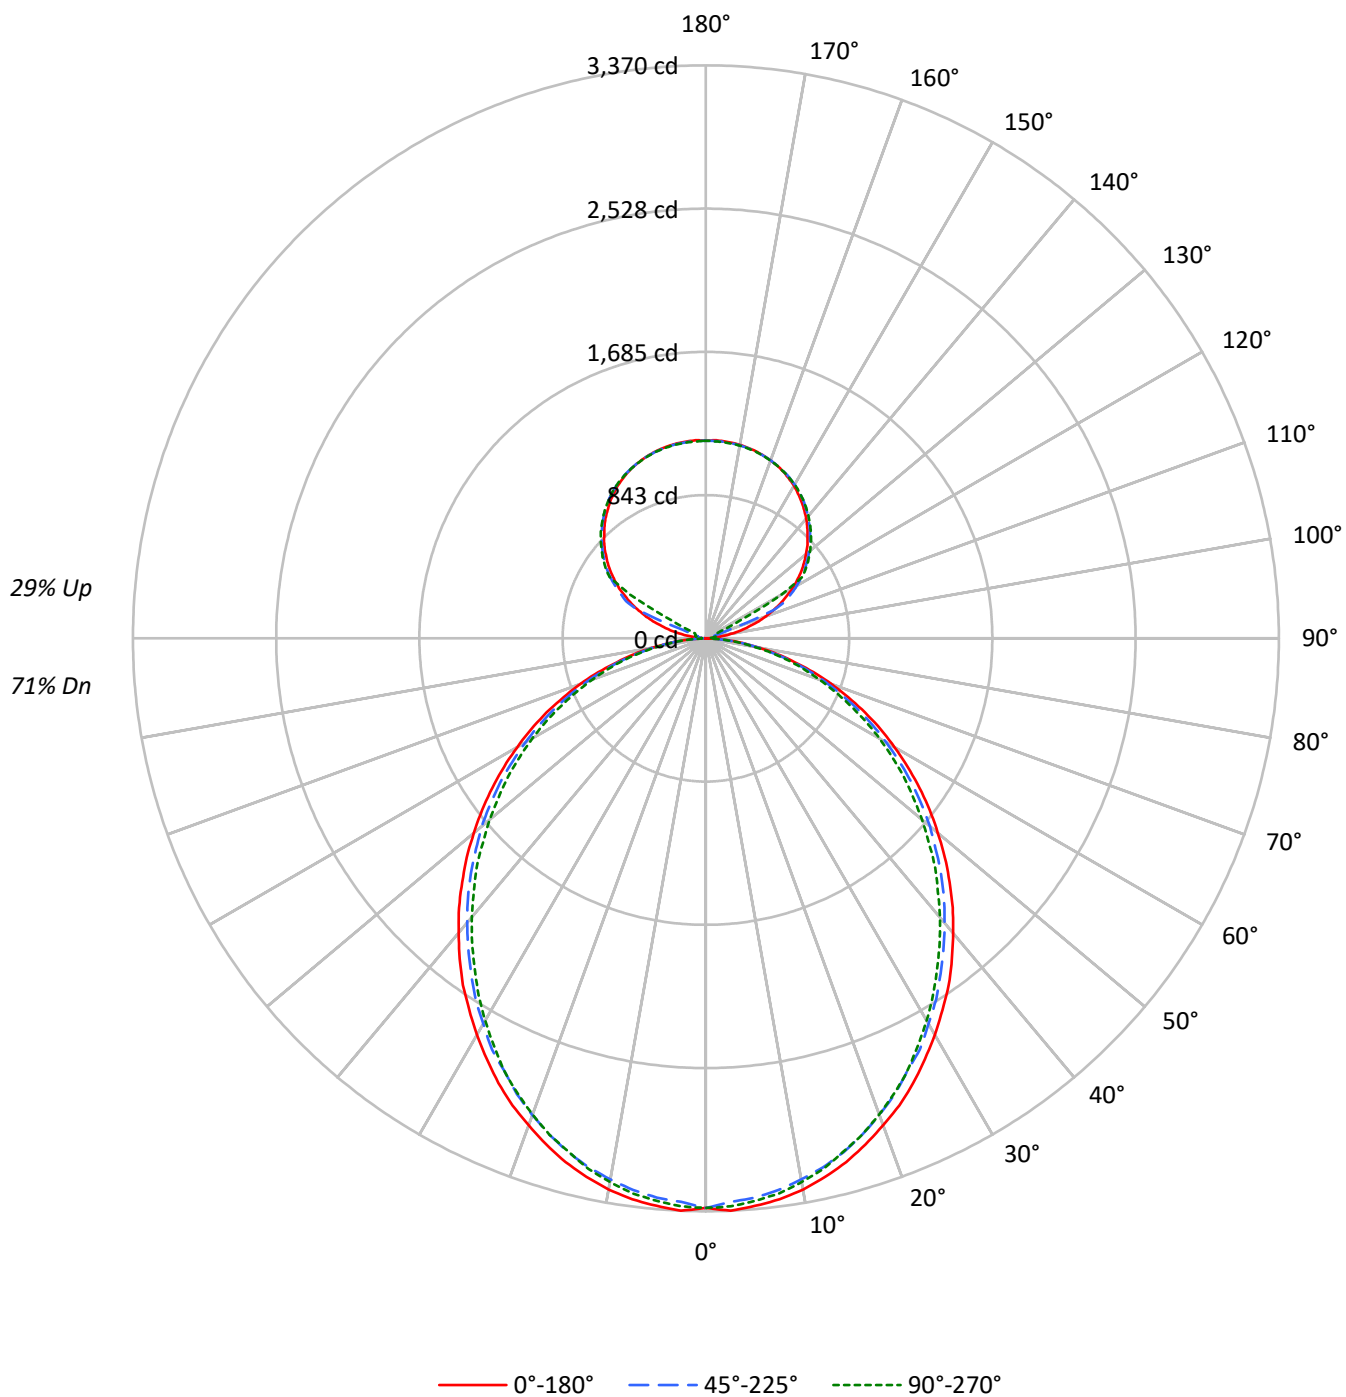

TEST NUMBER: P929032

CATALOG NUMBER: DFN2DIP-HX4F0-100D040US935-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	106	106	106	106	95	95	95	85	85	85	76	76	76
1	103	98	94	90	97	93	90	86	84	81	78	75	73	71	67	66	64
2	93	86	79	74	88	81	76	71	73	69	65	66	62	59	59	56	54
3	85	75	68	62	80	72	65	59	65	59	55	58	54	50	52	49	46
4	78	67	59	52	74	64	56	50	58	52	47	52	47	43	47	43	40
5	72	60	51	45	68	57	49	44	52	45	40	47	42	38	42	38	35
6	66	54	45	39	63	51	44	38	47	40	35	42	37	33	38	34	31
7	61	49	40	35	58	47	39	34	42	36	31	39	33	29	35	31	27
8	57	44	36	31	54	42	35	30	39	33	28	35	30	26	32	28	24
9	53	41	33	28	50	39	32	27	36	30	25	33	27	24	30	25	22
10	50	37	30	25	47	36	29	24	33	27	23	30	25	21	28	23	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2491	2491	2491
5°	2495	2457	2473
10°	2475	2424	2440
15°	2439	2384	2388
20°	2390	2329	2334
25°	2341	2263	2272
30°	2280	2201	2194
35°	2222	2129	2110
40°	2151	2056	2031
45°	2080	1982	1950
50°	2002	1905	1857
55°	1921	1816	1770
60°	1829	1710	1672
65°	1729	1601	1555
70°	1601	1467	1430
75°	1424	1308	1315
80°	1212	1104	1094
85°	879	753	728

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2080 cd/sqm

TEST NUMBER: P929032

CATALOG NUMBER: DFN2DIP-HX4F0-100D040US935-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	315.3	2.6
10°-20°	887.2	7.4
20°-30°	1303.8	10.9
30°-40°	1514.3	12.7
40°-50°	1512.4	12.7
50°-60°	1318.8	11.1
60°-70°	974.9	8.2
70°-80°	551.6	4.6
80°-90°	147.6	1.2
90°-100°	38.3	0.3
100°-110°	142.9	1.2
110°-120°	378.9	3.2
120°-130°	628.5	5.3
130°-140°	667.6	5.6
140°-150°	620.5	5.2
150°-160°	498.8	4.2
160°-170°	321.4	2.7
170°-180°	110.6	0.9
0°-30°	2506.3	21.0
0°-40°	4020.6	33.7
0°-60°	6851.8	57.4
0°-90°	8525.9	71.4
90°-120°	560.1	4.7
90°-150°	2476.6	20.8
90°-180°	3407.0	28.6
0°-180°	11933.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3350	3350	3350	3350	3350	
5°	3350	3338	3302	3328	3322	318
15°	3189	3170	3128	3141	3125	898
25°	2886	2861	2806	2812	2806	1328
35°	2490	2458	2406	2387	2371	1555
45°	2026	2004	1955	1920	1907	1564
55°	1534	1514	1476	1437	1421	1371
65°	1034	1015	983	954	938	1023
75°	541	535	518	499	506	578
85°	132	129	126	116	113	147
90°	1	10	17	21	23	11
95°	55	27	33	37	36	65
105°	256	281	51	60	64	273
115°	484	498	519	130	69	476
125°	684	695	711	717	719	610
135°	846	860	867	876	874	654
145°	982	981	995	1001	997	614
155°	1081	1073	1083	1088	1082	498
165°	1139	1134	1136	1142	1136	322
175°	1165	1159	1161	1166	1158	111
180°	1162	1162	1162	1162	1162	

TEST NUMBER: P929032

CATALOG NUMBER: DFN2DIP-HX4F0-100D040US935-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3350.2	3350.2	3350.2	3350.2	3350.2
2.5°	3369.7	3353.6	3318.0	3350.2	3344.0
5°	3350.2	3337.6	3302.0	3327.7	3321.5
7.5°	3327.7	3308.5	3272.9	3298.9	3292.5
10°	3292.5	3269.9	3231.2	3256.9	3247.3
12.5°	3243.9	3224.8	3186.1	3202.2	3195.7
15°	3189.2	3170.1	3128.0	3141.0	3125.0
17.5°	3121.6	3102.4	3060.3	3076.4	3060.3
20°	3047.3	3028.2	2983.1	2992.7	2980.0
22.5°	2973.5	2944.5	2902.4	2902.4	2896.0
25°	2886.4	2860.8	2806.1	2812.2	2806.1
27.5°	2789.6	2767.1	2725.4	2715.9	2699.8
30°	2693.3	2667.3	2619.1	2609.5	2596.5
32.5°	2590.1	2570.9	2519.3	2499.8	2486.8
35°	2490.3	2458.2	2406.5	2387.0	2370.9
37.5°	2377.5	2348.4	2296.8	2274.2	2258.1
40°	2261.6	2235.6	2184.0	2155.3	2142.3
42.5°	2148.8	2122.8	2071.6	2039.1	2020.0
45°	2026.4	2003.9	1955.3	1920.1	1907.2
47.5°	1907.2	1884.6	1833.0	1797.4	1778.3
50°	1781.4	1765.3	1720.2	1675.1	1659.1
52.5°	1659.1	1636.5	1594.7	1559.3	1536.7
55°	1533.6	1514.2	1475.5	1436.8	1420.8
57.5°	1407.8	1391.7	1349.7	1311.1	1298.1
60°	1282.0	1269.4	1224.3	1188.7	1179.1
62.5°	1159.7	1137.1	1105.0	1072.9	1059.9
65°	1034.2	1014.8	982.7	953.6	937.5
67.5°	905.4	889.0	860.3	837.8	824.8
70°	786.1	773.1	744.1	721.5	708.9
72.5°	663.7	650.7	634.7	612.2	602.5
75°	541.1	534.9	518.5	499.4	505.8
77.5°	431.7	418.7	412.2	402.6	393.0
80°	322.3	318.9	312.4	302.8	296.4
82.5°	219.1	219.1	216.0	203.0	203.0
85°	131.9	128.9	125.8	115.9	112.8
87.5°	58.1	51.6	45.1	35.6	32.1
90°	0.8	10.1	16.8	21.1	22.6
92.5°	21.1	17.7	20.1	21.9	22.6
95°	54.6	26.9	32.7	37.0	36.2
97.5°	98.4	29.4	42.9	45.5	46.2
100°	148.9	33.7	48.0	54.6	56.3
102.5°	204.3	202.8	49.6	58.8	61.4
105°	255.6	280.9	51.3	60.5	63.9
107.5°	315.4	336.4	53.0	62.3	65.6
110°	372.6	390.2	147.2	63.1	66.4

TEST NUMBER: P929032

CATALOG NUMBER: DFN2DIP-HX4F0-100D040US935-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	426.5	441.5	427.2	64.7	67.3
115°	483.5	497.8	518.9	129.5	69.1
117.5°	533.2	550.0	564.4	444.0	223.7
120°	588.8	601.3	616.5	626.6	513.1
122.5°	635.8	649.3	666.2	671.1	672.0
125°	683.7	694.7	710.7	716.6	719.1
127.5°	727.5	739.3	751.9	760.3	761.1
130°	768.7	782.2	791.3	800.6	799.9
132.5°	810.7	821.7	831.0	838.5	837.8
135°	846.1	859.6	867.1	875.6	873.9
137.5°	883.0	893.1	901.6	910.0	907.5
140°	919.2	926.0	935.2	942.8	938.6
142.5°	949.6	955.5	966.4	973.0	968.9
145°	981.5	980.7	994.9	1000.8	996.6
147.5°	1009.2	1006.7	1021.0	1025.2	1021.9
150°	1036.1	1030.3	1043.8	1048.8	1044.6
152.5°	1058.9	1052.1	1064.7	1069.8	1063.9
155°	1080.7	1073.2	1083.3	1088.3	1081.6
157.5°	1098.4	1091.7	1099.3	1105.2	1098.4
160°	1113.5	1108.5	1113.5	1118.5	1112.7
162.5°	1127.0	1122.0	1126.2	1132.0	1124.5
165°	1138.8	1133.8	1136.3	1142.1	1136.3
167.5°	1148.1	1142.9	1145.6	1151.4	1143.8
170°	1155.6	1150.6	1152.2	1158.1	1150.6
172.5°	1160.6	1155.6	1157.4	1163.2	1155.6
175°	1164.8	1158.9	1160.6	1166.5	1158.1
177.5°	1166.5	1160.6	1161.5	1167.4	1159.9
180°	1162.4	1162.4	1162.4	1162.4	1162.4

TEST NUMBER: P929032

CATALOG NUMBER: DFN2DIP-HX4F0-100D040US935-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.22	13.32	12.97	14.09	15.01	11.79	12.88	12.54	13.66	14.58
	3H	13.90	14.88	14.66	15.66	16.62	13.43	14.41	14.19	15.19	16.15
	4H	14.50	15.43	15.28	16.22	17.19	14.03	14.95	14.81	15.74	16.71
	6H	14.91	15.77	15.71	16.57	17.55	14.44	15.29	15.23	16.09	17.08
	8H	15.02	15.84	15.83	16.66	17.64	14.55	15.37	15.35	16.18	17.17
	12H	15.08	15.86	15.89	16.67	17.68	14.60	15.38	15.41	16.19	17.20
4H	2H	12.71	13.64	13.50	14.43	15.40	12.37	13.30	13.15	14.09	15.06
	3H	14.60	15.38	15.40	16.20	17.19	14.21	14.98	15.00	15.81	16.79
	4H	15.33	16.03	16.14	16.85	17.87	14.92	15.62	15.73	16.45	17.46
	6H	15.85	16.47	16.68	17.31	18.33	15.44	16.06	16.27	16.90	17.92
	8H	16.01	16.58	16.84	17.42	18.46	15.60	16.17	16.43	17.01	18.04
	12H	16.10	16.61	16.95	17.47	18.51	15.67	16.19	16.52	17.05	18.09
8H	4H	15.54	16.11	16.37	16.95	17.99	15.18	15.75	16.01	16.59	17.63
	6H	16.18	16.66	17.04	17.54	18.57	15.82	16.29	16.68	17.18	18.21
	8H	16.41	16.83	17.28	17.71	18.76	16.04	16.46	16.91	17.34	18.39
	12H	16.55	16.92	17.42	17.79	18.90	16.17	16.54	17.04	17.41	18.51
12H	4H	15.54	16.05	16.39	16.92	17.95	15.19	15.70	16.04	16.56	17.60
	6H	16.22	16.64	17.09	17.52	18.57	15.86	16.28	16.73	17.16	18.21
	8H	16.47	16.84	17.34	17.71	18.82	16.11	16.48	16.99	17.35	18.46

END OF REPORT