

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P929058

Luminaire Tested: DFN2DIP-HX4F0-100D100US935-RLLONL

Issue Date: 12/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P929058
REPORT IS A COMBINATION OF REPORTS P900940 AND P896187
Test Lab: INNOVATION CENTER
Issue Date: 12/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-100D100US935-RLLONL
Description: 4 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15842.4 lumens
Efficiency: N/A
Efficacy: 90.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 175.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P929058

CATALOG NUMBER: DFN2DIP-HX4F0-100D100US935-RLLONL

Luminous Intensity Polar Plot

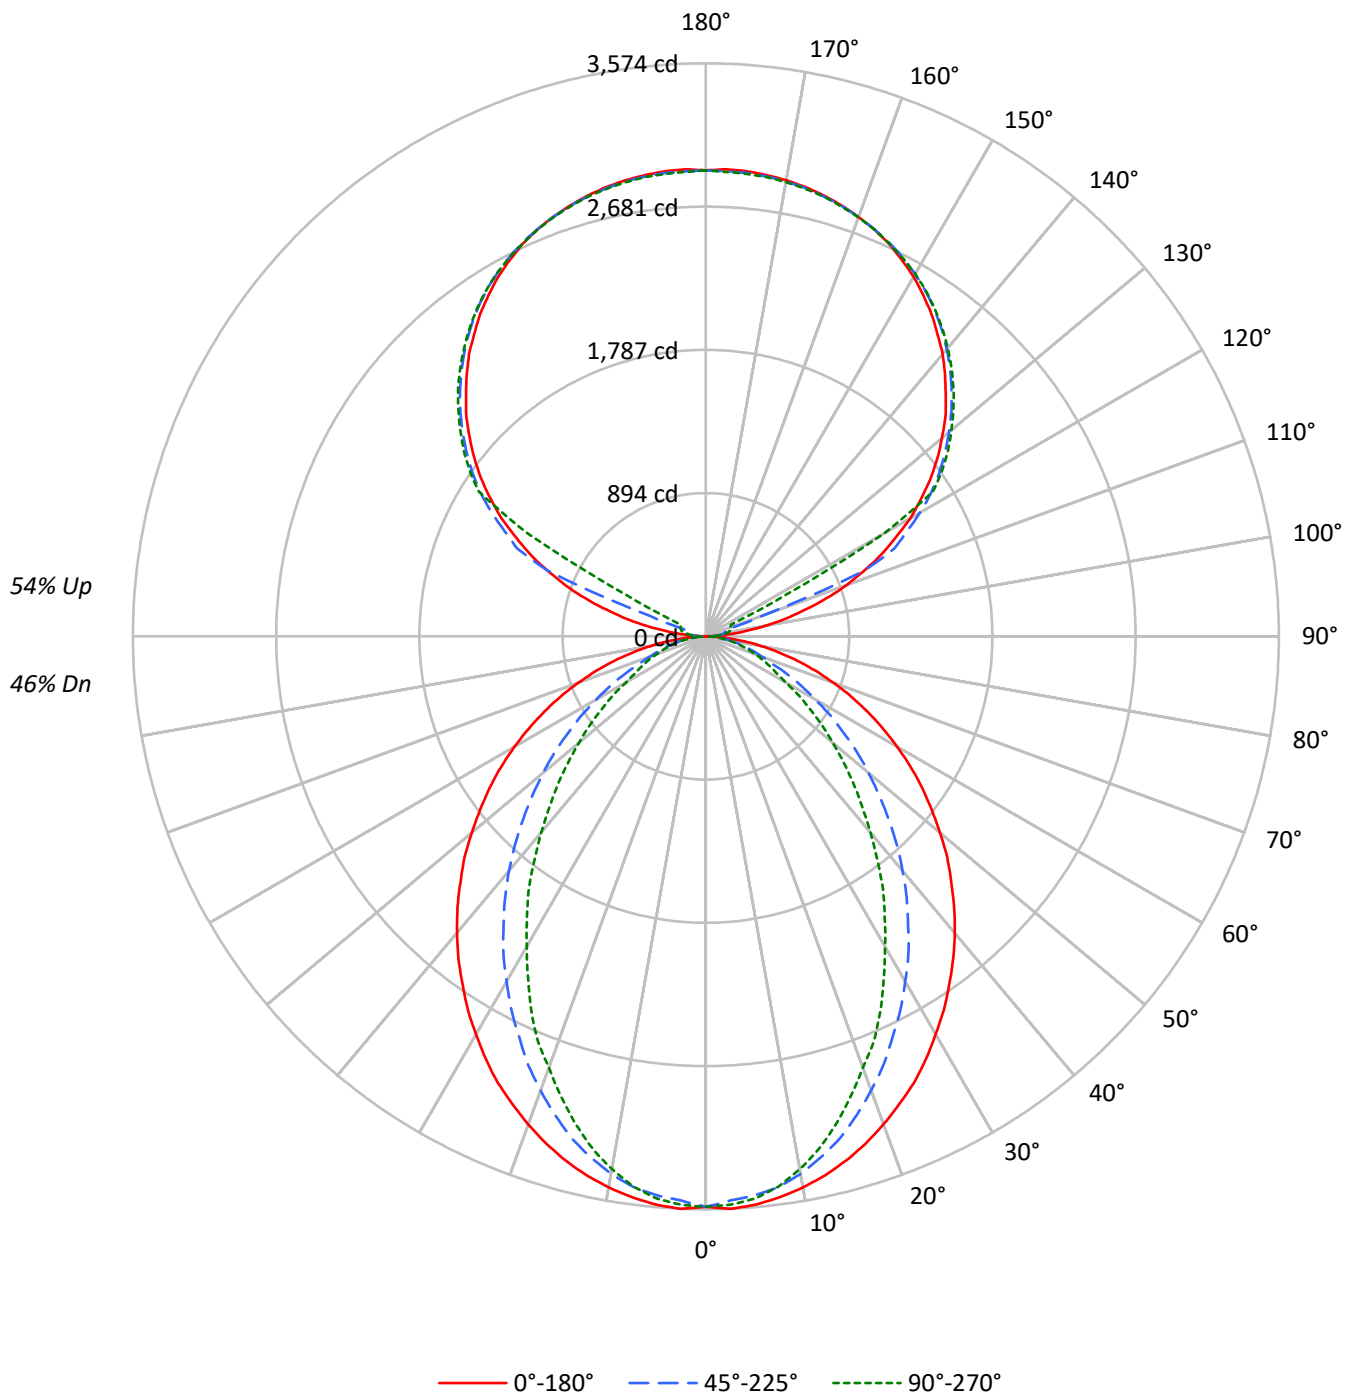

TEST NUMBER: P929058

CATALOG NUMBER: DFN2DIP-HX4F0-100D100US935-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53			46
1	97	93	90	86	89	86	83	80	72	70	68	59	58	56	47	46	45			40
2	89	82	76	71	82	76	70	66	63	60	57	52	50	48	42	40	39			34
3	81	72	65	60	75	67	61	56	56	52	48	47	43	41	38	35	34			29
4	75	64	57	51	68	60	53	48	50	45	41	42	38	35	34	31	29			26
5	69	58	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26			23
6	63	52	44	38	58	48	41	36	41	36	32	34	30	27	28	25	23			20
7	59	47	39	34	54	44	37	32	37	32	28	31	27	24	26	23	21			18
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	19			16
9	51	39	32	27	47	36	30	25	31	26	22	27	23	20	22	19	17			15
10	48	36	29	24	44	33	27	23	29	24	20	25	21	18	20	18	15			13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2646	2646	2646
5°	2650	2604	2621
10°	2624	2553	2536
15°	2588	2469	2404
20°	2541	2353	2242
25°	2492	2223	2086
30°	2427	2090	1888
35°	2362	1946	1714
40°	2297	1797	1515
45°	2221	1632	1334
50°	2143	1466	1157
55°	2061	1288	987
60°	1966	1102	813
65°	1857	913	732
70°	1725	736	663
75°	1560	650	603
80°	1320	546	523
85°	923	366	394

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2221 cd/sqm

TEST NUMBER: P929058

CATALOG NUMBER: DFN2DIP-HX4F0-100D100US935-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	333.5	2.1
10°-20°	915.5	5.8
20°-30°	1285.4	8.1
30°-40°	1401.2	8.8
40°-50°	1287.8	8.1
50°-60°	1011.4	6.4
60°-70°	658.3	4.2
70°-80°	338.9	2.1
80°-90°	91.6	0.6
90°-100°	95.8	0.6
100°-110°	357.2	2.3
110°-120°	947.3	6.0
120°-130°	1571.2	9.9
130°-140°	1669.0	10.5
140°-150°	1551.1	9.8
150°-160°	1247.1	7.9
160°-170°	803.6	5.1
170°-180°	276.6	1.7
0°-30°	2534.4	16.0
0°-40°	3935.6	24.8
0°-60°	6234.8	39.4
0°-90°	7323.6	46.2
90°-120°	1400.3	8.8
90°-150°	6191.6	39.1
90°-180°	8519.0	53.8
0°-180°	15842.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3558	3558	3558	3558	3558	
5°	3558	3542	3500	3530	3520	337
15°	3385	3349	3240	3179	3146	954
25°	3072	2969	2757	2625	2576	1413
35°	2647	2483	2200	1997	1926	1657
45°	2164	1948	1610	1381	1304	1671
55°	1646	1394	1046	854	792	1470
65°	1111	850	560	451	441	1102
75°	592	367	258	235	232	627
85°	138	71	61	61	61	159
90°	2	25	42	53	57	15
95°	137	67	82	93	90	162
105°	639	702	128	151	160	683
115°	1209	1245	1297	324	172	1190
125°	1709	1737	1777	1792	1798	1525
135°	2115	2149	2168	2189	2185	1634
145°	2454	2452	2487	2502	2492	1535
155°	2702	2683	2708	2721	2704	1245
165°	2847	2834	2841	2855	2841	804
175°	2912	2897	2902	2916	2895	277
180°	2906	2906	2906	2906	2906	

TEST NUMBER: P929058

CATALOG NUMBER: DFN2DIP-HX4F0-100D100US935-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3558.5	3558.5	3558.5	3558.5	3558.5
2.5°	3574.5	3558.5	3523.0	3555.4	3549.0
5°	3558.5	3542.4	3500.4	3529.5	3519.9
7.5°	3529.5	3510.3	3465.2	3477.8	3461.8
10°	3490.8	3468.3	3404.0	3394.1	3375.0
12.5°	3442.7	3413.6	3326.5	3307.4	3271.8
15°	3384.6	3349.0	3239.7	3178.6	3146.4
17.5°	3316.9	3265.3	3130.1	3059.3	3007.7
20°	3239.7	3175.1	3014.2	2933.9	2862.8
22.5°	3156.0	3081.9	2894.9	2785.7	2737.5
25°	3072.3	2969.2	2756.6	2624.7	2576.2
27.5°	2972.5	2862.8	2627.8	2476.4	2402.3
30°	2866.3	2743.6	2486.0	2322.0	2234.9
32.5°	2763.1	2614.8	2351.0	2157.7	2077.0
35°	2647.2	2483.0	2199.7	1996.7	1925.6
37.5°	2534.5	2357.2	2057.9	1835.5	1755.1
40°	2415.3	2222.2	1909.6	1681.0	1597.3
42.5°	2292.9	2086.9	1761.7	1523.2	1442.9
45°	2164.1	1948.2	1610.3	1381.4	1304.2
47.5°	2041.9	1813.3	1465.4	1236.5	1165.8
50°	1906.5	1677.9	1323.6	1101.2	1033.9
52.5°	1774.3	1532.8	1188.4	975.8	914.6
55°	1645.5	1394.4	1046.5	853.5	792.3
57.5°	1513.6	1255.9	921.2	740.7	689.1
60°	1378.3	1120.7	788.9	624.9	573.3
62.5°	1246.4	988.8	676.1	521.8	496.1
65°	1111.1	850.1	560.3	451.0	441.1
67.5°	982.3	721.3	451.0	396.0	386.4
70°	847.0	595.9	373.4	341.3	328.4
72.5°	718.2	479.7	312.3	286.6	280.2
75°	592.5	367.0	257.6	235.1	232.0
77.5°	467.1	260.7	202.9	189.9	183.5
80°	350.9	186.9	154.5	141.8	141.8
82.5°	244.6	125.7	106.2	99.8	99.8
85°	138.4	70.7	61.1	61.1	61.1
87.5°	51.6	25.7	25.7	22.6	22.6
90°	2.0	25.2	41.9	52.7	56.7
92.5°	52.7	44.2	50.5	54.7	56.7
95°	136.6	67.2	81.9	92.6	90.4
97.5°	245.9	73.6	107.1	113.6	115.6
100°	372.3	84.1	119.9	136.6	140.9
102.5°	510.8	506.9	124.1	147.1	153.5
105°	639.2	702.3	128.4	151.3	159.8
107.5°	788.5	840.9	132.6	155.6	164.0
110°	931.5	975.5	368.0	157.8	166.0

TEST NUMBER: P929058

CATALOG NUMBER: DFN2DIP-HX4F0-100D100US935-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1066.1	1103.8	1068.2	161.8	168.3
115°	1208.9	1244.7	1297.4	323.8	172.5
117.5°	1333.0	1375.0	1410.9	1110.1	559.3
120°	1471.9	1503.3	1541.3	1566.5	1282.6
122.5°	1589.5	1623.2	1665.3	1677.8	1680.1
125°	1709.3	1736.8	1776.8	1791.5	1797.7
127.5°	1818.7	1848.1	1879.8	1900.8	1902.8
130°	1921.8	1955.5	1978.5	2001.7	1999.7
132.5°	2026.9	2054.3	2077.3	2096.3	2094.3
135°	2115.3	2149.0	2167.7	2188.9	2184.7
137.5°	2207.7	2232.9	2254.1	2275.1	2268.8
140°	2298.0	2315.1	2338.0	2357.0	2346.5
142.5°	2373.9	2388.7	2415.9	2432.6	2422.2
145°	2453.8	2451.6	2487.3	2502.1	2491.6
147.5°	2523.0	2516.8	2552.4	2562.9	2554.8
150°	2590.4	2575.7	2609.4	2621.9	2611.4
152.5°	2647.1	2630.4	2661.9	2674.5	2659.8
155°	2701.8	2683.0	2708.3	2720.8	2704.1
157.5°	2746.0	2729.3	2748.2	2762.9	2746.0
160°	2784.0	2771.2	2784.0	2796.4	2781.7
162.5°	2817.4	2804.9	2815.4	2830.1	2811.2
165°	2846.8	2834.3	2840.6	2855.3	2840.6
167.5°	2870.1	2857.3	2863.9	2878.6	2859.6
170°	2889.0	2876.3	2880.6	2895.3	2876.3
172.5°	2901.5	2889.0	2893.3	2908.0	2889.0
175°	2912.0	2897.3	2901.5	2916.3	2895.3
177.5°	2916.3	2901.5	2903.8	2918.5	2899.5
180°	2905.8	2905.8	2905.8	2905.8	2905.8

TEST NUMBER: P929058

CATALOG NUMBER: DFN2DIP-HX4F0-100D100US935-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.17	10.97	11.16	11.97	13.29	6.14	6.94	7.13	7.94	9.27
	3H	11.84	12.56	12.85	13.57	14.92	7.33	8.04	8.33	9.05	10.40
	4H	12.45	13.13	13.47	14.14	15.50	7.78	8.45	8.80	9.47	10.82
	6H	12.87	13.49	13.90	14.51	15.88	8.10	8.72	9.13	9.74	11.11
	8H	13.00	13.59	14.03	14.62	15.99	8.19	8.78	9.22	9.82	11.18
	12H	13.06	13.62	14.10	14.65	16.04	8.23	8.79	9.27	9.82	11.21
4H	2H	10.18	10.86	11.21	11.87	13.23	6.73	7.41	7.76	8.42	9.78
	3H	12.01	12.57	13.04	13.61	14.98	8.08	8.64	9.11	9.69	11.05
	4H	12.70	13.21	13.74	14.25	15.64	8.63	9.14	9.67	10.18	11.57
	6H	13.21	13.66	14.26	14.71	16.10	9.05	9.49	10.10	10.55	11.94
	8H	13.39	13.80	14.44	14.85	16.26	9.18	9.59	10.23	10.64	12.04
	12H	13.48	13.86	14.55	14.92	16.33	9.24	9.61	10.31	10.68	12.09
8H	4H	12.67	13.08	13.72	14.13	15.53	8.91	9.32	9.96	10.37	11.77
	6H	13.23	13.57	14.31	14.67	16.07	9.43	9.77	10.50	10.86	12.26
	8H	13.45	13.75	14.53	14.83	16.24	9.62	9.92	10.70	10.99	12.41
	12H	13.59	13.85	14.67	14.92	16.38	9.74	10.00	10.82	11.07	12.53
12H	4H	12.62	12.99	13.68	14.05	15.46	8.91	9.28	9.98	10.35	11.76
	6H	13.21	13.51	14.29	14.58	16.00	9.48	9.78	10.56	10.85	12.27
	8H	13.43	13.69	14.51	14.76	16.22	9.69	9.95	10.77	11.02	12.48

END OF REPORT