

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P929064

Luminaire Tested: DFN2DIP-HX4F0-100D120US935-FLLONL

Issue Date: 12/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P929064
REPORT IS A COMBINATION OF REPORTS P900975 AND P896187
Test Lab: INNOVATION CENTER
Issue Date: 12/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-100D120US935-FLLONL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 18752.6 lumens
Efficiency: N/A
Efficacy: 96.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 195.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P929064
CATALOG NUMBER: DFN2DIP-HX4F0-100D120US935-FLLONL

Luminous Intensity Polar Plot

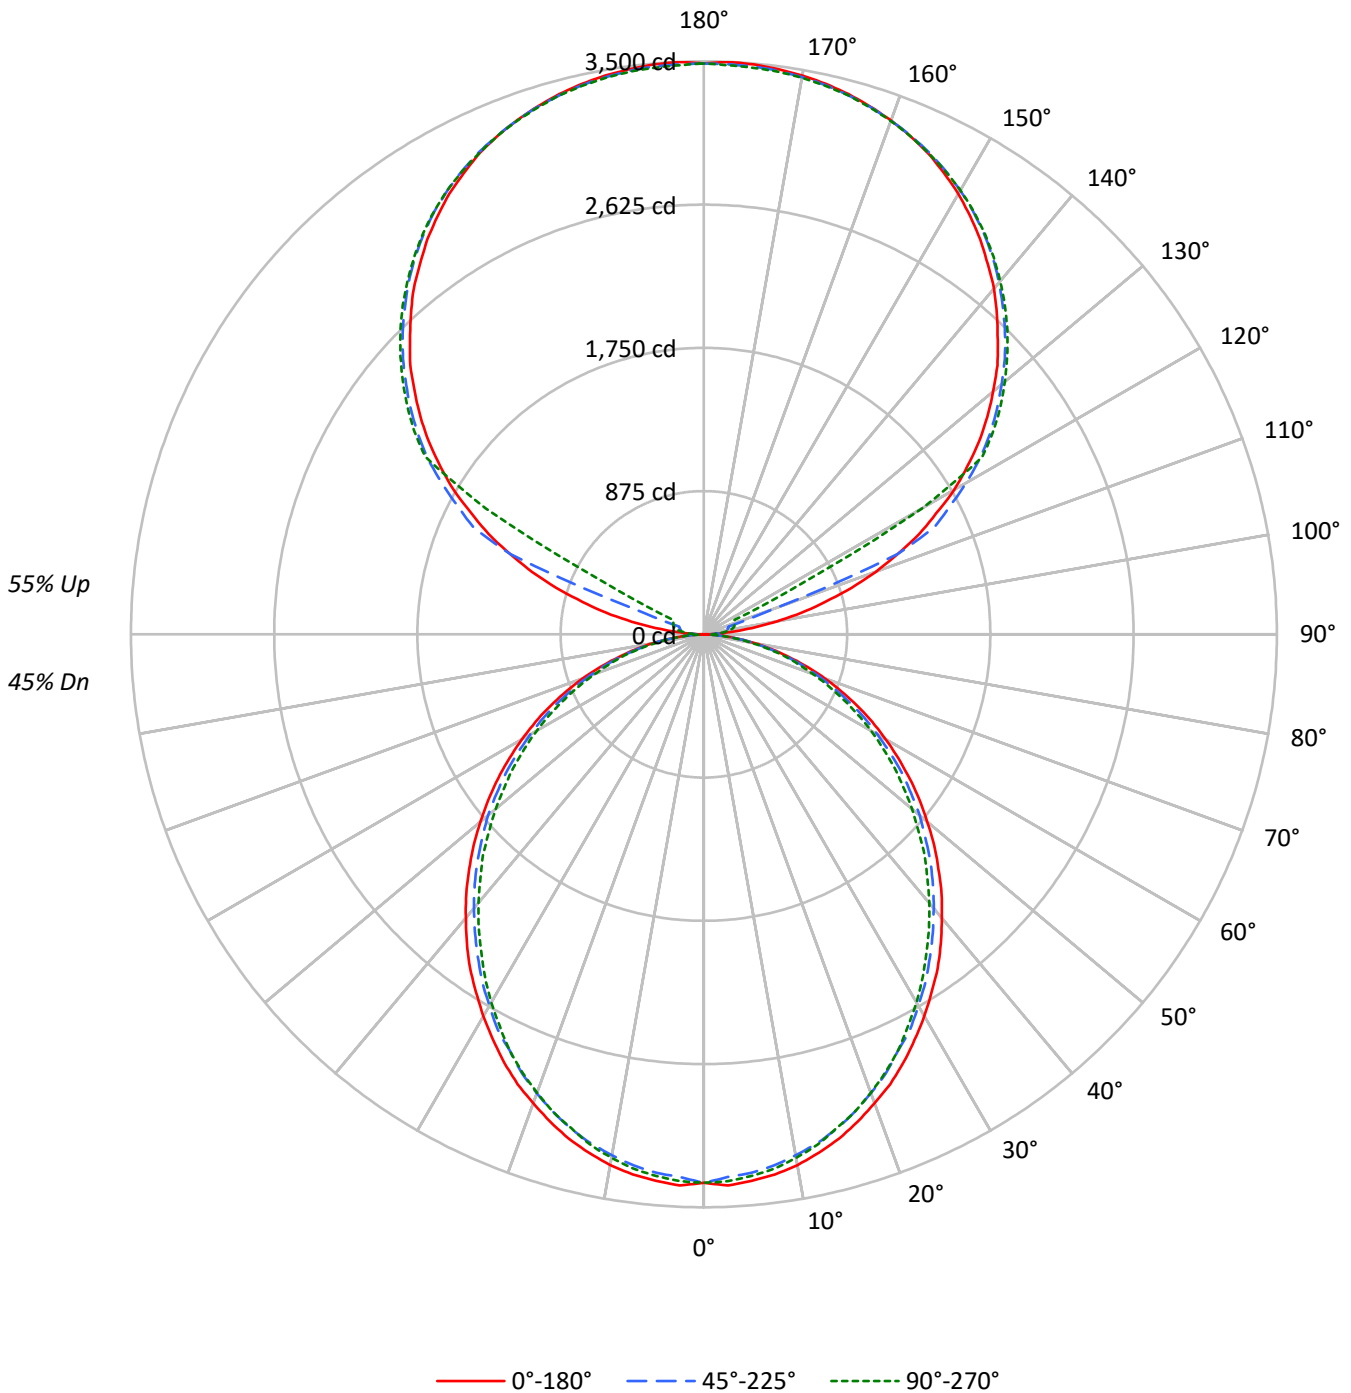



TEST NUMBER: P929064

CATALOG NUMBER: DFN2DIP-HX4F0-100D120US935-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	106	106	106	106	97	97	97	97	81	81	81	66	66	66	52	52	52	45	45	45	45
1	97	92	89	85	89	85	82	79	71	68	66	58	56	55	46	45	44	38	38	38	38
2	88	81	75	70	81	74	69	65	62	58	55	51	48	46	40	39	37	32	32	32	32
3	80	71	64	58	73	65	59	54	55	50	46	45	42	39	36	33	31	27	27	27	27
4	74	63	55	49	67	58	51	46	49	43	39	40	36	33	32	29	27	23	23	23	23
5	67	56	48	42	62	52	45	39	43	38	34	36	32	29	29	26	24	20	20	20	20
6	62	50	42	36	57	46	39	34	39	34	30	32	28	25	26	23	21	18	18	18	18
7	57	45	37	32	53	42	35	30	35	30	26	30	25	22	24	21	18	16	16	16	16
8	53	41	33	28	49	38	31	26	32	27	23	27	23	20	22	19	17	14	14	14	14
9	50	37	30	25	45	35	28	24	30	24	21	25	21	18	20	17	15	13	13	13	13
10	46	34	27	22	42	32	25	21	27	22	19	23	19	16	19	16	14	12	12	12	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2491	2491	2491
5°	2495	2457	2473
10°	2475	2424	2440
15°	2439	2384	2388
20°	2390	2329	2334
25°	2341	2263	2272
30°	2280	2201	2194
35°	2222	2129	2110
40°	2151	2056	2031
45°	2080	1982	1950
50°	2002	1905	1857
55°	1921	1816	1770
60°	1829	1710	1672
65°	1729	1601	1555
70°	1601	1467	1430
75°	1424	1308	1315
80°	1212	1104	1094
85°	879	753	728

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 2080 cd/sqm



TEST NUMBER: P929064

CATALOG NUMBER: DFN2DIP-HX4F0-100D120US935-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	315.3	1.7
10°-20°	887.2	4.7
20°-30°	1303.8	7.0
30°-40°	1514.3	8.1
40°-50°	1512.4	8.1
50°-60°	1318.8	7.0
60°-70°	974.9	5.2
70°-80°	551.6	2.9
80°-90°	151.7	0.8
90°-100°	115.0	0.6
100°-110°	428.6	2.3
110°-120°	1136.8	6.1
120°-130°	1885.4	10.1
130°-140°	2002.8	10.7
140°-150°	1861.3	9.9
150°-160°	1496.5	8.0
160°-170°	964.3	5.1
170°-180°	331.9	1.8
0°-30°	2506.3	13.4
0°-40°	4020.6	21.4
0°-60°	6851.8	36.5
0°-90°	8530.0	45.5
90°-120°	1680.4	9.0
90°-150°	7429.9	39.6
90°-180°	10223.0	54.5
0°-180°	18752.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3350	3350	3350	3350	3350	
5°	3350	3338	3302	3328	3322	318
15°	3189	3170	3128	3141	3125	898
25°	2886	2861	2806	2812	2806	1328
35°	2490	2458	2406	2387	2371	1555
45°	2026	2004	1955	1920	1907	1564
55°	1534	1514	1476	1437	1421	1371
65°	1034	1015	983	954	938	1023
75°	541	535	518	499	506	578
85°	132	129	126	116	113	147
90°	2	30	50	63	68	17
95°	164	81	98	111	108	194
105°	767	843	154	182	192	820
115°	1451	1494	1557	389	207	1428
125°	2051	2084	2132	2150	2157	1829
135°	2538	2579	2601	2627	2622	1961
145°	2945	2942	2985	3002	2990	1842
155°	3242	3220	3250	3265	3245	1494
165°	3416	3401	3409	3426	3409	965
175°	3494	3477	3482	3500	3474	333
180°	3487	3487	3487	3487	3487	



TEST NUMBER: P929064

CATALOG NUMBER: DFN2DIP-HX4F0-100D120US935-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3350.2	3350.2	3350.2	3350.2	3350.2
2.5°	3369.7	3353.6	3318.0	3350.2	3344.0
5°	3350.2	3337.6	3302.0	3327.7	3321.5
7.5°	3327.7	3308.5	3272.9	3298.9	3292.5
10°	3292.5	3269.9	3231.2	3256.9	3247.3
12.5°	3243.9	3224.8	3186.1	3202.2	3195.7
15°	3189.2	3170.1	3128.0	3141.0	3125.0
17.5°	3121.6	3102.4	3060.3	3076.4	3060.3
20°	3047.3	3028.2	2983.1	2992.7	2980.0
22.5°	2973.5	2944.5	2902.4	2902.4	2896.0
25°	2886.4	2860.8	2806.1	2812.2	2806.1
27.5°	2789.6	2767.1	2725.4	2715.9	2699.8
30°	2693.3	2667.3	2619.1	2609.5	2596.5
32.5°	2590.1	2570.9	2519.3	2499.8	2486.8
35°	2490.3	2458.2	2406.5	2387.0	2370.9
37.5°	2377.5	2348.4	2296.8	2274.2	2258.1
40°	2261.6	2235.6	2184.0	2155.3	2142.3
42.5°	2148.8	2122.8	2071.6	2039.1	2020.0
45°	2026.4	2003.9	1955.3	1920.1	1907.2
47.5°	1907.2	1884.6	1833.0	1797.4	1778.3
50°	1781.4	1765.3	1720.2	1675.1	1659.1
52.5°	1659.1	1636.5	1594.7	1559.3	1536.7
55°	1533.6	1514.2	1475.5	1436.8	1420.8
57.5°	1407.8	1391.7	1349.7	1311.1	1298.1
60°	1282.0	1269.4	1224.3	1188.7	1179.1
62.5°	1159.7	1137.1	1105.0	1072.9	1059.9
65°	1034.2	1014.8	982.7	953.6	937.5
67.5°	905.4	889.0	860.3	837.8	824.8
70°	786.1	773.1	744.1	721.5	708.9
72.5°	663.7	650.7	634.7	612.2	602.5
75°	541.1	534.9	518.5	499.4	505.8
77.5°	431.7	418.7	412.2	402.6	393.0
80°	322.3	318.9	312.4	302.8	296.4
82.5°	219.1	219.1	216.0	203.0	203.0
85°	131.9	128.9	125.8	115.9	112.8
87.5°	58.1	51.6	45.1	35.6	32.1
90°	2.4	30.2	50.4	63.2	68.0
92.5°	63.2	53.0	60.5	65.6	68.0
95°	163.8	80.6	98.2	111.2	108.5
97.5°	295.2	88.4	128.5	136.3	138.7
100°	446.7	101.0	143.8	163.8	169.0
102.5°	613.0	608.2	148.9	176.5	184.3
105°	767.0	842.8	154.0	181.6	191.7
107.5°	946.2	1009.1	159.1	186.7	196.8
110°	1117.8	1170.6	441.6	189.3	199.2



TEST NUMBER: P929064

CATALOG NUMBER: DFN2DIP-HX4F0-100D120US935-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1279.4	1324.6	1281.8	194.2	201.9
115°	1450.7	1493.6	1556.8	388.6	207.1
117.5°	1599.7	1650.0	1693.2	1332.1	671.1
120°	1766.3	1804.0	1849.5	1879.8	1539.1
122.5°	1907.4	1947.8	1998.5	2013.4	2016.1
125°	2051.2	2084.1	2132.1	2149.7	2157.2
127.5°	2182.4	2217.8	2255.8	2281.0	2283.4
130°	2306.1	2346.6	2374.1	2402.0	2399.6
132.5°	2432.2	2465.2	2492.8	2515.6	2513.2
135°	2538.3	2578.8	2601.3	2626.7	2621.7
137.5°	2649.2	2679.4	2704.9	2730.1	2722.6
140°	2757.7	2778.0	2805.6	2828.4	2815.8
142.5°	2848.7	2866.4	2899.1	2919.1	2906.6
145°	2944.6	2942.0	2984.7	3002.5	2989.8
147.5°	3027.6	3020.1	3063.0	3075.6	3065.7
150°	3108.5	3090.8	3131.3	3146.3	3133.7
152.5°	3176.5	3156.4	3194.2	3209.5	3191.8
155°	3242.1	3219.6	3249.9	3264.9	3244.9
157.5°	3295.1	3275.1	3297.9	3315.5	3295.1
160°	3340.7	3325.4	3340.7	3355.7	3338.0
162.5°	3380.9	3365.9	3378.5	3396.1	3373.4
165°	3416.2	3401.2	3408.7	3426.4	3408.7
167.5°	3444.1	3428.8	3436.6	3454.2	3431.5
170°	3466.8	3451.6	3456.7	3474.3	3451.6
172.5°	3481.8	3466.8	3472.0	3489.6	3466.8
175°	3494.4	3476.7	3481.8	3499.5	3474.3
177.5°	3499.5	3481.8	3484.6	3502.2	3479.5
180°	3487.0	3487.0	3487.0	3487.0	3487.0



TEST NUMBER: P929064
 CATALOG NUMBER: DFN2DIP-HX4F0-100D120US935-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.01	10.83	11.01	11.84	13.17	9.58	10.40	10.57	11.41	12.74
	3H	11.67	12.41	12.68	13.42	14.78	11.20	11.93	12.20	12.95	14.30
	4H	12.26	12.95	13.27	13.97	15.34	11.78	12.48	12.80	13.50	14.86
	6H	12.65	13.30	13.68	14.32	15.70	12.18	12.82	13.21	13.85	15.22
	8H	12.76	13.37	13.79	14.41	15.78	12.28	12.90	13.32	13.94	15.31
	12H	12.81	13.39	13.85	14.42	15.82	12.33	12.91	13.36	13.94	15.34
4H	2H	10.47	11.17	11.49	12.19	13.55	10.12	10.82	11.15	11.84	13.20
	3H	12.33	12.92	13.37	13.96	15.34	11.94	12.52	12.97	13.57	14.95
	4H	13.05	13.58	14.09	14.62	16.02	12.64	13.17	13.68	14.21	15.61
	6H	13.56	14.02	14.61	15.08	16.48	13.15	13.61	14.20	14.67	16.07
	8H	13.71	14.14	14.76	15.19	16.60	13.30	13.73	14.35	14.78	16.19
	12H	13.78	14.17	14.85	15.24	16.65	13.36	13.75	14.43	14.82	16.23
8H	4H	13.24	13.67	14.29	14.72	16.13	12.88	13.31	13.93	14.36	15.77
	6H	13.87	14.23	14.95	15.32	16.73	13.51	13.86	14.58	14.96	16.37
	8H	14.09	14.40	15.17	15.48	16.91	13.72	14.03	14.81	15.11	16.54
	12H	14.22	14.50	15.31	15.57	17.04	13.84	14.11	14.92	15.19	16.65
12H	4H	13.22	13.61	14.29	14.68	16.10	12.87	13.26	13.94	14.33	15.74
	6H	13.90	14.21	14.98	15.29	16.72	13.55	13.86	14.63	14.94	16.37
	8H	14.14	14.42	15.23	15.49	16.96	13.78	14.06	14.87	15.13	16.60