

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P929082

Luminaire Tested: DFN2DIP-HX4F0-110D070US935-RLLONL

Issue Date: 12/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P929082
REPORT IS A COMBINATION OF REPORTS P900888 AND P896187
Test Lab: INNOVATION CENTER
Issue Date: 12/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-110D070US935-RLLONL
Description: 4 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14017.1 lumens
Efficiency: N/A
Efficacy: 85.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 164.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9967
Total Harmonic Distortion (THDi): 0.063
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P929082

CATALOG NUMBER: DFN2DIP-HX4F0-110D070US935-RLLONL

Luminous Intensity Polar Plot

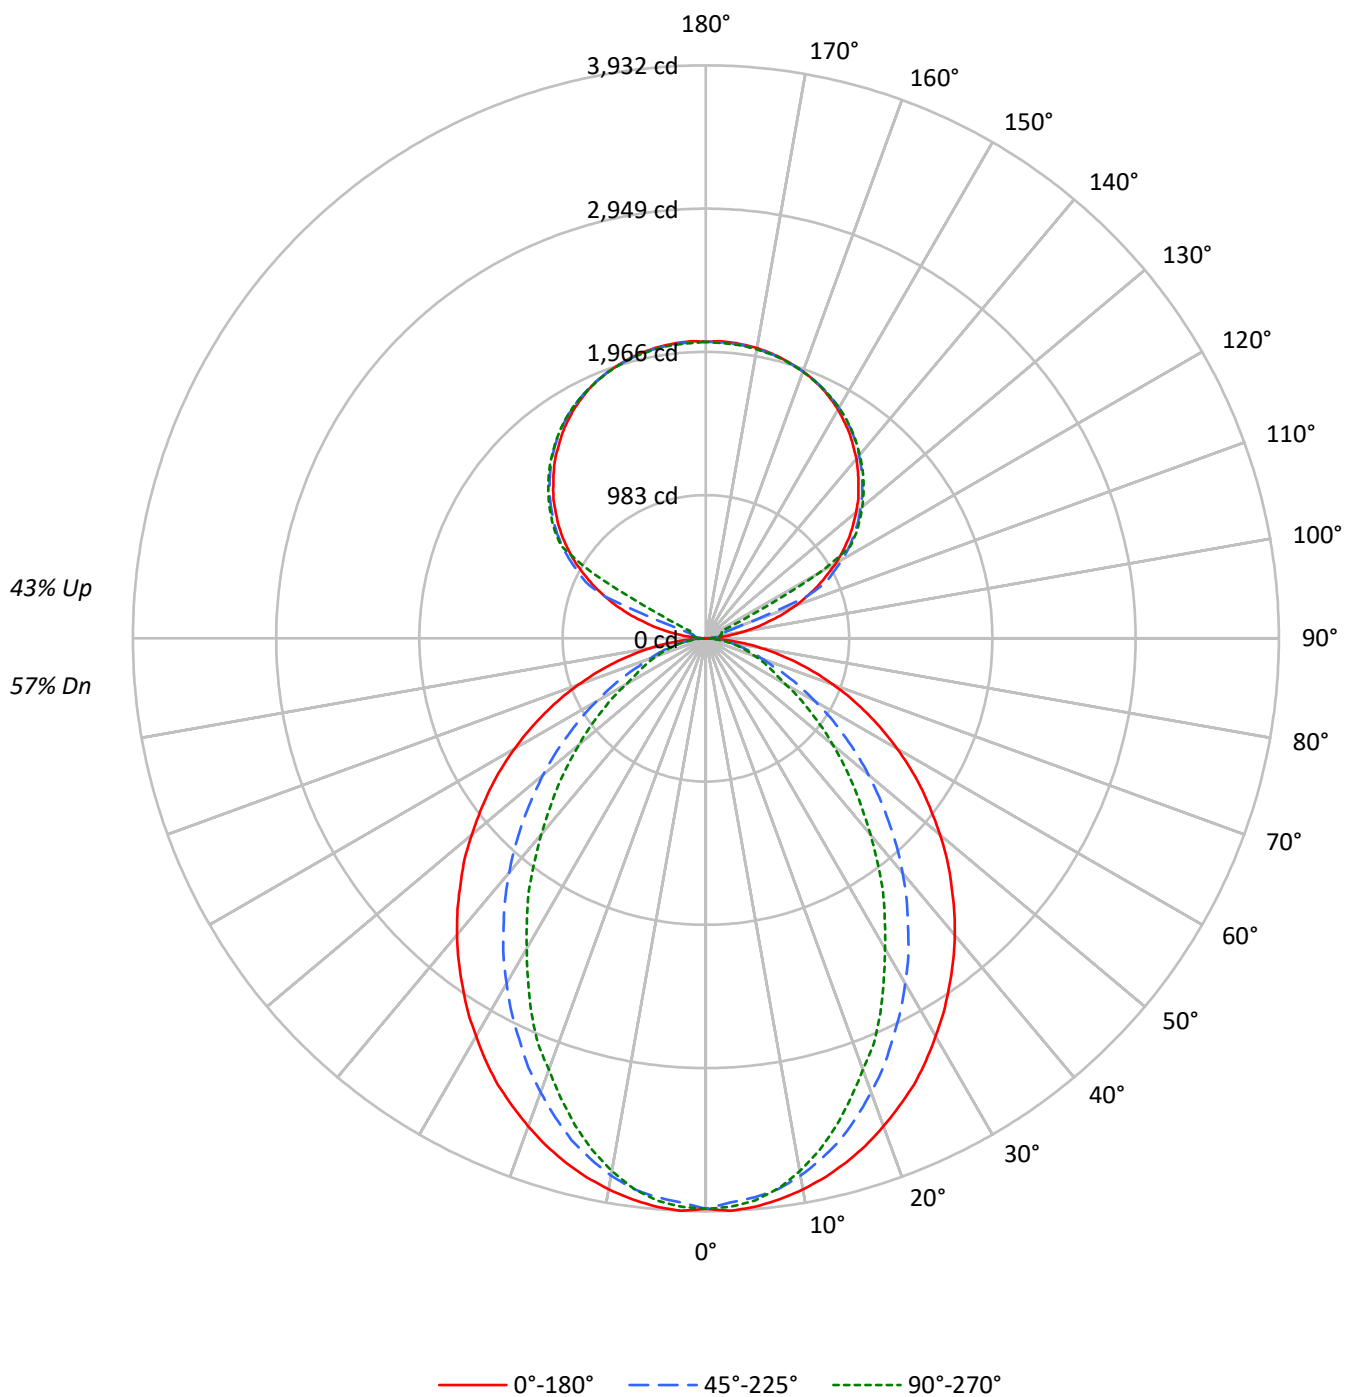

TEST NUMBER: P929082

CATALOG NUMBER: DFN2DIP-HX4F0-110D070US935-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20
RC	80					70					50					30					0
RW	70	50	30	10		70	50	30	10		50	30	10		50	30	10		50	30	10
RCR																					
0	109	109	109	109		101	101	101	101		87	87	87		75	75	75		63	63	63
1	100	96	92	89		93	89	86	83		78	75	73		67	65	63		57	55	54
2	92	84	78	73		85	79	74	69		69	65	61		59	56	54		50	48	47
3	84	75	68	62		78	70	64	59		61	56	52		53	49	46		45	43	40
4	77	66	59	53		72	62	56	50		55	49	45		47	43	40		41	38	35
5	71	60	52	46		66	56	49	44		49	44	39		43	39	35		37	34	31
6	66	54	46	40		61	51	43	38		45	39	35		39	35	31		34	30	28
7	61	49	41	35		57	46	39	34		41	35	31		36	31	28		31	27	25
8	57	44	37	32		53	42	35	30		37	32	28		33	28	25		29	25	22
9	53	41	33	28		49	38	32	27		34	29	25		30	26	23		27	23	20
10	49	37	30	26		46	35	29	25		32	26	23		28	24	21		25	21	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2911	2911	2911
5°	2915	2865	2883
10°	2887	2809	2789
15°	2847	2716	2644
20°	2795	2588	2466
25°	2741	2445	2295
30°	2669	2298	2077
35°	2599	2141	1885
40°	2527	1977	1666
45°	2444	1796	1467
50°	2357	1613	1273
55°	2267	1417	1086
60°	2163	1212	894
65°	2043	1004	805
70°	1898	810	729
75°	1716	715	663
80°	1452	601	576
85°	1015	402	433

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2444 cd/sqm

TEST NUMBER: P929082

CATALOG NUMBER: DFN2DIP-HX4F0-110D070US935-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	366.9	2.6
10°-20°	1007.1	7.2
20°-30°	1413.9	10.1
30°-40°	1541.3	11.0
40°-50°	1416.6	10.1
50°-60°	1112.5	7.9
60°-70°	724.2	5.2
70°-80°	372.8	2.7
80°-90°	98.7	0.7
90°-100°	67.1	0.5
100°-110°	250.0	1.8
110°-120°	663.1	4.7
120°-130°	1099.8	7.8
130°-140°	1168.3	8.3
140°-150°	1085.8	7.7
150°-160°	872.9	6.2
160°-170°	562.5	4.0
170°-180°	193.6	1.4
0°-30°	2787.9	19.9
0°-40°	4329.2	30.9
0°-60°	6858.3	48.9
0°-90°	8053.9	57.5
90°-120°	980.3	7.0
90°-150°	4334.1	30.9
90°-180°	5963.0	42.5
0°-180°	14017.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3914	3914	3914	3914	3914	
5°	3914	3897	3850	3882	3872	371
15°	3723	3684	3564	3496	3461	1049
25°	3380	3266	3032	2887	2834	1554
35°	2912	2731	2420	2196	2118	1823
45°	2381	2143	1771	1520	1435	1838
55°	1810	1534	1151	939	872	1617
65°	1222	935	616	496	485	1212
75°	652	404	283	259	255	689
85°	152	78	67	67	67	175
90°	1	18	29	37	40	13
95°	96	47	57	65	63	113
105°	448	492	90	106	112	478
115°	846	871	908	227	121	833
125°	1196	1216	1244	1254	1258	1067
135°	1481	1504	1517	1532	1529	1144
145°	1718	1716	1741	1751	1744	1074
155°	1891	1878	1896	1904	1893	872
165°	1993	1984	1988	1999	1988	563
175°	2038	2028	2031	2041	2027	194
180°	2034	2034	2034	2034	2034	

TEST NUMBER: P929082

CATALOG NUMBER: DFN2DIP-HX4F0-110D070US935-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3914.4	3914.4	3914.4	3914.4	3914.4
2.5°	3932.0	3914.4	3875.3	3911.0	3903.9
5°	3914.4	3896.7	3850.5	3882.4	3871.9
7.5°	3882.4	3861.3	3811.7	3825.7	3807.9
10°	3840.0	3815.1	3744.5	3733.6	3712.5
12.5°	3786.9	3755.0	3659.2	3638.1	3599.0
15°	3723.1	3684.0	3563.7	3496.4	3461.0
17.5°	3648.7	3591.9	3443.1	3365.2	3308.5
20°	3563.7	3492.6	3315.6	3227.3	3149.1
22.5°	3471.6	3390.0	3184.5	3064.2	3011.2
25°	3379.5	3266.0	3032.3	2887.2	2833.8
27.5°	3269.8	3149.1	2890.5	2724.0	2642.5
30°	3152.9	3018.0	2734.6	2554.2	2458.3
32.5°	3039.4	2876.3	2586.1	2373.4	2284.7
35°	2912.0	2731.2	2419.7	2196.4	2118.2
37.5°	2788.0	2592.9	2263.7	2019.0	1930.7
40°	2656.8	2444.5	2100.6	1849.1	1757.0
42.5°	2522.2	2295.6	1937.9	1675.5	1587.2
45°	2380.6	2143.0	1771.3	1519.5	1434.6
47.5°	2246.0	1994.6	1612.0	1360.1	1282.4
50°	2097.1	1845.7	1456.0	1211.3	1137.3
52.5°	1951.7	1686.0	1307.2	1073.4	1006.1
55°	1810.0	1533.8	1151.2	938.8	871.6
57.5°	1665.0	1381.6	1013.2	814.9	758.0
60°	1516.1	1232.8	867.8	687.4	630.7
62.5°	1371.1	1087.7	743.8	573.9	545.7
65°	1222.2	935.0	616.4	496.1	485.2
67.5°	1080.6	793.4	496.1	435.6	425.1
70°	931.7	655.5	410.8	375.5	361.2
72.5°	790.0	527.7	343.5	315.3	308.2
75°	651.7	403.6	283.4	258.6	255.2
77.5°	513.8	286.8	223.3	209.0	201.8
80°	386.0	205.6	169.9	156.0	156.0
82.5°	269.1	138.3	116.9	109.8	109.8
85°	152.2	77.8	67.2	67.2	67.2
87.5°	56.7	28.2	28.2	24.8	24.8
90°	1.4	17.7	29.4	36.9	39.7
92.5°	36.9	30.9	35.3	38.3	39.7
95°	95.6	47.0	57.3	64.8	63.3
97.5°	172.1	51.6	75.0	79.6	80.9
100°	260.6	58.9	83.9	95.6	98.6
102.5°	357.6	354.8	86.9	103.0	107.5
105°	447.5	491.6	89.8	105.9	111.8
107.5°	551.9	588.7	92.8	108.9	114.9
110°	652.1	682.9	257.6	110.5	116.2

TEST NUMBER: P929082

CATALOG NUMBER: DFN2DIP-HX4F0-110D070US935-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	746.3	772.7	747.7	113.2	117.8
115°	846.3	871.2	908.1	226.7	120.8
117.5°	933.2	962.5	987.7	777.1	391.5
120°	1030.3	1052.3	1078.9	1096.6	897.9
122.5°	1112.6	1136.2	1165.8	1174.5	1176.0
125°	1196.5	1215.7	1243.7	1254.0	1258.4
127.5°	1273.1	1293.7	1315.9	1330.6	1332.0
130°	1345.2	1368.8	1384.9	1401.2	1399.8
132.5°	1418.8	1438.0	1454.1	1467.4	1466.0
135°	1480.7	1504.3	1517.4	1532.2	1529.3
137.5°	1545.3	1563.1	1577.9	1592.6	1588.2
140°	1608.6	1620.5	1636.6	1649.8	1642.5
142.5°	1661.7	1672.1	1691.1	1702.8	1695.5
145°	1717.7	1716.1	1741.1	1751.4	1744.1
147.5°	1766.1	1761.8	1786.7	1794.1	1788.3
150°	1813.3	1803.0	1826.6	1835.3	1828.0
152.5°	1853.0	1841.2	1863.3	1872.2	1861.9
155°	1891.3	1878.1	1895.7	1904.5	1892.8
157.5°	1922.2	1910.5	1923.7	1934.1	1922.2
160°	1948.8	1939.8	1948.8	1957.5	1947.2
162.5°	1972.2	1963.4	1970.7	1981.1	1967.8
165°	1992.8	1984.1	1988.4	1998.7	1988.4
167.5°	2009.1	2000.1	2004.7	2015.0	2001.7
170°	2022.3	2013.4	2016.4	2026.7	2013.4
172.5°	2031.1	2022.3	2025.3	2035.6	2022.3
175°	2038.4	2028.1	2031.1	2041.3	2026.7
177.5°	2041.3	2031.1	2032.6	2043.0	2029.6
180°	2034.0	2034.0	2034.0	2034.0	2034.0

TEST NUMBER: P929082

CATALOG NUMBER: DFN2DIP-HX4F0-110D070US935-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.53	12.42	12.43	13.34	14.50	7.50	8.40	8.40	9.31	10.47
	3H	13.21	14.01	14.12	14.93	16.12	8.70	9.50	9.61	10.42	11.61
	4H	13.82	14.58	14.75	15.51	16.71	9.15	9.91	10.08	10.84	12.03
	6H	14.25	14.95	15.19	15.88	17.09	9.48	10.17	10.41	11.11	12.32
	8H	14.38	15.04	15.32	15.99	17.20	9.57	10.23	10.52	11.18	12.39
	12H	14.44	15.07	15.39	16.02	17.25	9.62	10.25	10.57	11.19	12.43
4H	2H	11.56	12.31	12.49	13.24	14.44	8.11	8.86	9.04	9.79	10.99
	3H	13.39	14.02	14.33	14.98	16.19	9.46	10.09	10.40	11.05	12.26
	4H	14.09	14.66	15.04	15.61	16.85	10.02	10.59	10.97	11.54	12.78
	6H	14.61	15.10	15.57	16.08	17.31	10.44	10.93	11.40	11.91	13.15
	8H	14.78	15.24	15.75	16.21	17.46	10.57	11.03	11.54	12.00	13.25
	12H	14.88	15.30	15.87	16.28	17.54	10.64	11.06	11.63	12.04	13.30
8H	4H	14.06	14.52	15.03	15.49	16.74	10.30	10.76	11.27	11.73	12.98
	6H	14.63	15.01	15.62	16.02	17.27	10.83	11.20	11.82	12.22	13.47
	8H	14.85	15.18	15.85	16.18	17.45	11.02	11.35	12.02	12.35	13.62
	12H	14.99	15.29	15.99	16.28	17.59	11.14	11.44	12.14	12.43	13.74
12H	4H	14.02	14.43	15.00	15.42	16.67	10.31	10.72	11.29	11.71	12.97
	6H	14.61	14.94	15.61	15.94	17.21	10.87	11.21	11.87	12.21	13.48
	8H	14.83	15.13	15.83	16.12	17.43	11.09	11.39	12.09	12.38	13.69