

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919193

Luminaire Tested: DFN2DIP-HX4F0-110D100US935-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919193
REPORT IS A COMBINATION OF REPORTS P899422 AND P896188
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-110D100US935-RLLFLL
Description: 4 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15670.2 lumens
Efficiency: N/A
Efficacy: 92.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 170
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9967
Total Harmonic Distortion (THDi): 0.063
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919193

CATALOG NUMBER: DFN2DIP-HX4F0-110D100US935-RLLFLL

Luminous Intensity Polar Plot

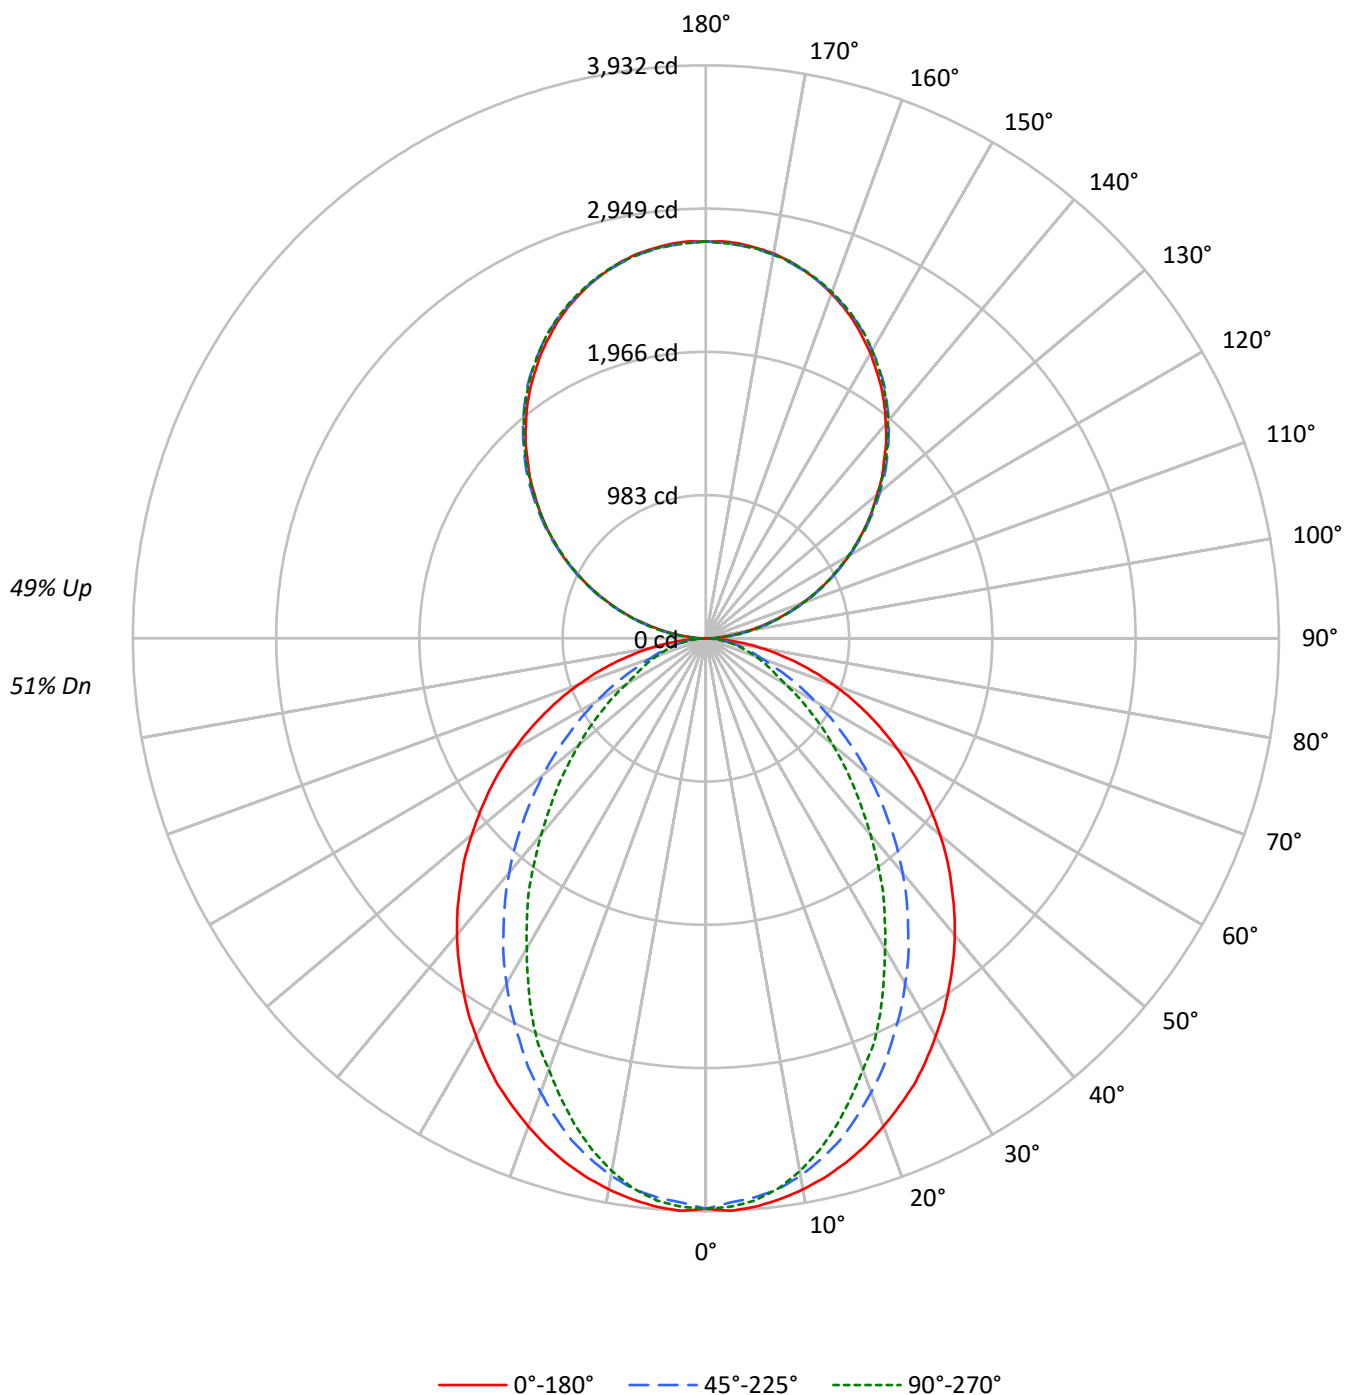

TEST NUMBER: P919193

CATALOG NUMBER: DFN2DIP-HX4F0-110D100US935-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	84	84	84	70	70	70	57	57	57
1	99	94	91	87	91	87	84	81	74	72	70	63	61	59	52	50	49
2	90	83	77	72	83	77	72	68	66	62	59	56	53	50	46	44	42
3	83	73	66	61	76	68	62	57	59	54	50	50	46	43	41	39	37
4	76	65	58	52	70	61	54	49	52	47	43	44	41	37	37	34	32
5	70	58	51	45	64	55	48	42	47	42	38	40	36	33	34	31	28
6	64	53	45	39	59	49	42	37	43	37	33	36	32	29	31	28	25
7	60	48	40	34	55	45	38	33	39	33	29	33	29	26	28	25	23
8	55	43	36	31	51	41	34	29	36	30	26	31	26	23	26	23	20
9	52	40	32	27	48	37	31	26	33	27	24	28	24	21	24	21	18
10	48	37	29	25	45	34	28	24	30	25	21	26	22	19	22	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2911	2911	2911
5°	2915	2865	2883
10°	2887	2809	2789
15°	2847	2716	2644
20°	2795	2588	2466
25°	2741	2445	2295
30°	2669	2298	2077
35°	2599	2141	1885
40°	2527	1977	1666
45°	2444	1796	1467
50°	2357	1613	1273
55°	2267	1417	1086
60°	2163	1212	894
65°	2043	1004	805
70°	1898	810	729
75°	1716	715	663
80°	1452	601	576
85°	1015	402	433

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2444 cd/sqm

TEST NUMBER: P919193

CATALOG NUMBER: DFN2DIP-HX4F0-110D100US935-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	366.9	2.3
10°-20°	1007.1	6.4
20°-30°	1413.9	9.0
30°-40°	1541.3	9.8
40°-50°	1416.6	9.0
50°-60°	1112.5	7.1
60°-70°	724.2	4.6
70°-80°	372.8	2.4
80°-90°	102.9	0.7
90°-100°	168.5	1.1
100°-110°	535.4	3.4
110°-120°	916.2	5.8
120°-130°	1204.9	7.7
130°-140°	1352.5	8.6
140°-150°	1326.3	8.5
150°-160°	1112.6	7.1
160°-170°	737.8	4.7
170°-180°	257.9	1.6
0°-30°	2787.9	17.8
0°-40°	4329.1	27.6
0°-60°	6858.3	43.8
0°-90°	8058.1	51.4
90°-120°	1620.1	10.3
90°-150°	5503.8	35.1
90°-180°	7612.0	48.6
0°-180°	15670.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3914	3914	3914	3914	3914	
5°	3914	3897	3850	3882	3872	371
15°	3723	3684	3564	3496	3461	1049
25°	3380	3266	3032	2887	2834	1554
35°	2912	2731	2420	2196	2118	1823
45°	2381	2143	1771	1520	1435	1838
55°	1810	1534	1151	939	872	1617
65°	1222	935	616	496	485	1212
75°	652	404	283	259	255	689
85°	152	78	67	67	67	175
90°	2	30	80	76	78	15
95°	120	143	147	147	143	133
105°	494	501	506	510	510	522
115°	920	932	928	926	920	909
125°	1337	1358	1351	1344	1341	1195
135°	1730	1755	1760	1758	1751	1337
145°	2100	2116	2130	2132	2123	1312
155°	2401	2408	2415	2427	2419	1105
165°	2612	2610	2610	2626	2615	737
175°	2718	2712	2707	2723	2709	258
180°	2723	2723	2723	2723	2723	

TEST NUMBER: P919193

CATALOG NUMBER: DFN2DIP-HX4F0-110D100US935-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3914.4	3914.4	3914.4	3914.4	3914.4
2.5°	3932.0	3914.4	3875.3	3911.0	3903.9
5°	3914.4	3896.7	3850.5	3882.4	3871.9
7.5°	3882.4	3861.3	3811.7	3825.7	3807.9
10°	3840.0	3815.1	3744.5	3733.5	3712.5
12.5°	3786.9	3755.0	3659.2	3638.1	3599.0
15°	3723.0	3684.0	3563.7	3496.4	3461.0
17.5°	3648.7	3591.9	3443.0	3365.2	3308.5
20°	3563.7	3492.6	3315.6	3227.3	3149.1
22.5°	3471.6	3390.0	3184.5	3064.2	3011.2
25°	3379.5	3266.0	3032.3	2887.2	2833.8
27.5°	3269.8	3149.1	2890.5	2724.0	2642.5
30°	3152.9	3018.0	2734.6	2554.2	2458.3
32.5°	3039.4	2876.2	2586.1	2373.4	2284.7
35°	2912.0	2731.2	2419.7	2196.4	2118.2
37.5°	2788.0	2592.9	2263.6	2019.0	1930.7
40°	2656.8	2444.5	2100.6	1849.1	1757.0
42.5°	2522.2	2295.6	1937.8	1675.5	1587.2
45°	2380.6	2143.0	1771.3	1519.5	1434.6
47.5°	2246.0	1994.6	1612.0	1360.1	1282.4
50°	2097.1	1845.7	1456.0	1211.3	1137.3
52.5°	1951.7	1686.0	1307.2	1073.4	1006.1
55°	1810.0	1533.8	1151.2	938.8	871.6
57.5°	1665.0	1381.6	1013.2	814.8	758.0
60°	1516.1	1232.8	867.8	687.4	630.7
62.5°	1371.1	1087.7	743.8	573.9	545.7
65°	1222.2	935.0	616.4	496.1	485.2
67.5°	1080.6	793.4	496.1	435.6	425.1
70°	931.7	655.5	410.8	375.5	361.2
72.5°	790.0	527.7	343.5	315.3	308.2
75°	651.7	403.6	283.4	258.6	255.2
77.5°	513.8	286.8	223.3	209.0	201.8
80°	386.0	205.6	169.9	156.0	156.0
82.5°	269.1	138.3	116.9	109.8	109.8
85°	152.2	77.8	67.2	67.2	67.2
87.5°	56.7	28.2	28.2	24.8	24.8
90°	2.5	29.5	80.4	75.5	78.0
92.5°	50.9	69.0	71.5	73.9	73.9
95°	119.9	142.8	147.0	147.0	142.8
97.5°	199.5	220.8	229.9	229.9	229.9
100°	291.4	310.3	316.8	316.8	314.4
102.5°	388.3	402.3	411.3	413.7	411.3
105°	494.2	500.8	505.7	509.8	509.8
107.5°	599.3	609.2	609.2	610.8	599.3
110°	701.1	714.2	714.2	714.2	707.7

TEST NUMBER: P919193

CATALOG NUMBER: DFN2DIP-HX4F0-110D100US935-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	811.1	825.0	822.6	816.0	811.1
115°	919.5	932.5	928.5	926.0	919.5
117.5°	1027.0	1045.1	1033.5	1027.0	1020.4
120°	1135.3	1153.4	1135.3	1135.3	1128.0
122.5°	1233.8	1256.8	1245.3	1238.8	1233.8
125°	1337.3	1357.8	1351.3	1343.8	1341.4
127.5°	1438.3	1463.7	1454.7	1444.8	1438.3
130°	1532.7	1562.2	1558.1	1553.2	1544.2
132.5°	1638.6	1661.6	1663.2	1651.7	1645.1
135°	1729.7	1755.1	1760.1	1757.6	1751.0
137.5°	1831.5	1852.0	1856.1	1854.5	1844.6
140°	1921.0	1941.5	1953.0	1953.0	1944.0
142.5°	2012.9	2033.4	2040.0	2042.5	2033.4
145°	2099.9	2116.3	2129.5	2131.9	2122.9
147.5°	2177.9	2198.5	2208.3	2212.4	2203.4
150°	2258.4	2272.3	2281.4	2288.7	2281.4
152.5°	2329.8	2343.7	2355.3	2364.3	2355.3
155°	2401.2	2407.8	2415.2	2426.6	2419.2
157.5°	2462.8	2467.7	2471.8	2488.2	2476.7
160°	2517.8	2522.7	2525.1	2539.1	2529.3
162.5°	2568.7	2568.7	2571.1	2586.7	2575.2
165°	2612.2	2609.7	2609.7	2626.1	2614.7
167.5°	2651.6	2644.2	2644.2	2660.7	2649.1
170°	2681.1	2674.6	2672.1	2688.6	2674.6
172.5°	2701.6	2695.1	2692.6	2709.0	2695.1
175°	2718.1	2711.5	2706.6	2723.0	2709.0
177.5°	2727.1	2720.6	2715.6	2729.5	2715.6
180°	2723.0	2723.0	2723.0	2723.0	2723.0

TEST NUMBER: P919193

CATALOG NUMBER: DFN2DIP-HX4F0-110D100US935-RLFL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.99	11.83	11.94	12.80	14.05	6.96	7.81	7.92	8.77	10.02
	3H	12.67	13.42	13.63	14.40	15.67	8.15	8.91	9.12	9.88	11.16
	4H	13.28	13.99	14.26	14.97	16.25	8.61	9.32	9.58	10.29	11.58
	6H	13.70	14.36	14.69	15.34	16.64	8.93	9.59	9.92	10.57	11.86
	8H	13.83	14.45	14.82	15.45	16.75	9.02	9.65	10.02	10.64	11.94
	12H	13.89	14.48	14.89	15.48	16.79	9.07	9.66	10.07	10.65	11.97
4H	2H	11.01	11.72	11.99	12.70	13.98	7.56	8.27	8.54	9.25	10.53
	3H	12.84	13.43	13.83	14.44	15.74	8.91	9.51	9.91	10.51	11.81
	4H	13.54	14.08	14.54	15.07	16.40	9.46	10.00	10.46	11.00	12.33
	6H	14.05	14.52	15.06	15.54	16.86	9.89	10.35	10.90	11.37	12.69
	8H	14.23	14.66	15.24	15.68	17.01	10.02	10.45	11.03	11.47	12.80
	12H	14.32	14.72	15.36	15.75	17.09	10.08	10.47	11.11	11.50	12.84
8H	4H	13.50	13.94	14.52	14.95	16.29	9.75	10.18	10.76	11.19	12.53
	6H	14.07	14.43	15.11	15.49	16.82	10.27	10.62	11.30	11.68	13.01
	8H	14.29	14.60	15.33	15.65	17.00	10.46	10.77	11.50	11.82	13.17
	12H	14.43	14.71	15.48	15.74	17.14	10.58	10.86	11.63	11.90	13.29
12H	4H	13.46	13.85	14.49	14.88	16.22	9.75	10.14	10.78	11.17	12.51
	6H	14.05	14.36	15.09	15.41	16.76	10.32	10.63	11.36	11.68	13.03
	8H	14.27	14.55	15.32	15.58	16.98	10.53	10.81	11.58	11.84	13.24

END OF REPORT