

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P921800

Luminaire Tested: DFN2DIP-HX4F0-050D040US940-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P921800
REPORT IS A COMBINATION OF REPORTS P899301 AND P896188
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-050D040US940-FLLFLL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7570.7 lumens
Efficiency: N/A
Efficacy: 112.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 67.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P921800

CATALOG NUMBER: DFN2DIP-HX4F0-050D040US940-FLLFLL

Luminous Intensity Polar Plot

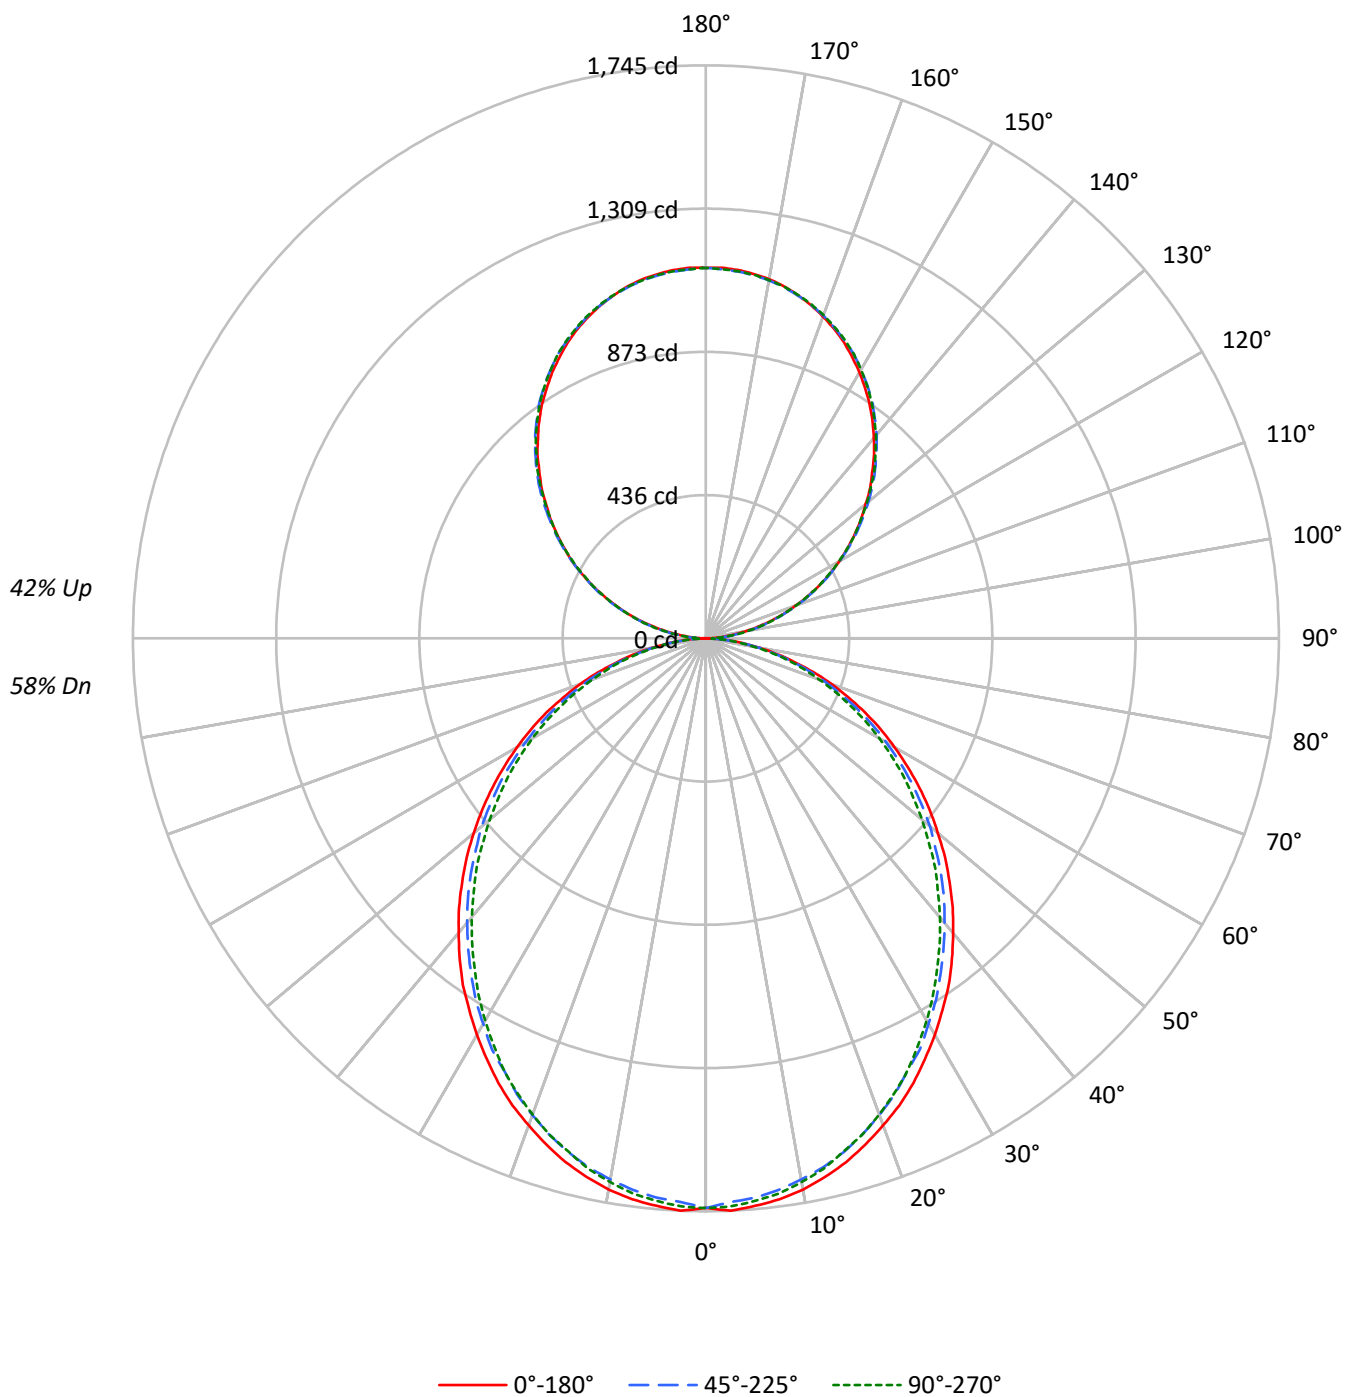

TEST NUMBER: P921800

CATALOG NUMBER: DFN2DIP-HX4F0-050D040US940-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	102	102	102	102	88	88	88	75	75	75	64	64	64
1	100	95	91	88	93	89	86	82	77	75	72	66	65	63	56	55	54
2	91	83	77	72	84	78	72	68	68	64	60	58	55	52	50	47	45
3	83	73	66	60	77	69	62	57	60	55	50	52	48	44	44	41	39
4	76	65	57	51	70	61	54	48	53	47	43	46	42	38	39	36	33
5	70	58	50	43	65	54	47	41	48	42	37	41	37	33	35	32	29
6	64	52	44	38	60	49	41	36	43	37	32	37	33	29	32	29	26
7	59	47	39	33	55	44	37	32	39	33	29	34	29	26	29	26	23
8	55	43	35	29	51	40	33	28	36	30	26	31	26	23	27	23	20
9	51	39	31	26	48	37	30	25	33	27	23	29	24	21	25	21	18
10	48	36	28	24	45	34	27	23	30	25	21	27	22	19	23	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1290	1290	1290
5°	1292	1272	1281
10°	1282	1255	1263
15°	1263	1235	1236
20°	1238	1206	1209
25°	1212	1172	1177
30°	1181	1140	1136
35°	1151	1102	1093
40°	1114	1065	1052
45°	1077	1026	1010
50°	1037	987	961
55°	995	940	917
60°	947	886	866
65°	895	829	805
70°	829	760	741
75°	738	677	681
80°	628	572	567
85°	455	389	377

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1077 cd/sqm

TEST NUMBER: P921800

CATALOG NUMBER: DFN2DIP-HX4F0-050D040US940-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	163.3	2.2
10°-20°	459.4	6.1
20°-30°	675.2	8.9
30°-40°	784.2	10.4
40°-50°	783.2	10.3
50°-60°	682.9	9.0
60°-70°	504.8	6.7
70°-80°	285.6	3.8
80°-90°	78.6	1.0
90°-100°	69.8	0.9
100°-110°	221.8	2.9
110°-120°	379.5	5.0
120°-130°	499.2	6.6
130°-140°	560.3	7.4
140°-150°	549.4	7.3
150°-160°	460.9	6.1
160°-170°	305.7	4.0
170°-180°	106.8	1.4
0°-30°	1297.9	17.1
0°-40°	2082.0	27.5
0°-60°	3548.1	46.9
0°-90°	4417.2	58.3
90°-120°	671.2	8.9
90°-150°	2280.1	30.1
90°-180°	3153.0	41.6
0°-180°	7570.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1735	1735	1735	1735	1735	
5°	1735	1728	1710	1723	1720	165
15°	1651	1642	1620	1627	1618	465
25°	1495	1481	1453	1456	1453	688
35°	1290	1273	1246	1236	1228	805
45°	1049	1038	1012	994	988	810
55°	794	784	764	744	736	710
65°	536	526	509	494	485	530
75°	280	277	268	259	262	299
85°	68	67	65	60	58	76
90°	1	12	33	31	32	7
95°	50	59	61	61	59	55
105°	205	207	210	211	211	216
115°	381	386	385	384	381	377
125°	554	562	560	557	556	495
135°	717	727	729	728	725	554
145°	870	877	882	883	880	544
155°	995	998	1000	1005	1002	458
165°	1082	1081	1081	1088	1083	305
175°	1126	1123	1121	1128	1122	107
180°	1128	1128	1128	1128	1128	

TEST NUMBER: P921800

CATALOG NUMBER: DFN2DIP-HX4F0-050D040US940-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1734.8	1734.8	1734.8	1734.8	1734.8
2.5°	1744.9	1736.6	1718.2	1734.8	1731.7
5°	1734.8	1728.3	1709.9	1723.1	1720.0
7.5°	1723.1	1713.2	1694.9	1708.3	1705.0
10°	1705.0	1693.3	1673.3	1686.5	1681.6
12.5°	1679.8	1669.9	1649.9	1658.2	1654.8
15°	1651.4	1641.5	1619.8	1626.6	1618.2
17.5°	1616.4	1606.5	1584.7	1593.0	1584.7
20°	1578.1	1568.2	1544.8	1549.7	1543.2
22.5°	1539.8	1524.7	1503.0	1503.0	1499.6
25°	1494.7	1481.4	1453.0	1456.3	1453.0
27.5°	1444.6	1432.9	1411.3	1406.3	1398.0
30°	1394.6	1381.3	1356.3	1351.3	1344.6
32.5°	1341.2	1331.3	1304.6	1294.5	1287.8
35°	1289.5	1272.9	1246.2	1236.1	1227.8
37.5°	1231.1	1216.1	1189.4	1177.7	1169.4
40°	1171.2	1157.7	1131.0	1116.1	1109.4
42.5°	1112.8	1099.3	1072.7	1055.9	1046.0
45°	1049.4	1037.7	1012.5	994.3	987.6
47.5°	987.6	975.9	949.2	930.8	920.9
50°	922.5	914.2	890.8	867.5	859.1
52.5°	859.1	847.4	825.8	807.4	795.8
55°	794.2	784.1	764.0	744.0	735.8
57.5°	729.0	720.7	698.9	678.9	672.2
60°	663.9	657.4	634.0	615.5	610.6
62.5°	600.6	588.9	572.2	555.5	548.8
65°	535.6	525.5	508.8	493.8	485.4
67.5°	468.9	460.4	445.5	433.8	427.0
70°	407.1	400.4	385.3	373.6	367.1
72.5°	343.8	337.0	328.7	317.0	312.0
75°	280.2	277.0	268.5	258.6	262.0
77.5°	223.6	216.8	213.5	208.5	203.6
80°	166.9	165.1	161.8	156.9	153.5
82.5°	113.4	113.4	111.8	105.1	105.1
85°	68.3	66.7	65.1	60.0	58.4
87.5°	30.1	26.8	23.4	18.4	16.7
90°	1.0	12.2	33.3	31.3	32.3
92.5°	21.0	28.5	29.6	30.6	30.6
95°	49.7	59.2	60.9	60.9	59.2
97.5°	82.7	91.5	95.2	95.2	95.2
100°	120.7	128.6	131.3	131.3	130.3
102.5°	160.9	166.7	170.4	171.4	170.4
105°	204.7	207.4	209.5	211.2	211.2
107.5°	248.3	252.4	252.4	253.0	248.3
110°	290.4	295.9	295.9	295.9	293.2

TEST NUMBER: P921800

CATALOG NUMBER: DFN2DIP-HX4F0-050D040US940-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	336.0	341.8	340.7	338.0	336.0
115°	380.8	386.4	384.6	383.6	380.8
117.5°	425.4	432.9	428.2	425.4	422.8
120°	470.4	477.8	470.4	470.4	467.3
122.5°	511.1	520.7	515.9	513.2	511.1
125°	554.0	562.5	559.8	556.7	555.7
127.5°	595.8	606.4	602.6	598.5	595.8
130°	634.9	647.2	645.5	643.5	639.7
132.5°	678.8	688.3	689.0	684.2	681.5
135°	716.6	727.1	729.2	728.1	725.4
137.5°	758.8	767.2	768.9	768.2	764.2
140°	795.8	804.3	809.0	809.0	805.3
142.5°	833.9	842.4	845.1	846.1	842.4
145°	870.0	876.7	882.2	883.2	879.5
147.5°	902.2	910.7	914.8	916.5	912.8
150°	935.6	941.4	945.1	948.2	945.1
152.5°	965.2	970.9	975.7	979.5	975.7
155°	994.7	997.5	1000.5	1005.3	1002.2
157.5°	1020.3	1022.3	1024.0	1030.8	1026.0
160°	1043.0	1045.1	1046.1	1051.9	1047.8
162.5°	1064.1	1064.1	1065.1	1071.6	1066.8
165°	1082.2	1081.1	1081.1	1087.9	1083.2
167.5°	1098.5	1095.4	1095.4	1102.2	1097.4
170°	1110.7	1108.0	1107.0	1113.7	1108.0
172.5°	1119.2	1116.5	1115.4	1122.3	1116.5
175°	1126.1	1123.3	1121.2	1128.0	1122.3
177.5°	1129.8	1127.0	1125.0	1130.8	1125.0
180°	1128.0	1128.0	1128.0	1128.0	1128.0

TEST NUMBER: P921800

CATALOG NUMBER: DFN2DIP-HX4F0-050D040US940-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.89	9.83	9.77	10.74	11.88	8.46	9.40	9.34	10.31	11.45
	3H	10.56	11.41	11.45	12.32	13.49	10.09	10.93	10.98	11.84	13.02
	4H	11.15	11.95	12.06	12.87	14.05	10.68	11.48	11.59	12.40	13.58
	6H	11.56	12.29	12.48	13.22	14.41	11.08	11.82	12.00	12.74	13.94
	8H	11.66	12.37	12.59	13.31	14.50	11.19	11.89	12.12	12.83	14.03
	12H	11.72	12.38	12.65	13.32	14.54	11.23	11.90	12.17	12.84	14.06
4H	2H	9.36	10.16	10.28	11.08	12.26	9.02	9.82	9.93	10.74	11.92
	3H	11.24	11.91	12.16	12.86	14.05	10.85	11.51	11.77	12.46	13.66
	4H	11.96	12.57	12.89	13.51	14.73	11.55	12.16	12.49	13.10	14.33
	6H	12.48	13.00	13.43	13.97	15.19	12.07	12.59	13.02	13.56	14.78
	8H	12.63	13.12	13.58	14.08	15.32	12.22	12.71	13.17	13.67	14.91
	12H	12.71	13.15	13.68	14.13	15.37	12.29	12.73	13.26	13.71	14.95
8H	4H	12.16	12.65	13.11	13.61	14.85	11.80	12.29	12.75	13.25	14.49
	6H	12.80	13.20	13.78	14.21	15.44	12.43	12.84	13.41	13.84	15.08
	8H	13.02	13.38	14.01	14.37	15.62	12.65	13.01	13.64	14.00	15.25
	12H	13.16	13.47	14.15	14.46	15.76	12.77	13.09	13.76	14.07	15.37
12H	4H	12.15	12.59	13.12	13.57	14.81	11.80	12.24	12.77	13.22	14.46
	6H	12.83	13.19	13.82	14.18	15.43	12.48	12.84	13.46	13.83	15.08
	8H	13.08	13.39	14.07	14.38	15.68	12.72	13.03	13.71	14.02	15.32

END OF REPORT