

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P929192

Luminaire Tested: DFN2DIP-HX4F0-050D080US940-FLLONL

Issue Date: 12/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P929192
REPORT IS A COMBINATION OF REPORTS P900893 AND P896187
Test Lab: INNOVATION CENTER
Issue Date: 12/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-050D080US940-FLLONL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11480.0 lumens
Efficiency: N/A
Efficacy: 112.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 102
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P929192

CATALOG NUMBER: DFN2DIP-HX4F0-050D080US940-FLLONL

Luminous Intensity Polar Plot

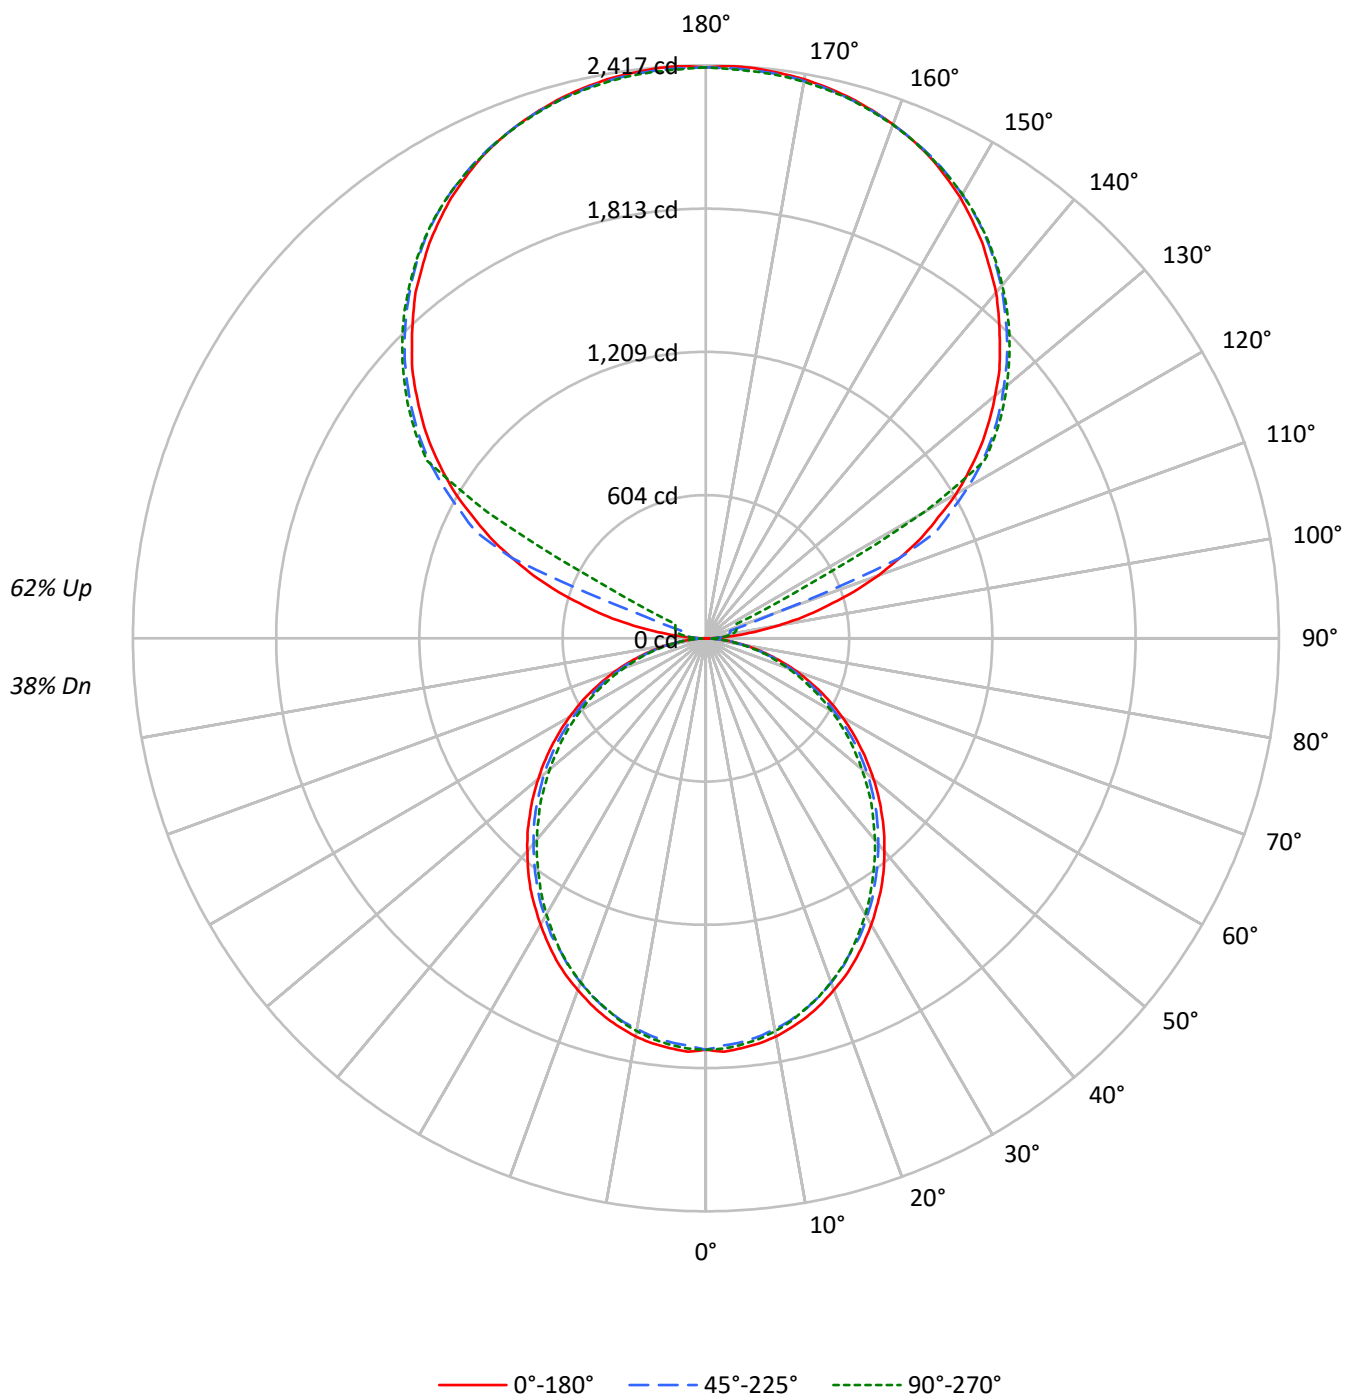

TEST NUMBER: P929192

CATALOG NUMBER: DFN2DIP-HX4F0-050D080US940-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	95	95	95	95	77	77	77	61	61	61	46	46	46
1	95	91	87	84	86	83	80	77	67	65	63	53	52	50	40	39	38
2	87	79	73	68	78	72	67	63	59	55	52	47	44	42	35	34	32
3	79	70	63	57	71	64	57	52	52	48	44	41	38	36	31	29	28
4	72	62	54	48	65	56	50	44	46	41	37	37	33	30	28	26	24
5	66	55	47	41	60	50	43	38	41	36	32	33	29	26	25	23	21
6	61	49	41	36	55	45	38	33	37	32	28	30	26	23	23	20	18
7	56	44	36	31	51	41	34	29	34	28	25	27	23	20	21	18	16
8	52	40	33	27	47	37	30	25	31	25	22	25	21	18	19	16	14
9	49	37	29	24	44	34	27	23	28	23	19	23	19	16	18	15	13
10	45	33	26	22	41	31	25	20	26	21	17	21	17	15	16	14	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1290	1290	1290
5°	1293	1273	1281
10°	1282	1256	1264
15°	1263	1235	1237
20°	1238	1206	1209
25°	1213	1172	1177
30°	1181	1140	1136
35°	1151	1103	1093
40°	1114	1065	1052
45°	1077	1027	1010
50°	1037	987	962
55°	995	941	917
60°	947	886	866
65°	896	829	806
70°	830	760	741
75°	738	677	681
80°	628	572	567
85°	455	389	377

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1237 cd/sqm

TEST NUMBER: P929192

CATALOG NUMBER: DFN2DIP-HX4F0-050D080US940-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	163.3	1.4
10°-20°	459.6	4.0
20°-30°	675.4	5.9
30°-40°	784.4	6.8
40°-50°	783.4	6.8
50°-60°	683.1	6.0
60°-70°	505.0	4.4
70°-80°	285.7	2.5
80°-90°	79.7	0.7
90°-100°	79.4	0.7
100°-110°	296.0	2.6
110°-120°	785.1	6.8
120°-130°	1302.2	11.3
130°-140°	1383.2	12.0
140°-150°	1285.6	11.2
150°-160°	1033.6	9.0
160°-170°	666.0	5.8
170°-180°	229.2	2.0
0°-30°	1298.3	11.3
0°-40°	2082.7	18.1
0°-60°	3549.3	30.9
0°-90°	4419.7	38.5
90°-120°	1160.6	10.1
90°-150°	5131.6	44.7
90°-180°	7060.0	61.5
0°-180°	11480.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1735	1735	1735	1735	1735	
5°	1735	1729	1710	1724	1721	165
15°	1652	1642	1620	1627	1619	465
25°	1495	1482	1454	1457	1454	688
35°	1290	1273	1247	1236	1228	806
45°	1050	1038	1013	995	988	810
55°	794	784	764	744	736	710
65°	536	526	509	494	486	530
75°	280	277	269	259	262	299
85°	68	67	65	60	58	76
90°	2	21	35	44	47	11
95°	113	56	68	77	75	134
105°	530	582	106	125	132	566
115°	1002	1032	1075	268	143	986
125°	1417	1439	1472	1485	1490	1263
135°	1753	1781	1797	1814	1811	1354
145°	2034	2032	2062	2074	2065	1272
155°	2239	2224	2245	2255	2241	1032
165°	2360	2349	2354	2366	2354	667
175°	2414	2401	2405	2417	2400	230
180°	2408	2408	2408	2408	2408	

TEST NUMBER: P929192

CATALOG NUMBER: DFN2DIP-HX4F0-050D080US940-FLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1735.4	1735.4	1735.4	1735.4	1735.4
2.5°	1745.5	1737.2	1718.8	1735.4	1732.3
5°	1735.4	1728.9	1710.4	1723.7	1720.6
7.5°	1723.7	1713.8	1695.4	1708.9	1705.5
10°	1705.5	1693.8	1673.8	1687.0	1682.1
12.5°	1680.3	1670.4	1650.5	1658.8	1655.4
15°	1652.0	1642.1	1620.3	1627.1	1618.7
17.5°	1616.9	1607.0	1585.3	1593.6	1585.3
20°	1578.6	1568.7	1545.3	1550.2	1543.7
22.5°	1540.3	1525.2	1503.5	1503.5	1500.1
25°	1495.2	1481.9	1453.5	1456.7	1453.5
27.5°	1445.0	1433.4	1411.8	1406.8	1398.5
30°	1395.1	1381.7	1356.7	1351.7	1345.0
32.5°	1341.7	1331.8	1305.0	1294.9	1288.2
35°	1289.9	1273.3	1246.6	1236.5	1228.2
37.5°	1231.5	1216.5	1189.7	1178.1	1169.8
40°	1171.6	1158.1	1131.3	1116.4	1109.7
42.5°	1113.1	1099.7	1073.1	1056.2	1046.3
45°	1049.7	1038.0	1012.9	994.7	987.9
47.5°	987.9	976.2	949.5	931.1	921.2
50°	922.8	914.5	891.1	867.7	859.4
52.5°	859.4	847.7	826.1	807.7	796.0
55°	794.4	784.3	764.3	744.3	736.0
57.5°	729.2	720.9	699.1	679.2	672.4
60°	664.1	657.6	634.2	615.7	610.8
62.5°	600.8	589.1	572.4	555.7	549.0
65°	535.7	525.7	509.0	494.0	485.6
67.5°	469.0	460.5	445.6	434.0	427.2
70°	407.2	400.5	385.4	373.7	367.2
72.5°	343.9	337.1	328.8	317.1	312.1
75°	280.3	277.1	268.6	258.7	262.1
77.5°	223.6	216.8	213.5	208.5	203.6
80°	167.0	165.2	161.8	156.9	153.5
82.5°	113.5	113.5	111.9	105.2	105.2
85°	68.3	66.7	65.1	60.0	58.4
87.5°	30.1	26.8	23.4	18.4	16.7
90°	1.7	20.9	34.8	43.6	47.0
92.5°	43.6	36.7	41.8	45.3	47.0
95°	113.2	55.7	67.9	76.8	74.9
97.5°	203.8	61.0	88.8	94.2	95.8
100°	308.5	69.8	99.4	113.2	116.7
102.5°	423.4	420.0	102.8	121.8	127.3
105°	529.8	582.1	106.3	125.4	132.5
107.5°	653.5	696.9	109.9	128.9	135.9
110°	772.1	808.5	305.1	130.8	137.6

TEST NUMBER: P929192

CATALOG NUMBER: DFN2DIP-HX4F0-050D080US940-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	883.6	914.8	885.3	134.1	139.5
115°	1002.0	1031.6	1075.2	268.4	143.0
117.5°	1104.8	1139.6	1169.4	920.0	463.6
120°	1219.9	1245.9	1277.4	1298.3	1063.0
122.5°	1317.3	1345.3	1380.3	1390.6	1392.5
125°	1416.7	1439.4	1472.5	1484.7	1489.9
127.5°	1507.3	1531.7	1558.1	1575.4	1577.1
130°	1592.8	1620.7	1639.8	1659.0	1657.3
132.5°	1679.9	1702.6	1721.7	1737.4	1735.7
135°	1753.1	1781.1	1796.6	1814.2	1810.7
137.5°	1829.8	1850.6	1868.2	1885.6	1880.4
140°	1904.6	1918.7	1937.8	1953.5	1944.7
142.5°	1967.6	1979.7	2002.3	2016.2	2007.4
145°	2033.8	2031.9	2061.5	2073.7	2065.0
147.5°	2091.1	2085.9	2115.5	2124.2	2117.3
150°	2147.0	2134.7	2162.7	2173.0	2164.3
152.5°	2194.0	2180.0	2206.1	2216.7	2204.5
155°	2239.3	2223.8	2244.6	2255.0	2241.2
157.5°	2275.8	2262.0	2277.7	2289.9	2275.8
160°	2307.3	2296.8	2307.3	2317.7	2305.5
162.5°	2335.1	2324.7	2333.4	2345.6	2329.9
165°	2359.5	2349.2	2354.3	2366.5	2354.3
167.5°	2378.7	2368.2	2373.5	2385.7	2370.0
170°	2394.5	2383.9	2387.4	2399.7	2383.9
172.5°	2404.8	2394.5	2398.0	2410.2	2394.5
175°	2413.5	2401.3	2404.8	2417.0	2399.7
177.5°	2417.0	2404.8	2406.6	2418.8	2403.1
180°	2408.3	2408.3	2408.3	2408.3	2408.3

TEST NUMBER: P929192

CATALOG NUMBER: DFN2DIP-HX4F0-050D080US940-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.99	7.76	8.04	8.81	10.24	6.56	7.33	7.61	8.38	9.81
	3H	8.65	9.33	9.71	10.40	11.84	8.17	8.86	9.23	9.92	11.37
	4H	9.23	9.88	10.30	10.95	12.40	8.76	9.41	9.83	10.47	11.92
	6H	9.63	10.23	10.71	11.29	12.76	9.15	9.75	10.23	10.82	12.28
	8H	9.73	10.30	10.81	11.38	12.84	9.25	9.82	10.34	10.91	12.37
	12H	9.77	10.32	10.86	11.39	12.88	9.29	9.83	10.38	10.91	12.40
4H	2H	7.44	8.09	8.52	9.16	10.61	7.10	7.75	8.18	8.81	10.27
	3H	9.30	9.84	10.39	10.94	12.40	8.91	9.45	9.99	10.54	12.01
	4H	10.01	10.51	11.10	11.59	13.08	9.61	10.11	10.70	11.19	12.67
	6H	10.52	10.95	11.62	12.06	13.54	10.11	10.54	11.21	11.65	13.13
	8H	10.67	11.07	11.77	12.17	13.66	10.26	10.66	11.36	11.76	13.25
	12H	10.74	11.10	11.86	12.21	13.71	10.32	10.68	11.43	11.79	13.29
8H	4H	10.20	10.60	11.30	11.70	13.20	9.84	10.24	10.94	11.34	12.83
	6H	10.83	11.16	11.95	12.30	13.79	10.47	10.80	11.59	11.94	13.43
	8H	11.05	11.34	12.18	12.46	13.97	10.68	10.97	11.81	12.09	13.60
	12H	11.18	11.43	12.31	12.55	14.10	10.79	11.05	11.93	12.17	13.72
12H	4H	10.18	10.55	11.30	11.66	13.16	9.83	10.19	10.95	11.30	12.80
	6H	10.86	11.15	11.99	12.27	13.78	10.51	10.80	11.64	11.92	13.43
	8H	11.10	11.35	12.23	12.47	14.02	10.74	11.00	11.87	12.11	13.66

END OF REPORT