

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P921836

Luminaire Tested: DFN2DIP-HX4F0-070D040US940-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P921836
REPORT IS A COMBINATION OF REPORTS P899305 AND P896188
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX4F0-070D040US940-FLLFLL
Description: 4 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9336.3 lumens
Efficiency: N/A
Efficacy: 103.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.54' x L: 4.09' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 90
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P921836

CATALOG NUMBER: DFN2DIP-HX4F0-070D040US940-FLLFLL

Luminous Intensity Polar Plot

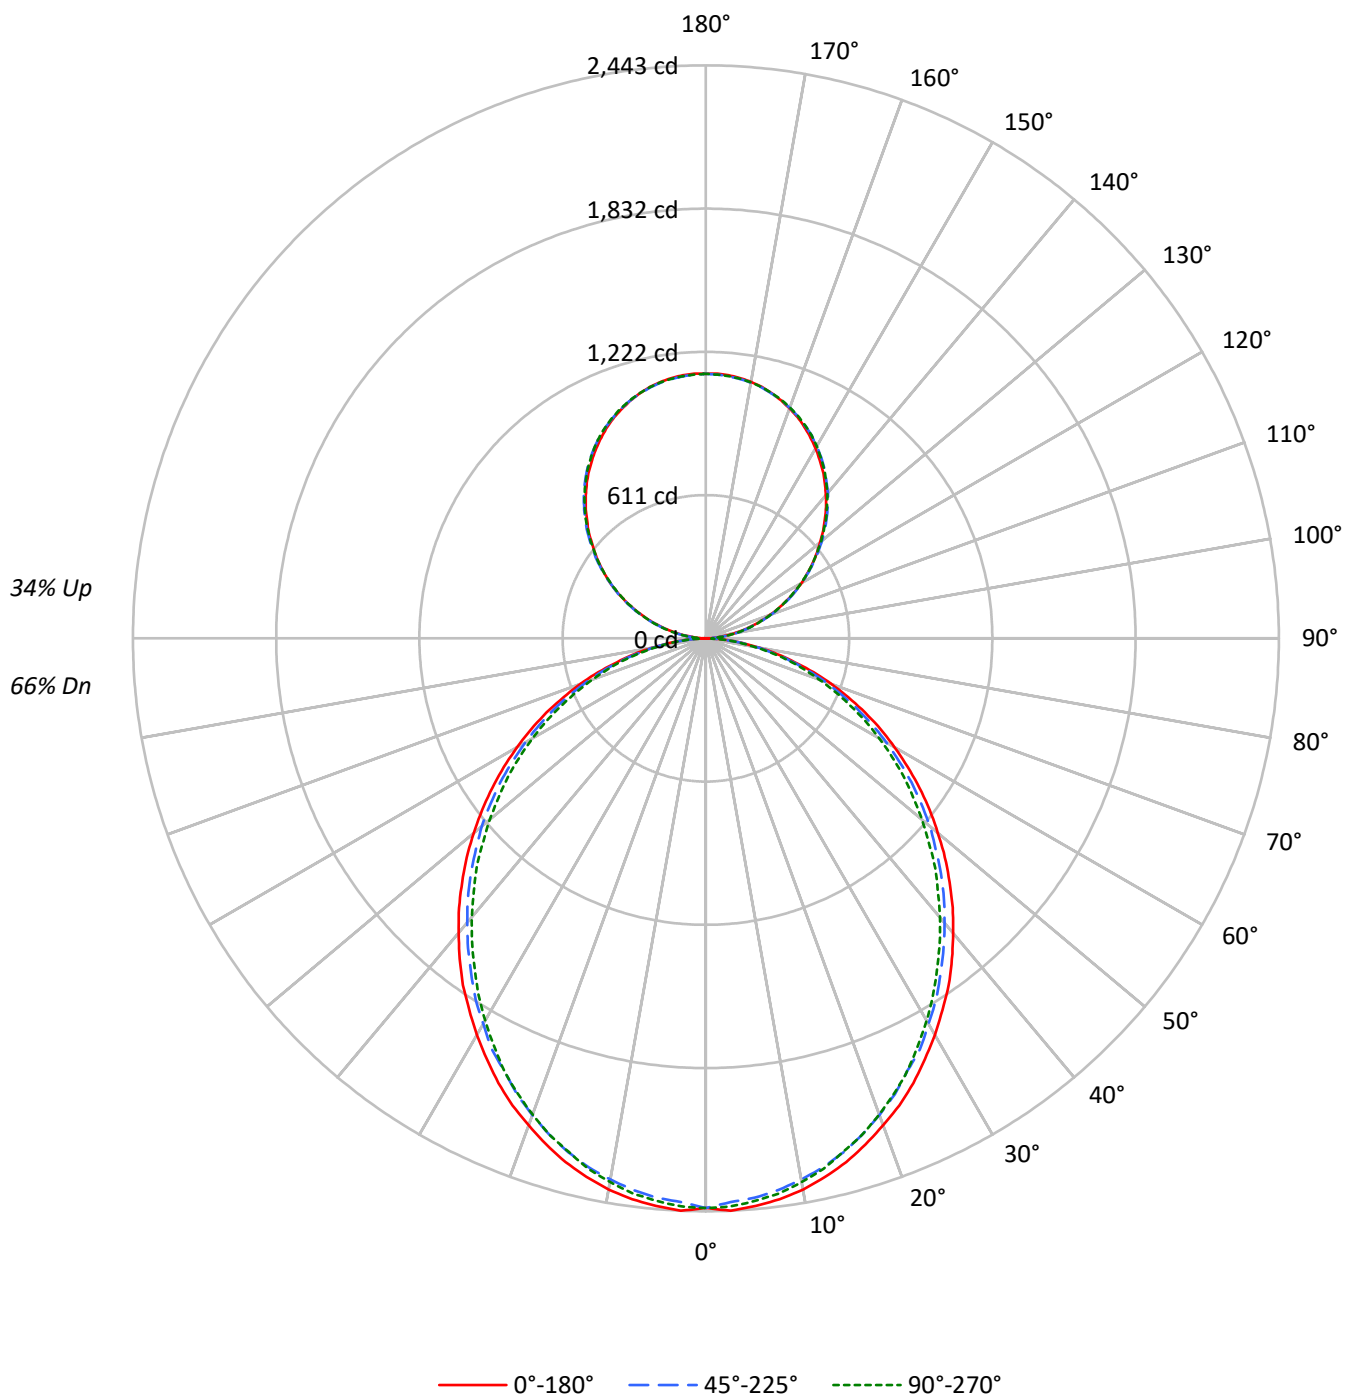

TEST NUMBER: P921836

CATALOG NUMBER: DFN2DIP-HX4F0-070D040US940-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	111	111	111	111	104	104	104	104	92	92	92	81	81	81	71	71	71
1	101	97	93	89	95	91	88	85	81	78	76	72	70	68	63	61	60
2	92	85	78	73	87	80	74	70	71	67	63	63	60	57	55	53	51
3	84	75	67	61	79	70	64	58	63	57	53	56	51	48	49	46	43
4	77	66	58	52	72	63	55	50	56	50	45	50	45	41	44	40	37
5	71	59	51	44	67	56	48	43	50	44	39	45	40	36	40	36	32
6	65	53	45	39	61	50	43	37	45	39	34	40	35	31	36	32	29
7	61	48	40	34	57	46	38	33	41	35	30	37	32	28	33	29	25
8	56	44	36	30	53	42	34	29	38	31	27	34	29	25	30	26	23
9	53	40	32	27	49	38	31	26	34	28	24	31	26	22	28	24	21
10	49	37	29	24	46	35	28	24	32	26	22	29	24	20	26	22	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1806	1806	1806
5°	1809	1781	1793
10°	1794	1757	1769
15°	1768	1728	1731
20°	1733	1688	1692
25°	1697	1640	1647
30°	1653	1596	1590
35°	1611	1543	1530
40°	1559	1490	1473
45°	1508	1437	1414
50°	1452	1381	1346
55°	1393	1317	1283
60°	1326	1240	1212
65°	1253	1161	1128
70°	1161	1064	1037
75°	1033	948	953
80°	878	801	793
85°	638	546	528

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1508 cd/sqm

TEST NUMBER: P921836

CATALOG NUMBER: DFN2DIP-HX4F0-070D040US940-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	228.6	2.4
10°-20°	643.2	6.9
20°-30°	945.2	10.1
30°-40°	1097.8	11.8
40°-50°	1096.5	11.7
50°-60°	956.1	10.2
60°-70°	706.8	7.6
70°-80°	399.9	4.3
80°-90°	108.8	1.2
90°-100°	69.8	0.7
100°-110°	221.8	2.4
110°-120°	379.5	4.1
120°-130°	499.2	5.3
130°-140°	560.3	6.0
140°-150°	549.4	5.9
150°-160°	460.9	4.9
160°-170°	305.7	3.3
170°-180°	106.8	1.1
0°-30°	1817.0	19.5
0°-40°	2914.9	31.2
0°-60°	4967.4	53.2
0°-90°	6182.8	66.2
90°-120°	671.2	7.2
90°-150°	2280.1	24.4
90°-180°	3153.0	33.8
0°-180°	9336.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2429	2429	2429	2429	2429	
5°	2429	2420	2394	2412	2408	231
15°	2312	2298	2268	2277	2266	651
25°	2093	2074	2034	2039	2034	963
35°	1805	1782	1745	1730	1719	1127
45°	1469	1453	1418	1392	1383	1134
55°	1112	1098	1070	1042	1030	994
65°	750	736	712	691	680	741
75°	392	388	376	362	367	419
85°	96	94	91	84	82	107
90°	1	12	33	31	32	9
95°	50	59	61	61	59	55
105°	205	207	210	211	211	216
115°	381	386	385	384	381	377
125°	554	562	560	557	556	495
135°	717	727	729	728	725	554
145°	870	877	882	883	880	544
155°	995	998	1000	1005	1002	458
165°	1082	1081	1081	1088	1083	305
175°	1126	1123	1121	1128	1122	107
180°	1128	1128	1128	1128	1128	

TEST NUMBER: P921836

CATALOG NUMBER: DFN2DIP-HX4F0-070D040US940-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2428.8	2428.8	2428.8	2428.8	2428.8
2.5°	2442.9	2431.2	2405.5	2428.8	2424.3
5°	2428.8	2419.7	2393.9	2412.4	2408.0
7.5°	2412.4	2398.5	2372.8	2391.7	2386.9
10°	2386.9	2370.5	2342.5	2361.2	2354.2
12.5°	2351.7	2337.9	2309.9	2321.5	2316.8
15°	2312.1	2298.2	2267.7	2277.2	2265.5
17.5°	2263.0	2249.2	2218.7	2230.3	2218.7
20°	2209.2	2195.4	2162.7	2169.6	2160.4
22.5°	2155.7	2134.7	2104.2	2104.2	2099.4
25°	2092.6	2073.9	2034.3	2038.8	2034.3
27.5°	2022.4	2006.1	1975.9	1968.9	1957.2
30°	1952.6	1933.7	1898.8	1891.9	1882.4
32.5°	1877.7	1863.9	1826.4	1812.3	1802.9
35°	1805.4	1782.1	1744.6	1730.5	1718.9
37.5°	1723.6	1702.5	1665.1	1648.8	1637.1
40°	1639.6	1620.8	1583.3	1562.5	1553.1
42.5°	1557.8	1539.0	1501.8	1478.3	1464.4
45°	1469.1	1452.8	1417.6	1392.0	1382.6
47.5°	1382.6	1366.3	1328.8	1303.1	1289.2
50°	1291.5	1279.8	1247.1	1214.4	1202.7
52.5°	1202.7	1186.4	1156.2	1130.4	1114.0
55°	1111.8	1097.7	1069.7	1041.7	1030.0
57.5°	1020.7	1009.0	978.5	950.5	941.1
60°	929.4	920.2	887.6	861.8	854.9
62.5°	840.7	824.4	801.1	777.8	768.4
65°	749.8	735.7	712.4	691.3	679.7
67.5°	656.4	644.5	623.7	607.3	597.9
70°	569.9	560.5	539.4	523.1	513.9
72.5°	481.2	471.8	460.1	443.8	436.8
75°	392.3	387.8	375.9	362.0	366.8
77.5°	313.0	303.5	298.8	291.9	285.0
80°	233.6	231.2	226.5	219.5	214.8
82.5°	158.8	158.8	156.6	147.2	147.2
85°	95.7	93.5	91.2	84.0	81.8
87.5°	42.1	37.5	32.7	25.8	23.3
90°	1.0	12.2	33.3	31.3	32.3
92.5°	21.0	28.5	29.6	30.6	30.6
95°	49.7	59.2	60.9	60.9	59.2
97.5°	82.7	91.5	95.2	95.2	95.2
100°	120.7	128.6	131.3	131.3	130.3
102.5°	160.9	166.7	170.4	171.4	170.4
105°	204.7	207.4	209.5	211.2	211.2
107.5°	248.3	252.4	252.4	253.0	248.3
110°	290.4	295.9	295.9	295.9	293.2

TEST NUMBER: P921836

CATALOG NUMBER: DFN2DIP-HX4F0-070D040US940-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	336.0	341.8	340.7	338.0	336.0
115°	380.8	386.4	384.6	383.6	380.8
117.5°	425.4	432.9	428.2	425.4	422.8
120°	470.4	477.8	470.4	470.4	467.3
122.5°	511.1	520.7	515.9	513.2	511.1
125°	554.0	562.5	559.8	556.7	555.7
127.5°	595.8	606.4	602.6	598.5	595.8
130°	634.9	647.2	645.5	643.5	639.7
132.5°	678.8	688.3	689.0	684.2	681.5
135°	716.6	727.1	729.2	728.1	725.4
137.5°	758.8	767.2	768.9	768.2	764.2
140°	795.8	804.3	809.0	809.0	805.3
142.5°	833.9	842.4	845.1	846.1	842.4
145°	870.0	876.7	882.2	883.2	879.5
147.5°	902.2	910.7	914.8	916.5	912.8
150°	935.6	941.4	945.1	948.2	945.1
152.5°	965.2	970.9	975.7	979.5	975.7
155°	994.7	997.5	1000.5	1005.3	1002.2
157.5°	1020.3	1022.3	1024.0	1030.8	1026.0
160°	1043.0	1045.1	1046.1	1051.9	1047.8
162.5°	1064.1	1064.1	1065.1	1071.6	1066.8
165°	1082.2	1081.1	1081.1	1087.9	1083.2
167.5°	1098.5	1095.4	1095.4	1102.2	1097.4
170°	1110.7	1108.0	1107.0	1113.7	1108.0
172.5°	1119.2	1116.5	1115.4	1122.3	1116.5
175°	1126.1	1123.3	1121.2	1128.0	1122.3
177.5°	1129.8	1127.0	1125.0	1130.8	1125.0
180°	1128.0	1128.0	1128.0	1128.0	1128.0

TEST NUMBER: P921836

CATALOG NUMBER: DFN2DIP-HX4F0-070D040US940-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.70	11.73	11.51	12.56	13.58	10.27	11.30	11.07	12.13	13.15
	3H	12.38	13.30	13.19	14.14	15.18	11.90	12.83	12.72	13.66	14.71
	4H	12.97	13.84	13.81	14.69	15.75	12.50	13.37	13.33	14.21	15.27
	6H	13.38	14.19	14.23	15.04	16.11	12.90	13.71	13.75	14.56	15.63
	8H	13.49	14.26	14.35	15.13	16.20	13.02	13.78	13.87	14.65	15.72
	12H	13.55	14.28	14.41	15.14	16.24	13.06	13.80	13.93	14.66	15.76
4H	2H	11.18	12.06	12.02	12.90	13.96	10.84	11.71	11.68	12.56	13.61
	3H	13.07	13.80	13.92	14.67	15.75	12.67	13.40	13.52	14.28	15.35
	4H	13.79	14.45	14.65	15.33	16.43	13.38	14.05	14.25	14.92	16.02
	6H	14.31	14.89	15.19	15.79	16.89	13.90	14.48	14.78	15.38	16.48
	8H	14.47	15.00	15.35	15.90	17.02	14.06	14.59	14.94	15.49	16.60
	12H	14.55	15.03	15.45	15.95	17.07	14.13	14.61	15.03	15.52	16.65
8H	4H	14.00	14.54	14.88	15.43	16.55	13.64	14.18	14.52	15.07	16.19
	6H	14.64	15.08	15.55	16.02	17.14	14.28	14.72	15.18	15.66	16.77
	8H	14.86	15.26	15.78	16.18	17.32	14.49	14.89	15.41	15.81	16.95
	12H	15.00	15.35	15.92	16.27	17.46	14.62	14.96	15.54	15.88	17.07
12H	4H	13.99	14.48	14.89	15.39	16.51	13.64	14.12	14.54	15.04	16.16
	6H	14.67	15.07	15.59	15.99	17.13	14.32	14.71	15.24	15.64	16.78
	8H	14.92	15.27	15.84	16.19	17.37	14.56	14.91	15.49	15.83	17.02

END OF REPORT